## **INLET SPECIAL** -TOP OF GRATE CURB BOX ADJUSTABLE TO 225 (9) HIGH TOP OF MASONRY \* THE WALL ADJUSTMENTS SHALL BE MADE WITH CONCRETE BUILDING BRICK OR CLASS SI CONCRETE. -OPTIONAL FACE OF INLET ---CONSTRUCTION JOINT THE HEIGHT OF THE BOX MAY BE CONSTRUCTED 150 (6) SHORT TO ALLOW FOR FIELD ADJUSTMENTS. OPTIONAL CONSTRUCTION 150 75 SAND CUSHION ---(3) IF PRECAST NO. 15 (NO. 4) BARS AT 300 (12) CTS. SEC. B-B SEC. A-A

### NOTES

SEE STANDARD 602701 FOR DETAILS OF STEPS.

EXCEPT AS NOTED HEREON INLET SPECIAL SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION 602 OF THE STANDARD SPECIFICATIONS.

THE SIDE WALLS MAY BE BUILT AS PRECAST SEGMENTED SECTIONS.

ALL VOIDS AROUND PIPE ENTRANCE, BOTH INSIDE AND OUTSIDE, SHALL BE SEALED WITH MORTAR.


WEIGHT OF CAST IRON FRAME & GRATE = 240 kg (530 lbs.)  $\pm$  . STEPS SHALL BE OMITTED WHEN DEPTH OF "H" IS LESS THAN 1.5 m (5 ft) .

# DETAIL OF FRAME & GRATE

### NOTES

CLASS SI CONCRETE OR PRECAST CONCRETE SHALL BE USED THROUGHOUT, PRECAST CONCRETE SHALL BE ISSET HIROUGHOUT, PRECAST CONCRETE SHALL BE IN ACCORDANCE WITH SECTION 504,01 THRU 504,05 OF THE STANDARD SPECIFICATIONS EXCEPT THAT CONCRETE STRENGTH SHALL BE 27.5 MPa (4,000 psi) AFTER 28 DAYS.

THE CONTRACT UNIT PRICE EACH FOR INLET SPECIAL SHALL INCLUDE THE COST OF CONSTRUCTING THE INLET BOX, FURNISHING AND INSTALLING THE FRAME AND GRATE, THE CAST IRON STEPS (IF USED), THE PRECAST FLOOR SLABS, SAND CUSHION (WHEN USED) AND REINFORCEMENT BARS.



USER NAME = \$USER\$

PLOT SCALE = 1.000 '/ IN.


PLAN OF GRATE \* \* THIS GRATE TO BE USED WITHOUT CURB BOX WHEN INLET IS IN DRIVEWAY.


DESIGNED

CHECKED

DRAWN

DATE

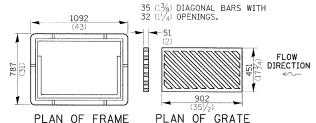



SECTION A-A ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS

REVISED


REVISED

REVISED

REVISED

24'

A



# STANDARD INLET FOR CURB & GUTTER TYPE B-6.24

STANDARD INLET FOR

CURB & GUTTER TYPE B-6.24

12'-0"

В

В 🚤

FLOW LINE

NOTES

Class SI Concrete shall be used throughout.

requirementsof Article 606.07 of the

installed at construction joints.

Standard Specifications.

The Curb and Gutter inlet will be paid for at the contract

unit price per cubic yard for Class SI Concrete (OUTLETS).

Joints shall be constructed in accordance with the

When curb and gutter is constructed adjacent to

flexible pavement, a 1" expansion joint shall be

6'-0"

TOTAL SHEET NO. SECTION COUNTY WINNEBAGO (W-1-15d)BR-1 CONTRACT NO. 64D22

21.2

- QUANTITY -

Section A-A to C-C

Class SI Concrete

(1.23 Cu. Yds.)

C-

4'-9"

EDGE OF PAVEMENT

## **INLET SPECIAL**

STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION

10.2 REVISED

10-10-06			

SCALE:

SECTION C-C

11/2'

SECTION B-B

SECTION A-A

SHEET NO. OF SHEETS STA.

REGION 2 / DISTRICT 2 STANDARD TO STA.

REVISED - 11-10-94

FILE NAME Pro Inclis\2944\DGNS\786267STD2.dor