



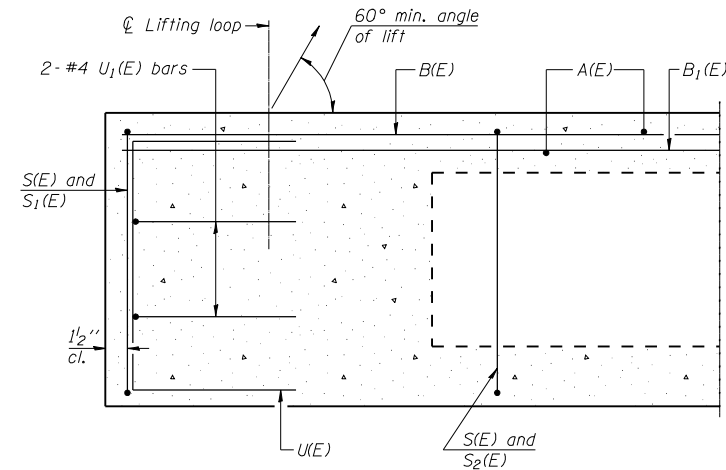


SECTION A-A

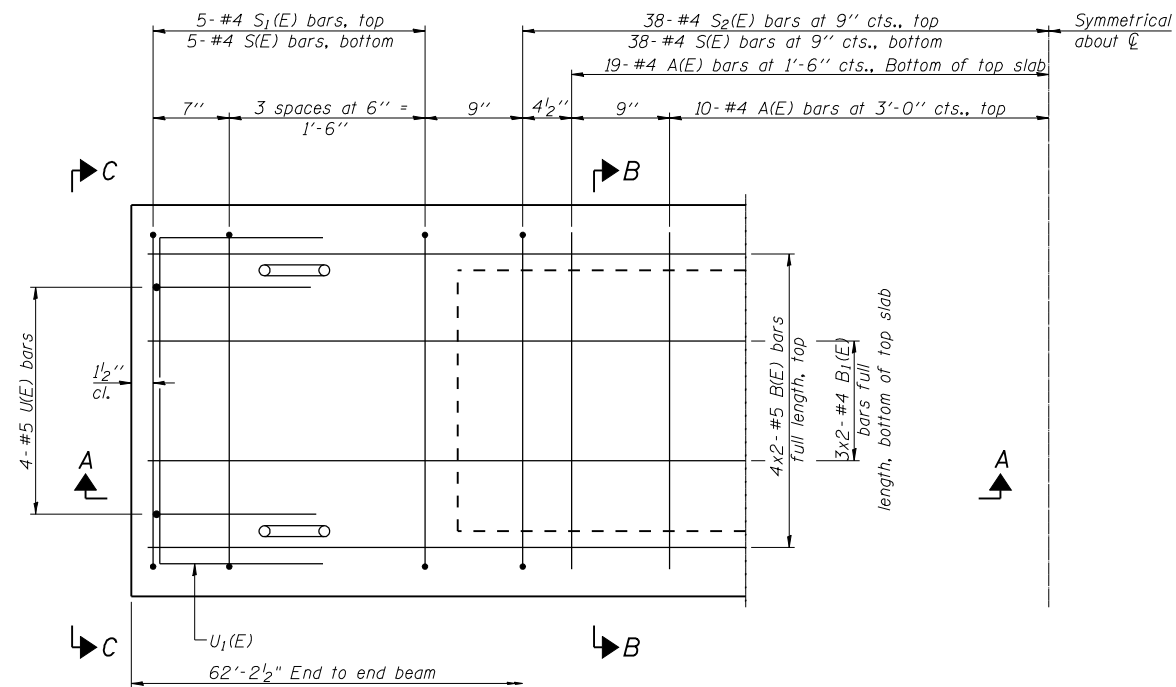


PLAN VIEW

Notes:
Spacing of S(E) and S2(E) bars may be adjusted up to 4\"/>

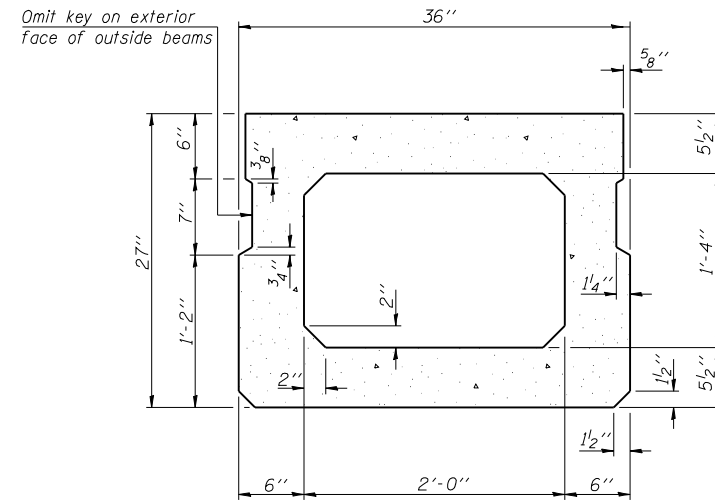


SECTION B-B

(Showing dimensions)

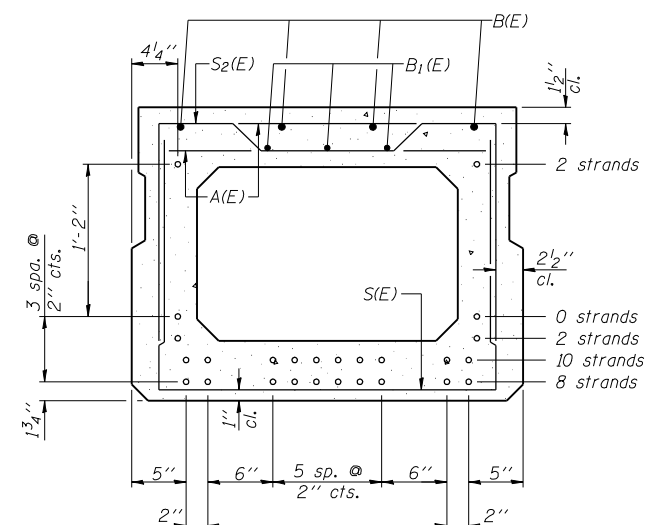

SECTION B-B

(Showing reinforcement and permissible strand locations)
Note: Place the number of strands specified in each row symmetrically about the centerline of beam in the permissible strand locations shown.

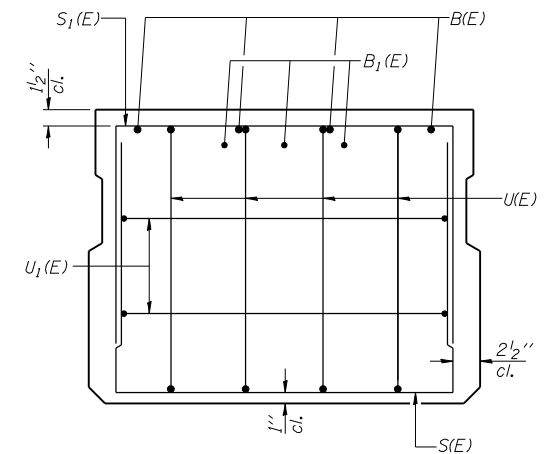

VIEW C-C

BAR LIST
ONE BEAM ONLY
(For information only)

Bar	No.	Size	Length	Shape
A(E)	58	#4	2'-7"	—
B(E)	8	#5	30'-11"	—
B1(E)	6	#4	30'-8"	—
D(E)*	22	#4	2'-9"	L
S(E)	86	#4	6'-5"	U
S1(E)	10	#4	5'-11"	U
S2(E)	76	#4	6'-2"	U
U(E)	8	#5	4'-6"	U
U1(E)	4	#4	5'-0"	U

Note: See sheet S13 of S16 for additional details and Bill of Material.

*Bar D(E) is for exterior beams only.
See sheet S8 & S13 for more details.

MINIMUM BAR LAP

#4 bar = 2'-0"
#5 bar = 2'-6"