

CONCRETE RETAINING WALL SECTION



(LOOKING EAST)
RT STA 9+32.57 TO RT STA 9+44.57

BAR LIST


Bar	No.	Size	Length	Shape
H	8	#4	11'-10"	
V	13	#4	3'-1"	
N	13	#4	3'-0"	
P	12	#4	2'-4"	

CONCRETE STRUCTURES = 3.1 CU YD
REINFORCEMENT BARS = 140 LBS

LONGITUDINAL REINFORCEMENT SHALL BE CONTINUOUS THROUGH THE CONTRACTION JOINTS. JOINTS WHETHER PREFORMED OR SAWCUT SHALL BE NOT LESS THAN 2" DEEP AND BE PLACED FROM TOP TO BOTTOM. THE WALL SHALL BE FINISHED IN ACCORDANCE WITH ARTICLE 503.15.

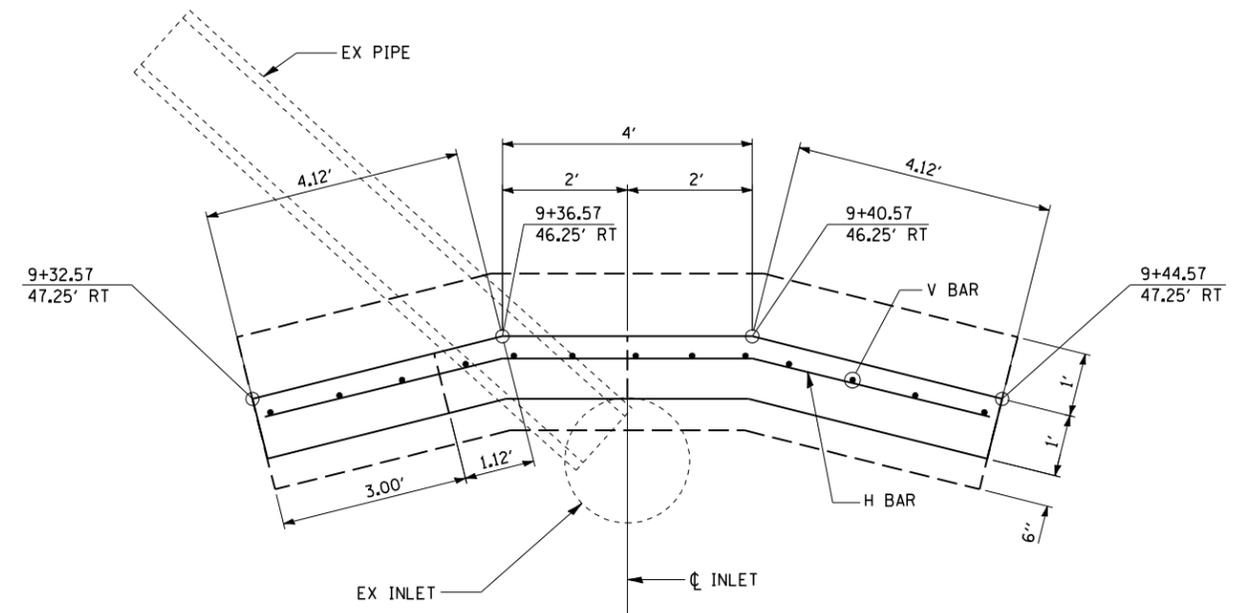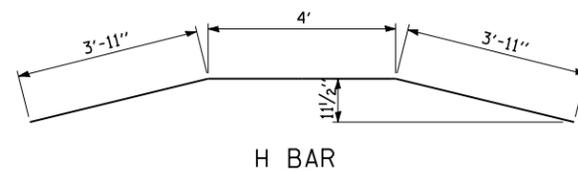

RETAINING WALL PLAN

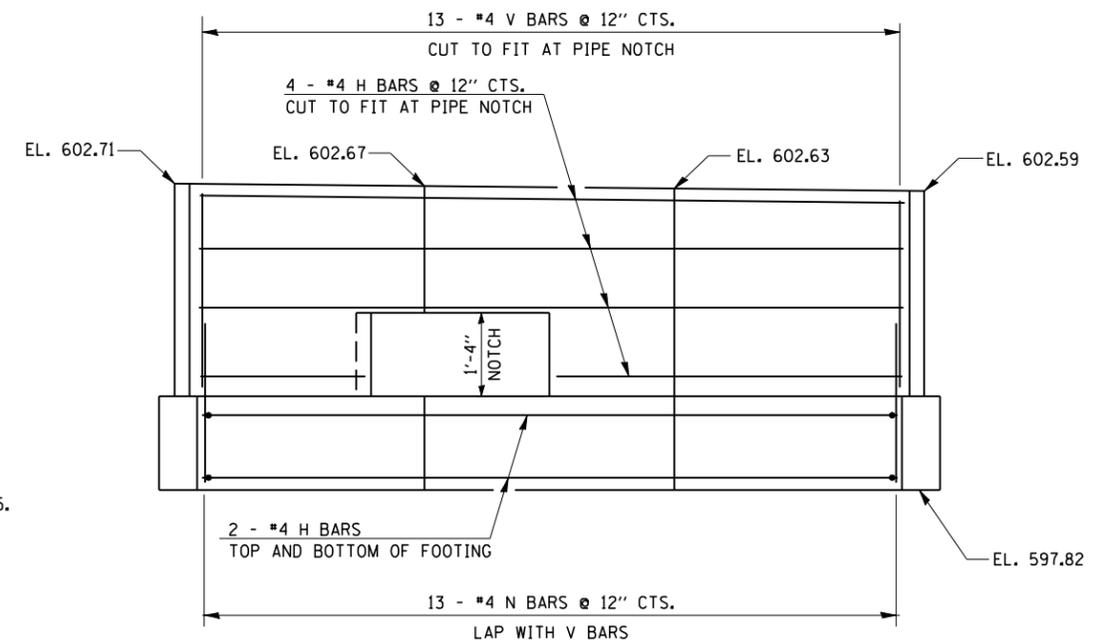

RETAINING WALL ELEVATION