


- 43 STA. 24+33, 0 FT RT. MANHOLE, T-A, 4' DIA., T-1F CL
T/F=726.50
INV.=720.13 (E)(W)
INV.=721.90 (N)
INV.=722.74 (S)
- 44 STORM SEWER, RG, CLASS A, TYPE 2
19' -12" @ 1.0%
TBF=6.7 CY
- 45 STA. 24+33, 18.5 FT LT. CATCH BASIN, T-A, 4' DIA., T-4 F&G
T/F=726.13
INV.=722.09
- 46 STORM SEWER, RG, CLASS A, TYPE 2
19' -12" @ 1.0%
TBF=7.1 CY
- 47 STA. 24+33, 18.5 FT LT. CATCH BASIN, T-A, 4' DIA., T-4 F&G
T/F=726.13
INV.=722.93
- 48 STORM SEWER, RG, CLASS A, TYPE 2
121' -15" @ 1.0%
TBF=121.6 CY
- 48A STA. 25+54, 0 FT RT. MANHOLE, T-A, 4' DIA., T-1F CL
T/F=727.80
INV.=721.34 (E)(W)
INV.=723.45 (S)
- 48B STORM SEWER, RG, CLASS A, TYPE 2
19' -12" @ 1.0%
TBF=7.1 CY
- 48C STA. 24+33, 18.5 FT LT. CATCH BASIN, T-A, 4' DIA., T-4 F&G
T/F=727.44
INV.=723.64 (N)
INV.=725.03 (S)
- 48D STORM SEWER, RG, CLASS A, TYPE 1
24' -12" @ 6.7%
TBF=2.9 CY
- 48E STORM SEWER, RG, CLASS A, TYPE 2
95' -15" @ 1.0%
TBF=85.5 CY
- 49 STA. 26+48, 0 FT LT. MANHOLE T-A, 4' DIA., T-1F CL
T/F=728.40
INV.=722.32 (E)(W)
INV.=723.80 (N)
INV.=724.62 (S)
- 50 STORM SEWER, RG, CLASS A, TYPE 2
19' -12" @ 1.0%
TBF=7.1 CY
- 51 STA. 26+48, 19 FT LT. CATCH BASIN T-A, 4' DIA., T-4 F&G
T/F=728.01
INV.=723.99
- 52 STORM SEWER, RG, CLASS A, TYPE 2
19' -12" @ 1.0%
TBF=6.7 CY
- 53 STA. 26+48, 19 FT RT. CATCH BASIN, T-A, 4' DIA., T-4 F&G
T/F=728.01
INV.=724.81
- 54 STORM SEWER, RG, CLASS A, TYPE 2
225' -15" @ 1.0%
TBF=184.1 CY
- 55 STA. 28+74, 0 FT LT. MANHOLE, T-A, 4' DIA., T-1F CL
T/F=729.74
INV.=724.57 (E)(W)
INV.=725.15 (N)
INV.=725.74 (SE)
- 56 STORM SEWER, RG, CLASS A, TYPE 2
19' -12" @ 1.0%
TBF=7.1 CY
- 57 STA. 28+74, 0 FT LT. CATCH BASIN, T-A, 4' DIA., T-4 F&G
T/F=729.36
INV.=725.34
- 58 STORM SEWER, RG, CLASS A, TYPE 1
51' -12" @ 1.0%
TBF=15.0 CY
- 59 STA. 28+74, 19 FT RT. CATCH BASIN T-A, 4' DIA., T-4 F&G
T/F=729.36
INV.=726.25
- 60 STORM SEWER, RG, CLASS A, TYPE 2
227' -12" @ 1.0%
TBF=200.0 CY

- A SANITARY MANHOLES TO BE ADJUSTED
- B VALVE VAULTS TO BE ADJUSTED
- C INLETS TO BE ADJUSTED
- D CATCH BASINS TO BE ADJUSTED
- E FIRE HYDRANTS TO BE RELOCATED
- F REMOVING CATCH BASINS
- G VALVE BOXES TO BE ADJUSTED
- H REMOVING MANHOLES

DRAIN-4

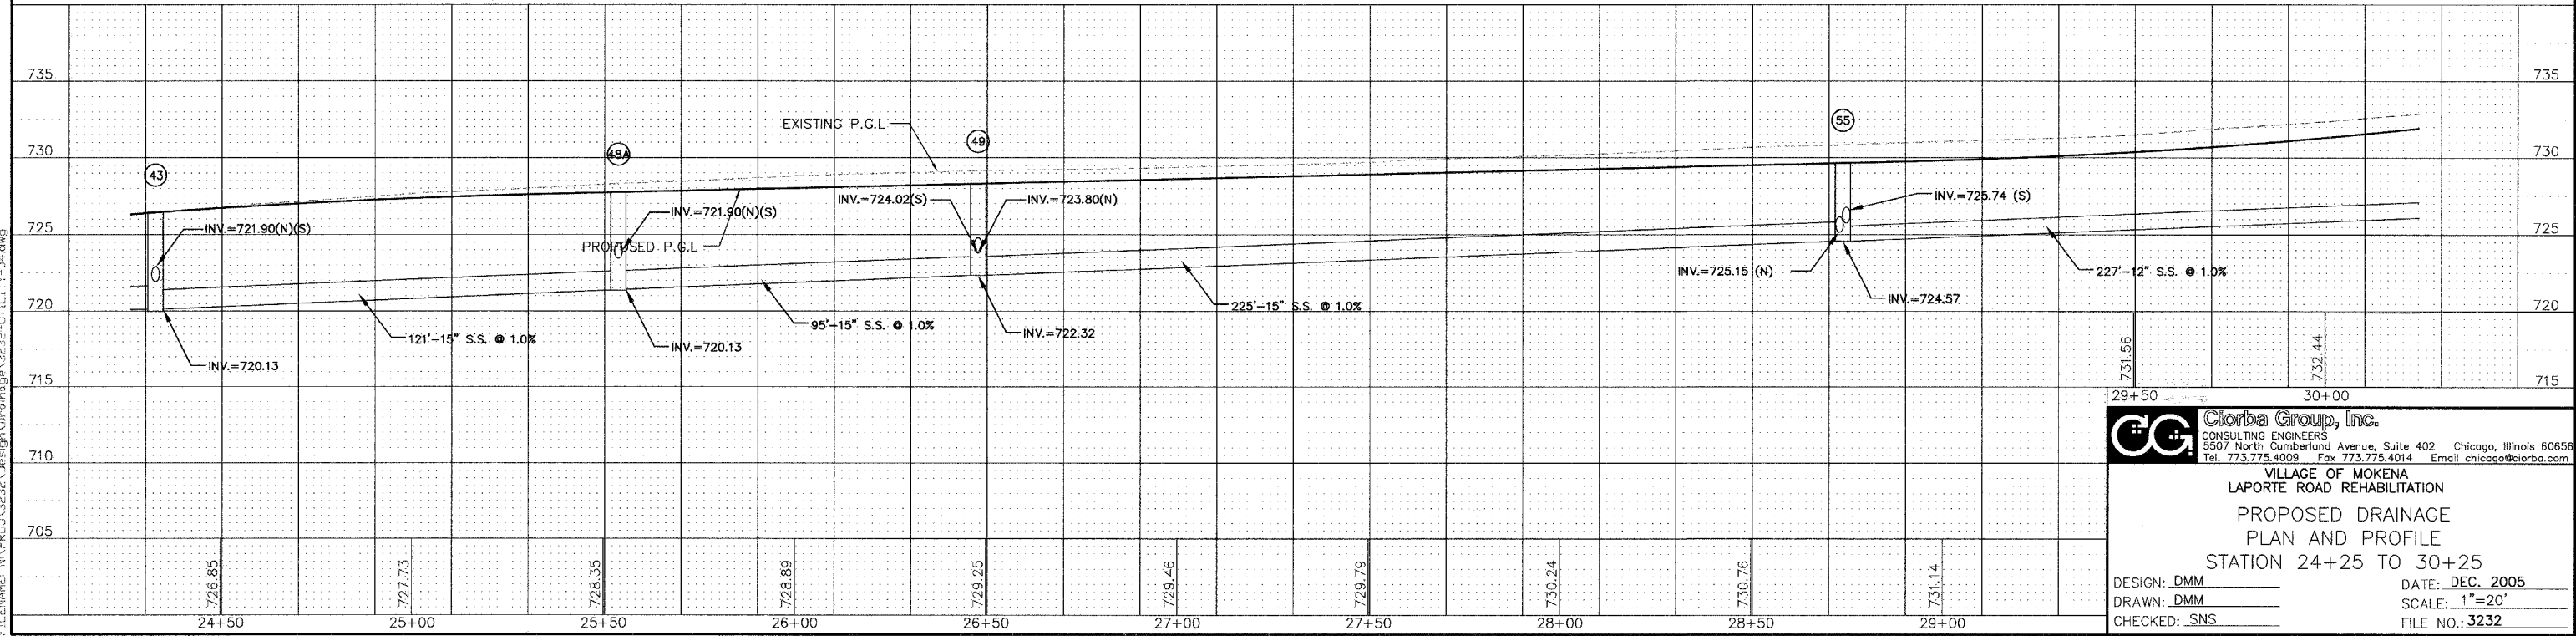

CG **Clorba Group, Inc.**
CONSULTING ENGINEERS
5507 North Cumberland Avenue, Suite 402 Chicago, Illinois 60656
Tel. 773.775.4009 Fax 773.775.4014 Email chicago@clorba.com

VILLAGE OF MOKENA
LAPORTE ROAD REHABILITATION
PROPOSED DRAINAGE
PLAN AND PROFILE
STATION 24+25 TO 30+25

DESIGN: DMM
DRAWN: DMM
CHECKED: SNS

DATE: DEC. 2005
SCALE: 1"=20'
FILE NO.: 3232

PLU1 DATE: Dec 22, 2005 4:10pm
FILENAME: N:\PROJECTS\2005\Design\Drawings\Utility-04.dwg