
* 01-00029-00-FP CONTRACT NO. 83825

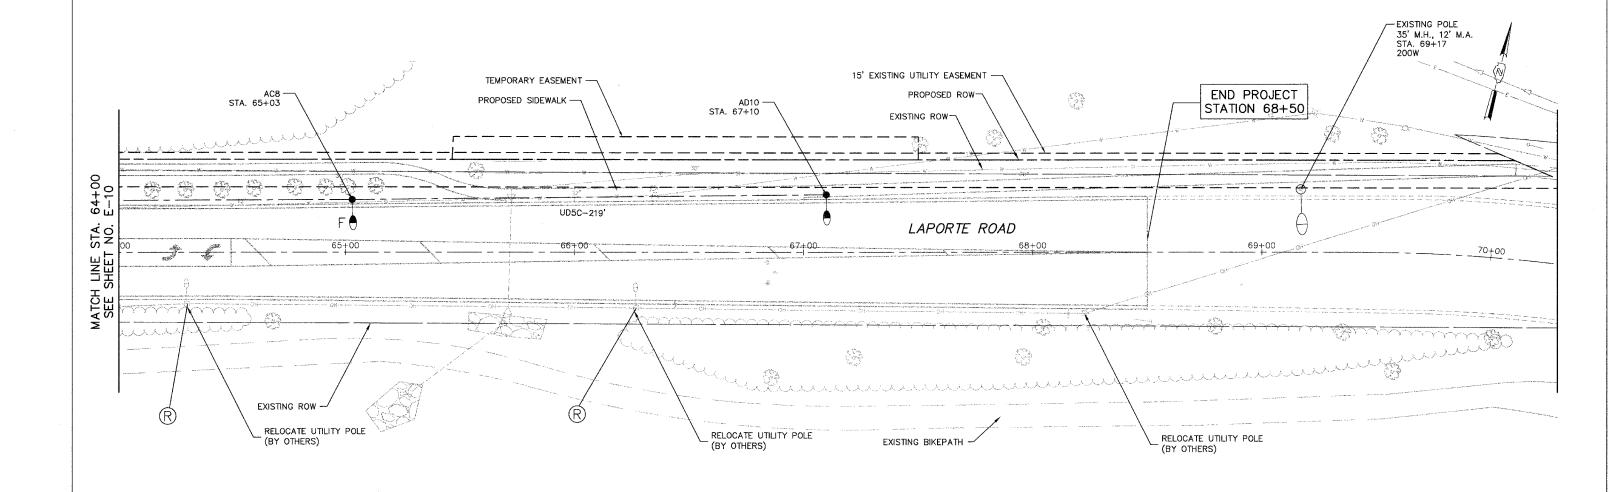

LIGHT POLE, 35' $\mbox{M.H.}$, 10' \mbox{MAST} ARM, AND LUMINAIRE, 200W, UNLESS OTHERWISE NOTED

UTILITY POLE MOUNTED MAST ARM, LUMINAIRE TO BE REMOVED BY OTHERS

EXISTING LIGHT POLE, SIZE AS NOTED

UNIT DUCT WITH 4-1/C NO. 4 AND 1/C NO. 6 GROUND 600V (EPR-TYPE RHW) 1-1/2" POLYTHYLENE AND LENGTH AS NOTED GALVANIZED STEEL CONDUIT, PUSHED, DIAMETER AND LENGTH AS NOTED



PROPOSED LIGHTING CONTROLLER, 120/240V, 100A

PROPOSED SERVICE CONNECTION

OFFSET FOUNDATION

<u>NOTES</u>

- 1. ALL POLES SHALL BE OFFSET 8' FROM EDGE OF PAVEMENT TO CENTER OF POLE, UNLESS OTHERWISE NOTED.
- 2. EXISTING UTILITY POLE MOUNTED LUMINAIRES SHALL REMAIN IN USE DURING CONSTRUCTION.



Ciorba Giroup, Inc.

CONSULTING ENGINEERS
5507 North Cumberland Avenue, Suite 402 Chicago, litinote 60656
Tell. 773.775.4009 Fax 773.775.4014 Email chicago@ciorbe.com

VILLAGE OF MOKENA LAPORTE ROAD REHABILITATION LAPORTE ROAD IMPROVEMENTS LIGHTING PLAN STATION 64+00 TO 70+29

DESIGN: KDM DRAWN: KDM CHECKED: JMV DATE: <u>DEC. 2005</u> SCALE: <u>1"=20'</u> FILE NO.: <u>3232</u>

E-11