



CLEAN & SEAL BITUMINOUS CRACKS (AR201661) N.T.S.

NOTES:

- THE CRACK ROUTING DIMENSIONS WILL PROVIDE A WIDTH
 TO DEPTH RATIO OF 1:1 FOR SEALANT MATERIAL.
- CRACKS TO BE ROUTED, CLEANED AND SEALED AT LOCATIONS DESIGNATED BY THE RESIDENT ENGINEER.

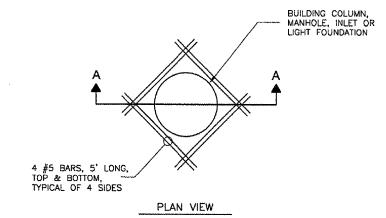

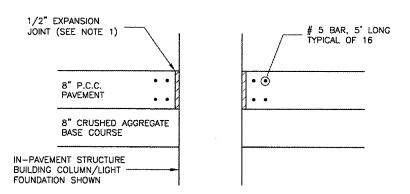

SECTION A-A

P.C.C. PAVING AT IN-PAVEMENT STRUCTURES

N.T.S.

NOTES:

- 1. A MINIMUM 1/2" EXPANSION IS REQUIRED AT BUILDING COLUMNS AND LIGHT FOUNDATIONS. IN-PAVEMENT MANHOLES AND INLETS MAY HAVE THE EXPANSION JOINT ELIMINATED AT THE DISCRETION OF THE RESIDENT ENGINNER. THE EXPANSION JOINTS WILL BE SEALED.
- 2. JOINT LOCATIONS SHOWN ARE FOR ILLUSTRATIVE PURPOSES AND MAY NOT REFLECT ACTUAL FIELD CONDITIONS.
- PAVEMENT LEADING UP TO IN-PAVEMENT MANHOLES AND INLETS DESIGNED TO ACCEPT STORMWATER RUNOFF WILL BE SLOPED TOWARDS THE DRAIN.
- 4. A MINIMUM OF 2-INCH COVER IS REQUIRED OVER THE TIE BARS LOCATED AS SHOWN IN THE DETAIL.
- ANY DAMAGE TO THE EXISTING IN-PAVEMENT STRUCTURES CAUSED BY THE CONTRACTOR'S OPERATIONS WILL BE REPAIRED BY HIM AT HIS EXPENSE PRIOR TO COMPLETING THE P.C.C. PAVING.

