



CHECKED BY: KHC


GENERAL NOTES:

- THE CONTRACTOR SHALL VISIT THE SITE IN ORDER TO FAMILIARIZE THEMSELVES WITH THE CONDITIONS UNDER WHICH THEY WILL PERFORM THE WORK.
- THE CONTRACTOR SHALL INCLUDE DISCONNECTION AND REMOVAL OF ALL RELATED ELECTRICAL EQUIUPMENT, CABLE, CONDUIT AND APPURTENENANCES AS PART OF THEIR DEMOLITION WORK.
- 3. ALL MATERIALS, EQUIPMENT & APPURTENANCES NOT SPECIFICALLY IDENTIFIED BUT WHICH REQUIRE REMOVAL FOR COMPLETION OF THE REQUIRED WORK SHALL BE REMOVED AT NO ADDITIONAL COST TO THE OWNER.
- 4. EXISTING ELECTRICAL SERVICE FEEDERS SHALL BE REMOVED BY THE CONTRACTOR, ALL OTHER ELECTRIC SERVICE EQUIPMENT SHALL BE REMOVED BY COMEd.
- 5. ALL CONDUIT OPENINGS SHALL BE SEALED, FOR PATCHING REQUIREMENTS SEE NOTES ON DRAWING E16.
- 6. CORE DRILL FLOOR FOR NEW SERVICE ENTRANCE CONDUITS, FUTURE GENERATOR CONDUITS, AND CONDUITS FOR GROUND GRID CONNECTION. SEE DRAWING E16 FOR LOCATIONS AND SIZES.
- * DENOTES EXISTING ELECTRICAL TO REMAIN.
- ___ DENOTES EXISTING ELECTRICAL TO BE RELOCATED.
- ▲. DENOTES EXISTING ELECTRICAL TO BE REMOVED.

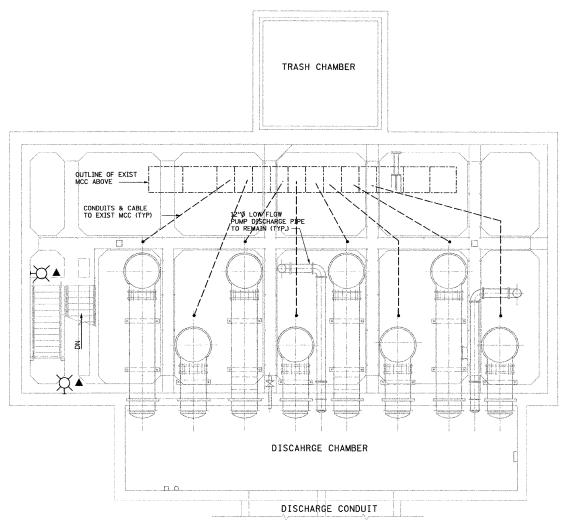

PLAN ABOVE EL. +6.5'

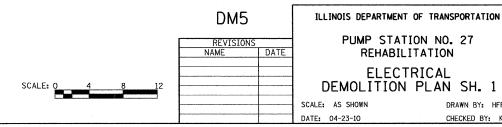

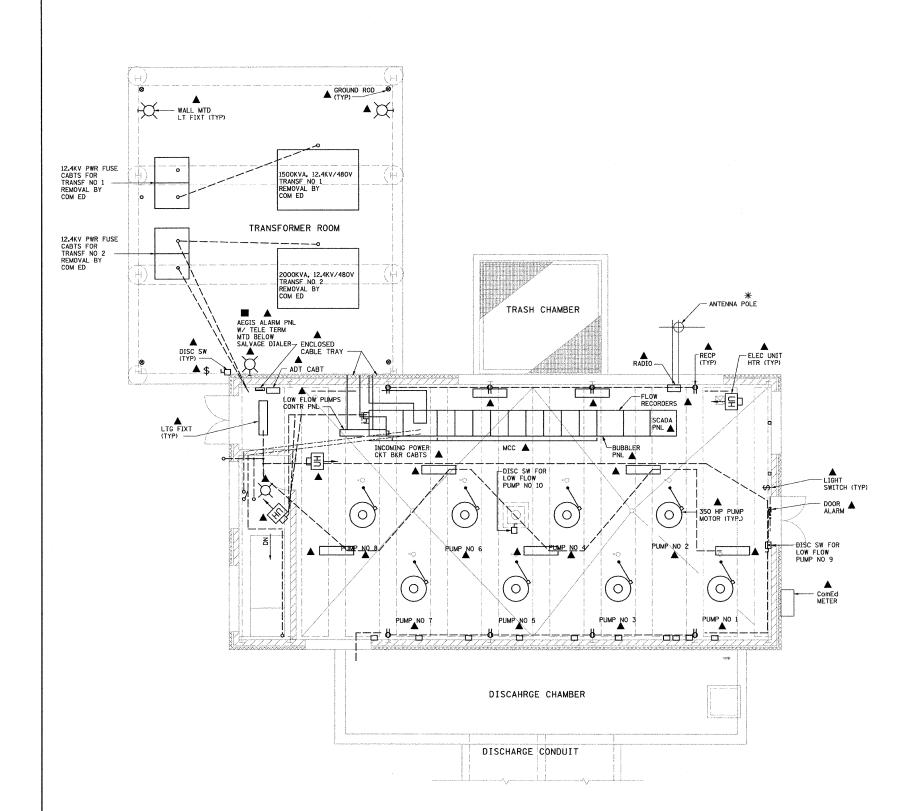

FLOOR PLAN ABOVE EL. + 9.5'

