
# A◀₁ Brg. € 34"\$ Bolts, 78"\$ holes in Beam Flange Bearina Assembly 18" elastomeric neoprene leveling pad according to the material properties of Article 1052,02(a) of the Standard Specifications. Cost included with Elastomeric Bearing Assembly Type II.

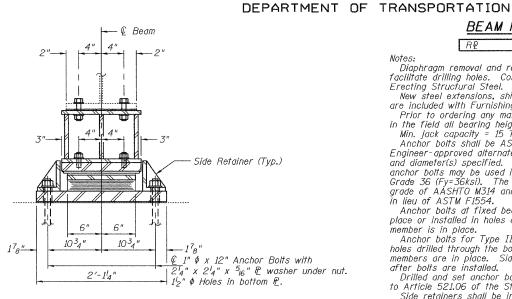


# SECTION A-A

# Span 4 <sup>3</sup>₄"∮ Threaded Stud with flat washer & hex nut, (4-Read.)


# TOP BEARING ASSEMBLY


**ELEVATION AT ABUTMENT** 

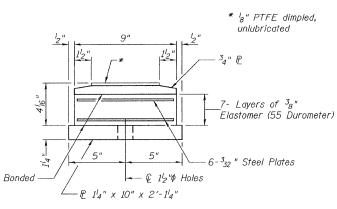



" Stainless Steel

# BOTTOM BEARING ASSEMBLY



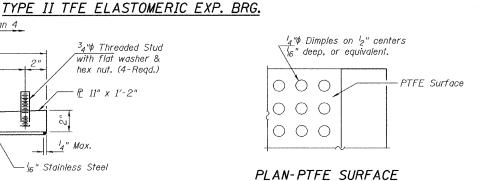



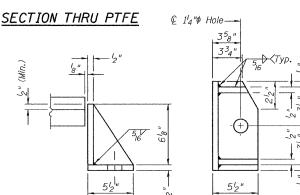

## SIDE RETAINER Equivalent rolled angle with stiffeners

will be allowed in lieu of welded plates.

## Engineer-approved alternate material) of the grade(s) and diameter(s) specified. ASTM A307 Grade C anchor bolts may be used in lieu of ASTM F1554 Grade 36 (Fy=36ksi). The corresponding specified grade of AASHTO M314 anchor bolts may be used in lieu of ASTM F1554. Anchor bolts at fixed bearings may be either cast in place or installed in holes drilled after the supported member is in place. Anchor bolts for Type II bearings shall be placed in holes drilled through the bottom bearing plate after members are in place. Side retainers shall be placed after bolts are installed. Drilled and set anchor bolts shall be installed according to Article 521.06 of the Standard Specifications. Side retainers shall be included in the cost of Elastomeric Bearing Assembly, Type II. The 'g" PTFE sheet shall be bonded directly to the

Erecting Structural Steel.

STATE OF ILLINOIS

top steel plate with a two-component, medium viscosity epoxy resin, conforming to the requirements of the Federal Specification MMM-A-134, Type I. The bond agent shall be applied on the full area of the contact surfaces. Bonding of <sup>I</sup>g" PTFE sheet during vulcanizing process

BEAM REACTIONS


Diaphragm removal and reinstallation may be required to facilitate drilling holes. Cost included with Furnishing and

New steel extensions, shim plates and connection bolts are included with Furnishing and Erecting Structural Steel. Prior to ordering any material, the Contractor shall verify in the field all bearing height and shim thickness dimensions. Min. jack capacity = 15 Tons. Anchor bolts shall be ASTM F1554 all-thread (or an

will be permitted provided the process and method of adjusting assembly height is approved by the Engineer.

# 2'-14" 23<sub>8"++</sub> — € 1½" ¢ Holes 1'-9" 21/8"

#### BOTTOM BEARING PLATE PLAN

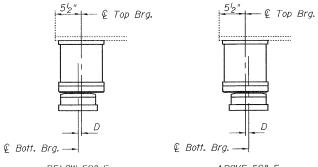


ABOVE 50° F. BELOW 50° F. (Move bott. brg. away from fixed brg.) (Move bott. brg. toward fixed brg.)


# SETTING ANCHOR BOLTS AT EXP. BRG.

 $D = {}^{l}_{8}$ " per each 100' of expansion for every 15° temp. change from the normal temp. of 50°F.

# € 78"\$ Holes


#### PLAN TOP AND BOTTOM PLATE





#### SECTION B-B

## STEEL EXTENSION DETAIL



Burn existing anchor bolts flush with existing concrete surface. Grind existing anchor bolt smooth and seal with epoxy.

#### EXISTING BEARING REMOVAL DETAIL

Cost included with Jack and Remove Existina Bearings.

#### BILL OF MATERIAL

Item	Unit	Total
Elastomeric Bearing Assembly, Type II	Each	2
Jack and Remove Existing Bearings	Each	2
Furnishing and Erecting Structural Steel	Pound	280
Anchor Bolts 1"\$	Each	4

### NORTH ABUTMENT GIRDERS 1 & 6 BEARING DETAILS SN 058-0103

			MATERIAL PROPERTY AND A STATE OF THE STATE O					
SHEET NO. 6		F.A.P. RTE.	SECTION			COUNTY	TOTAL SHEETS	SHEET NO.
OHLL		322	(58-20)RS		Macon	151	134	
9	SHEETS		(30~20)K3			CONTRACT	NO.	74150
		FED. RO	DAD DIST. NO.   ILLINOIS FED. AI		D PROJECT			

SLT-97-001-09

0580103.don 4/29/2010 8:27:39 AM

c.f.w.