TOTAL SHEET SHEETS NO. SECTION COUNTY 107 41A 303 | 131B (1&2) BR McHENRY STA. TO STA FED. ROAD DIST. NO. ILLINOIS FED. AID PROJECT

CONTRACT NO. 60B83

406.4mm×304.8mm×203.2mm MAX.


(16"H×12"W×8"D)

NEMA 4X ENCLOSURE

UNISTRUT CHANNEL FOR

MOUNTING OF SERVICE BOX.

- ELECTRIC SERVICE SHALL BE OF THE VOLTAGE INDICATED OR DESIGNATED BY THE ENGINEER, AND SERVICE DROP CABLE SHALL BE COMPATIBLE WITH THE SERVICE ACCORDINGLY. SOME INSTALLATIONS MAY CALL FOR SERVICE ENTRANCE EQUIPMENT SUITABLE FOR 3-WIRE SERVICE EVEN THOUGH INITIALLY WIRED FOR 2-WIRE SERVICE.
- 2. THE POLE-MOUNTED ELECTRIC SERVICE BOX DETAIL DEPICTS
  THE BASIC CONSTRUCTION OF THE EQUIPMENT. SLIGHT
  MODIFICATIONS APPLY FOR DIFFERING SERVICES AND APPLICATIONS AS FOLLOWS:
  - TYPE A FULLY EQUIPPED FOR 240/120V. 3W SERVICE, COMPLETE WITH LIGHTING MAIN BREAKER
- 3. THE ELECTRIC SERVICE EQUIPMENT ASSEMBLY SHALL BE UL LISTED AS SUITABLE FOR USE AS SERVICE ENTRANCE
- THE ELECTRIC SERVICE EQUIPMENT ENCLOSURE SHALL BE
  NEMA 4X STAINLESS STEEL, NOMINALLY 12"W X 16"H X 8"D, WITH
  A PIANO-HINGED DOOR, STEEL BACK PANEL, FAST-ACTING
  STAINLESS STEEL ENCLOSURE CLAMPS, PADLOCK PROVISIONS
  AND DOOR STOP, HOFFMAN CATALOG NO. A-16H12O8SS6LP/A-16 P12/A-DSTOPK/C-PMK12, OR APPROVED EQUAL.
- 5. CIRCUIT BREAKERS SHALL BE THERMAL MAGNETIC BOLT-ON TYPE WITH A MINIMUM INTERRUPTING CAPACITY OF 25,000 SYMMETRICAL AMPERES AT 240 VOLTS. THEY SHALL BE LOCKABLE IN THE "OFF" POSITION FOR COMPLIANCE WITH OSHA LOCK-OUT/ TAG-OUT REQUIREMENTS. HANDLES SHALL BE TRIP FREE.
- 6. THE SURGE PROTECTOR SHALL BE SUITABLE FOR 240/120 VOLT SINGLE PHASE 60HZ AC ELECTRICAL SERVICE, WITH A SURGE ENERGY CAPABILITY OF 2160 JOULES OR BETTER AT 8/20 MICRO-SECONDS, RATED -40 TO 60 DEGREES C., WITH LED OPERATING INDICATORS, AND SHALL BE UL LISTED PER UL 1449, CUTLER-HAMMER CMOV230L065XST OR APPROVED EQUAL.
- 7. BUS BARS, CONNECTORS, AND LUGS SHALL BE COPPER, INSULATED AND ISOLATED, AND CONFIGURED TO PREVENT SHORTED CONDITIONS FROM TIGHTENING TERMINATIONS, ETC. THE OVERALL BUS SECTION SHALL BE CONFIGURED BEHIND AN INSULATING BARRIER SHIELD WHICH IS REMOVABLE FOR ACCESS TO CONNECTIONS, OR THE ASSEMBLY SHALL BE A MANUFACTURED SPECIALTY PANEL BOARD, CUTLER-HAMMER PRL2A OR APPROVED
- 8. THE COMBINATION GROUND AND NEUTRAL BAR SHALL BE CONFIGURED WITH SEPARATE GROUND AND NEUTRAL SECTIONS AND SPARE TERMINALS AS INDICATED. THE HEADS OF GROUND SCREWS SHALL BE PAINTED GREEN. THE HEADS OF NEUTRAL SCREWS SHALL BE PAINTED WHITE. THE SERVICE NEUTRAL AND SERVICE GROUNDING ELECTRODE CONDUCTOR SHALL BE TERMINATED ADJACENT TO EACH OTHER AT THE DIVIDE BETWEEN THE SECTIONS AND WIRING SHALL BE TERMINATED ONLY UPON THE APPROPRIATE SECTION.
- THE WIRING TERMINALS, INCLUDING THE GROUND/NEUTRAL BAR SHALL BE ARRANGED TO PROVIDE ADEQUATE ROOM FOR PERFORMING FIELD TERMINATIONS.
- 10. A PLASTIC LAMINATED LAYOUT AND CIRCUIT DIAGRAM SHALL BE MECHANICALLY SECURED TO THE INTERIOR SIDE OF THE ENCLOSURE DOOR.
- A 2-COLOR ENGRAVED PLASTIC NAMEPLATE, ATTACHED WITH SCREWS, AND ENGRAVED AS INDICATED, SHALL BE PROVIDED FOR EACH MAIN
- 12. LUGS AND CONNECTORS SHALL BE RATED FOR 75 C CONDUCTOR.
- 13. THE EXACT MOUNTING HEIGHT OF THE BOX SHALL BE FIELD DETERMINED TO AVOID OBSTRUCTIONS AND PUBLIC ACCESS. TYPICAL HEIGHT SHALL BE APPROXIMATELY 10 FEET ABOVE GRADE.
- 14. SERVICE CONDUCTORS SHALL BE TERMINATED ACCORDING TO N.E.C. CODE AND GROUNDING AND NEUTRAL CONDUCTORS SHALL BE BONDED THROUGH GROUNDED ELECTROBE CONDUCTOR. SERVICE SHOULD BE RATED ACCORDING TO THE LATEST N.E.C. CODE.
- 15. PROPOSED ITEM "ELECTRIC SERVICE INSTALLATION" (AS SHOWN ON SHEET 39) SHALL INCLUDE ELECTRIC SERVICE DISCONNECT BOX WITH ALL NECESSARY CABLES AND PARTS FOR ITS COMPLETE INSTALLATION AND OPERATION.

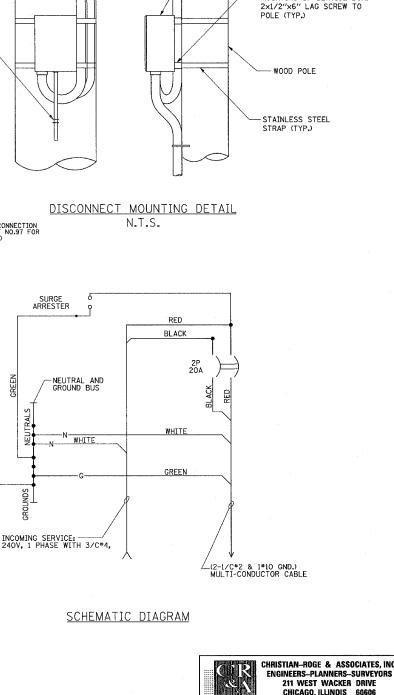

6" DECAL ON FRONT COVER

HOLD-OPEN ATTACHMENT-(DOOR STOP)

CIRCUIT BREAKER (S)

NEUTRAL/GROUND --1"x6"x1/4" COPPER BAR (SEE NOTE 7)

BONDED MOUNTING -

SERVICE GROUNDING— ELECTRODE CONDUCTOR 1\*6, INSULATED

1/4" WET-LOCATION — CORD CONNECTOR W/MALE THREAD END

U-NAIL (TYP.) -

3/4 " 3-PIECE CONDUIT COUPLING (THREADED) (EXISTING)

CASE GROUNDING

¾" THREADED HUB W/INSULATED THROAT

-EXISTING

PADLOCK PROVISIONS

POLE-MOUNTED ELECTRIC SERVICE
BOX, TYPE AS INDICATED. BOX SHALL
BE COMPLETE WITH STAINLESS STEEL
STRAPS AND MOUNTING ACCESSORIES
AS REQUIRED FOR A SECURE, STABLE
ATTACHMENT TO THE POLE.

ELECTRIC SERVICE DISCONNECT BOX DETAIL GENERAL LAYOUT DIAGRAM

3/4 " 3-PIECE CONDUIT COUPLING (THREADED) (EXISTING)

TO COMED SERVICE

TO LUMINAIRE ON POLE NO.TL-16

TO SERVICE INSTALLATION FOR COMED SERVICE-

MALEABLE IRON -CONDUIT STRAP AND

LAG SCREW (TYP.)

TO LUMINAIRE ON POLE NO.TL-16

SERVICE GROUND WELL ACHIEVE 10 OHMS OR LESS

ELECTICAL CABLE ASSEMBLY (2-1/C\*2 & 1\*10 END.)
(2-1/C\*2 & 1\*10 END.)
(WATERPROOF SPLICE REQUIRED AT CONNECTION TO LUMINAIRE ASSEMBLY, SEE SHEET NO.97 FOR "AERIAL CABLE CONNECTION DETAIL")

SURGE ARRESTER

WHITE

INSULATED PLATE

COVER PLATE WITH OPENING FOR CIRCUIT BREAKER (S)

-3/C#4 RHW XLP JACKETED SERVICE ENTRANCE CABLE (FREE AIR)

ENGRAVED NAMEPLATES ON COVER PLATE

ISOLATED MOUNTING CONNECTION

ENCLOSURE BACK-PANEL

SURGE ARRESTER

LIGHTING

SEE NOTE 6 --

SCHEMATIC DIAGRAM

1-312-372-2023 FAX: 1-312-372-5274

ADDENDUM 1 05-01-0 ELECTRIC SERVICE DISCONNECT BOX DETAIL

DATE: 05-02-07

CHECKED BY: I.B

ILLINOIS DEPARTMENT OF TRANSPORTATION