

## STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION

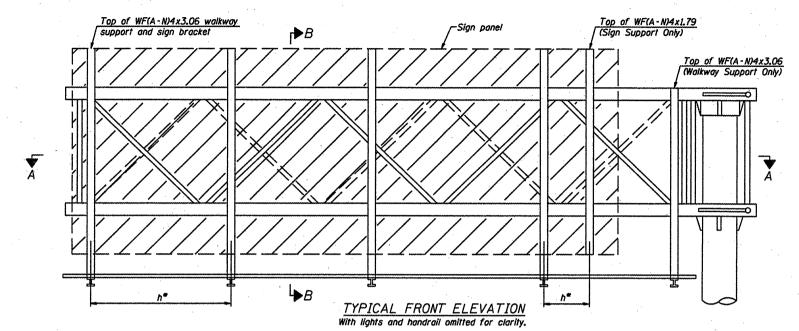


FAI Routes 55 & 72 D6 OVD SIN STR REPL 2009-11 Sanaamon County Sheet 26 of 32 Contract Number 46010



Walkway and truss grating dimensions are nominal and may vary (width \$12". depth ±12") based on available standard

PLAN WALKWAY AND HANDRAIL SKETCH (Road plan beneath truss varies)

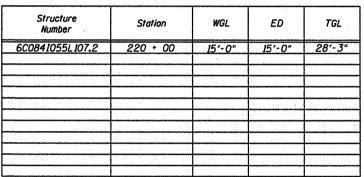


The Contractor and the Engineer shall field verify the walkway grating length to assure the walkway is accessible from the shoulder.

- Space walkway brackets WF(A-N)4x3.06 and sign brackets WF(A-N)4x1.79 for efficiency and within limits shown:

- f = 12" maximum, 4" minimum (End of sign to € of nearest bracket) g = 12" maximum, 4" minimum (End of walkway to € of nearest bracket) h = 6'-0" maximum (€ to € sign and/or walkway support brackets, WF(A-N)4x1.79 or WF(A-N)4x3.06)
- \*\*\* If walkway bracket at safety chain location is behind sign, add angle to bracket. See alternate safety chain attachment on base sheet OSC-A-8

For details of sign placement, sign/walkway brackets, truss and walkway gratings, grating splices and Section B-B, see Base Sheet OSC-A-7.

For details of handrail, handrail joint, safety chain and Details F and G, see Base Sheet OSC-A-8.

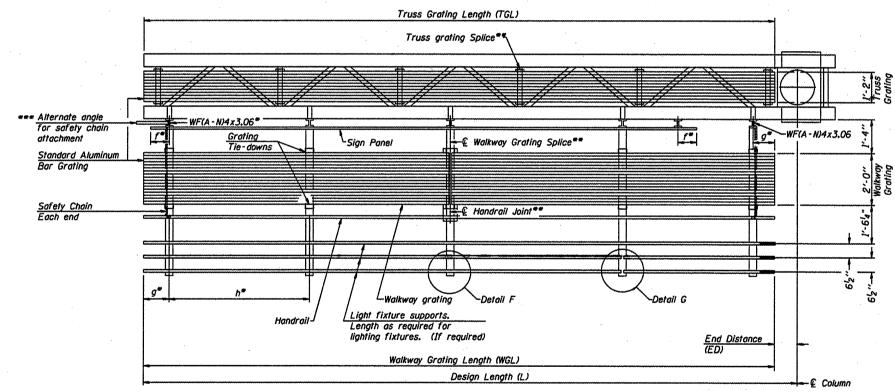

Truss grating to facilitate inspection shall run full length of cantilevers. Cost of truss grating is included in Overhead Sign Structure Cantilever.

EXAMINED

ENGINEER OF BRIDGES AND STRU

PASSED

5/16/08

DESIGNED -

CHECKED -

CHECKED -OSC-A-6

DRAWN

## SECTION A-A

Handrail and walkway grating shall span a minimum of three brackets between splices. == Use and location of handrail joints or grating splices are optional, based on lengths needed and material availability.

TGL = L - ( Post O.D. + 6")

|          |               | 2                                      |      |  |
|----------|---------------|--|------|--|
|          | NUMBER        | REVISION                               | DATE |  |
| <u></u>  |               |  |      |  |
|          | ļ             | ······································ |      |  |
| DESIDN   | <del>  </del> |  |      |  |
| ETUMES   |               |  |      |  |
| E ILPICS |               |  |      |  |
|          |               |  |      |  |
|          |               |  |      |  |

## BRACKET TABLE

| WF(A-N)4x1.79 or WF(A-N)4x3.06<br>ASTM B308, Alloy 6061-T6 |                          |                      |  |
|--|--------------------------|----------------------|--|
| Sign Width   |                          | Number               |  |
| Greater Than   | Less Than or<br>Equal To | Brackets<br>Required |  |
|  | 8'-0"                    | 2                    |  |
| 8'-0"  | 14'-0"                   | 3                    |  |
| 14'-0"   | 20'-0"                   | 4                    |  |
| 20'-0"   | 26'-0"                   | 5                    |  |
| 26'-0"   | 32'-0"                   | 6                    |  |

CANTILEVER SIGN STRUCTURES ALUMINUM WALKWAY DETAILS ALUMINUM TRUSS & STEEL POST

> District 6 Overhead Sign Structure Replacement