

LIGHT POLE FOUNDATION DEPTH TABLE 30 FT. (9.144 m) TO 35 FT. (10.668 m) MOUNTING HEIGHT

| 1321-1-1111/10 33 | | | |
|-----------------------------------|--------------------------------|-------------------|--|
| COLL CONDITIONS | DESIGN DEPTH "D" OF FOUNDATION | | |
| SOIL CONDITIONS | SINGLE ARM POLE | TWIN ARM POLE | |
| SOFT CLAY | 11'-0'' | 12'-8" | |
| Qu = 0.375 TON/SO. FT. | (3,35 m) | (3 . 85 m) | |
| MEDIUM CLAY | 9'-0'' | 14'-10'' | |
| Ou = 0.75 TON/SQ.FT | (2.74 m) | (4 . 52 m) | |
| STIFF CLAY Ou = 1.50 TON/SO. FT. | 7'-6'' (2 . 29 m) | 8'-7" (2.61 m) | |
| LOOSE SAND | 9'-6'' | 10'-7" | |
| Ø = 34° | (2.90 m) | (3.22 m) | |
| MEDIUM SAND | 9'-0'' | 9'-10" | |
| Ø = 37.5° | (2.74 m) | (2.99 m) | |
| DENSE SAND | 8'-3'' | 9'-7'' | |
| Ø = 40° | (2.51 m) | (2.91 m) | |




ANCHOR ROD

TOP_VIEW

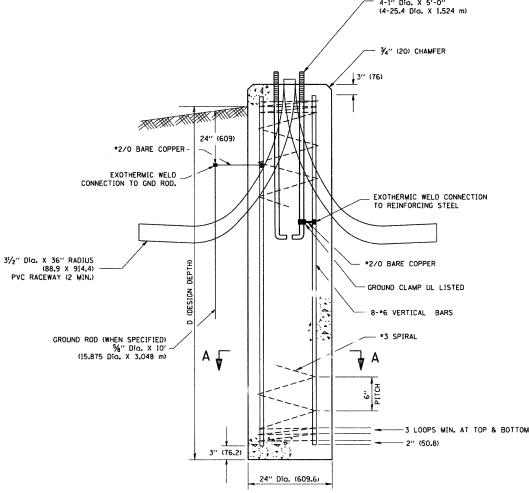

FOUNDATION DETAIL



FOUNDATION EXTENSION DETAIL

60" (1500)

5" (127.0

TOP OF ANCHOR ROD

ANCHOR BOLT DETAIL

5%" T. X 4" DIA.— WASHER, TACK WELDED

#4 SPIRAL

SECTION A-A

| 1 | | | | |
|----------------------------|-----------------------------|------------|-----------|---|
| FILE NAME = | USER NAME = gaglianobt | DESIGNED - | REVISED - | Γ |
| W:\diststd\22x34\be300.dgn | | DRAWN - | REVISED - | |
| | PLOT SCALE = 50.0000 '/ IN. | CHECKED ~ | REVISED - | |
| | PLOT DATE = 1/4/2008 | DATE - | REVISED - | |

STATE OF ILLINOIS **DEPARTMENT OF TRANSPORTATION**

| LIGHT POLE FOUNDATION 30' (9.144 m) TO 35' (10.668 m) M.H. 11 12" (292 mm) BOLT CIRCLE | | F.A RTÉ. | RTE. SECTION COUNTY SHEE | | | |
|--|--|-------------|-----------------------------|----------------|--------|--|
| | | * | 06-00036-00-LS | LAKE | 70 | |
| | | BE-300 | | CONTRACT NO. | | |
| | SCALE: NONE SHEET NO. 1 OF 1 SHEETS STA. TO STA. | FED. ROA | DIST. NO. 1 ILLINOIS FED. A | ID PROJECT ARA | 1-00D1 | |

NOTES

BEFORE THE CONCRETE IN PLACED.

BEFORE LIGHT POLES ARE INSTALLED.

PROCESS ACCORDING TO ASTM F 1136.

BEFORE THE LIGHT POLE IS ERECTED.

APPROVAL OF THE ENGINEER.

ACCORDING TO ASTM F 436.

1. ALL DIMENSIONS ARE IN INCHES (MILLIMETERS) UNLESS OTHERWISE SHOWN.

THE ANCHOR RODS AND RACEWAYS SHALL BE PROPERLY SECURED IN PLACE

THE FOUNDATION SHALL NOT PROTRUDE MORE THAN 4 IN. (100 mm) ABOVE THE FINISHED GRADE WITHIN A 60 IN. (1.5 m) CHORD ACROSS THE FOUNDATION, WITH ANCHOR RODS INCLUDED,

IN ACCORDANCE WITH AASHTO GUIDELINES. IF THE FOUNDATION HEIGHT, INCLUDING ANCHOR RODS, EXTENDS BEYOND THESE SPECIFIED LIMITS, THE FOUNDATION SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE. SEE FOUNDATION EXTENSION DETAIL.

THE HOLE FOR THE FOUNDATION SHALL BE MADE BY DRILLING WITH AN AUGER, OF THE SAME DIAMETER AS THE FOUNDATION. IF SOIL CONDITIONS REQUIRE THE USE OF A LINER TO FORM THE HOLE, THE LINER SHALL BE WITHDRAWN AS THE CONCRETE IS DEPOSITED.

THE TOP OF THE FOUNDATION SHALL BE CONSTRUCTED LEVEL. A LINER OR FORM SHALL BE USED TO PRODUCE A UNIFORM SMOOTH SIDE TO THE TOP OF THE FOUNDATION. FOUNDATION TOP SHALL BE CHAMFERED $\frac{\pi}{4}$ -In. (20 mm).

THE CONCRETE SHALL BE CLASS SI. CONCRETE SHALL CURE ACCORDING TO ARTICLE 1020.13

7. THE ANCHOR ROD SHALL BE A HOOK ROD TYPE. COLD BENDING OF THE ANCHOR ROD WILL NOT BE ALLOWED. THE RADIUS OF THE HOOK BEND SHALL NOT BE LESS THAN 4 TIMES THE NOMINAL DIAMETER OF THE ANCHOR ROD. A TACK WELDED ANCHOR ROD MAY BE SUBSTITUTED WITH THE

8. THE ANCHOR RODS SHALL BE ACCORDING TO ASTM F1554 GRADE 725 (GRADE 105). NUTS SHALL

10. THE ANCHOR RODS SHALL BE THREADED A MINIMUM OF 6 INCHES (150 mm) WITH A MINIMUM OF

11. ANCHOR RODS SHALL PROJECT 23/4" (69.9 mm) ABOVE THE TOP OF THE FOUNDATION. IF BREAKAWAY COUPLINGS ARE SPECIFIED, THE CONTRACTOR SHALL CAREFULLY COORDINATE THE ANCHOR ROD PROJECTION WITH THE INSTALLATION REQUIREMENTS OF THE BREAKAWAY COUPLINGS.

12. THE CONTRACTOR SHALL USE A "3 SPIRAL AT 6" (152.4 mm) PITCH OR MAY SUBSTITUTE "3 TIES AT 12" (304.8 mm) O.C. WITH THE APPROVAL OF THE ENGINEER.

13. THE CABLE TRENCHES AND FOUNDATION SHALL BE BACK FILLED AND COMPACTED AS SPECIFIED

3 INCHES (75 mm) OF THREADED ANCHOR ROD EMBEDDED IN THE FOUNDATION.

14. THE RACEWAYS SHALL PROJECT 1" (25.4 mm) ABOVE THE TOP OF THE FOUNDATION.

BE HEXAGON NUTS ACCORDING TO ASTM A 194 2H OR ASTM A 563 DH, AND WASHERS SHALL BE

9. ANCHOR RODS, NUTS AND WASHERS SHALL BE COMPLETELY GALVANIZED BY EITHER THE HOT-DIPPED PROCESS CONFORMING WITH AASHTO M 232, THE MECHANICAL PLATING METHOD CONFORMING TO

AASHTO M 298, CLASS 50 WITH A MAXIMUM COATING THICKNESS OF 150 UM(6 MILS) OR THE ELECTROLYTIC

* F.A.P. 352 ILLINOIS ROUTE 137 (SHERIDAN ROAD

C-91-197-10