

\* Granular or solid flux filled headed studs

 $\frac{7}{16}$  ''  $\phi$  holes at 4'-0" cts. for  $\frac{3}{8}$ "  $\phi$ 

bolts. All bolts shall be burned, sawed,

or chipped off flush with the plates

after forms are removed, typ.

Strip seal $l_{2}^{l}$ " (S Abut),  $l_{4}^{3}$ " (N Abut) Locking edge rail-— Top of slab  $*^{3}$ 4"  $\phi$  x 8" studs 234" (S Abut), 3" (N Abut) Place plates at 1'-0'' cts.  $s'' \phi$  holes at 4'-0" cts. for  $\frac{3}{8}'' \phi$ (alt. with top horizontal studs) bolts. All bolts shall be burned, sawed,

SECTION THRU

WELDED RAIL JOINT


The strip seal shall be made continuous and shall have a minimum thickness of \( \begin{align\*} \lambda \end{align\*} \). The configuration of the strip seal shall match the configuration of the Locking Edge Rails. Open or "webbed" strip seal gland configurations are not permitted. The gland shall be sized for a maximum rated movement of 4 inches.


The height and thickness of the Locking Edge Rails shown are minimum dimensions. The actual configuration of the Locking Edge Rails and matching strip seal May vary from manufacturer to manufacturer. Flanged edge rails will not be allowed. Locking Edge Rails May be spliced at slope discontinuities and stage construction joints.

The manufacturer's recommended installation methods shall be followed. The joint opening and deck dimensions detailed on the superstructure are based on a rolled rail expansion joint. If the Contractor elects to use the welded rail expansion joint, the opening and deck dimensions shall be modified according to the dimensions detailed on this sheet. Required modifications shall be made at no additional cost to the State.

All steel components shall be galvanized after fabrication according to Article 520.03 of the Standard Specifications.


# SECTION THRU ROLLED RAIL JOINT





or chipped off flush with the plates

after forms are removed, typ.



ANCHOR P

(for welded rail)

Top of locking edge rail Top of sidewalk Top of deck or median Top of locking edge rail

AT PARAPET

AT SIDEWALK OR MEDIAN Shorter plates with a single row of studs at 12" cts. May be necessary on medians which are shallower than 9". See manufacturer's recommendation.

#### ROLLED EXTRUDED RAIL WELDED RAIL


LOCKING EDGE RAIL SPLICE

complete joint penetration

is verified by mock-up.


The inside of the locking edge rail groove shall be free of weld residue.

### TYPICAL END TREATMENTS

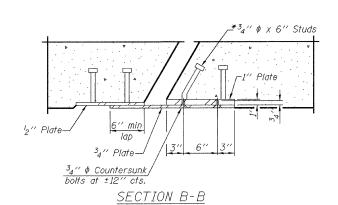


<u>BILL OF MAT</u>		
Item	Unit	Total
Preformed Joint Strip Seal	Foot	289.5

## LOCKING EDGE RAILS



PLAN



SECTION A-A

POINT BLOCK DETAILS (for skews > 30°)

## PREFORMED JOINT STRIP SEAL SN 082-0247 & 0248

SHEET NO. 5	F.A.I RTE.	SECTION			COUNTY	TOTAL SHEETS	SHEET NO.	
	255	82-1HVB-I-1			ST. CLAIR	45	30	
20 SHEETS					CONTRACT	NO. 76	926	
	FED. RO	DAD DIST.	NO.	ILLINOIS	FED. A	ID PROJECT		

DESIGNED J. Uehle CHECKED A. Halloway J. Uehle DRAWN CHECKED A. Halloway

EJ-SSJ 10-1-08

0820247-76926.dqn 11/5/2009 11:38:00 AM