



FILE PATH = p:\388035-par\lsc\com\lme\local\p\AEC\00\Documents\01\_Americas\Transportation\62629938\_Circle\Phase\_1\1000\_CAD\016\_Electrical\Sheets\60W29\_Contract\160W29-sht-Light-09

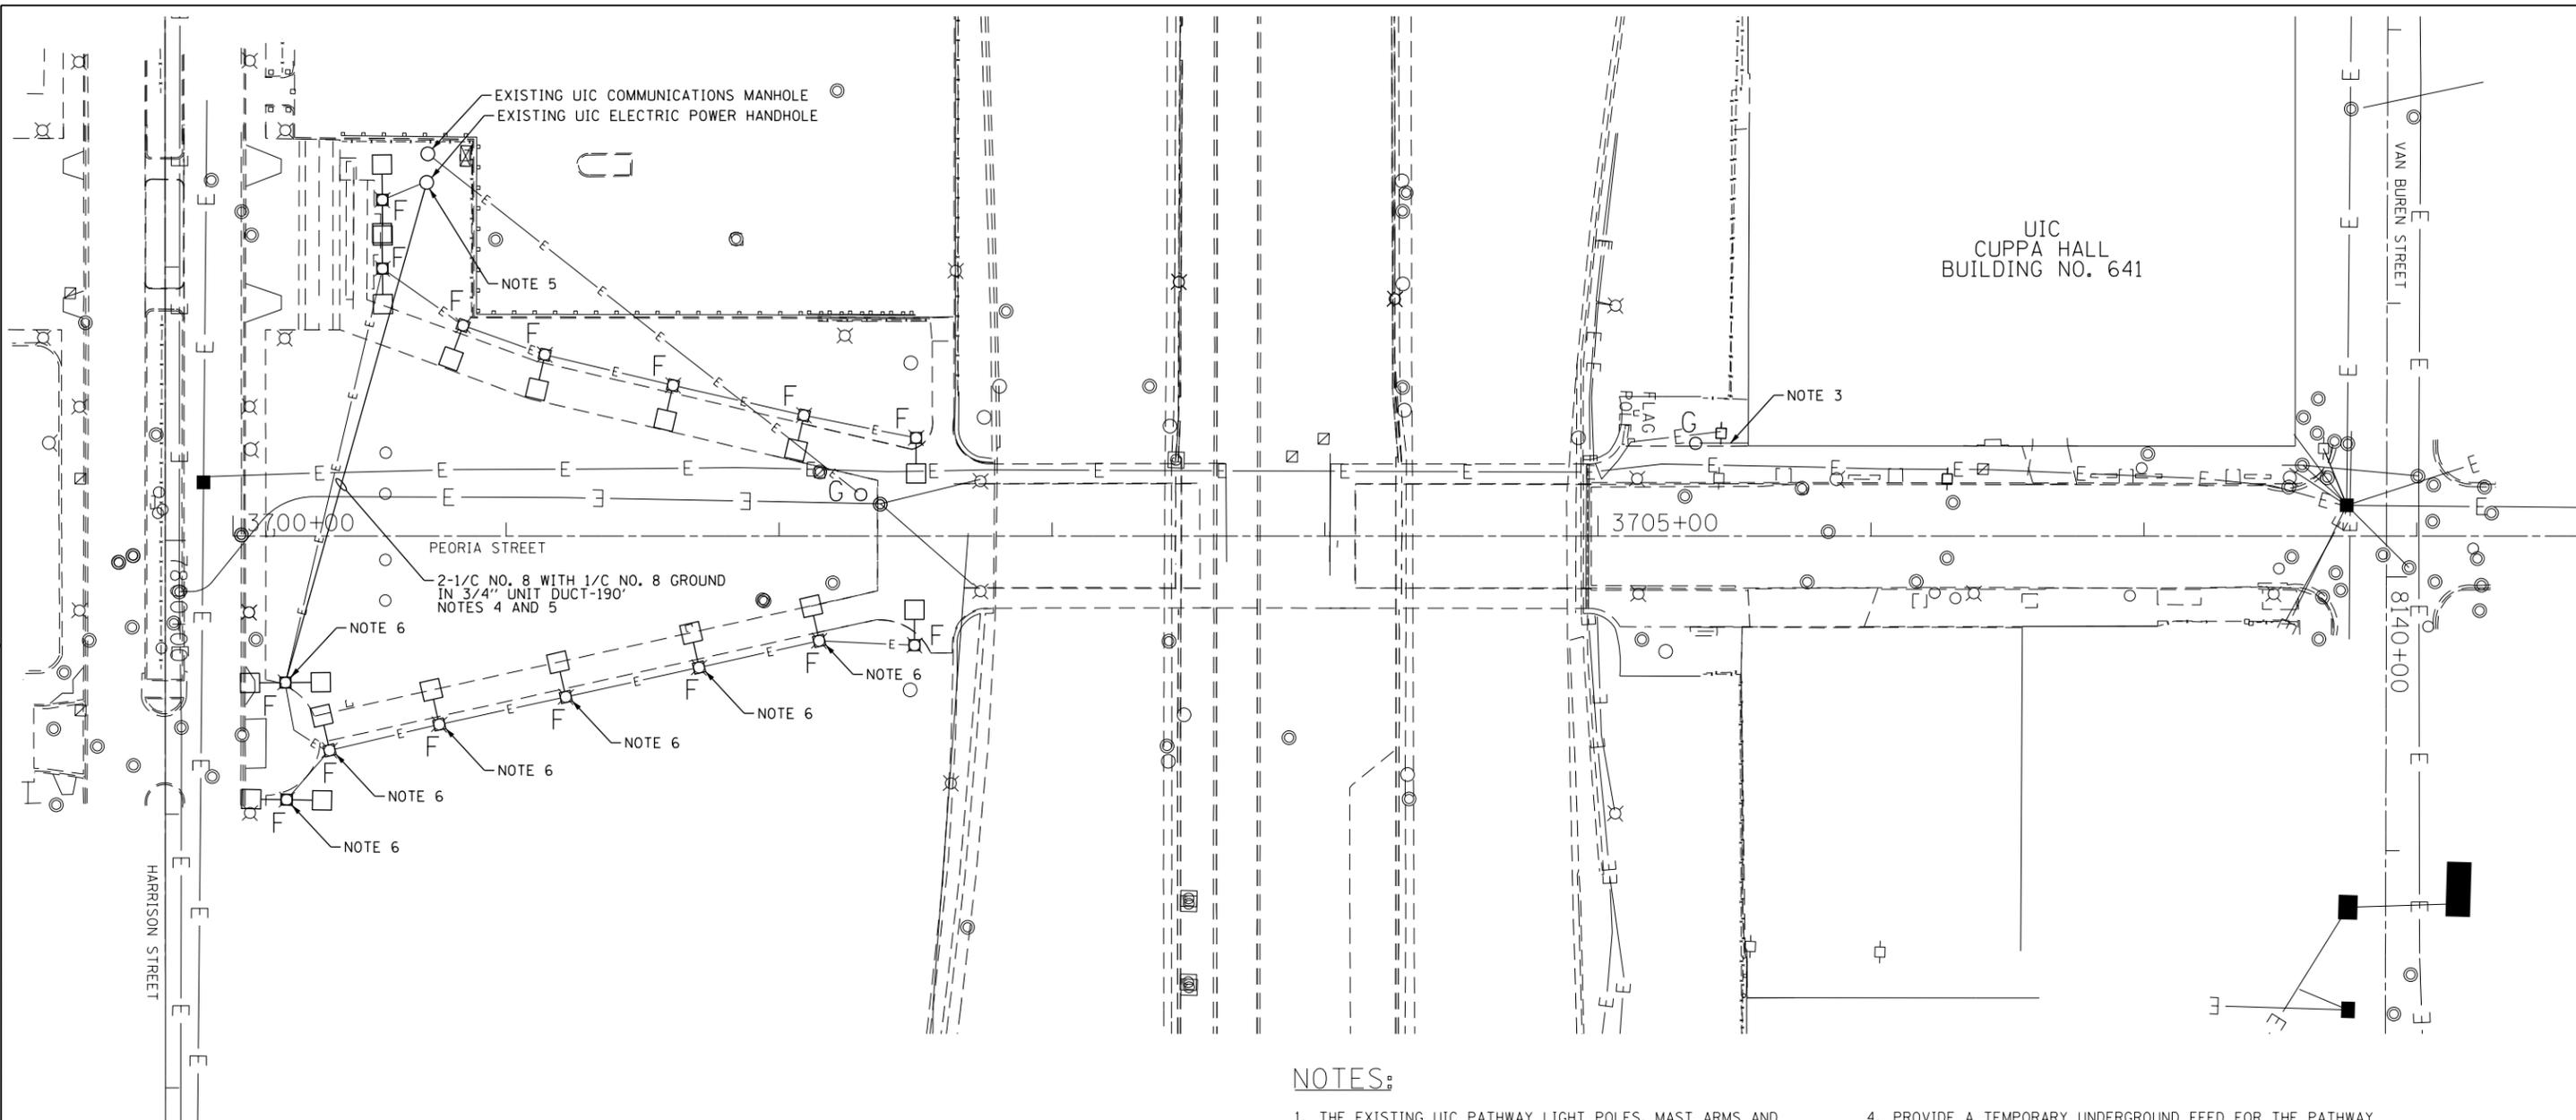

"E" EXISTING TO REMAIN  
 "F" REMOVE EXISTING UIC LIGHT POLE FOUNDATION COMPLETE. NOTES 1 AND 6  
 "G" REMOVE EXISTING ETU FOUNDATION COMPLETE. NOTE 2

**NOTES:**

- THE EXISTING UIC PATHWAY LIGHT POLES, MAST ARMS AND LUMINAIRES WILL BE REMOVED BY OTHERS. THE CONTRACTOR SHALL COORDINATE THIS REMOVAL WORK WITH UIC'S FACILITIES MANAGEMENT. UIC FACILITIES MANAGEMENT CONTACT INFORMATION IS AS FOLLOWS:  
  
 PABLO ACEVEDO 312-996-2106  
 KEVIN O'SHEA 312-996-2883  
 CLARENCE BRIDGES 312-413-5946  
  
 THE CONTRACTOR MUST CONTACT UIC'S FACILITIES MANAGEMENT A MINIMUM OF TWO WEEKS PRIOR TO THE REMOVAL OF THE EXISTING UIC PATHWAY LIGHTING UNITS.
- THE EXISTING UIC ETU BOLLARD SHALL BE REMOVED BY OTHERS. THE CONTRACTOR SHALL COORDINATE THE REMOVAL WORK WITH UIC'S TELECOM/ACCC ENGINEERING DEPARTMENT. UIC'S TELECOM/ACCC ENGINEERING DEPARTMENT INFORMATION IS AS FOLLOWS:  
  
 BRIAN NG 312-413-8254  
 BEVERLY BAILEY 312-213-7419  
 TOM WIESE 815-272-6607  
  
 THE CONTRACTOR MUST CONTACT UIC'S TELECOM/ACCC GROUP A MINIMUM OF TWO WEEKS PRIOR TO THE REMOVAL OF THE EXISTING UIC ETU BOLLARDS.
- THE EXISTING POWER AND DATA FEED FOR THE ETU BOLLARD IS ROUTED INTO BUILDING 641-CUPPA HALL. THE EXISTING POWER AND DATA CONDUITS SHALL BE SAWCUT, CAPPED AND PROTECTED DURING CONSTRUCTION FOR FUTURE USE. SEE DRAWING E-10 FOR PROPOSED CONDUIT CONNECTIONS.
- PROVIDE A TEMPORARY UNDERGROUND FEED FOR THE PATHWAY LIGHTING CIRCUITS ON THE EAST PATHWAY AS SHOWN. THE TEMPORARY FEED SHALL BE PROTECTED DURING CONSTRUCTION STAGES 1B THROUGH STAGE 3 UNTIL IT IS NO LONGER REQUIRED.
- THE TEMPORARY LIGHTING FEED SHALL BE SPLICED TO EXISTING UIC LIGHTING CIRCUITS LOCATED WITHIN THE EXISTING UIC POWER HANDHOLE. CONTRACTOR SHALL PROVIDE A WATERPROOF CONNECTION FOR ALL SPLICES.
- THE EXISTING UIC PATHWAY LIGHTING UNIT WILL REMAIN IN PLACE AND OPERATIONAL UNTIL THE END OF STAGE 3 OF THE SUGGESTED CONSTRUCTION SCHEDULE. THE CONTRACTOR SHALL PROTECT THE LIGHTING UNIT UNTIL THE ENGINEER DIRECTS THE CONTRACTOR TO REMOVE IT. SEE DRAWING E-09A FOR TEMPORARY POWER FEED TO THESE LIGHTING UNITS.



D160W29-sht-Light-09  
 USER NAME = BAW:tor.t  
 PLOT SCALE = 60.0000' / in.  
 PLOT DATE = 10/28/2013

DESIGNED - WDS  
 DRAWN - CAM  
 CHECKED - WDS  
 DATE - 10/30/2013  
 REVISED -  
 REVISED -  
 REVISED -  
 REVISED -

**STATE OF ILLINOIS  
DEPARTMENT OF TRANSPORTATION**

**EXISTING/TEMPORARY/DEMOLITION PLAN**  
**UNIVERSITY OF ILLINOIS AT CHICAGO**  
 SCALE: 1"=30'  
 SHEET 9 OF 19 SHEETS STA. TO STA.

|                           |                   |             |                    |               |
|---------------------------|-------------------|-------------|--------------------|---------------|
| F.A.I. RTE. 90/94/290     | SECTION 2013-011R | COUNTY COOK | TOTAL SHEETS 356   | SHEET NO. 119 |
| ILLINOIS FED. AID PROJECT |                   |             | CONTRACT NO. 60W29 |               |