

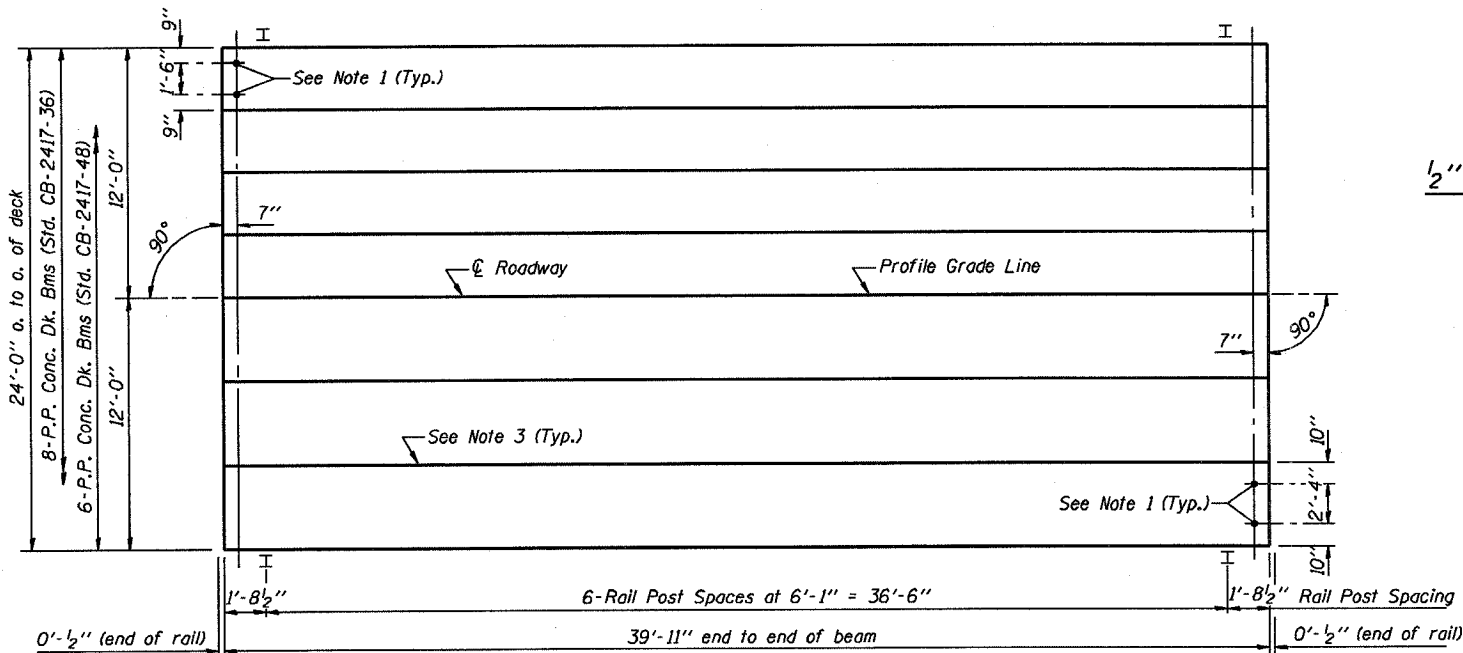


TYPICAL ELEVATIONS

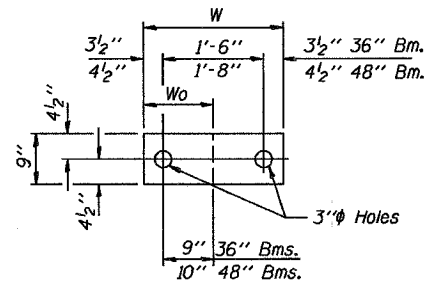


PLAN

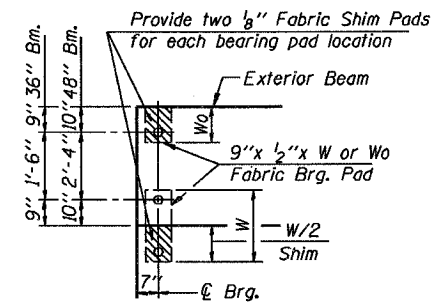


Beam	W	Wo
36"	2'-1"	1'-0 1/2"
48"	2'-5"	1'-2 1/2"


1/2" FABRIC BRG. PAD DETAILS

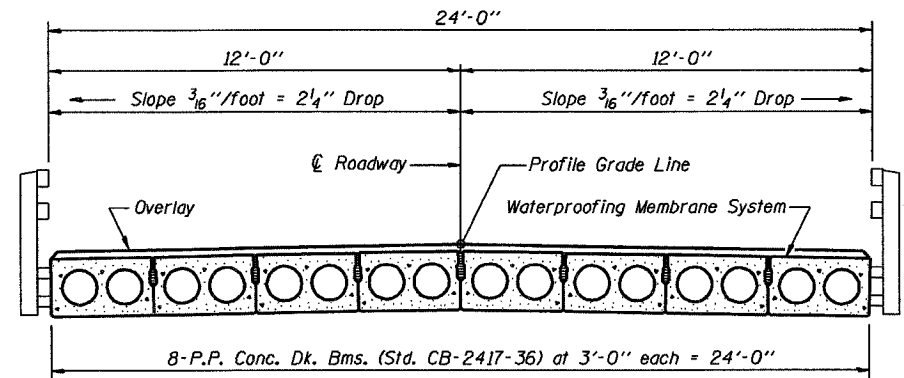


CROSS SECTION

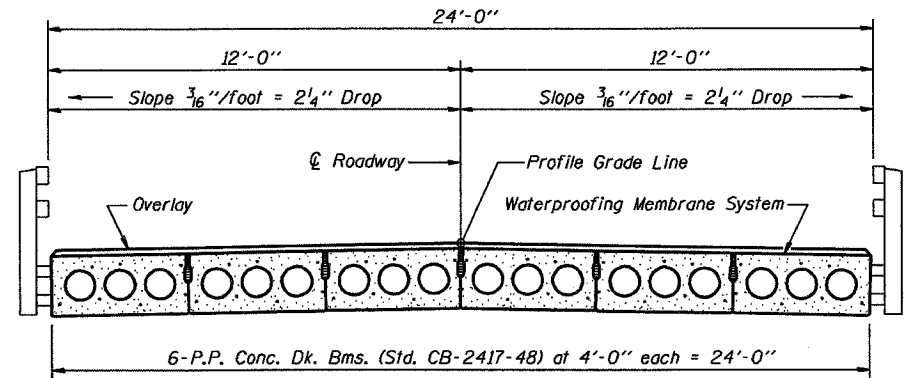

CROSS SECTION

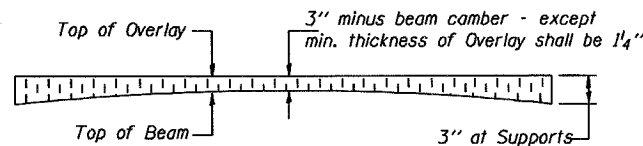

PROFILE OF OVERLAY

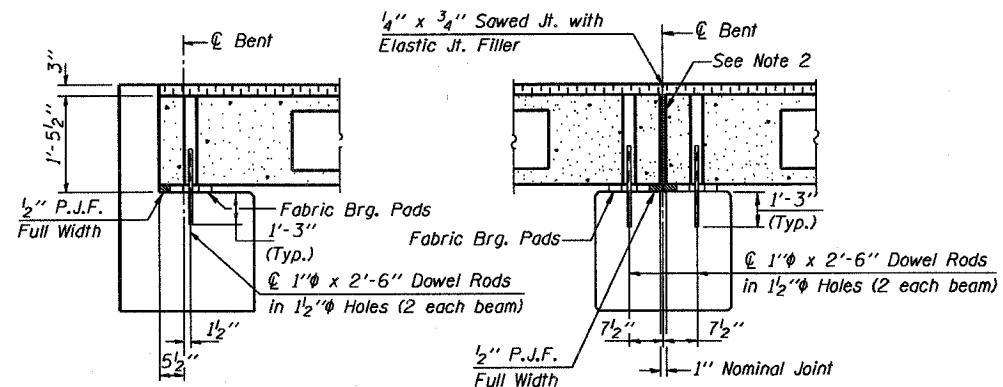

SECTION AT ABUTS.
(Along centerline of Beams)

SECTION AT PIERS
(Along centerline of Beams)

NOTES

- After beams have been erected, holes shall be drilled into substructure and anchor dowels placed. Dowel holes shall be filled with non-shrink grout to top of beam and allowed to cure min. 24 hrs. prior to grouting the shear keys.
- Nominal 1" joint at centerline of Pier shall be filled with non-shrink grout.
- Longitudinal keys shall be grouted.

QUANTITIES FOR ONE SPAN

P.P. Conc. Dk. Bm. 17" Dp.	960 Sq. Ft.
Steel Railing	80 Ft.
Waterproofing Membrane System	106.7 Sq. Yds.
Portland Cement Mortar	280 Ft. 36"
Fairing Course	200 Ft. 48"

Note: Quantity of overlay for one span = 13.2 Tons

P.P.C. DECK BEAM
SUPERSTRUCTURE

24' RDWY.	17" BMS.	40' SPAN	0° SKEW
STANDARD CS-2417-40			

Illinois Department of Transportation

PASSED APRIL 4, 2005

Thomas S. [Signature]

Engineer of Bridge Design

APPROVED APRIL 4, 2005

Ralph E. [Signature]

Engineer of Bridges and Structures

ISSUED