


NOTES:

1. ROUTE NEW CABLING FROM EXISTING MASLR POWER DISTRIBUTION PANEL TO NEW MALS TOWER IN EXISTING DUCT. NEW CABLE SIZE AND TYPE SHALL MATCH EXISTING; SEE TECHNICAL SPECIFICATIONS FOR FURTHER REQUIREMENTS.
2. GUARD WIRE ABOVE DUCT SHALL BE 1/0 BARE COPPER; SEE DUCTBANK DETAILS.

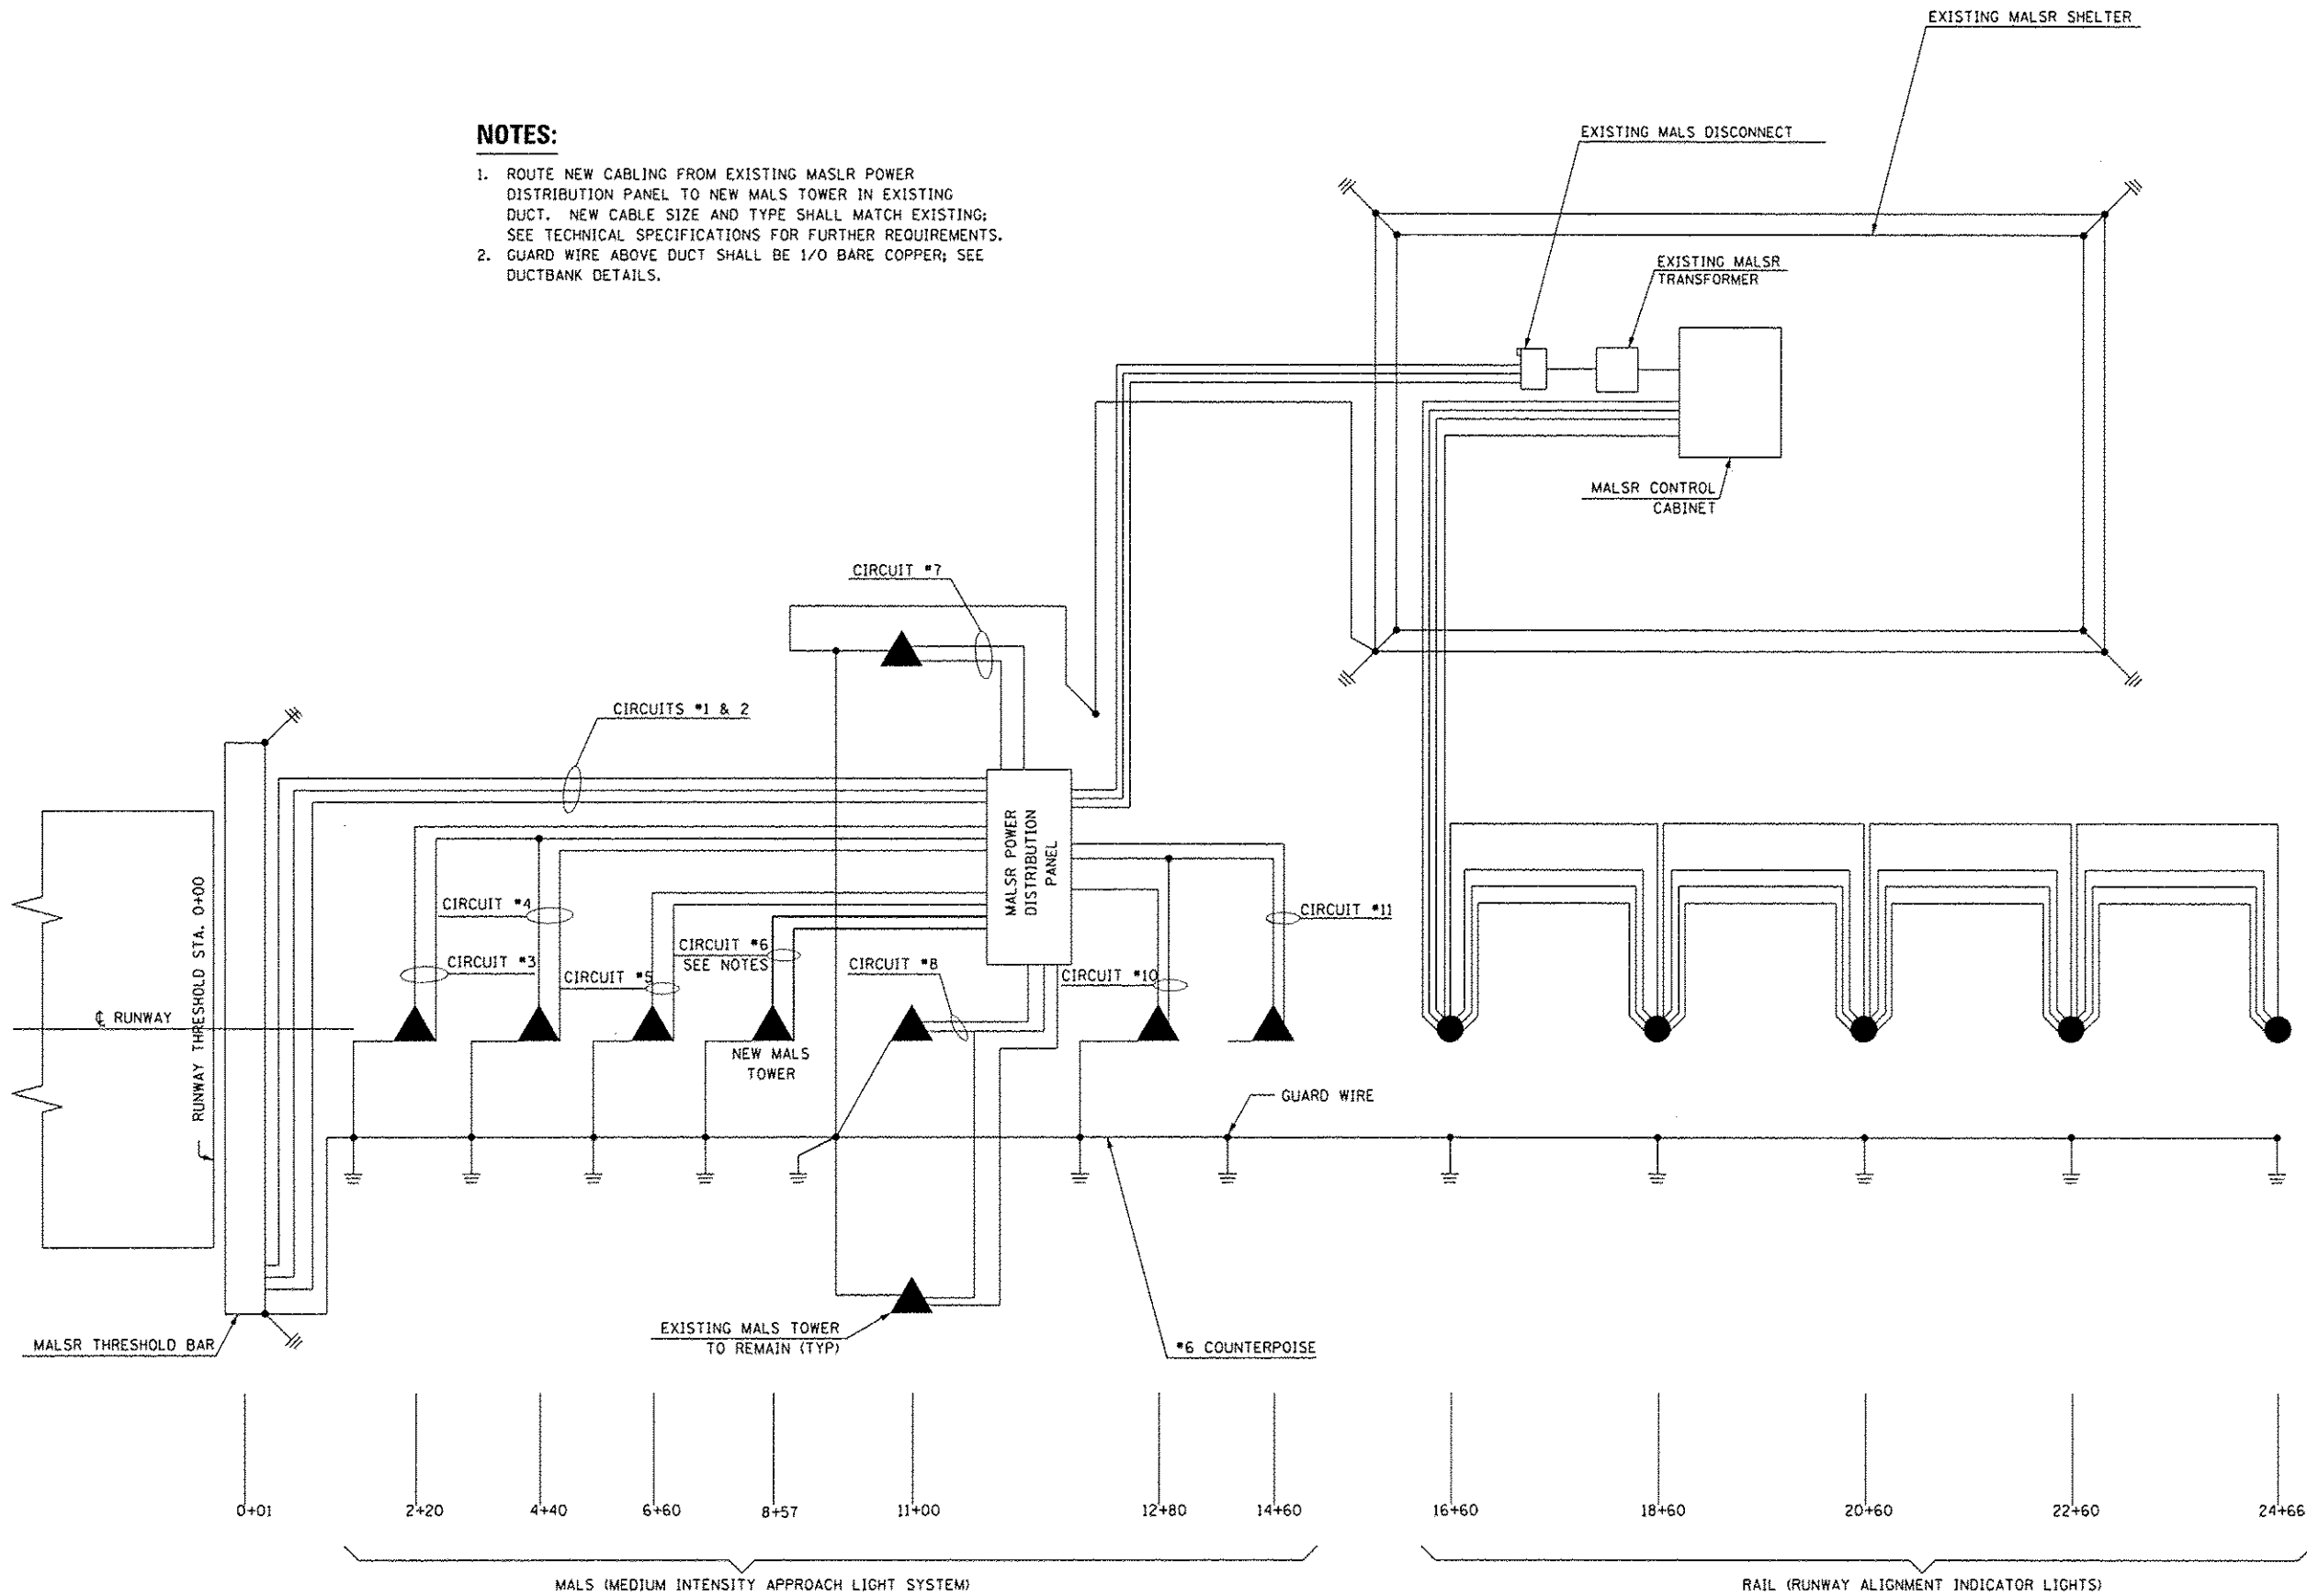

HNTB

USER NAME: mkgaur	DESIGNED: SJM	REVISED: -
	DRAWN: SJM	REVISED: -
PLOT SCALE: 1/2"=1'	CHECKED: SPG	REVISED: -
PLOT DATE: 26-DEC-2012	DATE: 12/28/12	ADDENDUM 1

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

NAVAIDS
RW 22L MALS RELOCATION
SYSTEM WIRING DIAGRAM OVERVIEW
SCALE: N.T.S. SHEET NO. 1 OF 6 SHEETS STA. N/A TO STA. N/A

F.A.P. RTE. 330	SECTION 0105 WRS&HB	COUNTY COOK	TOTAL SHEETS 605	SHEET NO. 605AN
CONTRACT NO. 60G37				
ILLINOIS FED. AID PROJECT				

ADDED SHEET
FAA-40

FILE NAME: IP_PWP\ids47844\DI68037-ahs-FAANAVD48.dgn