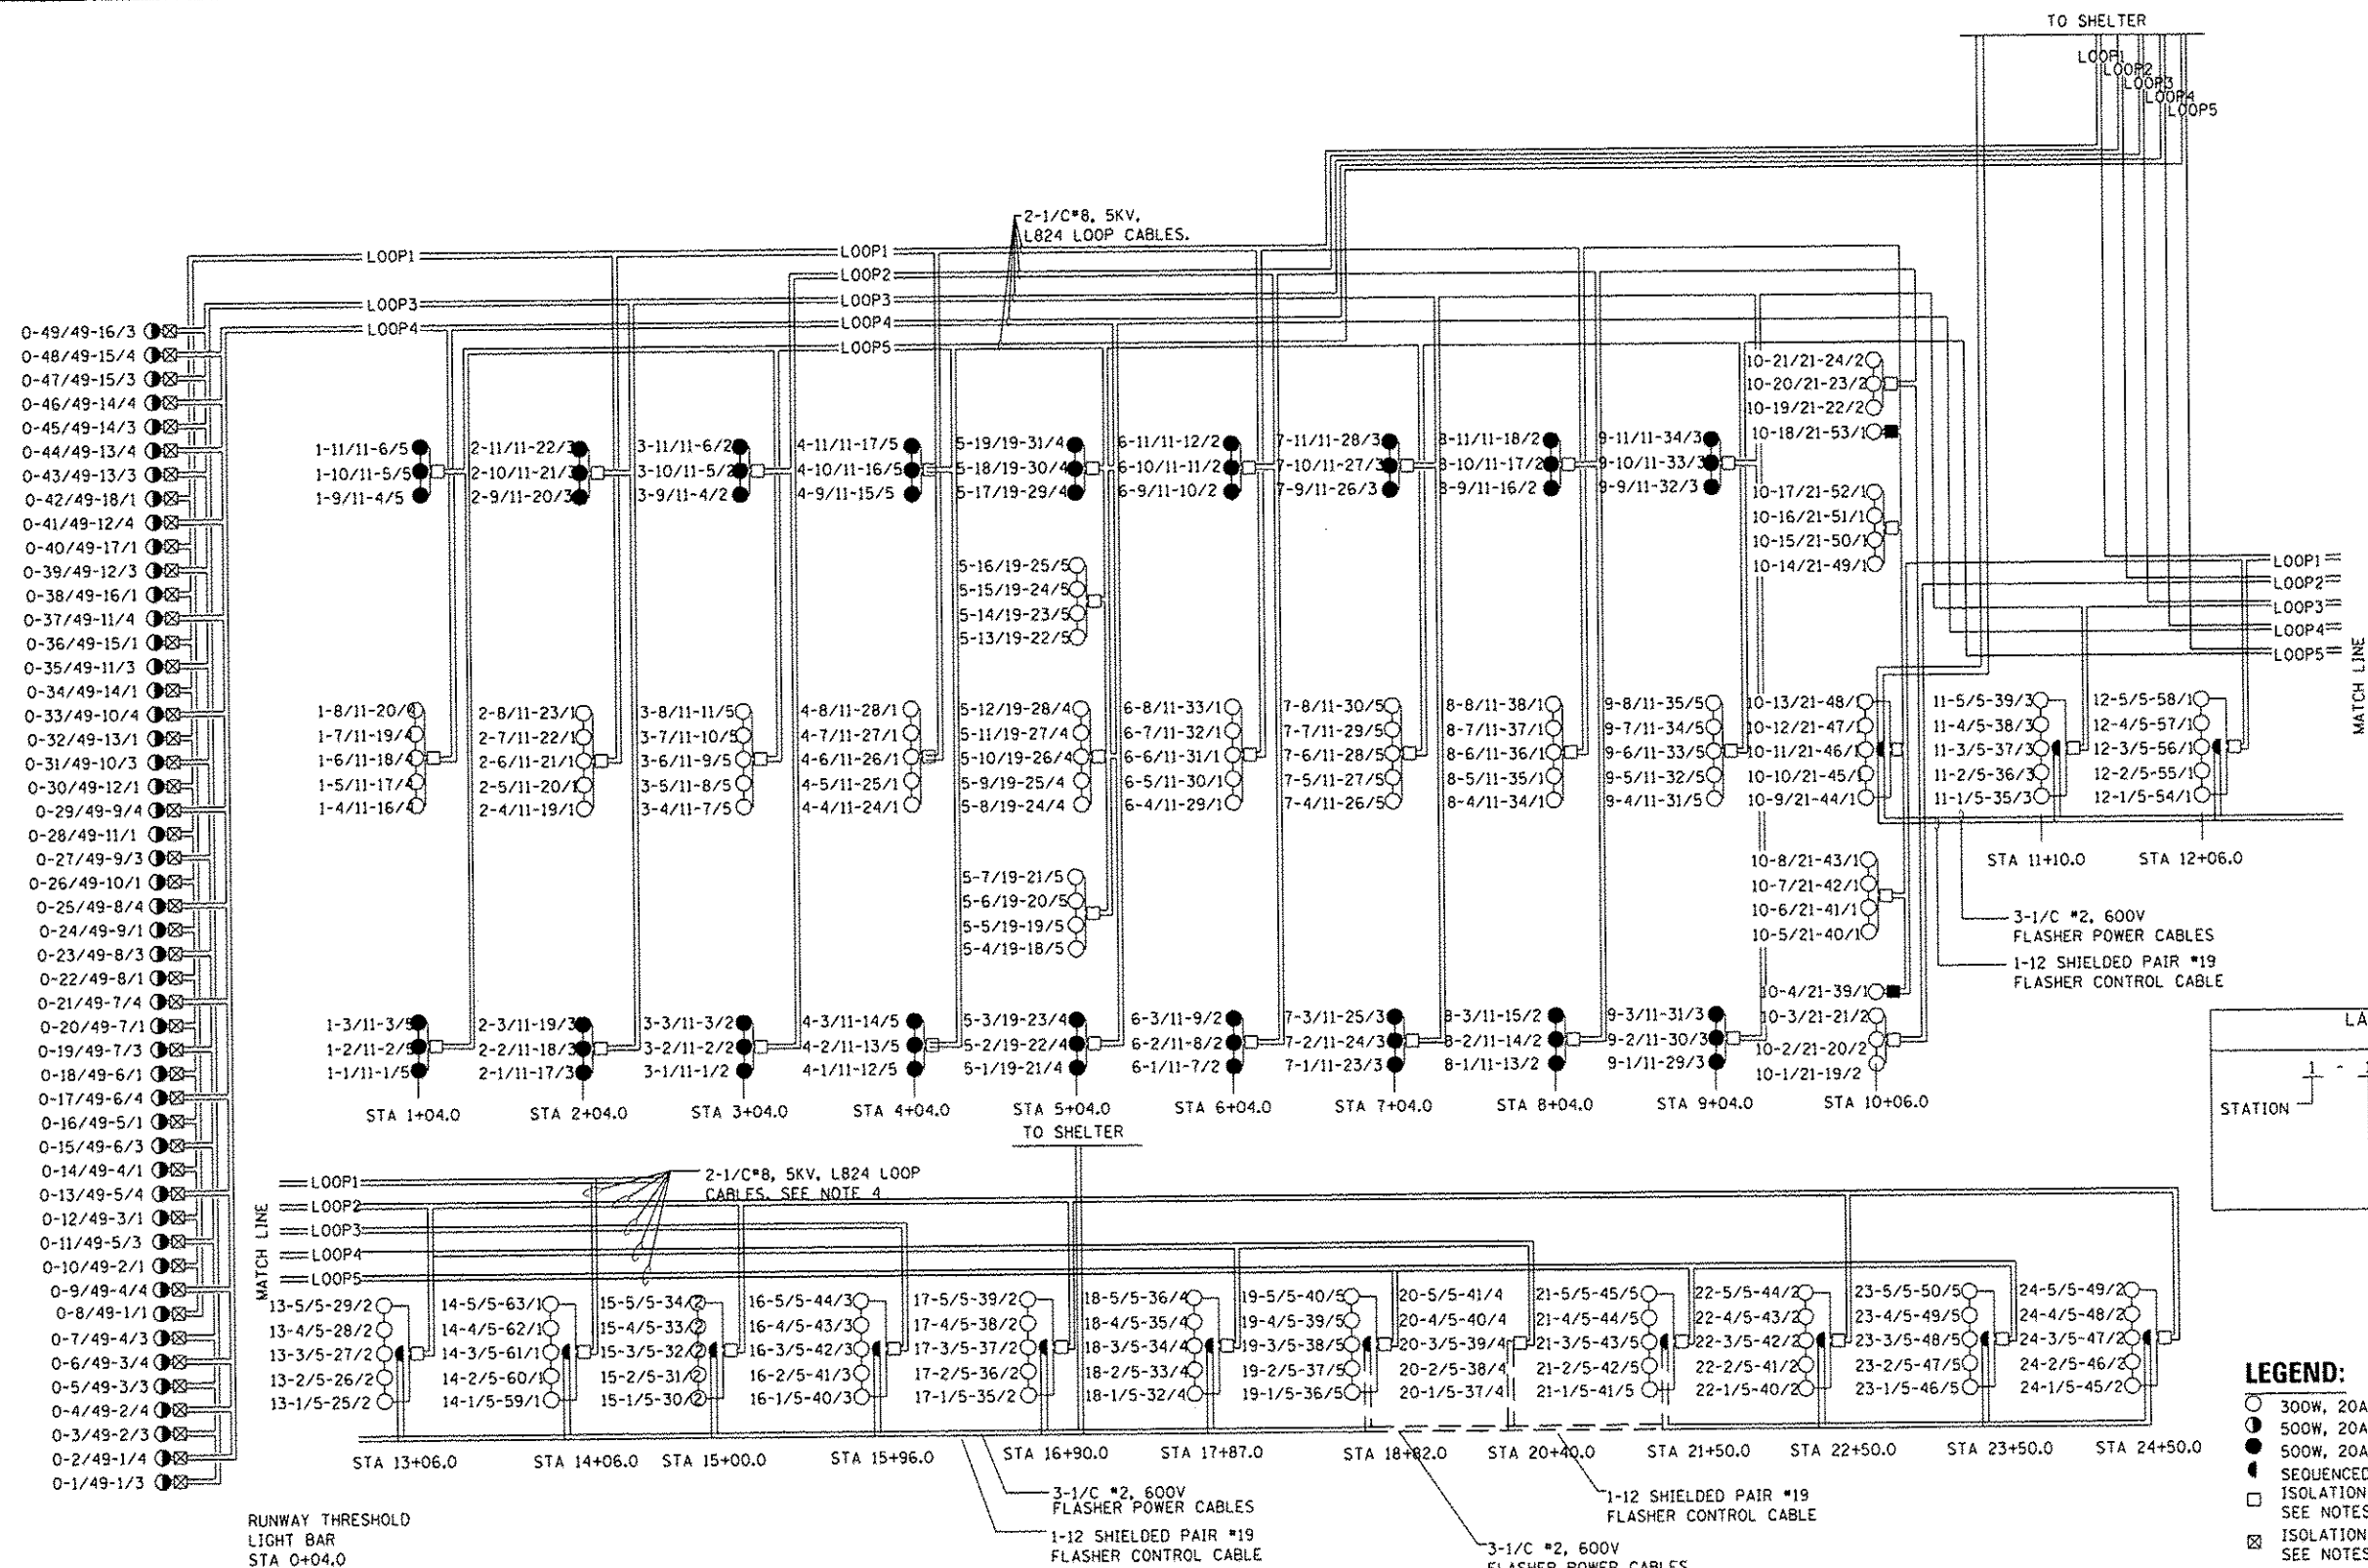


LEGEND:

- 300W, 20A LAMP WITH NO COLORED GLASS FILTER
- 500W, 20A LAMP WITH GREEN GLASS FILTER
- 500W, 20A LAMP WITH RED GLASS FILTER
- ⬢ SEQUENCED FLASHER
- ISOLATION TRANSFORMER (1500W, 20A/20A). SEE NOTES 1 AND 2
- ⊠ ISOLATION TRANSFORMER (500W, 20A/20A). SEE NOTES 1 AND 2
- ISOLATION TRANSFORMER (300W, 20A/20A). SEE NOTES 1 AND 2
- 0-14/59-4/1 LAMP ADDRESS CODE. SEE NOTE 3
- == LOOP1 == SYSTEM LOOPS
- POWER LINES FOR FLASHER
- SYSTEM LOOP CABLING TO BE INSTALLED NEW

HNTB

USER NAME: mhk02	DESIGNED: SJM	REVISED: -
DRAWN: SJM	REVISOR: -	
CHECKED: SPG	REVISOR: -	
DATE: 12/26/12	ADDENDUM: 1	

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

NAVAIDS
RW 28 ALSF-2 SYSTEM WIRING DIAGRAM

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
330	0105 WRS&HB	COOK	605	605AZ
CONTRACT NO. 60637				

SCALE: N.T.S. SHEET NO. 2 OF 16 SHEETS STA. N/A TO STA. N/A

ILLINOIS FED. AID PROJECT

ADDED SHEET
GLD-05-1