
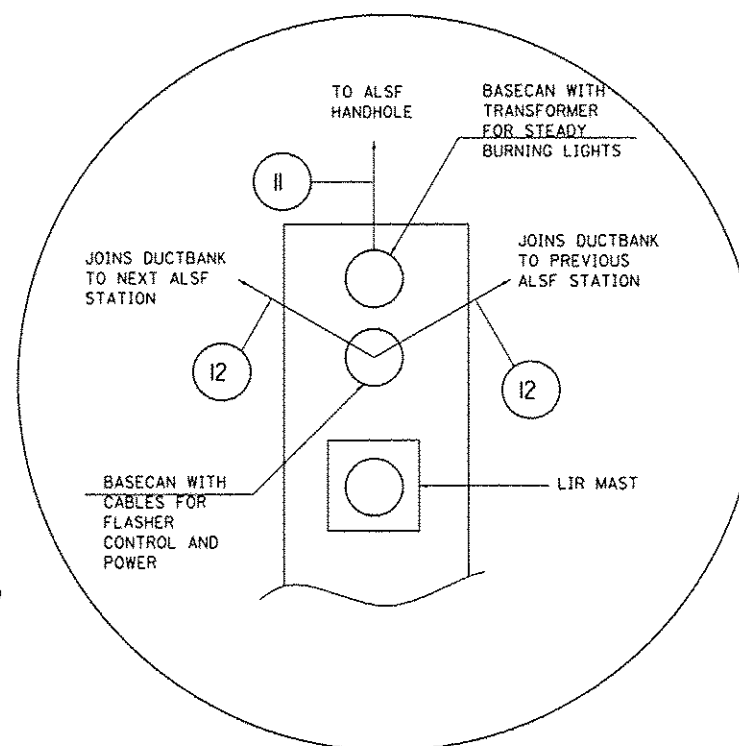
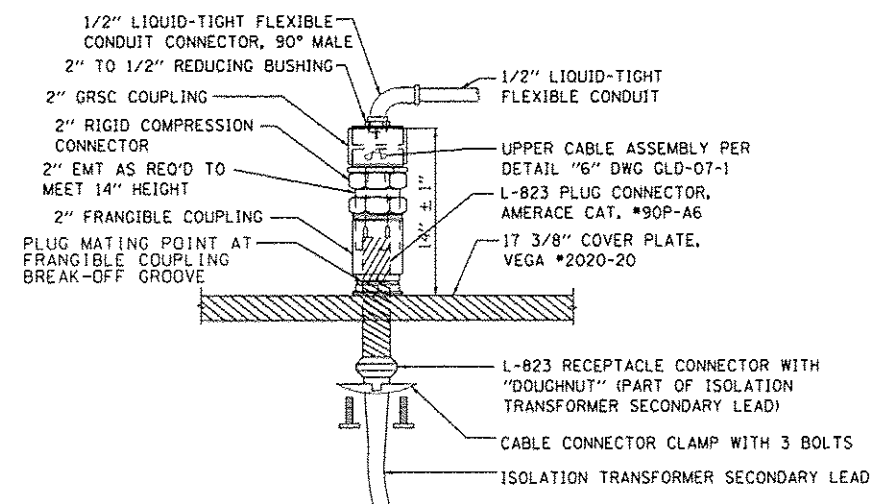
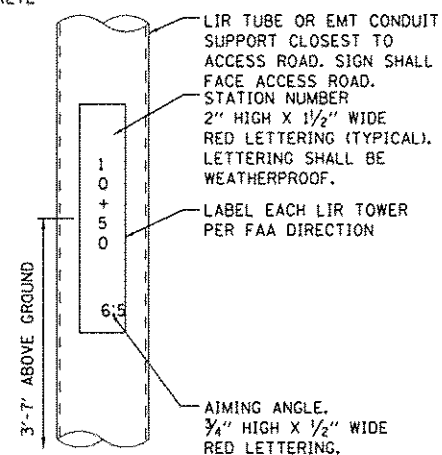
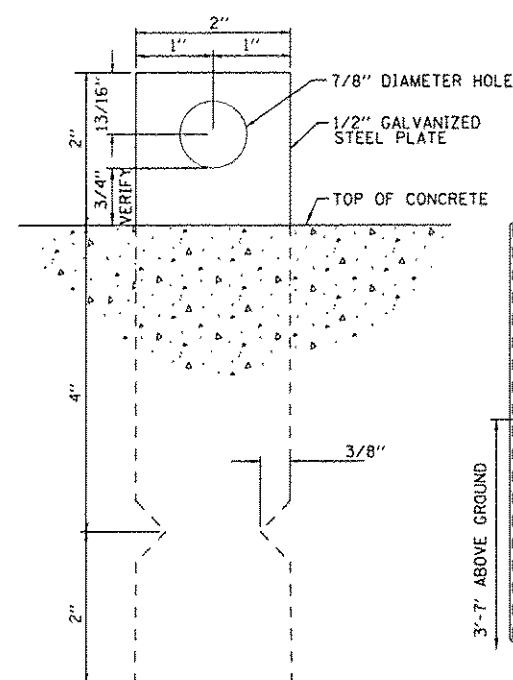
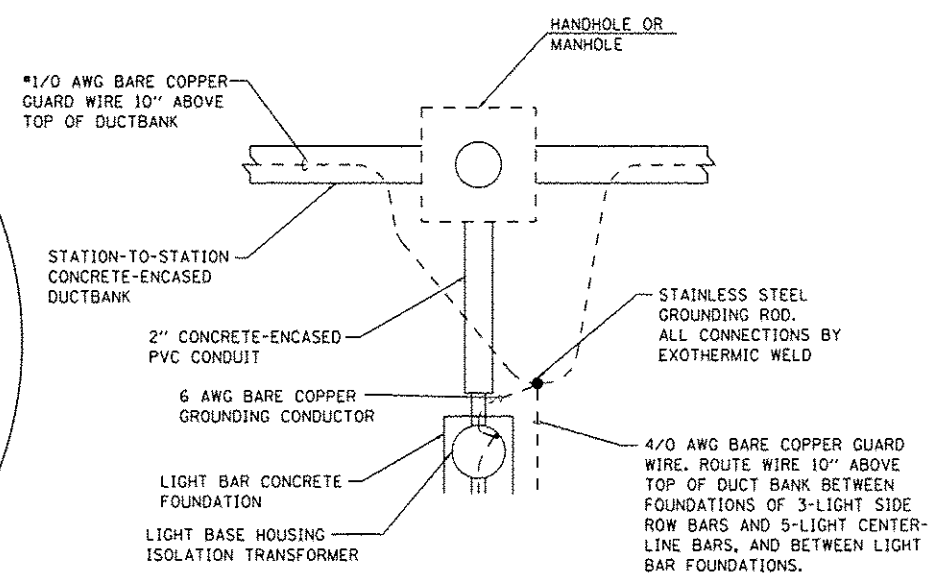


- SPLICING NOTES:**

1. INSIDE DIAMETER OF CONNECTOR SHALL PROPERLY MATCH THE OUTSIDE DIAMETER OF CABLE.
2. HEAT SHRINK TUBING SHALL BE USED ON ALL FIELD INSTALLED L-823 CONNECTORS EXCEPT FOR SECONDARY CONNECTIONS ON ISOLATION TRANSFORMERS.
3. USE PENCILING TOOL WHEN REMOVING CABLE INSULATION TO PREVENT NICKING.
4. USE CRIMPING TOOL (THOMAS & BETTS TBM 255 OR EQUAL) WHEN INSTALLING SERIES CIRCUIT PINS. EACH PIN SHALL BE CRIMPED TWICE (CRIMPS SHALL BE 90° APART)

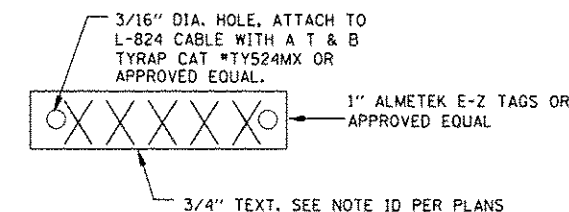

USER NAME * mikosir	DESIGNED <i>SJM</i>	REVISED -
	DRAWN <i>SJM</i>	REVISED -
PLOT SCALE * 2d	CHECKED <i>SPG</i>	REVISED -
PLOT DATE * 26-DEC-2012	DATE	REVISED Δ 12/28/12 ADDENDUM 1

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
330	0105 WRS&HB	COOK	605	605
		CONTRACT NO. 6063		
ILLINOIS FED. AID PROJECT				