


CONTRACT NO. 83773

TYPE OF SOIL	DESIGN DEPTH OF FOUNDATION		REINFORCEMENT IN FOUNDATION			
	SINGLE ARM D	TWIN ARM D	SINGLE ARM		TWIN ARM	
			VERT BARS	SPIRAL	VERT BARS	SPIRAL
SOFT CLAY	3.962 m (13'-0")	4.572 m (15'-0")	8-#6X3.810 m (12'-6")	*3X37.186 m (122')	8-#6X4.343 m (14'-3")	*3X42.977 m (141')
MEDIUM CLAY	2.896 m (9'-6")	3.277 m (10'-9")	8-#6X2.743 m (9'-0")	*3X27.432 m (90')	8-#6X3.048 m (10'-0")	*3X30.480 m (100')
STIFF CLAY	2.134 m (7'-0")	2.438 m (8'-0")	8-#6X1.981 m (6'-6")	*3X20.112 m (66')	8-#6X2.286 m (7'-6")	*3X23.165 m (76')
LOOSE SAND	2.743 m (9'-0")	3.048 m (10'-0")	8-#6X2.591 m (8'-6")	*3X25.908 m (85')	8-#6X2.896 m (9'-6")	*3X28.651 m (94')
MEDIUM SAND	2.515 m (8'-3")	2.743 m (9'-0")	8-#6X2.438 m (8'-0")	*3X23.774 m (78')	8-#6X2.591 m (8'-6")	*3X25.908 m (85')
DENSE SAND	2.362 m (7'-9")	2.743 m (9'-0")	8-#6X2.286 m (7'-6")	*3X22.250 m (73')	8-#6X2.591 m (8'-6")	*3X25.908 m (85')
ROCK OR SOLIDIFIED SLAG	1.524 m (5'-0")	1.524 m (5'-0")	NONE	NONE	NONE	NONE

1. ALL DEMINIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE SHOWN.
2. THE ENGINEER SHALL DETERMINE THE CLASS OF SOIL DURING EXCAVATION AND SELECT THE DESIGN DEPTH OF FOUNDATION FROM THE DESIGN TABLE.
3. EXCAVATION OF THE POLE FOUNDATION SHALL BE MADE WITH AN AUGER, 609.6 mm (24") OR 762.0 mm (30") IN DIAMETER.
4. THE ANCHOR SHALL BE A TACK WELDED TYPE BOLT OR HOOK TYPE BOLT. COLD BENDING OF THE HOOK BOLT WILL NOT BE ALLOWED.
5. THE ANCHOR BOLTS AND RACEWAYS SHALL BE PROPERLY SECURED IN PLACE BEFORE THE CONCRETE IS PLACED IN THE FORM.
6. THE ENTIRE LENGTH OF THE ANCHOR BOLTS AS WELL AS THE NUTS AND WASHERS SHALL BE HOT DIP GALVANIZED IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM DESIGNATION A 153.
7. THE CONTRACTOR SHALL COORDINATE EXTENSION OF ANCHOR BOLTS ABOVE TOP OF FOUNDATION WITH THE BREAKAWAY DEVICE MANUFACTURER'S REQUIREMENTS. IF LIGHT POLE IS MOUNTED WITHOUT BREAKAWAY DEVICE, ANCHOR BOLTS SHALL PROJECT 69.9 mm (2 $\frac{3}{4}$ ") ABOVE TOP OF THE FOUNDATION. THE CONTRACTOR SHALL CONFIRM ANCHOR BOLT EXTENTION WITH ENGINEER.
8. RACEWAYS SHALL PROJECT 25.4 mm (1") ABOVE THE TOP OF THE FOUNDATION.
9. CONCRETE SHALL BE CLASS "X". CONCRETE SHALL CURE ACCORDING TO ARTICLE 1020.13 BEFORE LIGHT POLES ARE INSTALLED.
10. THE CABLE TRENCH SHALL BE BACKFILLED AND FIRMLY COMPACTED BEFORE THE LIGHT IS ERECTED.

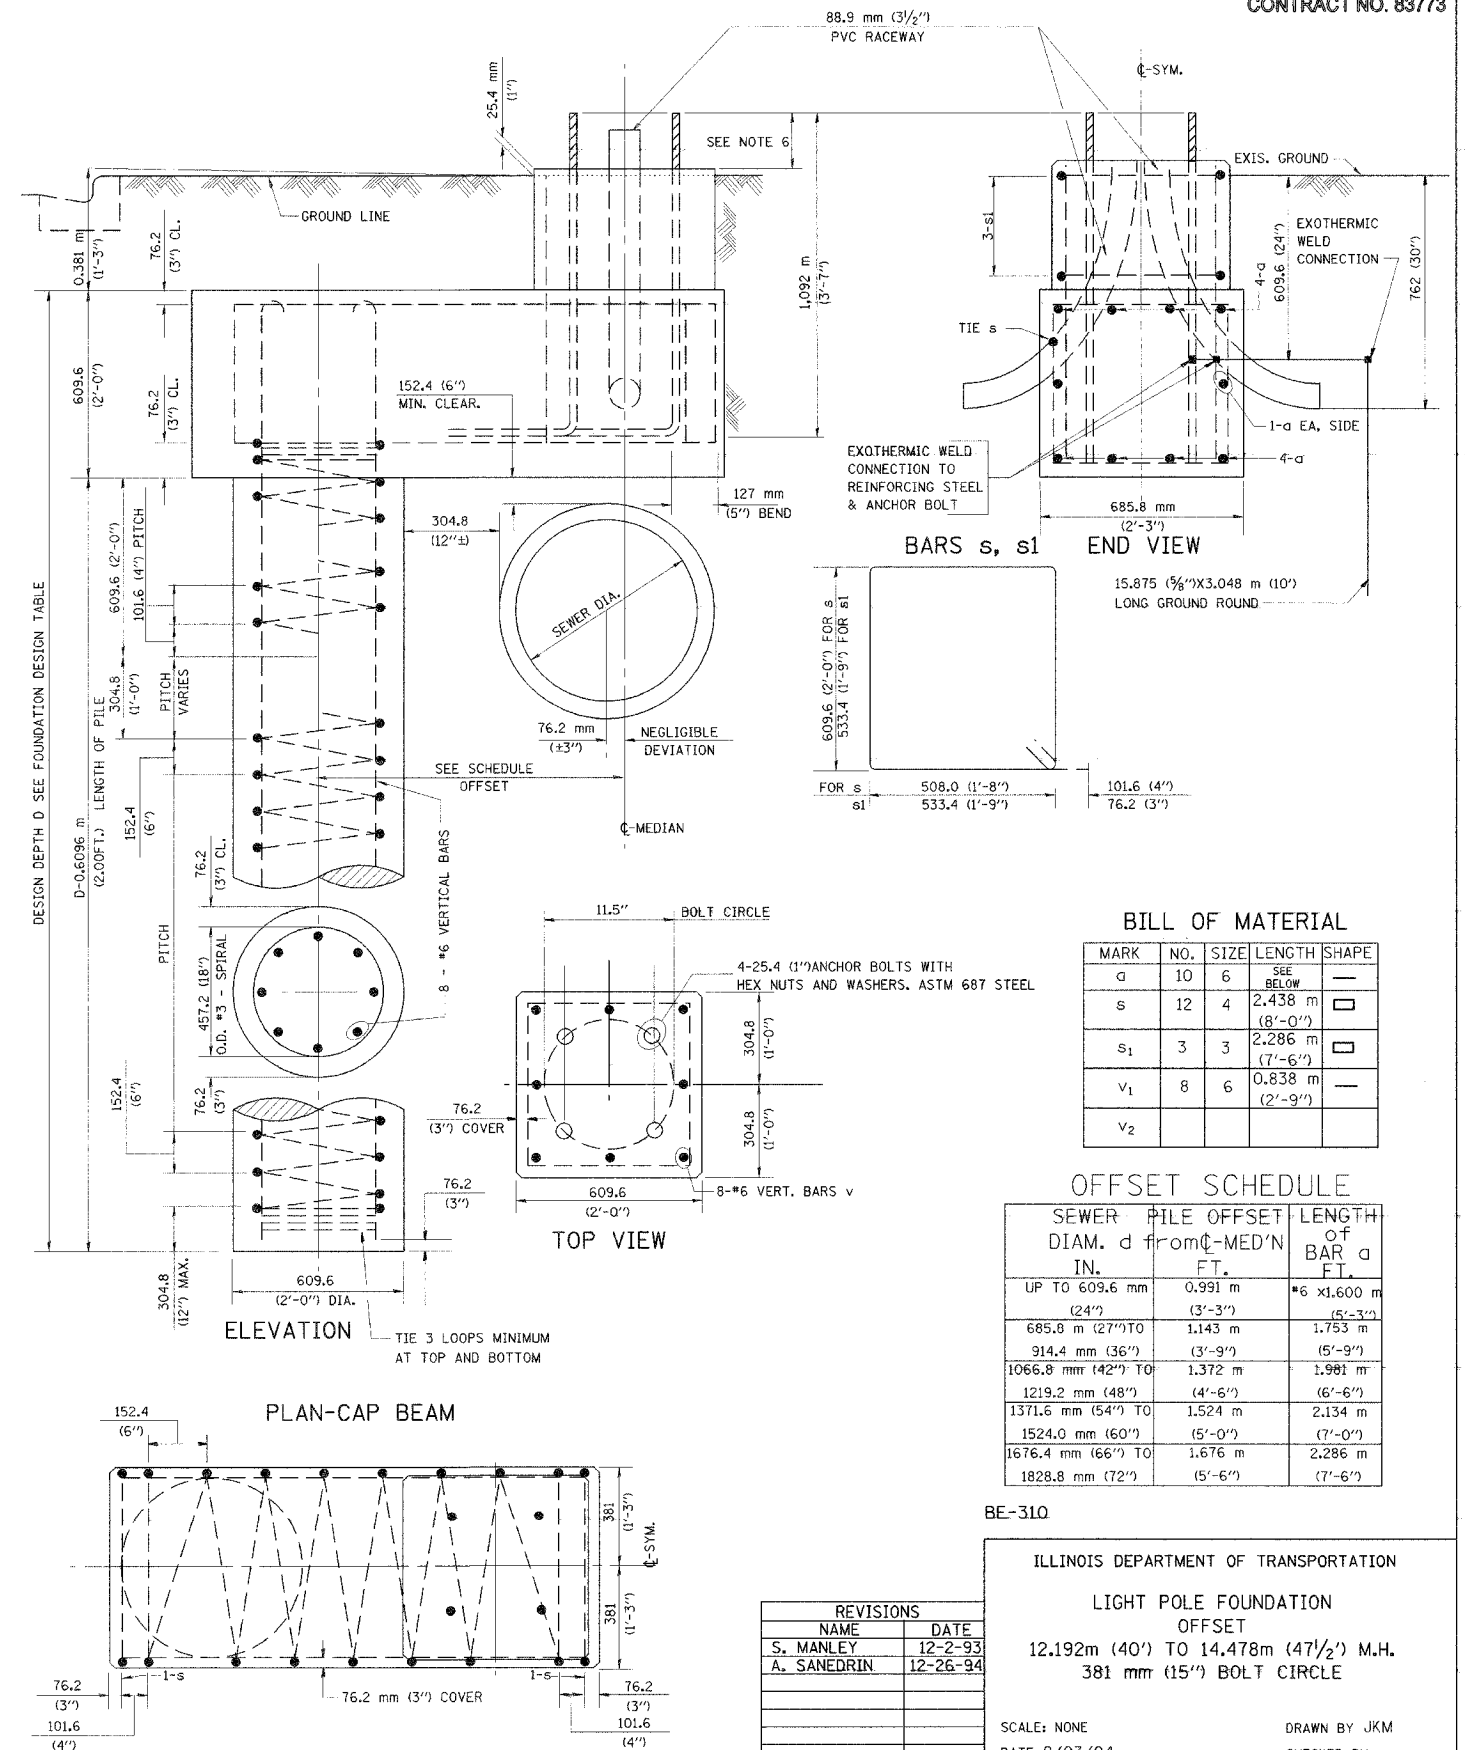

MARK	NO.	SIZE	LENGTH	SHAPE
a	10	6	SEE BELOW	—
s	12	4	2.438 m (8'-0")	
s ₁	3	3	2.286 m (7'-6")	
v ₁	8	6	0.838 m (2'-9")	—
v ₂				

OFFSET SCHEDULE		
SEWER DIAM. d from IN.	PILE OFFSET from MED'N FT.	LENGTH of BAR a FT.
UP TO 609.6 mm (24")	0.991 m (3'-3")	*6 x 1.600 m (5'-3")
685.8 m (27") TO 914.4 mm (36")	1.143 m (3'-9")	1.753 m (5'-9")
1066.8 mm (42") TO 1219.2 mm (48")	1.372 m (4'-6")	1.981 m (6'-6")
1371.6 mm (54") TO 1524.0 mm (60")	1.524 m (5'-0")	2.134 m (7'-0")
1676.4 mm (66") TO 1828.8 mm (72")	1.676 m (5'-6")	2.286 m (7'-6")

ILLINOIS DEPARTMENT OF TRANSPORTATION

LIGHT POLE FOUNDATION
OFFSET
12.192m (40') TO 14.478m (47½') M.H.
381 mm (15") BOLT CIRCLE

SCALE: NONE
DATE 9/03/04

DRAWN BY JKM
CHECKED BY

BE-310

DATE-TIME
DGN-SPEC
VI-BE6
ISER