




WALL MOUNTED

EXHAUST FAN DETAIL

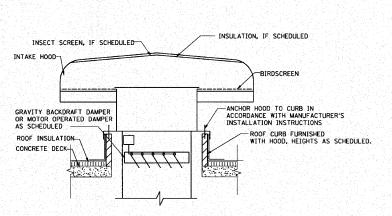

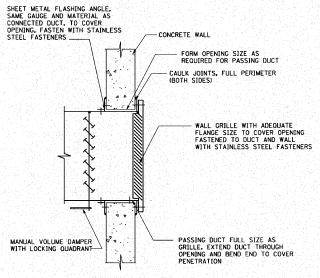




INTAKE HOOD ON **ROOF CURB DETAIL**


THROUGH WALL **GRILLE DETAIL**

TYPICAL DUCT WALL **PENETRATION DETAIL**

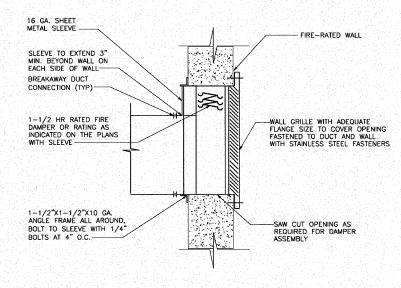


FIRE DAMPER OPENING

WITH GRILLE DETAIL

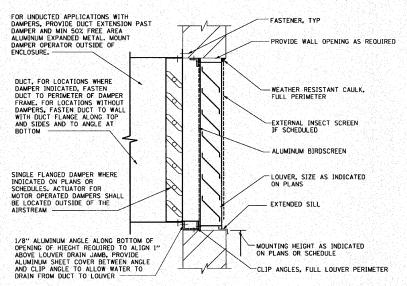


NOTE: ALL FASTENERS SHALL BE OF STAINLESS STEEL CONSTRUCTION

TYPICAL LOUVER DETAIL

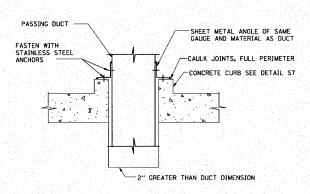

TYPICAL DUCT FLOOR **PENETRATION DETAIL**

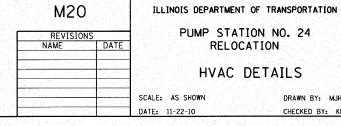

DRAWN BY: MJH

CHECKED BY: KHC

DONOHUE* A S S O C I A T B S