


FILE PATH = p:\388035-par\lsc\comon\me\local\p\AEC\000\Documents\01_Americas\Transportation\62629938_Circle\Phase_1\1000_CAD\015_Electrical\Sheets\60W29_Contract\DI60W29-sht-Light-09

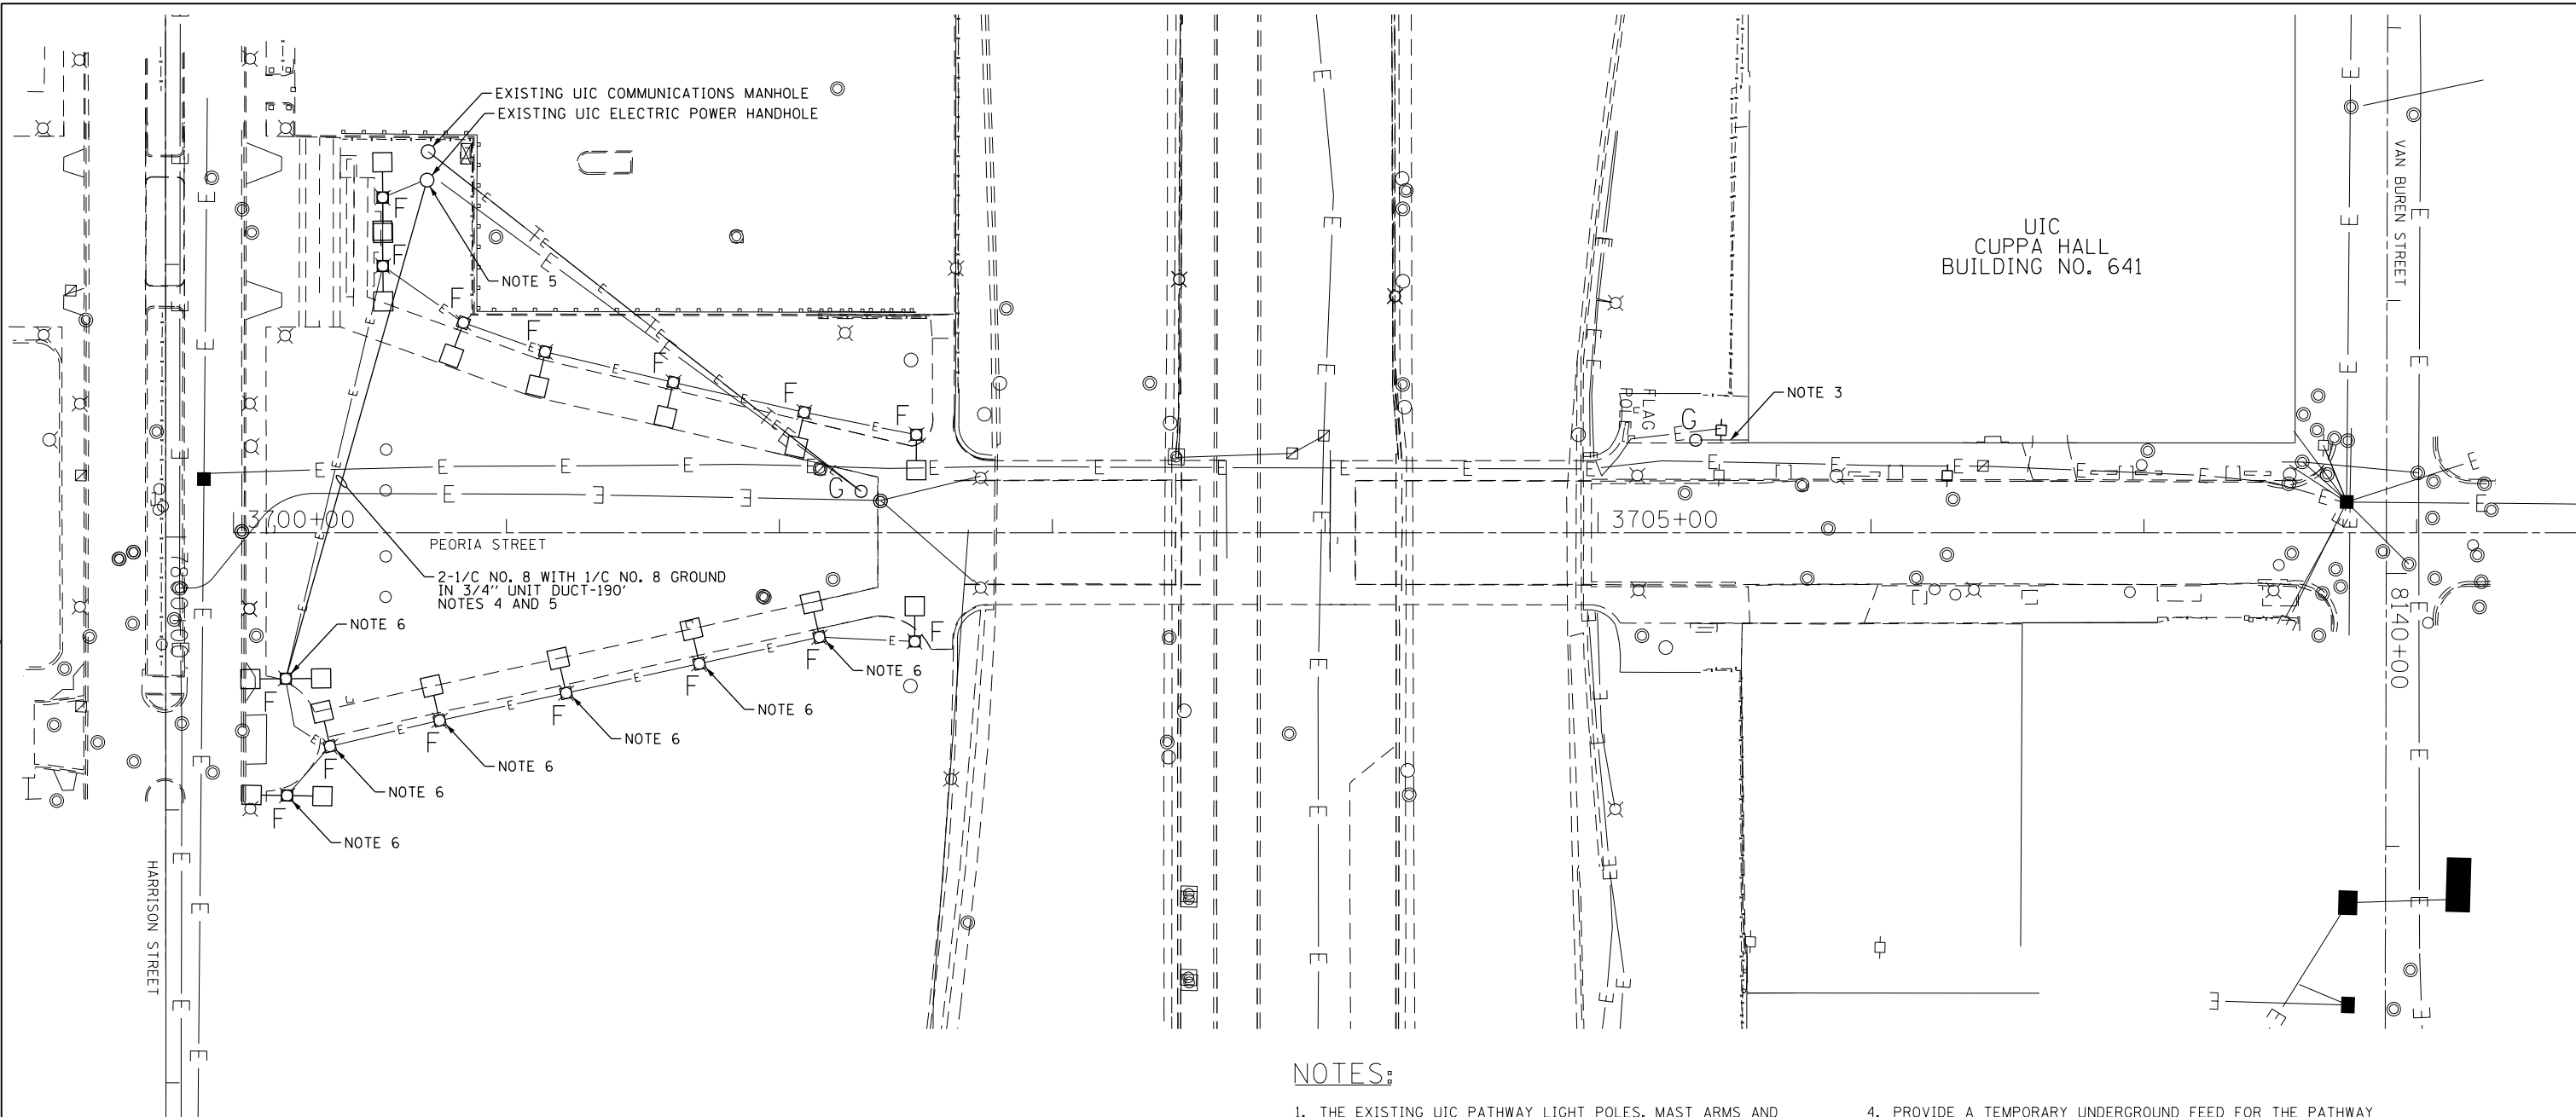

"E" EXISTING TO REMAIN
 "F" REMOVE EXISTING UIC LIGHT POLE FOUNDATION COMPLETE. NOTES 1 AND 6
 "G" REMOVE EXISTING ETU FOUNDATION COMPLETE. NOTE 2

NOTES:


- THE EXISTING UIC PATHWAY LIGHT POLES, MAST ARMS AND LUMINAIRES WILL BE REMOVED BY OTHERS. THE CONTRACTOR SHALL COORDINATE THIS REMOVAL WORK WITH UIC'S FACILITIES MANAGEMENT. UIC FACILITIES MANAGEMENT CONTACT INFORMATION IS AS FOLLOWS:

 PABLO ACEVEDO 312-996-2106
 KEVIN O'SHEA 312-996-2883
 CLARENCE BRIDGES 312-413-5946

 THE CONTRACTOR MUST CONTACT UIC'S FACILITIES MANAGEMENT A MINIMUM OF TWO WEEKS PRIOR TO THE REMOVAL OF THE EXISTING UIC PATHWAY LIGHTING UNITS.
- THE EXISTING UIC ETU BOLLARD SHALL BE REMOVED BY OTHERS. THE CONTRACTOR SHALL COORDINATE THE REMOVAL WORK WITH UIC'S TELECOM/ACCC ENGINEERING DEPARTMENT. UIC'S TELECOM/ACCC ENGINEERING DEPARTMENT INFORMATION IS AS FOLLOWS:

 BRIAN NG 312-413-8254
 BEVERLY BAILEY 312-213-7419
 TOM WIESE 815-272-6607

 THE CONTRACTOR MUST CONTACT UIC'S TELECOM/ACCC GROUP A MINIMUM OF TWO WEEKS PRIOR TO THE REMOVAL OF THE EXISTING UIC ETU BOLLARDS.
- THE EXISTING POWER AND DATA FEED FOR THE ETU BOLLARD IS ROUTED INTO BUILDING 641-CUPPA HALL. THE EXISTING POWER AND DATA CONDUITS SHALL BE SAWCUT, CAPPED AND PROTECTED DURING CONSTRUCTION FOR FUTURE USE. SEE DRAWING E-10 FOR PROPOSED CONDUIT CONNECTIONS.
- PROVIDE A TEMPORARY UNDERGROUND FEED FOR THE PATHWAY LIGHTING CIRCUITS ON THE EAST PATHWAY AS SHOWN. THE TEMPORARY FEED SHALL BE PROTECTED DURING CONSTRUCTION STAGES 1B THROUGH STAGE 3 UNTIL IT IS NO LONGER REQUIRED.
- THE TEMPORARY LIGHTING FEED SHALL BE SPLICED TO EXISTING UIC LIGHTING CIRCUITS LOCATED WITHIN THE EXISTING UIC POWER HANDHOLE. CONTRACTOR SHALL PROVIDE A WATERPROOF CONNECTION FOR ALL SPLICES.
- THE EXISTING UIC PATHWAY LIGHTING UNITS WILL REMAIN IN PLACE AND OPERATIONAL UNTIL THE END OF STAGE 2 OF THE SUGGESTED CONSTRUCTION SCHEDULE. THE CONTRACTOR SHALL PROTECT THE LIGHTING UNITS UNTIL THE ENGINEER DIRECTS THE CONTRACTOR TO REMOVE THEM.



E-09



DI60W29-sht-Light-09
 USER NAME = BAW:tor t
 PLOT SCALE = 60.0000' / in.
 PLOT DATE = 12/19/2013

DESIGNED - WDS	REVIS	12/18/2013
DRAWN - CAM	REVIS	
CHECKED - WDS	REVIS	
DATE - 10/30/2013	REVIS	

**STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION**

EXISTING/TEMPORARY/DEMOLITION PLAN
UNIVERSITY OF ILLINOIS AT CHICAGO
 SCALE: 1"=30' SHEET 9 OF 19 SHEETS STA. TO STA.

F.A.I. RTE. 90/94/290	SECTION 2013-011R	COUNTY COOK	TOTAL SHEETS 356	SHEET NO. 119
CONTRACT NO. 60W29				
ILLINOIS FED. AID PROJECT				