



NOTES:

1. PCR, FS LOCATED IN LCP ARE TO BE POTTER BRUMFIELD KRPA 1AAN120, SOCKET AND HOLD DOWN SPRING.
2. CN AND CE ARE TO BE SQUARE D ELECTRICALLY HELD 3 AMP TYPE LD WITH NORMALLY CLOSED CONTACTS COIL BURDEN 180VA IN RUSH, 35VA HOLD.
3. LIGHTING CONTRACTORS DE-ENERGIZED TO TURN LIGHTS ON IN NORMAL OPERATION OR PHOTO CELL FAILURE OR TEST.
4. DEVICES ARE TO BE MOUNTED IN ENCLOSURE (LCP).
5. DEVICES AND PANEL ARE TO BE PROVIDED BY ILLINOIS SWITCHBOARD OR APPROVED EQUAL.
6. CONTACTORS ARE TO BE MOUNTED AT THE BOTTOM OF ASSOCIATED LIGHTING PANEL UNDER SEPARATE DOOR AND COVER. TO BE SEPARATED FROM PANELBOARD AND WIRING BREAKERS, BUS WORK PANELBOARD.
7. PHOTO CELL LOCATED ON STATION HOUSE AS SHOWN ON THE SHEETS.
8. CONNECT EXTERIOR LIGHT FIXTURES TO PC.

- NOTES:**
- A. EACH DEVICE TO BE FED WITH WITH 2-#14 AWG, 1-#14 AWG GRD, IN 3/4" GRS CONDUIT.
 - B. PROVIDE CABLE AND CONDUIT AS REQUIRED.

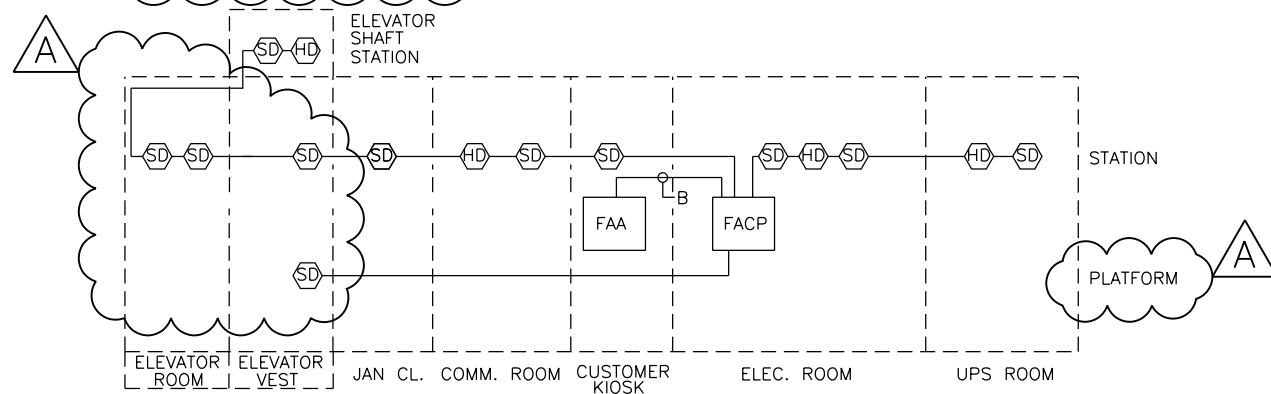

1 FIRE ALARM RISER DIAGRAM
SCALE N/A

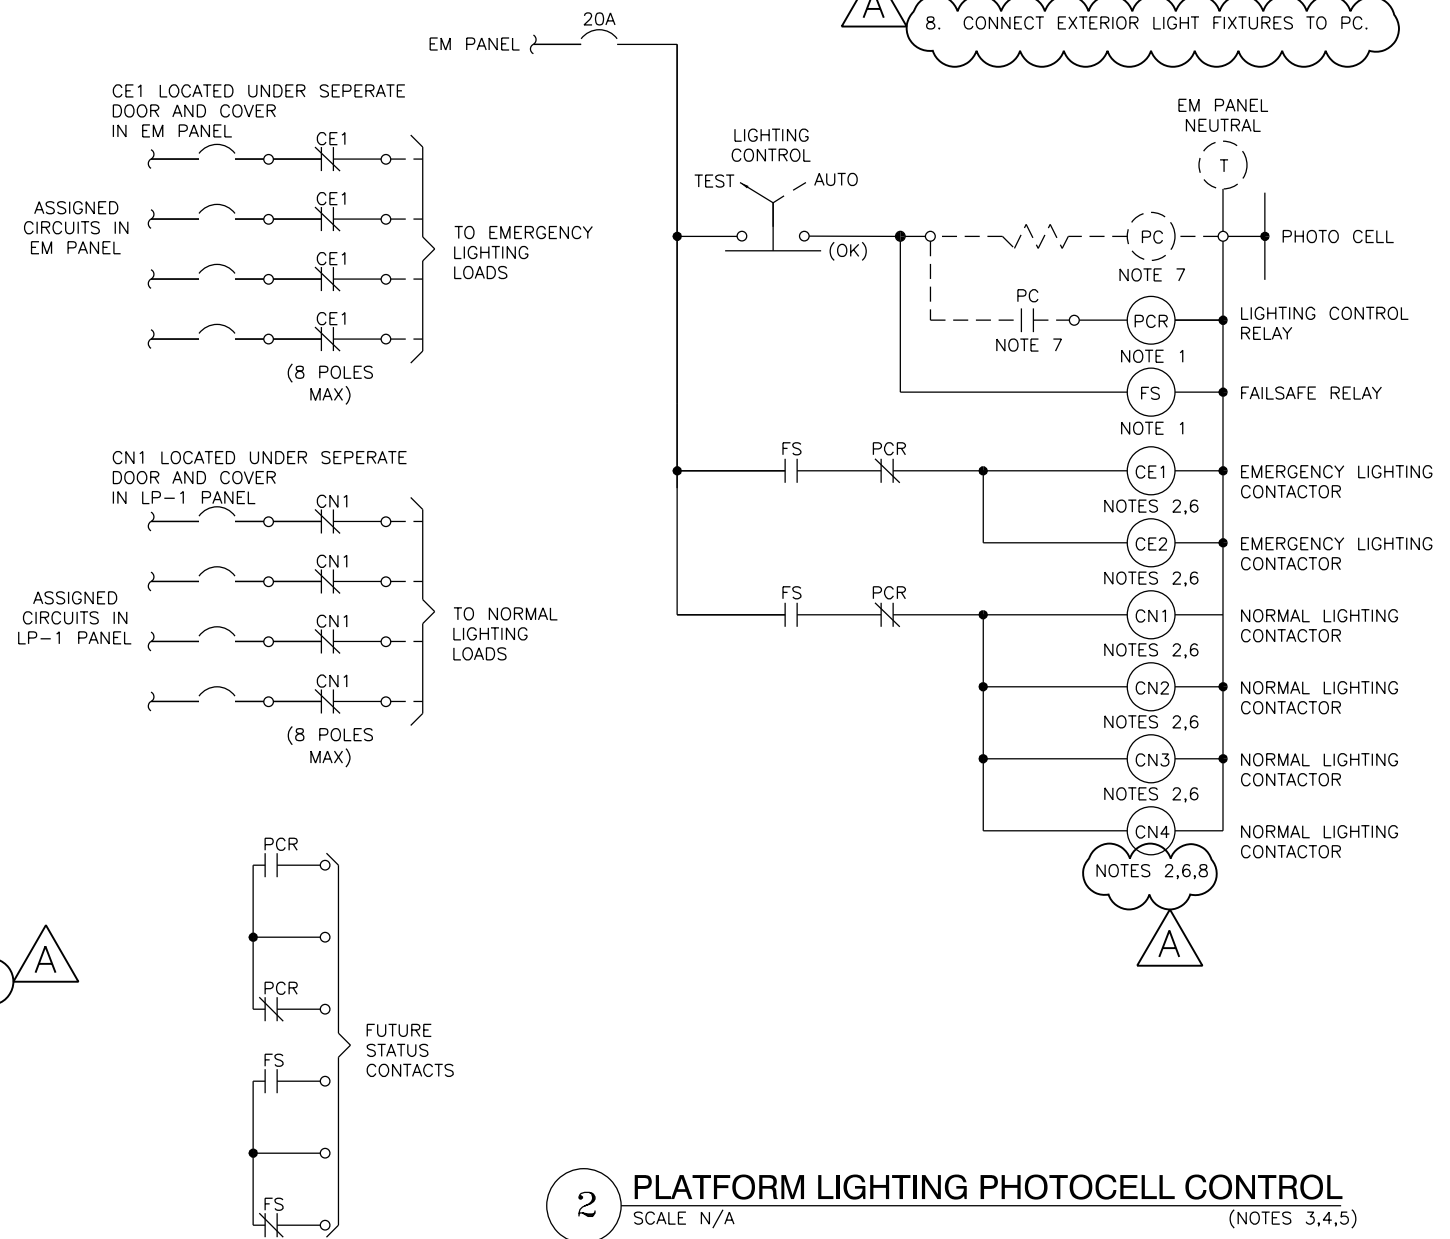

2 PLATFORM LIGHTING PHOTOCCELL CONTROL
SCALE N/A (NOTES 3,4,5)