


NOTES:

1. PROVIDE TYPE 66-P/25 CAT-5E TERMINAL BLOCKS FOR EACH VOICE DROPS, SCADA ITC ALARMS & RTU STATUS CABLING.
2. PROVIDE TYPE 110-P/25 CAT-5E FOR HUB INTERCONNECT CABLING.
3. PROVIDE 12-POLE DISCONNECT TERMINAL BLOCK FOR ALL PA SPEAKER CABLING.

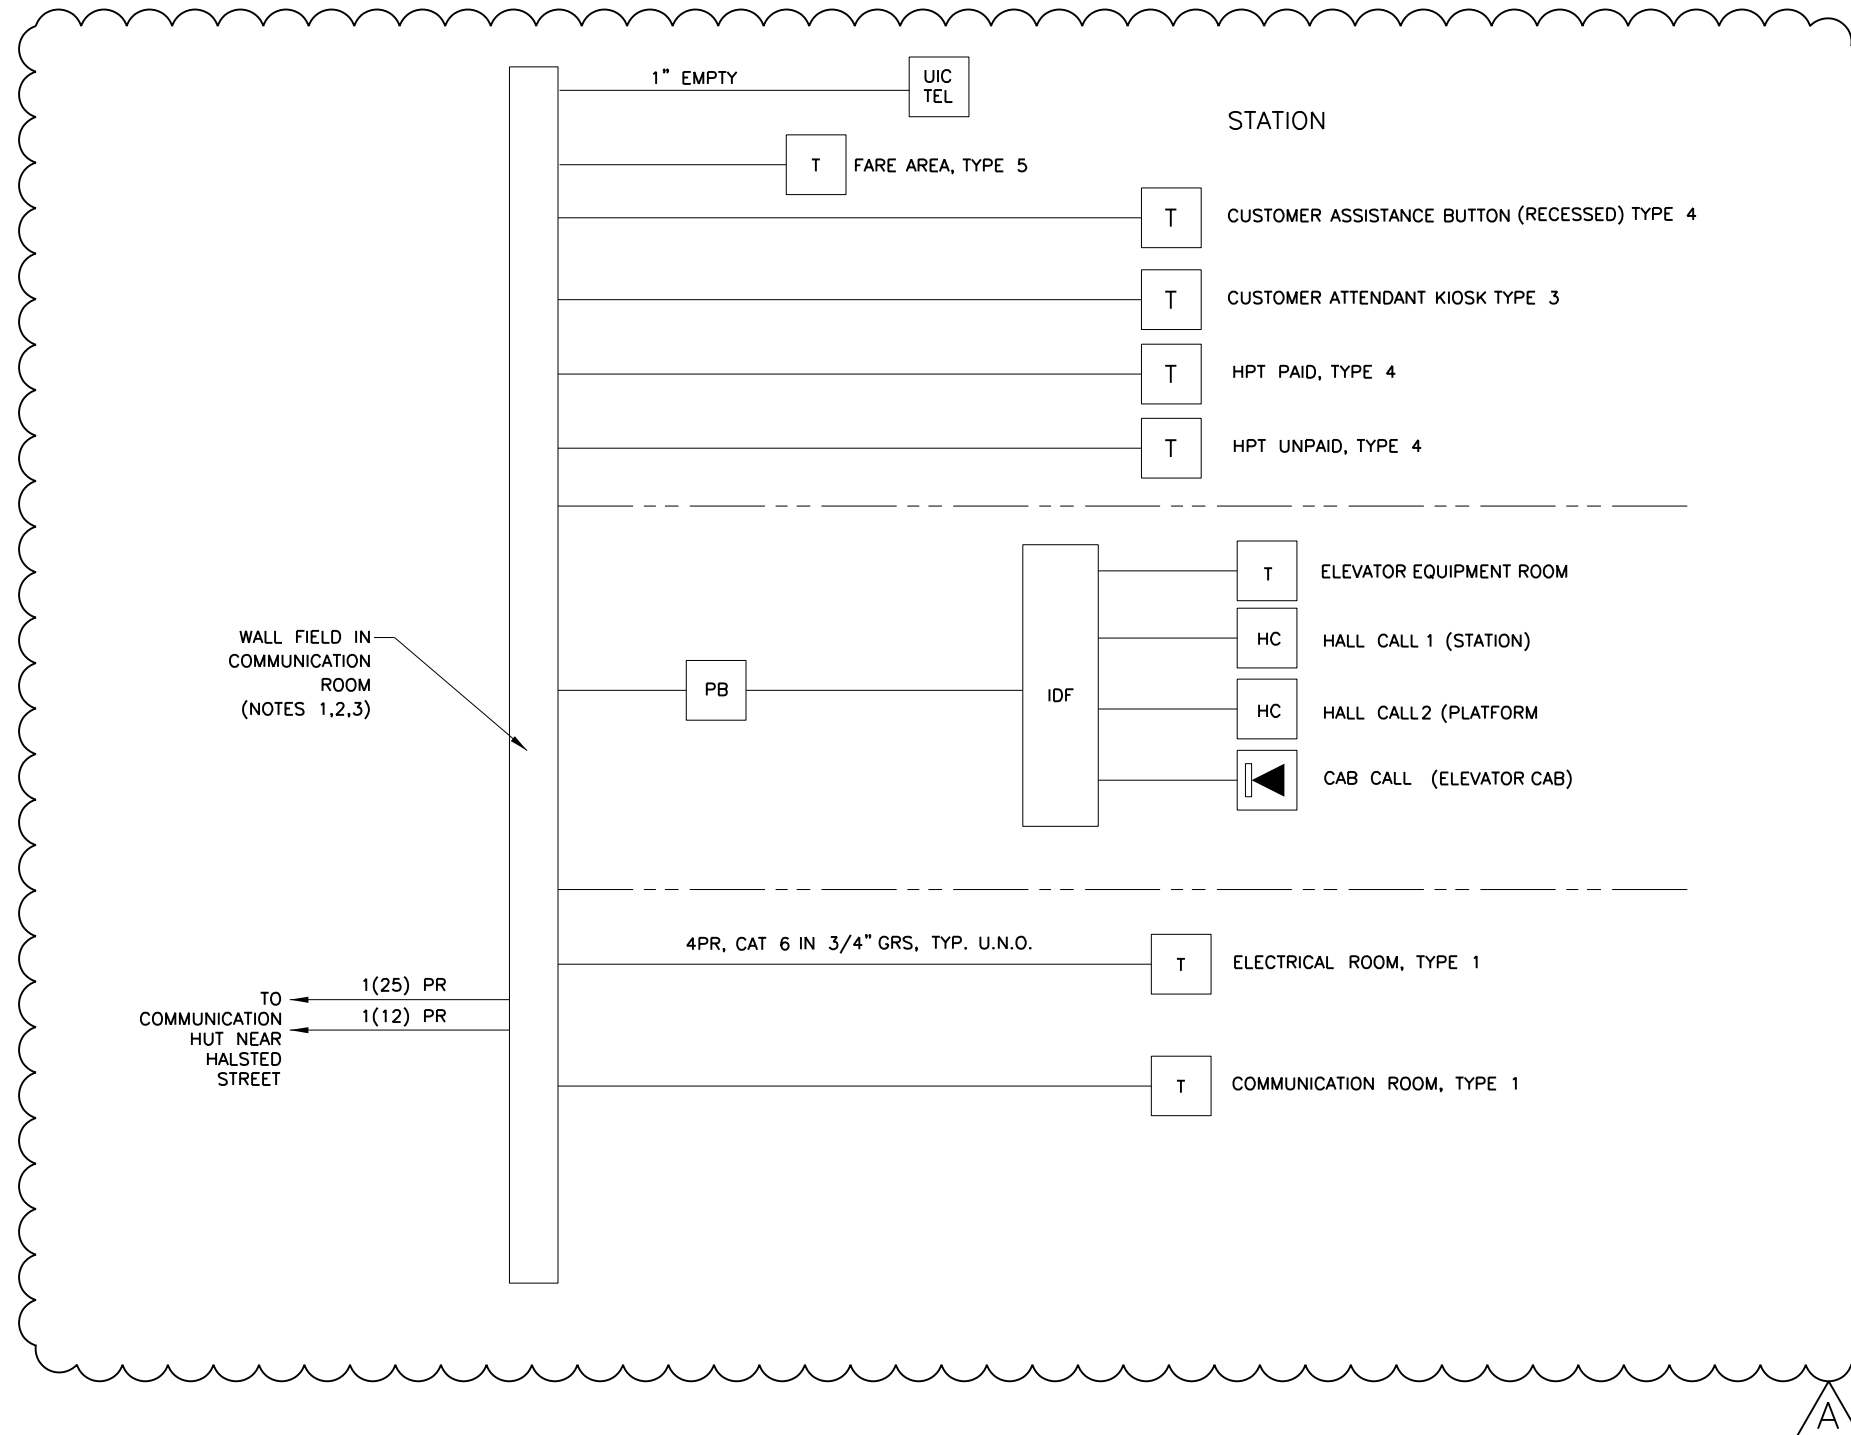

USER NAME = habib	DESIGNED JCM	REVISED A 1/20/2014
	CHECKED OS	REVISED
PLOT SCALE = 24:0 '4" / 1in.	DRAWN HR	REVISED
PLOT DATE = 1/21/2014	CHECKED BC	REVISED

**STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION**

**PEORIA STREET STATION
COMMUNICATION TELEPHONE SYSTEM BLOCK DIAGRAM**

MUN	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
2090	2013-011R	COOK	356	299
CONTRACT NO.			60W29	

SHEET NO.T-200 OF 117 SHEETS

ILLINOIS FED. AID PROJECT

1/21/2014 10:30 AM 60W29-299.dgn