


THE CONE OF THE VALVE VAULT SHALL BE

CONSTRUCTED AS SHOWN ABOVE ONLY WHEN THERE IS INTERFERENCE WITH UNDERGROUND CONDITIONS AND THOSE

CONDITIONS CANNOT BE ALTERED.

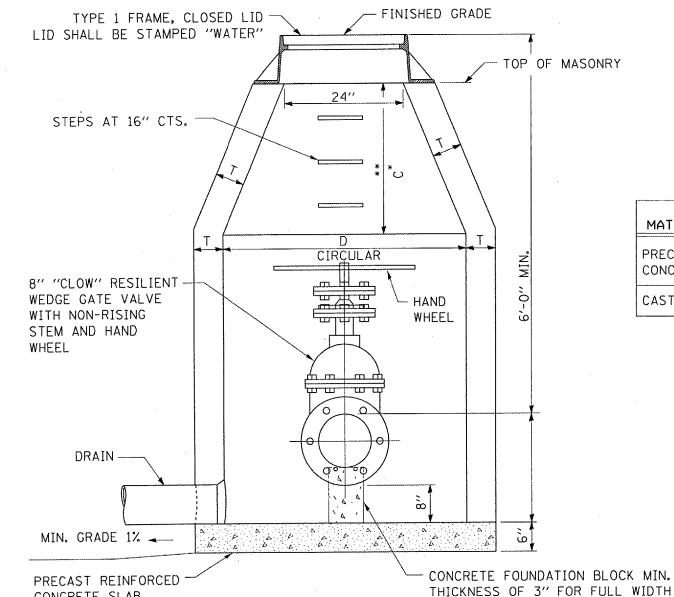

ELEVATION

OF GATE VALVE, MIN. (TYP)

ALTERNATE MATERIALS FOR WALLS	D	С	T (m1n.)
PRECAST REINFORCED CONCRETE SECTION	4'-0''	2′-6′′	4′′
CAST-IN-PLACE CONCRETE	4'-0''	2′-6′′	6′′

PREFABRICATED CONCRETE SLAB, WHEN THE PRECAST REINFORCED CONCRETE SECTION ALTERNATE IS USED. 2" MIN. .0

PRECAST REINFORCED 6 6 6 6 A A A A A CONCRETE SLAB Š Sand cushion

CONCRETE SLAB

ALTERNATE METHODS

GENERAL NOTES

- * DIMENSION "C" FOR PRECAST REINFORCED CONCRETE SECTION MAY VARY FROM THE DIMENSION GIVEN TO PLUS 6"
- ** SEE STANDARD 602601 FOR OPTIONAL PRECAST REINFORCED CONCRETE FLAT TOP SLAB.

ILLINOIS DEPARTMENT OF TRANSPORTATION **VALVE VAULT TYPE A** 4' DIAMETER F.A.I. ROUTE 80 SECTION (32,47-4)RA-2 **GRUNDY COUNTY**

GRUNDY COUNTY

SECTION (32,47-4)RA-2

FAI 80 (I-80)