LI032 TOTAL SHEETS - 70

# CONSTRUCTION PLANS


**FOR** 

# LITCHFIELD MUNICIPAL AIRPORT

LITCHFIELD, MONTGOMERY COUNTY, ILLINOIS
CONSTRUCT PARTIAL PARALLEL TAXIWAY TO RUNWAY END 36

# SCOPE OF WORK

THIS PROJECT CONSISTS OF CONSTRUCTING A PARTIAL PARALLEL TAXIWAY TO RUNWAY END 36. THE ASSOCIATED WORK ITEMS WILL BE GRADING, DRAINAGE, PAVING, LIGHTING, MARKING AND SEEDING.

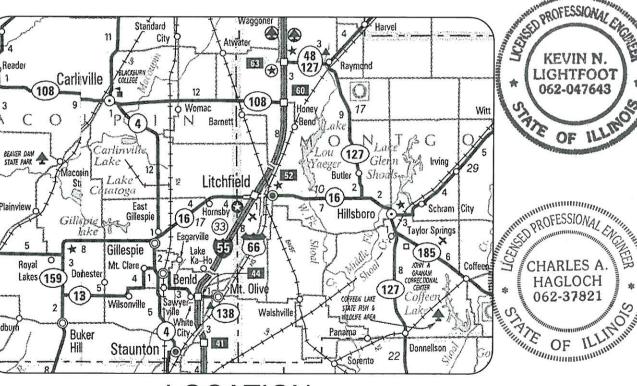

**LOCATION** 

ILL. PROJ.: 3LF-4046 A.I.P. PROJ.: 3-17-0063-B17 LATITUDE: 39° 09' 59" LONGITUDE: 89° 40' 29" ELEVATION: 690.0' M.S.L. DATE: FEBRUARY 18, 2011 COUERING ELECTRICAL

DESIGN

REVISED: 01/06/12

HANSON

ELECTRICAL ENGINEER

Was M L. Dobres

Date Submitted JANUARY 06, 2012

Lics. Exp. Date NOVEMBER 30, 2013



Hanson Professional Services In CIVIL ENGINEER

Date Submitted JANUARY 06, 2012

Lics. Exp. Date NOVEMBER 30, 2013

LITCHFIELD AIRPORT AUTHORITY

Approved Will- Oth CII.

3-1

Date 03-03-2011

1 of 70 shee

HANSON

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

RPORTS/LICHFELD\10A0094\CADD\ARPORT\SHEET\R-001CVR.DWG - COVER SHEET

SHOWN OCCUPY SHOWN ON SHOWN ON

LOCATION OF COUNTY

	SUMMARY OF QUANTITIES			
ITEM NO.	DESCRIPTION	UNIT	TOTAL QUANTITIES	AS BUILT QUANTITIES
AR108158	1/C #8 5 KV UG CABLE IN UD	L.F.	6,256	
AR109200	INSTALL ELECTRICAL EQUIPMENT	L.S.	1	
AR110502	2-WAY CONCRETE ENCASED DUCT	L.F.	80	
AR125410	MITL — STAKE MOUNTED	EA.	23	
AR125415	MITL - BASE MOUNTED	EA.	4	
AR125444	TAXI GUIDANCE SIGN, 4 CHARACTER	EA.	1	
AR125565	SPLICE CAN	EA.	1	
AR125961	RELOCATE STAKE MOUNTED LIGHT	EA.	4	
AR125962	RELOCATE BASE MOUNTED LIGHT	EA.	2	
AR150510	ENGINEER'S FIELD OFFICE	L.S.	1	
AR150520	MOBILIZATION	L.S.	1	
AR150540	HAUL ROUTE	L.S.	1	
AR152410	UNCLASSIFIED EXCAVATION	C.Y.	16,165	
AR155540	BY-PRODUCT LIME	TON	322	
AR155616	SOIL PROCESSING-16"	S.Y.	8,951	
AR156511	DITCH CHECK	EA.	5	
AR156521	HEADWALL PROTECTION	EA.	2	
AR156530	TEMPORARY SEEDING	ACRE	6.6	
AR156531	EROSION CONTROL BLANKET	S.Y.	1,825	
AR156544	RIPRAP-GRADATION NO. 4	S.Y.	373	
AR209510	CRUSHED AGGREGATE BASE COURSE	TON	5,065	
AR401613	BIT. SURF. CSEMETHOD 1, SUPERPAVE	TON	1,020	
AR401650	BITUMINOUS PAVEMENT MILLING	S.Y.	93	
AR403613	BIT. BASE CSEMETHOD 1, SUPERPAVE	TON	1,518	
AR602510	BITUMINOUS PRIME COAT	GAL.	3,015	
AR603510	BITUMINOUS TACK COAT	GAL.	1,320	
AR620520	PAVEMENT MARKING-WATERBORNE	S.F.	2,789	
AR620525	PAVEMENT MARKING-BLACK BORDER	S.F.	350	
AR701006	6" PVC STORM SEWER	L.F.	100	
AR701008	8" PVC STORM SEWER	L.F.	100	
AR701010	10" PVC STORM SEWER	L.F.	100	
AR701560	60" RCP, CLASS IV	L.F.	160	
AR701566	66" RCP, CLASS IV	L.F.	238	
AR705410	POROUS BACKFILL	C.Y.	96	
AR705524	4" PERFORATED UNDERDRAIN W/SOCK	L.F.	3,930	
AR705620	UNDERDRAIN END SECTION	EA.	1	
AR705630	UNDERDRAIN INSPECTION HOLE	EA.	11	
AR705900	REMOVE UNDERDRAIN	L.F.	140	
AR705903	REMOVE UNDERDRAIN INSP. HOLE	EA.	1	
AR752460	PRECAST REINFORCED CONC. FES 60"	EA.	1	
AR752466	PRECAST REINFORCED CONC. FES 66"	EA.	1	
AR752660	CONCRETE HEADWALL 60"	EA.	1	
AR752666	CONCRETE HEADWALL 66"	EA.	1	
AR754910	REMOVE PAVED DITCH	L.F.	241	
ARR00463	FIFI D. TILE DEDAID	ΕΛ	5	I

241 5 1,243

6.6 6.2

EA. L.F.

AC.

	INDEX TO SHEETS	REVIEW	
SHEET NO.	DESCRIPTION	REVISED PER IDA	
	COVER SHEET		
	SUMMARY OF QUANTITIES AND INDEX TO SHEETS PROPOSED SAFETY PLAN		
	PROPOSED STORMWATER POLLUTION PREVENTION PLAN		
	PROPOSED CONSTRUCTION PLAN STA. 65+76 TO STA. 72+00	DATE 01/05/12	
	PROPOSED CONSTRUCTION PLAN STA. 72+00 TO STA. 80+00	1/05/1	
	PROPOSED CONSTRUCTION PLAN STA. 80+00 TO STA. 85+76 PROPOSED PLFAN AND PROFILE STA. 65+00 TO STA. 73+00		
	PROPOSED PLAN AND PROFILE STA. 73+00 TO STA. 81+00		7
	PROPOSED PLAN AND PROFILE STA. 81+00 TO STA. 88+00		
	PROPOSED STAKING PLAN STA. 65+76 TO STA. 72+00	<b></b>   '≍	Š
	PROPOSED STAKING PLAN STA. 72+00 TO STA. 80+00 PROPOSED STAKING PLAN STA. 80+00 TO STA. 85+76	—  გ	ţ
	EXISTING DRAINAGE PLAN STA. 65+75.24 TO STA. 74+00	<b>⊢</b> ≝	<u>S</u>
	EXISTING DRAINAGE PLAN STA. 74+00 TO STA. 82+00	<b>□ </b>	2 3
	EXISTING DRAINAGE PLAN STA. 82+00 TO STA. 87+00	₹	<b>፲</b>
	PROPOSED DRAINAGE PLAN STA. 65+00 TO STA. 72+00 PROPOSED DRAINAGE PLAN STA. 72+00 TO STA. 80+00	⊣ 5	, ILLINOIS
	PROPOSED DRAINAGE FLAN STA. 72+00 TO STA. 80+00 PROPOSED DRAINAGE PLAN STA. 80+00 TO STA. 86+00	⊢ Ž	9
20	EXISTING ELECTRICAL RELOCATION PLAN	<b>□</b> ₹	Ψ
	PROPOSED ELECTRICAL PLAN STA. 65+75.24 TO STA. 74+00		生
	PROPOSED ELECTRICAL PLAN STA. 74+00 TO STA. 82+00 PROPOSED ELECTRICAL PLAN STA. 82+00 TO STA. 87+00	LITCHFIELD MUNICIPAL AIRPORT	ည
	PROPUSED ELECTRICAL PLAN STA. 82+00 TO STA. 87+00 ELECTRICAL DETAILS SHEET 1	<b>⊣</b> ⊑	<b>_</b>
25	ELECTRICAL DETAILS SHEET 2		LIT(
	ELECTRICALDETAILS SHEET 3	_	<del>.</del>
	ELECTRICAL DETAILS SHEET 4 ELECTRICAL NOTES SHEET 1		à
	ELECTRICAL NOTES SHEET 2		=
	ELECTRICAL LEGEND AND ABBREVIATIONS		00-
	EXISTING FLOOR PLAN FOR VAULT		/28/10 /28/10 /28/10
	EXISTING ELECTRICAL ONE LINE DIAGRAM FOR VAULT	00800	06/28/10
	PROPOSED FLOOR PLAN FOR VAULT PROPOSED ELECTRICAL ONE LINE DIAGRAM FOR VAULT		
	RUNWAY 18-36 LIGHTING CONTROL SCHEMATIC	Honson Project No. 10A0094D Filename R-002FLP.DWG Soole NOT 10 SCALE	
	HIGH VOLTAGE WIRING SCHEMATIC	ect No. 10AC R-002FLP, NOT TO SI	BAK
	GROUNDING DETAILS	R-00%	
	GROUNDING NOTES LEGEND PLATE SCHEDULE		
	PROPOSED MARKING PLAN STA. 65+75 TO STA. 74+00	Hanson Pr Filename Scale	LAYOUT DRAWN
	PROPOSED MARKING PLAN STA. 74+00 TO STA. 85+58	되 리 의 4	
	CROSS-SECTIONS FOR TAXIWAY C STA. 65+00 TO STA. 65+75.97		
	CROSS-SECTIONS FOR TAXIWAY C STA. 66+00 TO STA. 66+10.97 CROSS-SECTIONS FOR TAXIWAY C STA. 66+45.97 TO STA. 67+00		
	CROSS—SECTIONS FOR TAXIWAY C STA. 67+50 TO STA. 68+00		886 Inc.
	CROSS-SECTIONS FOR TAXIWAY C STA. 68+50 TO STA. 69+00		vices treet 03-26 de
	CROSS-SECTIONS FOR TAXIWAY C STA. 69+25.18 TO STA. 69+50	HANSO	al Sel xth S 627 onwic
	CROSS-SECTIONS FOR TAXIWAY C STA. 69+80.28 TO STA. 70+00 CROSS-SECTIONS FOR TAXIWAY C STA. 70+50 TO STA. 71+00		inois Inois Nati
	CROSS-SECTIONS FOR TAXIMAY C STA. 70+50 TO STA. 71+00		rofes 5 Sou eld, II
	CROSS-SECTIONS FOR TAXIWAY C STA. 72+50 TO STA. 73+00		Hanson Professional Services Inc. 1525 South Sixth Street Springfield, Illinois 62703-2886 Offices Nationwide
	CROSS-SECTIONS FOR TAXIWAY C STA. 73+50 TO STA. 73+63.86	<b>□ &gt;7</b>	Hans
	CROSS-SECTIONS FOR TAXIWAY C STA. 74+00 TO STA. 74+50	<b>─</b>	
	CROSS-SECTIONS FOR TAXIWAY C STA. 75+00 TO STA. 75+50 CROSS-SECTIONS FOR TAXIWAY C STA. 76+00 TO STA. 76+50	<del>-</del>	I
56	CROSS-SECTIONS FOR TAXIWAY C STA. 77+00 TO STA. 77+50		S
57	CROSS-SECTIONS FOR TAXIWAY C STA. 78+00 TO STA. 78+50		끝 2
	CROSS-SECTIONS FOR TAXIWAY C STA. 79+00 TO STA. 79+50	— ხz	<u> </u>
	CROSS-SECTIONS FOR TAXIWAY C STA. 80+00 TO STA. 80+50 CROSS-SECTIONS FOR TAXIWAY C STA. 81+00 TO STA. 81+50	<b>⊣</b> € 2	\section \text{HS}
	CROSS-SECTIONS FOR TAXIWAY C STA. 82+00 TO STA. 82+50	TAXIWAY "C"	SUMMARY OF QUANTITIES AND INDEX TO SHEETS
62	CROSS-SECTIONS FOR TAXIWAY C STA. 83+00 TO STA. 83+50		Ö X
	CROSS-SECTIONS FOR TAXIWAY C STA. 84+00 TO STA. 84+50	<b>  ≯</b>	\ <u>\rangle</u>   \rangle
	CROSS-SECTIONS FOR TAXIWAY C STA. 85+00 TO STA. 85+12 CROSS-SECTIONS FOR TAXIWAY C STA. 85+50 TO STA. 85+58.50	<b> </b>	M M
	CROSS—SECTIONS FOR TAXIWAY C STA. 80+00 IU STA. 80+08.00	-	54
67	CROSS-SECTIONS FOR TAXIWAY C3 STA. 302+00 TO STA. 302+50		ر ا
	CROSS-SECTIONS FOR TAXIWAY C3 STA. 303+00 TO STA. 303+27.50		
	CROSS—SECTIONS FOR TAXIWAY C3 STA. 303+82.50 TO STA. 304+00	<b>⊣ '</b>	)
70	CROSS-SECTIONS FOR TAXIWAY C3 STA. 304+17.50 TO STA. 304+50	<b>→</b> 4	<u>_</u>

LI032

AR800463

AR800531

AR901510

AR908510

FIELD TILE REPAIR

SEEDING

MULCHING

CLEAN & RESHAPE PAVED DITCH

# HAUL ROUTE AND VEHICLE PARKING

THE CONTRACTOR WILL USE THE DESIGNATED HAUL ROUTE AND PARKING AREA AS SHOWN ON THIS SHEET. THE PROPOSED PARKING AREA WILL BE 200' X 200'. THE CONTRACTOR WILL BE REQUIRED TO MAINTAIN THE PROPOSED HAUL ROUTE AND PARKING AREA THROUGHOUT THE COURSE OF THE PROJECT. ANY AREAS DAMAGED OUTSIDE OF THESE AREAS WILL BE REPAIRED BY THE CONTRACTOR AND AT THE CONTRACTOR'S OWN EXPENSE. AT THE CONCLUSION OF THE PROJECT THE CONTRACTOR WILL GRADE, FERTILIZE, SEED AND MULCH THE HAUL ROUTE AND PARKING AREA AS NEEDED TO RESTORE IT TO ITS' ORIGINAL STATE. RESTORATION OF THE HAUL ROUTE AND PARKING AREA WILL BE CONSIDERED INCIDENTAL TO THE PROJECT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

# CONTRACTOR RESPONSIBILITIES

THE CONTRACTOR'S EQUIPMENT PARKING AND STORAGE AREA WILL BE AS SHOWN ON THIS SHEET. THE CONTRACTOR'S EMPLOYEES WILL PARK THEIR VEHICLES IN THIS AREA. ONLY CONTRACTOR VEHICLES WILL BE ALLOWED OUTSIDE THIS AREA

THE CONTRACTOR AND HIS EMPLOYEES WILL BE RESTRICTED TO THE WORK AREA AND ALL OTHER AREAS OF THE AIRPORT ARE "OFF LIMITS" TO THEM.

THE CONTRACTOR SHALL KEEP ONE RUNWAY OPEN AT ALL TIMES. RUNWAY 9-27 WILL REMAIN OPEN THROUGHOUT THIS PROJECT. ALL WORK PERFORMED SHALL BE DONE IN A ORDERLY AND EFFECTIVE MANNER TO MINIMIZE RUNWAY CLOSURE

NO TRENCHES OR HOLES WILL REMAIN OPEN OVERNIGHT.

NO RUNWAY SHALL BE CLOSED OVERNIGHT.

# BARRICADES AND TRAFFIC CONES

BARRICADES SHALL BE PLACED AND MAINTAINED IN SUCH A WAY AS TO PREVENT AIRCRAFT ACCESS TO TAXIWAY SEGMENTS WHERE WORK IS BEING PERFORMED. WHILE MAINTAINING AIRCRAFT ACCESS TO ACTIVE AIRFIELD PAVEMENTS. AIRFIELD PAVEMENT CLOSURES SHALL BE SCHEDULED THROUGH AND WILL REQUIRE THE APPROVAL OF THE AIRPORT MANAGER. THE BARRICADES WILL BE EQUIPPED WITH RED FLASHING OR RED STEADY-BURN LIGHTS AND 20" SQUARE ORANGE FLAGS. THE BARRICADES, THEIR MAINTENANCE, PLACEMENT AND REMOVAL WILL BE CONSIDERED AS AN INCIDENTAL ITEM TO THE CONTRACT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

# LEGEND

\_\_\_ EXISTING IMPROVEMENTS

PROPOSED IMPROVEMENTS **EXISTING BUILDINGS** 

PROPOSED HAUL ROUTE AND EQUIPMENT PARKING AREA

PROPOSED BENCHMARK

PROPOSED BARRICADES OR TRAFFIC CONES

# SCOPE OF WORK

THIS PROJECT CONSISTS OF CONSTRUCTING A PARTIAL PARALLEL TAXIWAY TO RUNWAY END 36. THE ASSOCIATED WORK ITEMS WILL BE GRADING, DRAINAGE, PAVING, LIGHTING, MARKING AND SEEDING,

# AIRPORT SECURITY NOTE

AIRPORT SECURITY WILL BE MAINTAINED AT ALL TIMES. THE CONTRACTOR WILL CLOSE AND LOCK THE TEMPORARY GATE IN THE HAUL ROUTE AT THE END OF EACH WORKING DAY.

# HEIGHT OF CONSTRUCTION EQUIPMENT

THE MAXIMUM ANTICIPATED HEIGHT OF THE CONSTRUCTION EQUIPMENT WILL BE 25 FEET. THE TALLEST EQUIPMENT IS EXPECTED TO BE A DUMP TRUCK. ALL TRUCK BEDS AND CRANE BOOMS WILL BE LOWERED AT NIGHT.

# MATERIAL CERTIFICATION

COMPLETED WORK CANNOT BE PLACED ON A CONSTRUCTION REPORT UNTIL ALL MATERIAL CERTIFICATIONS FOR THAT PAY ITEM HAVE BEEN RECEIVED,


BENCHMARK DATA DESCRIPTION ELEV. ITPORT" NGS POINT, STEEL ROD IN 5" LOGO CAP LITPORT AZ MK NGS POINT, STEEL ROD IN 5" LOGO CAP 679 71

# CERTIFIED PAYROLLS

THE RESIDENT ENGINEER CANNOT FORWARD CONSTRUCTION REPORTS TO THE ILLINOIS DIVISION OF AERONAUTICS FOR PROCESSING UNTIL ALL CERTIFIED PAYROLLS FOR THE PERIOD HAVE BEEN RECEIVED.

ALL CONSTRUCTION/OPERATIONS ARE TO BE PERFORMED IN ACCORDANCE WITH FAA ADVISORY CIRCULAR (AC) 150/5370-2F "OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION" AND AC 150/5300-13 "AIRPORT DESIGN".

ALL CONSTRUCTION EQUIPMENT ON THE AIRPORT SHALL BE MARKED, LIGHTED AND/OF FLAGGED IN ACCORDANCE WITH AC 150/5210-5 AND 70/7460-1.



# DETAIL OF CROSS FOR CLOSED RUNWAY

COST OF CONSTRUCTING, PLACING, MAINTAINING AND REMOVING CROSSES WILL BE CONSIDERED INCIDENTAL TO THE CONTRACT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED. THE CROSSES WILL BE YELLOW IN COLOR AND SHALL BE MADE OF A SUITABLE MATERIAL AS APPROVED BY THE AIRPORT MANAGER. THE CROSSES WILL BE PLACED OVER THE NUMERALS AND SECURED IN A MANNER APPROVED BY THE MANAGER. THE PROPOSED CROSSES WILL BE PLACED EACH DAY THE RUNWAY IS CLOSED AND REMOVED WHEN THE RUNWAY IS RE-OPENED. THE CONTRACTOR WILL BE RESPONSIBLE FOR THE PLACEMENT AND REMOVAL OF THE CROSSES. NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

# J.U.L.I.E. INFORMATION

NOTE:

MONTGOMERY TOWNSHIP. SOUTH LITCHFIELD SECTION NO.\_\_ \_5 & 8 \_\_LITCHFIELD MUNICIPAL AIRPORT ADDRESS, P.O. BOX 381 US ROUTE 66 LITCHFIELD, IL 62056

# CRITICAL POINT DATA CRITICAL POINT #1 LATITUDE: 39' 09' 08.48"

LONGITUDE: 89° 40' 17.77" ELEVATION: 678.04 M.S.L. CRITICAL POINT #2 LATITUDE: 39° 09' 27.90" LONGITUDE: 89° 40' 17.87" ELEVATION: 677.74 M.S.L.

# PROPOSED SAFETY PLAN

GENERAL - THE LITCHFIELD MUNICIPAL AIRPORT IS COMPRISED OF A 3,900 FT BY 75 FT EAST-WEST (9-27) RUNWAY AND A 4,000 FT BY 75 FT NORTH-SOUTH (18-36) RUNWAY. THE PROPOSED CONSTRUCTION WILL NECESSITATE CLOSING RUNWAY 18-36. ANY TIME THE CONTRACTOR IS WORKING WITHIN 200' OF THE RUNWAY CENTERLINE THE RUNWAY WILL BE CLOSED. THE RUNWAY WILL BE CLOSED ONLY DURING THE CONSTRUCTION DAY. AT THE END OF EACH CONSTRUCTION DAY THE CONTRACTOR WILL SMOOTH GRADE ALL AREAS WITHIN THE SAFETY AREA TO THE SATISFACTION OF THE RESIDENT ENGINEER AND RE-OPEN THE RUNWAY. ALL WORK INCLUDED IN OPENING AND CLOSING THE RUNWAY WILL BE CONSIDERED. INCIDENTAL TO THE PROJECT AND NO ADDITIONAL COMPENSATION WILL BE

IDENTIFICATION - WHEN THE CONTRACTORS VEHICLES AND EQUIPMENT ARE ON THE AIRPORT THEY SHALL BE PROPERLY MARKED WITH THREE (3') FOOT SQUARE CHECKERED FLAGS (INTERNATIONAL ORANGE AND WHITE). CONTRACTOR WILL ALSO PROVIDE WORKERS WITH SOME TYPE OF TAG OR GARMENT TO IDENTIFY THE PERSON AS BEING PART OF THE CONSTRUCTION

RADIO CONTROL - THE CONTRACTOR WILL BE REQUIRED TO BE IN TWO-WAY RADIO CONTACT (122.8 MHz.) WITH THE AIRPORT UNICOM. THIS WILL KEEP THE CONTRACTOR IN CONSTANT CONTACT WITH THE LITCHFIELD MUNICIPAL AIRPORT AND ENABLE THE AIRPORT TO IMMEDIATELY CONTACT THE CONTRACTOR IN CASE OF AN AERONAUTIC EMERGENCY THAT WOULD REQUIRE ACTION BY THE CONTRACTOR AND/OR HIS PERSONNEL.

# 150-ENGINEER'S FIELD OFFICE NOTES

THE PROPOSED ENGINEER'S FIELD OFFICE WILL BE FURNISHED, MAINTAINED, AND REMOVED IN ACCORDANCE WITH ITEM AR150510 "ENGINEER'S FIELD OFFICE" AS STATED ON PAGE 49 OF THE STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS NOV. 2, 2009.

THE LOCATION OF THE PROPOSED ENGINEER'S FIELD OFFICE WILL BE DETERMINED AT THE PRE-CONSTRUCTION MEETING.

THE ENGINEERING FIRM WILL MAKE PAYMENT FOR ALL LONG DISTANCE TELEPHONE CALLS IN EXCESS OF ONE HUNDRED DOLLARS (\$100.00) PER

THE CONTRACTOR WILL FURNISH A WIRELESS PHONE TO THE RESIDENT ENGINEER FOR HIS EXCLUSIVE USE FOR THE DURATION OF THIS PROJECT. THE RESIDENT ENGINEER WILL USE THIS PHONE FOR PROJECT BUSINESS ONLY. THE CONTRACTOR WILL BE RESPONSIBLE FOR ALL CHARGES ASSOCIATED WITH THIS CELL PHONE.

THE PROPOSED ENGINEER'S FIELD OFFICE WILL BE PAID FOR UNDER ITEMS: AR150510 ENGINEER'S FIELD OFFICE \_\_\_\_ 1 L.S.

# EROSION CONTROL


SIZE SCALE: 1"= 1000

FULL SIZE SCALE:

THIS PROJECT WILL DISTURB MORE THAN 1 ACRE OF LAND, THEREFORE A N.P.D.E.S. PERMIT WILL BE REQUIRED.

# AIRCRAFT OPERATION LINE

THE CONTRACTOR WILL LOCATE THIS LINE AT THE START OF CONSTRUCTION AND WILL PLACE FLAGGED LATHE EVERY 150' ALONG IT. THIS LINE WILL BE THE LIMITS THAT ALL CONTRACTOR PERSONNEL MAY VENTURE WHEN A RUNWAY IS NOT CLOSED. THE CONTRACTOR WILL MAINTAIN THE LATHE LINE FOR RUNWAYS.

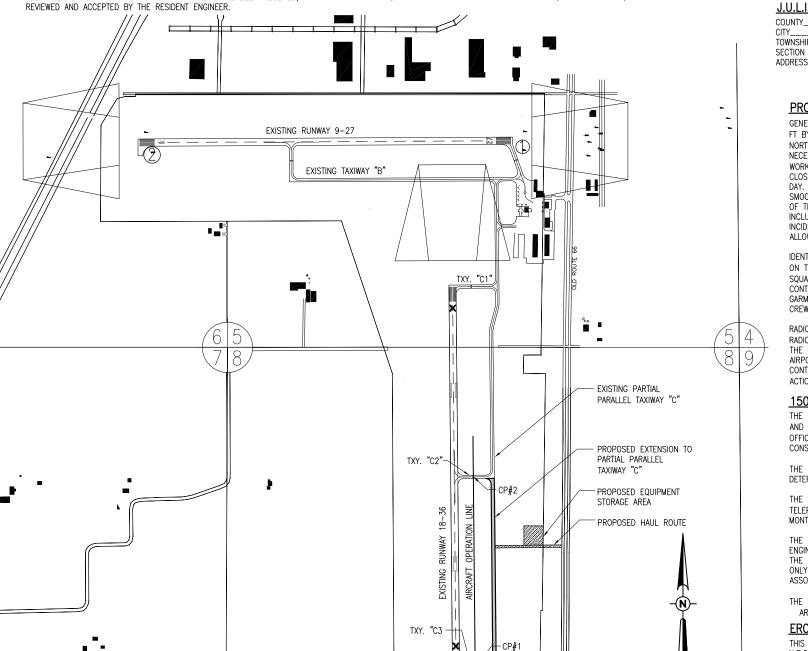




LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

ρŞ TAXIWAY EXTENSI

of 70 sheets

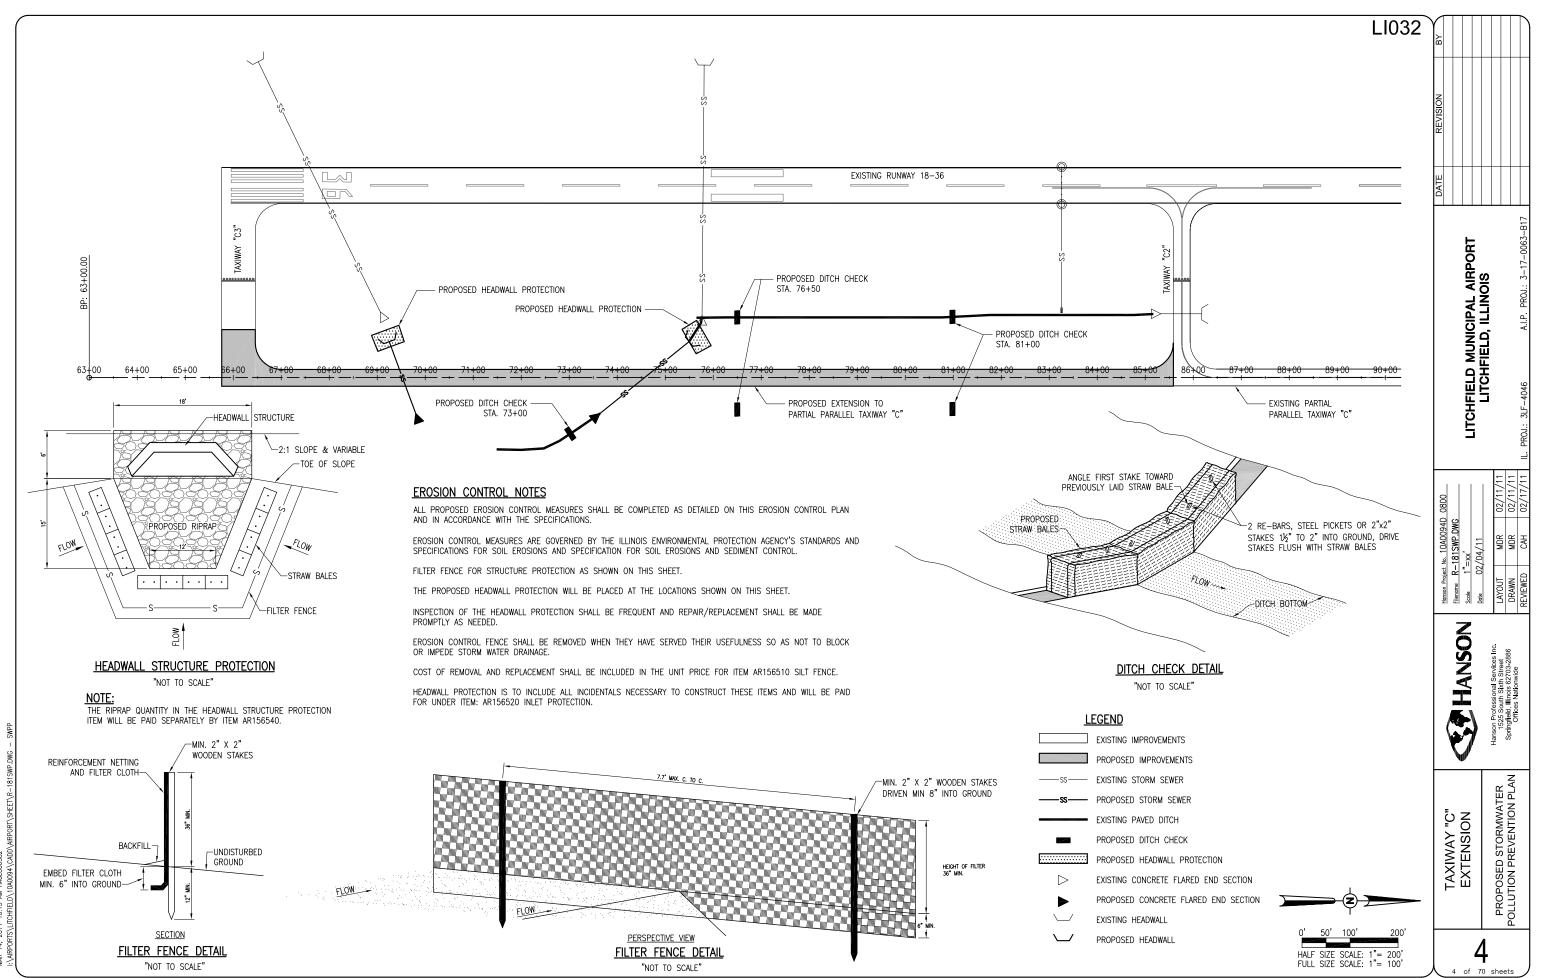

# 603-BITUMINOUS TACK COAT NOTES:

THE BITUMINOUS TACK COAT (603) SHALL BE PLACED IN ACCORDANCE WITH ITEM AR603 "BITUMINOUS TACK COAT" AS STATED ON PAGE 254 OF THE STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2, 2009.

THE PROPOSED BITUMINOUS TACK COAT SHALL BE PLACED ON THE PROPOSED BITUMINOUS PAVEMENT PRIOR TO THE PLACEMENT OF THE NEXT LIFT OF PROPOSED BITUMINOUS SURFACE COURSE. THE PROPOSED BITUMINOUS PAVEMENT SHALL HAVE A TACK COAT OF BITUMINOUS MATERIAL APPLIED IN ACCORDANCE WITH THE REQUIREMENTS OF THE SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL PROVISIONS.

THE PROPOSED BITUMINOUS TACK COAT WILL BE PAID FOR UNDER ITEM: AR603510 BITUMINOUS TACK COAT \_\_\_\_ PER GAL.

65+00

# 155-LIME-MODIFIED SUBGRADE NOTES:

THE PROPOSED LIME-MODIFIED SUBGRADE SHALL BE COMPLETED IN ACCORDANCE WITH ITEM 155 "LIME TREATED SUBGRADE" AS STATED ON PAGE 69 OF THE STANDARD SPECIFICATIONS FOR THE CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2, 2009

THIS ITEM OF WORK SHALL CONSIST OF CONSTRUCTING A 16" DEEP COURSE OF A MIXTURE OF SOIL, LIME AND WATER IN ACCORDANCE WITH THE RATES AND METHODS DESIGNED IN THE SPECIFICATIONS (EITHER THE WET OR DRY METHODS IS ACCEPTABLE).

THE SUBGRADE WILL BE CUT PRIOR TO LIME-MODIFICATION.

ANY SWELL WILL BE REMOVED BY THE CONTRACTOR AND DISPOSED OF ON THE AIRPORT SITE AS DIRECTED BY THE RESIDENT ENGINEER. NO ADDITIONAL PAYMENT WILL BE MADE FOR REMOVAL OF

THE LIME-MODIFIED SUBGRADE SHALL BE CUT TO FINISHED ELEVATION UPON COMPLETION (0.05+) IN ACCORDANCE TO SECTION 152-2.11 OF THE SPECIFICATIONS. THE LIME-MODIFIED SUBGRADE WILL BE WET CURED FOR 2 DAYS

THE CONTRACTOR WILL LIME-MODIFY THE SUBGRADE FROM THE CENTERLINE TO 1' OUTSIDE OF THE PROPOSED PAVEMENT SURFACE ON BOTH SIDES.

THE LIME-MODIFIED SUBGRADE WILL BE COMPACTED IN ACCORDANCE WITH PROCEDURES FOR AIRCRAFT WEIGHING (LESS) THAN 60,000 POUNDS.

THE ENTIRE THICKNESS OF THE TREATED SUBGRADE SHALL BE COMPACTED TO A DENSITY OF NOT LESS THAN (95 PERCENT OF THE STANDARD DRY DENSITY).

THE LIME, BY-PRODUCT LIME (CODE L), WAS CALCULATED AT 6% OF THE DRY SOIL WEIGHT AT MAXIMUM DENSITY. THE ACTUAL AMOUNT WILL BE DETERMINED PRIOR TO THE START OF CONSTRUCTION, BUT SHALL NOT EXCEED 6% BY WEIGHT. THE COST OF LIME WILL BE PAID FOR UNDER ITEM AR155540.

THE SOIL TEST INDICATES AN AVERAGE SOIL WEIGHT OF 100 POUNDS PER CUBIC FOOT. THEREFORE, THE MAXIMUM TONNAGE OF LIME WILL BE 322 TONS.

THE PROPOSED LIME-MODIFIED SUBGRADE WILL BE PAID FOR UNDER ITEMS: AR155540 BY-PRODUCT LIME PFR TONS AR155616 SOIL PROCESSING-16". PFR S.Y.

68+00

# AR403-BITUMINOUS BASE COURSE-METHOD I, SUPERPAVE NOTES

THE BITUMINOUS BASE COURSE (403) SHALL BE PLACED IN ACCORDANCE WITH ITEM AR403613 "BITUMINOUS BASE COURSE-METHOD I, SUPERPAVE" AS STATED ON PAGE 188 OF THE STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS. ADOPTED NOVEMBER 2, 2009.

THIS ITEM OF WORK SHALL CONSIST OF CONSTRUCTING 1 LIFT OF BITUMINOUS BASE COURSE (3 INCH DEPTH) ON THE PROPOSED CRUSHED AGGREGATE BASE COURSE.

THE PROPOSED BITUMINOUS BASE COURSE WILL BE DESIGNED TO A SUPERPAVE DESIGN OF LESS THAN 60,000 POUNDS FOR RUNWAY/TAXIWAY PAVEMENTS.

ALL BITUMINOUS BASE COURSE-METHOD 1, SUPERPAVE PAVEMENT WILL BE PAVED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2, 2009.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE QUALITY CONTROL IN THE PRODUCTION AND CONSTRUCTION OF THE BITUMINOUS BASE COURSE METHOD 1, SUPERPAVE.

403-4.9 ADD THE FOLLOWING TO THIS SECTION:

WHEN HAND SPREADING IS PERMITTED, THE MIXTURE WILL BE DISTRIBUTED AND SPREAD USING HAND TOOLS. WHEN THE WORK IS COMPLETED, THE LAYER WILL HAVE THE REQUIRED THICKNESS AND CONFORM TO THE GRADE AND SURFACE CONTOUR SHOWN ON THE PLANS.

403-4.12 ADD THE FOLLOWING TO THIS PARAGRAPH:

ALL PAVEMENT EDGES (LONGITUDINAL, RADIUS, AND PAVEMENT ENDS) MUST BE LEFT IN PROPER ALIGNMENT AS SHOWN ON THE PLANS. THIS MAY BE ACCOMPLISHED BY THE TRIMMING METHOD OUTLINED ABOVE OR AT THE CONTRACTOR'S OPTION BY SAWING AFTER THE PAVING HAS BEEN COMPLETED. NO ADDITIONAL COMPENSATION WILL BE MADE IF THE SAWING METHOD IS USED.

THE PROPOSED BITUMINOUS BASE COURSE WILL BE PAID FOR UNDER ITEM:

# 602-BITUMINOUS PRIME COAT NOTES:

THE BITUMINOUS PRIME COAT (602) SHALL BE PLACED IN ACCORDANCE WITH ITEM AR602 "BITUMINOUS PRIME COAT" AS STATED ON PAGE 251 OF THE STANDARD SPECIFICATION FOR CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2, 2009.

THE PROPOSED BITUMINOUS PRIME COAT SHALL BE PLACED ON THE PROPOSED AGGREGATE BASE COURSE PRIOR TO THE PLACEMENT OF THE FIRST LIFT OF PROPOSED BITUMINOUS BASE COURSE. THE PROPOSED AGGREGATE BASE COURSE SHALL HAVE A PRIME COAT OF BITUMINOUS MATERIAL APPLIED IN ACCORDANCE WITH THE REQUIREMENTS OF THE SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL PROVISIONS.


AR602510 BITUMINOUS PRIME COAT \_\_\_\_ PER GAL.

71+00

- PROPOSED BITUMINOUS TACK COAT (603) 0.05 0.15 GAL/S.Y.
- PROPOSED BITUMINOUS BASE COURSE (201) 3" COMPACTED THICKNESS
- PROPOSED CRUSHED AGGREGATE BASE COURSE (209) 10" COMPACTED THICKNESS

EXISTING IMPROVEMENTS

SCALE: FULL SIZE SCALE:



70' ITYP

66+0€

55' RADIUS

EP: 304+00.00 67+00

TAXIWAY "C3" STA. 304+00 TAXIWAY "C" STA. 66+10.97

TYPICAL SECTION "A-A" NOT TO SCALE

AR403613 BIT. BASE CSE.- METHOD I, SUPERPAVE - PER TON

70+00

THE PROPOSED BITUMINOUS PRIME COAT WILL BE PAID FOR UNDER ITEM:

PROPOSED TAXIWAY "C"

69+00

LEGEND FOR TYPICAL SECTION "A-A"

PROPOSED BITUMINOUS SURFACE COURSE (401) - 2" COMPACTED THICKNESS

PROPOSED BITUMINOUS PRIME COAT (602) - 0.35 GAL/S.Y. (DILUTED)

PROPOSED SOIL PROCESSING (155) - 16" DEPTH

LEGEND

PROPOSED IMPROVEMENTS

LI032

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON HANSON

TAXIWAY "C" EXTENSION

PROPOSED CONSTRUCTOR STAN STA. 65+76 TO STA.

# AR401611 BITUMINOUS SURFACE COURSE-METHOD 1, SUPERPAVE

THE BITUMINOUS SURFACE COURSE (401) SHALL BE PLACED IN ACCORDANCE WITH ITEM AR401003 "BITUMINOUS SURFACE COURSE-METHOD 1, SUPERPAVE" AS STATED ON PAGE 129 OF THE STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2. 2009

THIS ITEM OF WORK SHALL CONSIST OF CONSTRUCTING 1 LIFT OF BITUMINOUS SURFACE COURSE-METHOD 1, SUPERPAVE (2 INCH DEPTH EACH) ON THE BITUMINOUS BASE COURSE.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE QUALITY CONTROL IN THE PRODUCTION AND CONSTRUCTION OF THE BITUMINOUS SURFACE COURSE METHOD 1, SUPERPAVE.

THE PROPOSED BITUMINOUS SURFACE COURSE METHOD 1, SUPERPAVE WILL BE DESIGNED TO A SUPERPAVE DESIGN OF ((LESS) THAN 60,000 POUNDS.

401-4.9 ADD THE FOLLOWING TO THIS SECTION:

IF GRADE IS ESTABLISHED DURING THE PLACEMENT OF THE BITUMINOUS BASE COURSE. THE N THE PLACEMENT OF THE BITUMINOUS SURFACE COURSE SHALL BE LAID WITH A TRAVELING SKI ON BOTH SIDES OF THE PAVER FOR THE CENTER LANE WITH A MATCHING SHOE AND TRAVELING SKI ON

WHEN HAND SPREADING IS PERMITTED, THE MIXTURE WILL BE DISTRIBUTED AND SPREAD USING HAND TOOLS. WHEN THE WORK IS COMPLETED, THE LAYER WILL HAVE THE REQUIRED THICKNESS AND CONFORM TO THE GRADE AND SURFACE CONTOUR SHOWN ON THE PLANS.

401-4.12 ADD THE FOLLOWING TO THIS PARAGRAPH:

73+00

ALL PAVEMENT EDGES (LONGITUDINAL, RADIUS, AND PAVEMENT ENDS) MUST BE LEFT IN PROPER ALIGNMENT AS SHOWN ON THE PLANS. THIS MAY BE ACCOMPLISHED BY THE TRIMMING METHOD OUTLINED ABOVE OR AT THE CONTRACTOR'S OPTION BY SAWING AFTER THE PAVING HAS BEEN COMPLETED. NO ADDITIONAL COMPENSATION WILL BE MADE IF THE SAWING METHOD IS USED.

74+00

75+00

THE PROPOSED BITUMINOUS SURFACE COURSE WILL BE PAID FOR UNDER ITEM: AR401613 BIT. SURF. CSE. — METHOD I, SUPERPAVE \_ \_ PER TON.

# AR209-CRUSHED AGGREGATE BASE COURSE NOTES

THE CRUSHED AGGREGATE BASE COURSE (209) SHALL BE PLACED IN ACCORDANCE WITH ITEM 209 "CRUSHED AGGREGATE BASE COURSE" AS STATED ON PAGE 93 OF THE STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2, 2009.

THE CRUSHED AGGREGATE BASE COURSE MATERIAL (CA-6) WILL BE USED TO CONSTRUCT A BASE COURSE FOR THE PROPOSED BITUMINOUS BASE COURSE (403). THE CRUSHED AGGREGATE BASE COURSE MATERIAL WILL BE 10" IN DEPTH AND COMPACTED TO NOT LESS THAN 100 PERCENT

THE PROPOSED AGGREGATE FOR THE BASE COURSE MATERIAL SHALL MEET THE REQUIREMENTS OF GRADATION "B" IN TABLE 1 OF THE SUPPLEMENTAL SPECIFICATIONS.

209-3.2 EQUIPMENT. ADD THE FOLLOWING PARAGRAPHS TO THIS SECTION:

"PROVISIONS SHALL BE MADE BY THE CONTRACTOR FOR FURNISHING WATER AT THE PLANT AND AT THE SITE OF THE WORK BY EQUIPMENT OF AMPLE CAPACITY AND OF SUCH DESIGN AS TO ASSURE UNIFORM MIXING AND APPLICATION."

THE CONTRACTOR WILL PROVIDE THE RESIDENT ENGINEER A PROCTOR CURVE SHOWING OPTIMUM DENSITY AND MOISTURE FOR THE SUPPLIED BASE COURSE MATERIAL.

THE COMPACTION CONTROL TEST TO BE USED SHALL BE FAA COMPACTION CONTROL TEST T-611 FOR AIRCRAFT WEIGHING LESS THAN 60,000 LBS.

## 209-3.3 PLACING AND SPREADING.

AS PER THIS SECTION THE CONTRACTOR WILL PLACE THE AGGREGATE BASE COURSE USING A SPREADER BOX OR OTHER APPROVED DEVICES OR METHODS THAT SHALL SPREAD THE AGGREGATE TO THE REQUIRED DEPTHS WHILE MINIMIZING THE NEED TO "RE-HANDLE" THE MATERIAL.

C. METHOD OF PLACING. REVISE THE FIRST SENTENCE TO READ AS FOLLOWS:

"THE CONTRACTOR WILL BE ALLOWED TO PLACE THE PROPOSED AGGREGATE BASE COURSE IN TWO LIFTS PROVIDED HE CAN DEMONSTRATE HE CAN OBTAIN THE REQUIRED COMPACTION THROUGHOUT EACH LIFT."

# 209-3.4 FINISHING AND COMPACTING

76+00

PROPOSED TAXIWAY "C"


FOR TYPICAL SECTION "A-A" SEE SHEET NO. 5

AS PER THIS SECTION THE CONTRACTOR WILL FURNISH A 16-FOOT STRAIGHTEDGE TO TEST THE COMPLETED SURFACE OF THE AGGREGATE BASE COURSE.

THE PROPOSED CRUSHED AGGREGATE BASE COURSE WILL BE PAID FOR UNDER ITEM:

AR209510 CRUSHED AGGREGATE BASE COURSE \_ \_ PER TON.

77+00

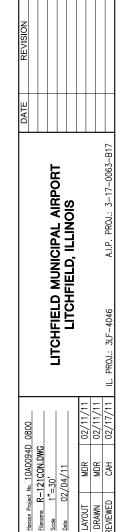

LI032

HANSON

TAXIWAY "C" EXTENSION

O

EXISTING IMPROVEMENTS PROPOSED IMPROVEMENTS HALF SIZE SCALE: 1"= 60 FULL SIZE SCALE: 1"= 30


79+00


**LEGEND** 


78+00

LI032 PAVEMENT SAWING NOTES **BITUMINOUS PAVEMENT MILLING** NOTE TO CONTRACTOR THE AREA(S) DESIGNATED AS \_\_\_\_\_\_\_\_ON THIS SHEET WILL BE CUT OR TRIMMED AS SHOWN ON THE CROSS-SECTIONS. THE CUTTING OR TRIMMING WILL BE DONE BY ROTO- MILLING. THE TOLERANCE OF THE MILLING WILL THE AREA(S) DESIGNATED AS ON THIS SHEET CAN AT THE DISCRETION OF THE CONTRACTOR BE REMOVED BY ANOTHER METHOD OTHER THAN MILLING. THE PERIMETER OF THE DESIGNATED AREAS WILL BE SAWED THE EDGE OF THE EXISTING PAVEMENT WILL BE SAWED FULL DEPTH. THE PROPOSED SAWING WILL REMOVE THE ROLLED DOWN EDGE AND PROVIDE A STRAIGHT PAVEMENT EDGE TO BUTT AGAINST. BE AS STATED IN THE STANDARD SPECIFICATIONS. TO INSURE A STRAIGHT EDGE. THE PAVEMENT WILL BE REMOVED TO A MIMINUM DEPTH EQUAL TO THE PROPOSED PAVEMENT MILLING. REGARDLESS OF WHAT METHOD THE CONTRACTOR USES TO REMOVE THE PAVEMENT IN THE RESIDENT ENGINEER WILL MARK THE PROPOSED SAW LINE IN THE FIELD. IF A SQUARE STRAIGHT EDGE IS NOT OBTAINED FROM THE MILLING OPERATIONS, THE EXISTING PAVEMENT WILL BE SAWED AS SHOWN ON THIS SHEET. SAWING WILL BE CONSIDERED AS AN INCIDENTAL ITEM TO THE THE DESIGNATED AREA THE WORK WILL BE PAID FOR UNDER ITEM AR401650 ANY BITUMINOUS PAVEMENT CUT FROM THE SAWING OPERATIONS "BITUMINOUS PAVEMENT MILLING" \_ \_ PER SQ. YD. WILL BE COLLECTED AND DISPOSED OF OFF THE AIRPORT SITE. PROPOSED PAVEMENT MILLING AND NO ADDITIONAL COMPENSATION WILL BE THE SAWING AND DISPOSAL OF ANY WASTE MATERIAL WILL BE CONSIDERED INCIDENTAL TO THE CONTRACT AND NO ADDITIONAL COMPENSATION WILL BE ALL MILLED MATERIAL WILL BE DISPOSED OF ON THE AIRPORT SITE. PRIOR TO APPLYING THE BITUMINOUS OVERLAY ALL MILLED MATERIAL WILL BE BROOMED AND BLOWN CLEAN AND A BITUMINOUS TACK COAT APPLIED. THE VERTICAL FACE OF ALL SAW CUTS WILL BE PAINTED WITH A LIQUID LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS ANY ADJACENT PAVEMENT DAMAGED BY THE MILLING OPERATIONS WILL BE REPAIRED AT THE CONTRACTOR'S OWN EXPENSE. ALL BITUMINOUS PAVEMENT MILLING AREAS WILL BE LOCATED AND MARKED BY THE RESIDENT ENGINEER. THIS ITEM OF WORK SHALL BE PAID FOR UNDER ITEM: +00 AR401650 "BITUMINOUS PAVEMENT MILLING" - PER S.Y. "CZ - PROPOSED BITUMINOUS PAVEMENT MILLING 93 S.Y. 55' RADIUS -204+00 HANSON 81+00 84+00 86+00 EP: 204+00.00 87+00 82+00 83+00 85+00 PROPOSED TAXIWAY "C" EXISTING TAXIWAY "C" TAXIWAY "C2" STA. 204+00 FOR TYPICAL SECTION "A-A" SEE SHEET NO. 5 TAXIWAY "C" STA. 85+76 TAXIWAY "C" EXTENSION <u>LEGEND</u> EXISTING IMPROVEMENTS PROPOSED IMPROVEMENTS HALF SIZE SCALE: 1"= 60° FULL SIZE SCALE: 1"= 30° PROPOSED PAVEMENT MILLING

PROPOSED CONSTRUCT PLAN STA. 80+00 TO STA.

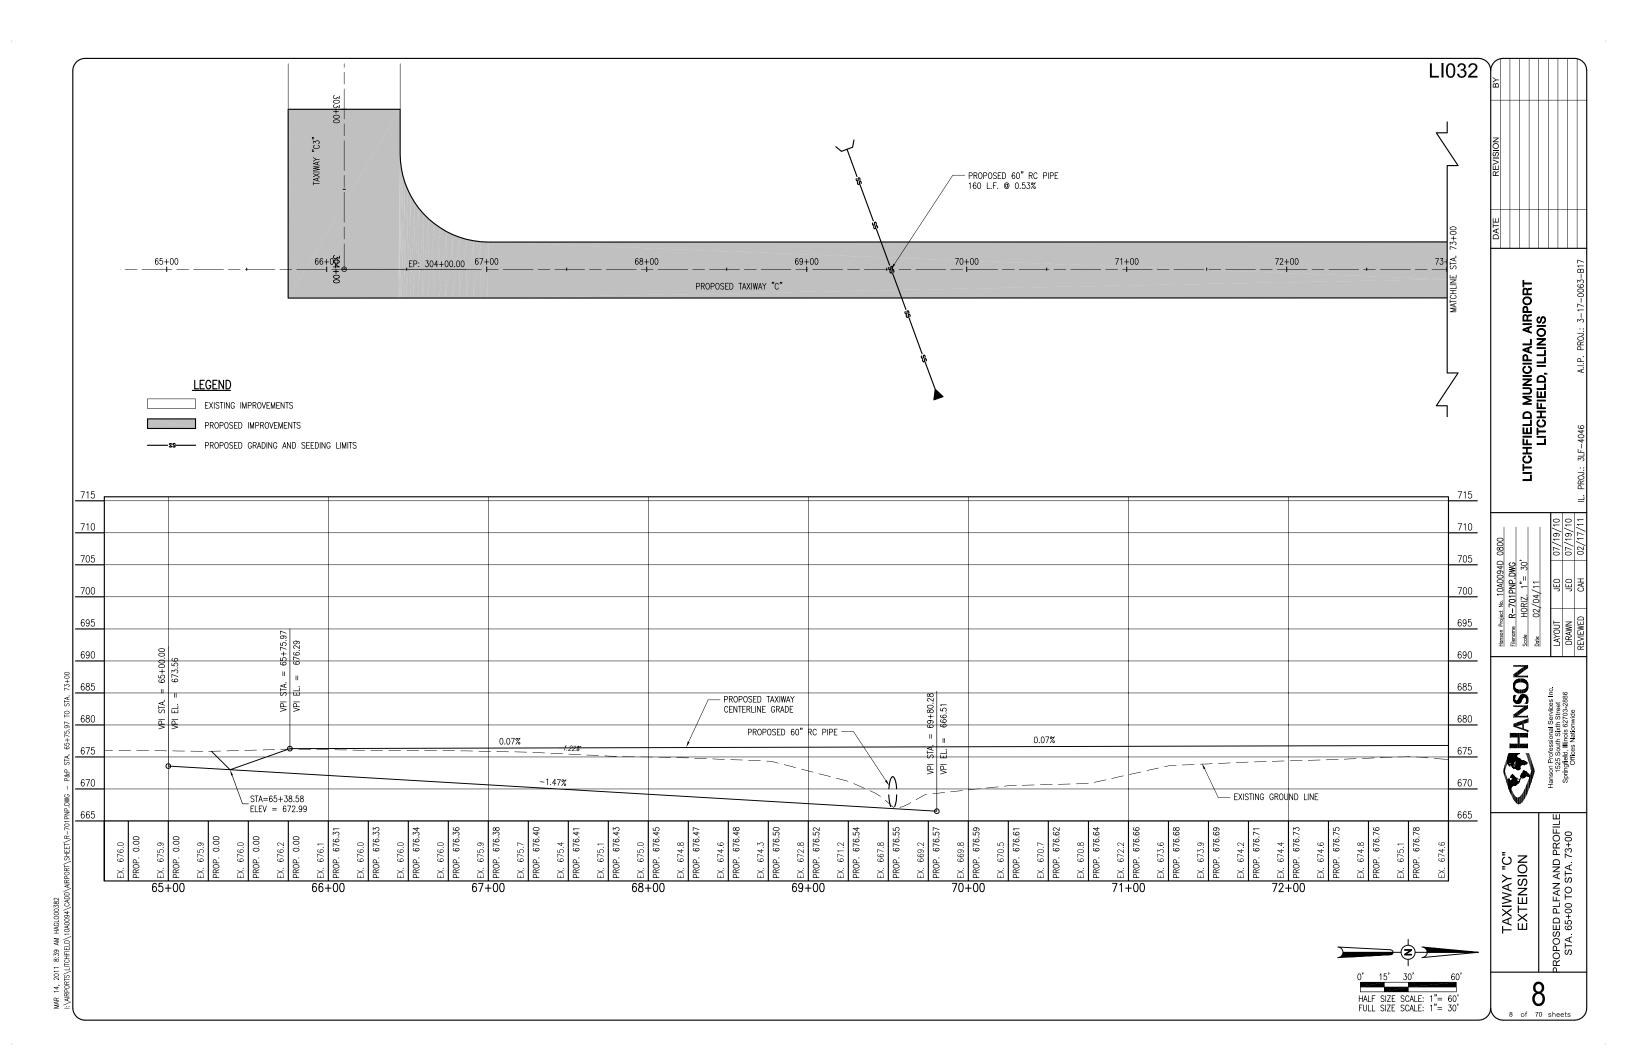

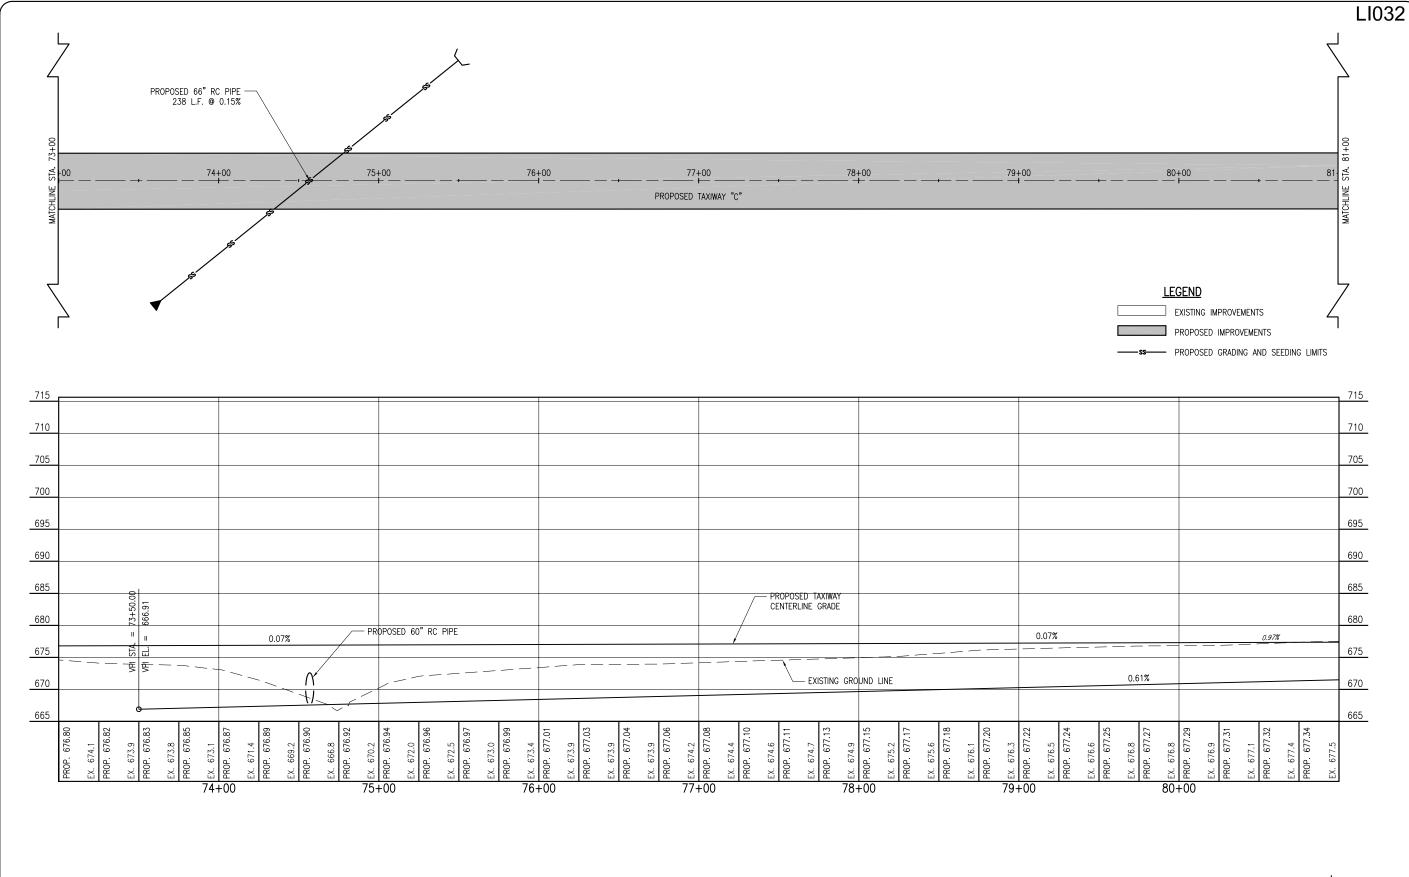





LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Henson Project No. 10A0094D O Fileranne R-701PNP.DWG Scale HORIZ, 1"= 30' Date 02/04/11 HANSON

ROPOSED PLAN AND PROFILE STA. 73+00 TO STA. 81+00

of 70 sheets

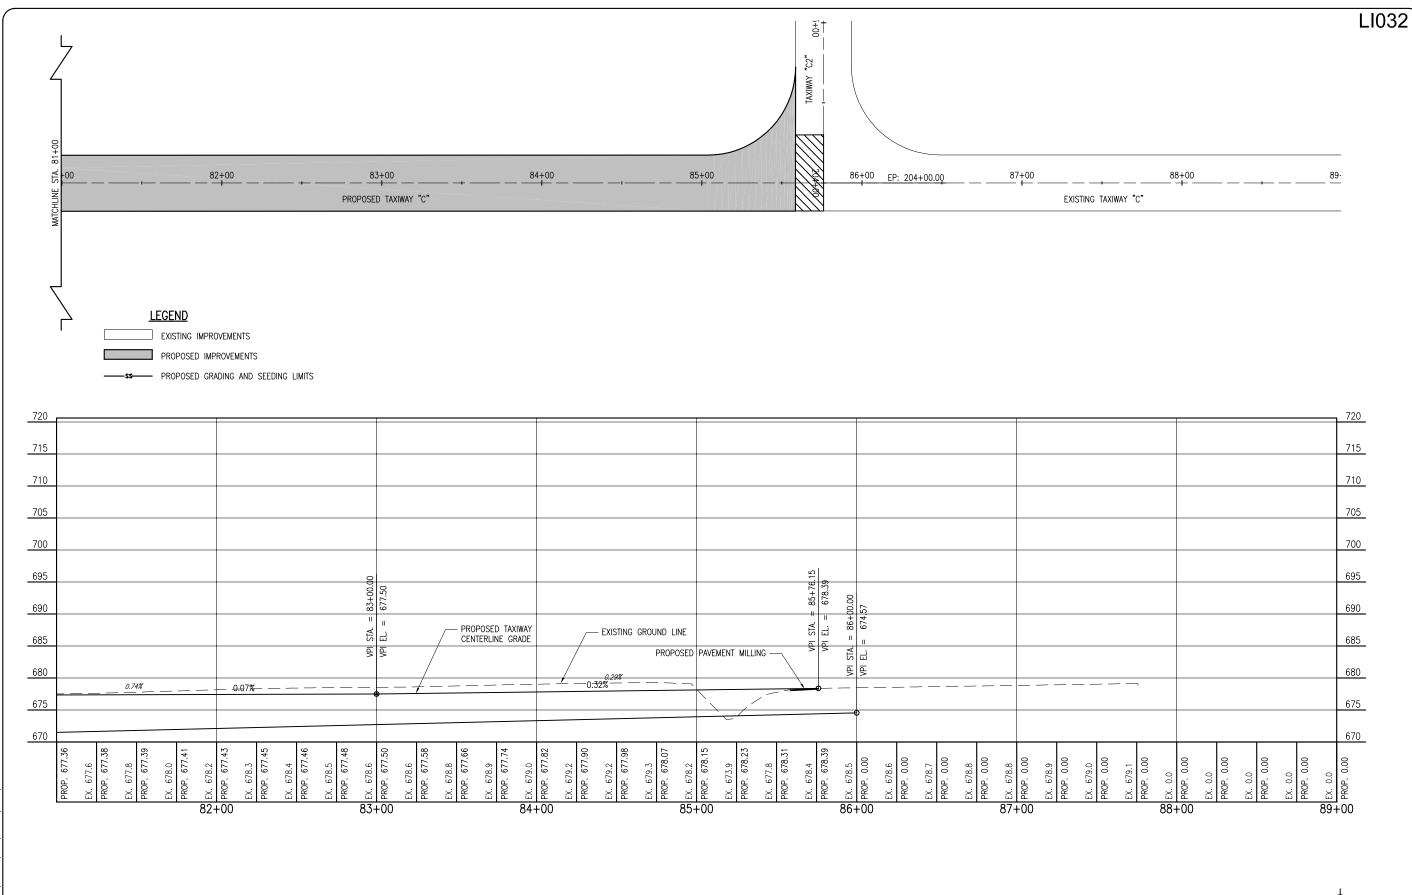




LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Hunson Project No. 10A0094D C Filename R=701PNP.DWG Scole HORIZ. 1"= 30" Date 02/04/11 HANSON

ROPOSED PLAN AND PROFILE STA. 81+00 TO STA. 88+00

10 of 70 sheets

TAXIWAY "C" EXTENSION

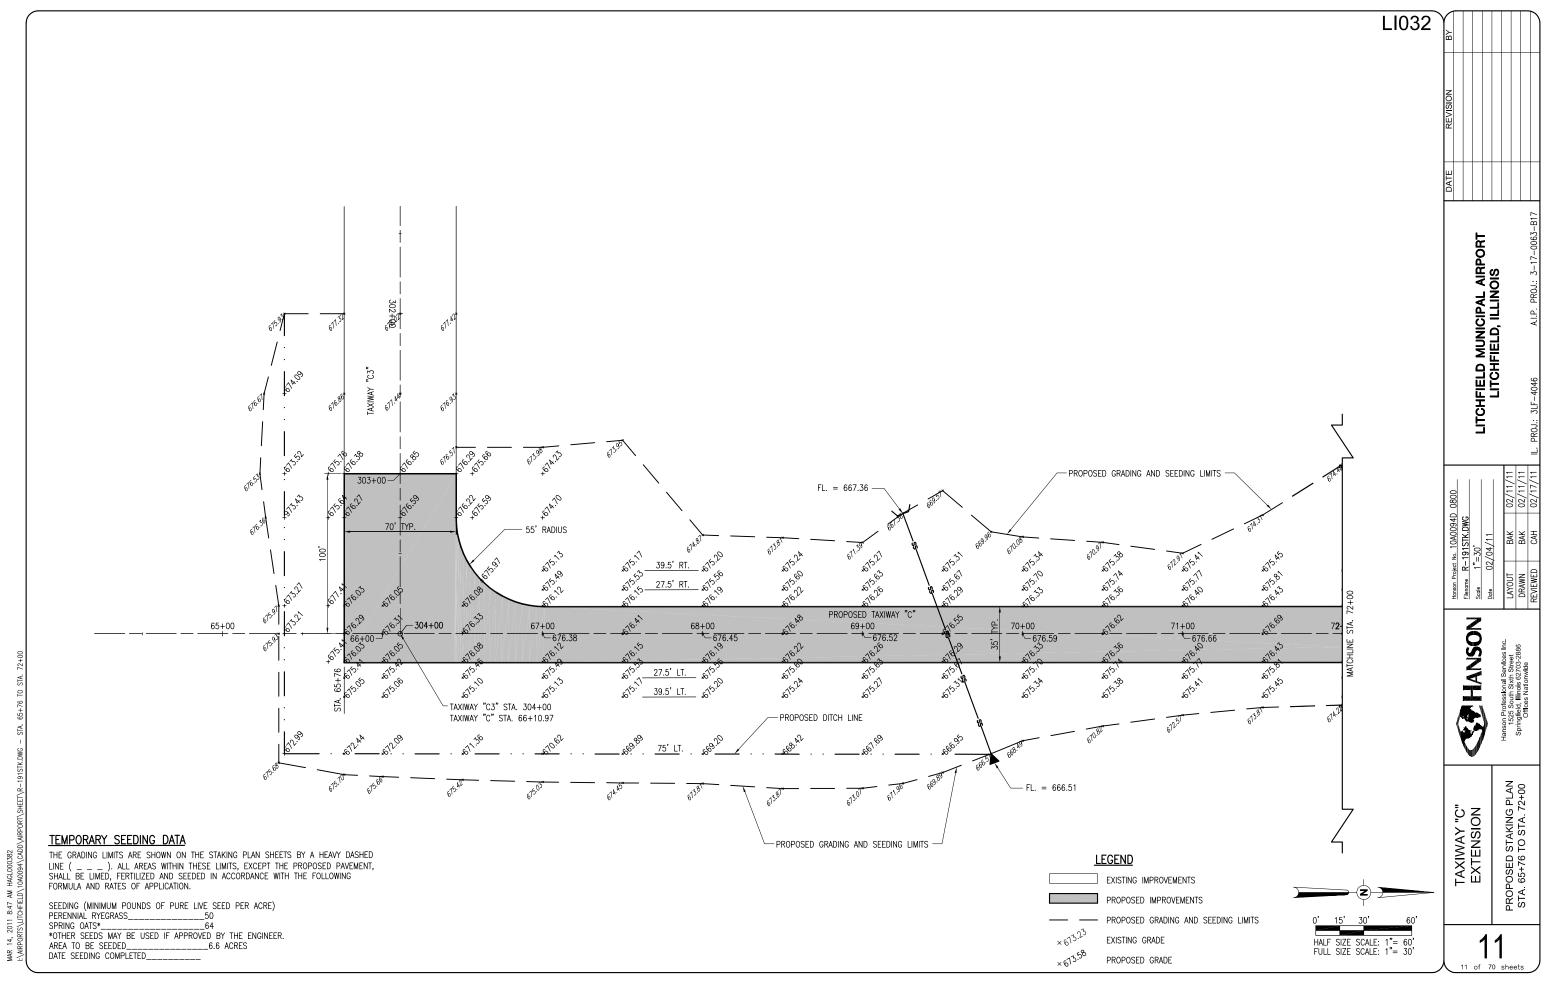

# 901 SEEDING NOTES THE PROPOSED SEEDING SHALL BE ACCOMPLISHED IN ACCORDANCE WITH ITEM 901 "SEEDING" AS STATED ON PAGE 324 OF THE STANDARD SPECIFICATIONS FOR, CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2, 2009. ALL DISTURBED AREAS LOCATED WITHIN THE PROPOSED GRADING AND SEEDING LIMITS WILL BE SEEDED IN ACCORDANCE WITH THE ABOVE NOTED SPECIFICATION. ALL AREAS OUTSIDE THE DESIGNATED GRADING AND SEEDING LIMITS WILL ALSO BE SEEDED BUT AT THE CONTRACTOR'S OWN EXPENSE. ALL MATERIALS AND/OR DEBRIS RESULTING FROM THE SEEDING OPERATIONS WILL BE REMOVED FROM THE PAVEMENTS AND MISCELLANEOUS STRUCTURES PRIOR TO OPENING THE RUNWAY.

THE PROPOSED SEEDING WILL BE PAID FOR UNDER ITEMS:

AR901510 SEEDING \_\_\_\_ PER ACRES

DATE SEEDING COMPLETED\_

# 908 MULCHING NOTES

THE PROPOSED MULCHING SHALL BE ACCOMPLISHED IN ACCORDANCE WITH ITEM 908 "MULCHING" AS STATED ON PAGE 334 OF THE STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS, ADOPTED NOVEMBER 2, 2009.

THIS ITEM SHALL CONSIST OF THE FURNISHING, TRANSPORTING, AND PLACING MULCH OVER THE SEEDED AREA. DISTURBED AREAS OUTSIDE THE GRADING LIMITS SHALL ALSO BE MULCHED AND PARTICIPATION WILL BE THE SAME AS FOR SEEDED AREAS.


908-2.1 MULCH MATERIAL: THE CONTRACTOR MAY EITHER FURNISH STRAW OR HYDROMULCH AS THE TYPE OF MULCH MATERIAL TO BE USED ON THIS PROJECT.

908-3.1 MULCHING: THE HYDRAULIC MULCH SHALL BE APPLIED AS A SLURRY OF 2,500 POUNDS OF MULCH AND NOT LESS THAN 2,500 GALLONS OF WATER PER ACRE.

908-3.4 STRUCTURE CLEANING: AFTER THE PROPOSED MULCH HAS BEEN APPLIED, THE CONTRACTOR WILL CLEAN THE MULCH OFF ALL STRUCTURES (DRAINAGE, ELECTRICAL, LIGHTS, ETC.).

DATE MULCHING COMPLETED\_\_\_\_\_.


THE PROPOSED MULCHING WILL BE PAID FOR UNDER ITEMS: AR908510 MULCHING \_\_\_\_ PER ACRES

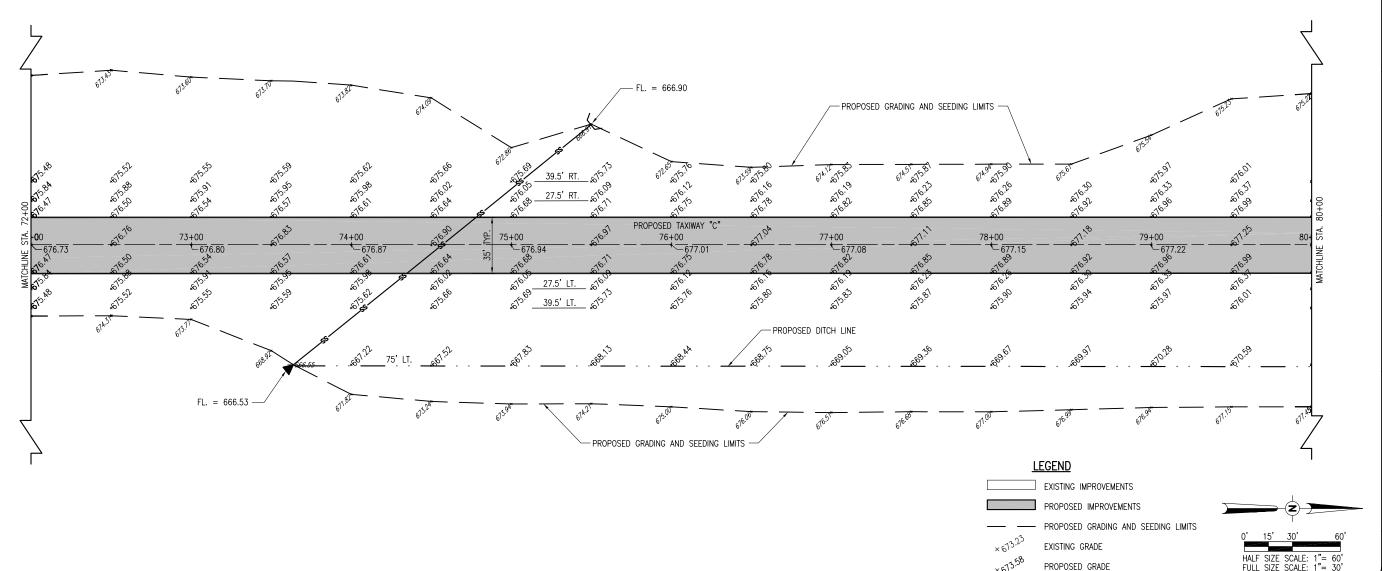


MAR 14, 2011 8:45 AM HAGLOUU382 I:\AIRPORTS\\ITCHFIFID\1040094\CAD\\ARPORT\SHFFT\R-1915TK.DWG - STA. 72+

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS HANSON PROPOSED STAKING PLAN STA: 72+00 TO STA: 80+00 TAXIWAY "C" EXTENSION

LI032

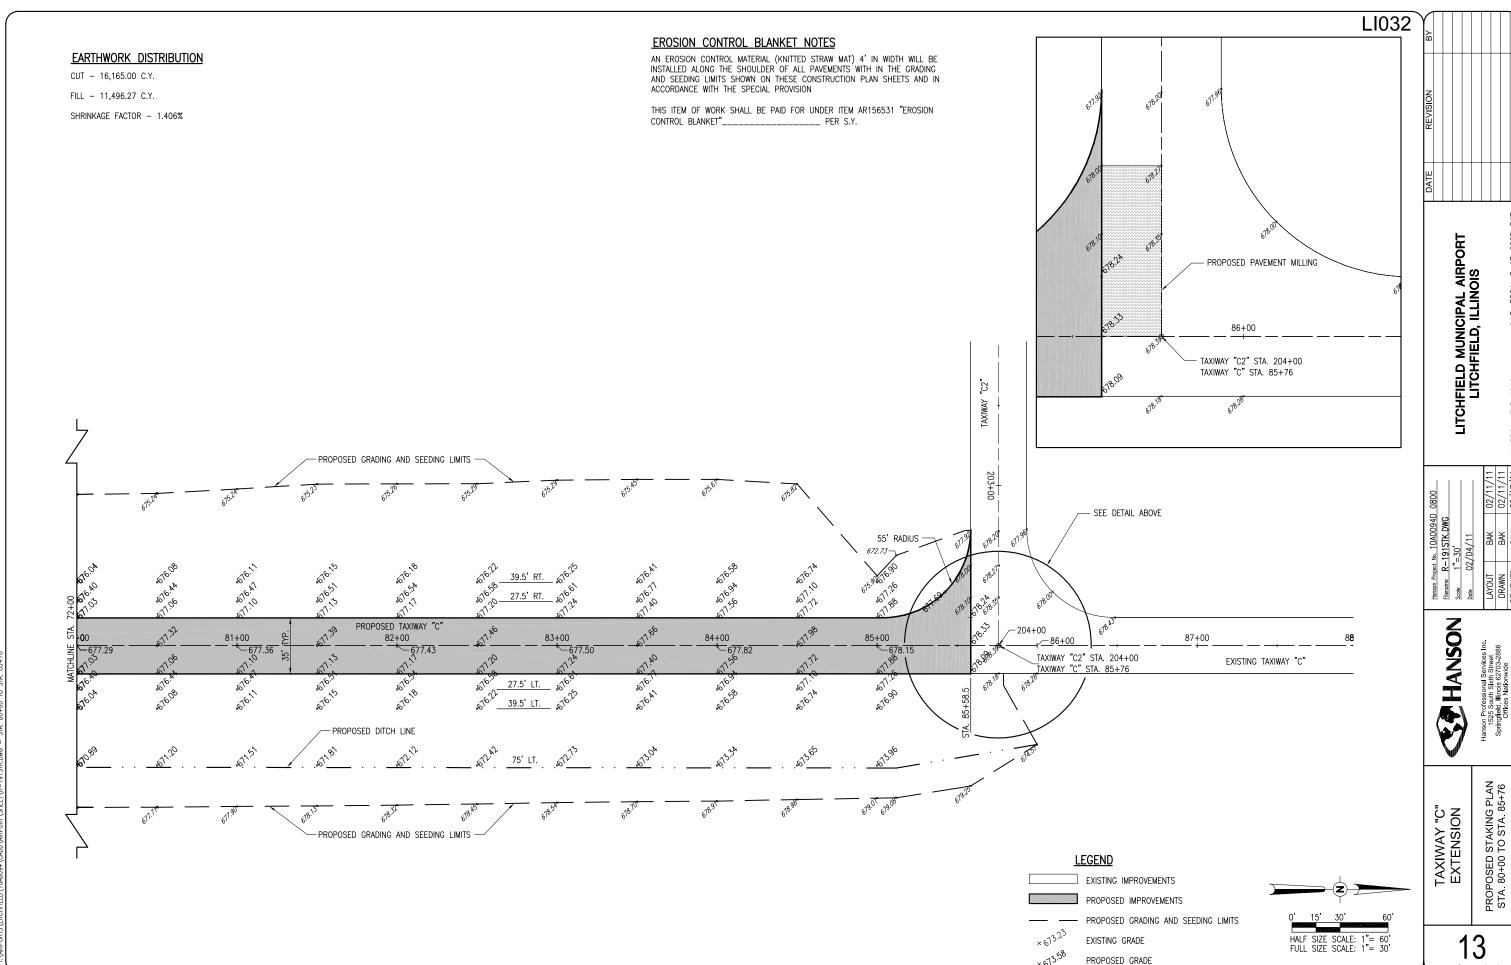


13 of 70 sheets

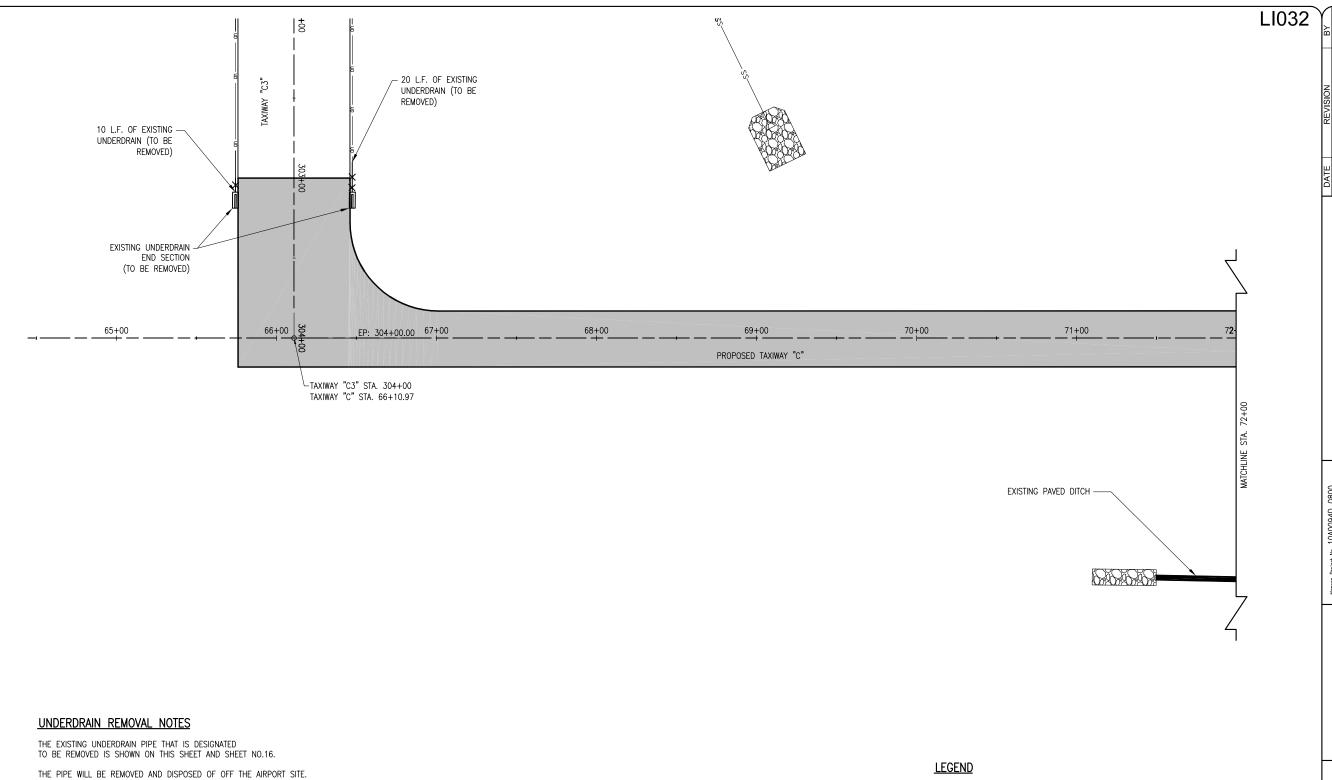

THE CONTRACTOR WILL BACKFILL THE TRENCH WITH THE SELECT EXCAVATED MATERIAL IF THE AREA IS NOT UNDER PROPOSED PAVEMENT. BACKFILL OF AREAS THAT ARE LOCATED UNDER PROPOSED PAVEMENT WILL BE WITH CA-7. THE CA-7 WILL EXTEND TO WITHIN 16" OF THE TOP OF THE PROPOSED SUBGRADE.

TWO EXISTING UNDERDRAIN END SECTIONS WILL BE REMOVED AND DISPOSED OF OFF THE AIRPORT SITE AS A INCIDENTAL ITEM TO THE UNDERDRAIN REMOVAL.

THE UNDERDRAIN REMOVAL SHALL BE PAID FOR UNDER:
AR705900 REMOVE UNDERDRAIN \_\_\_\_ PER LIN. FT.



PROPOSED IMPROVEMENTS

——ss—— Existing Storm sewer

----- UD------ EXISTING UNDERDRAIN


\*\*\* UD \*\*\* EXISTING UNDERDRAIN (TO BE REMOVED)

EXISTING PAVED DITCH

EXISTING RIPRAP

EXISTING CONCRETE FLARED END SECTION

EXISTING UNDERDRAIN END SECTION (TO BE REMOVED)



TAXIWAY "C"

EXTENSION

EXISTING DRAINAGE PLAN

STA. 66+75.24 TO STA.

ATA-100

TAXIWAY "C"

Hanson Professional Services Inc.


1525 South State Springfield, Illinois 62703-2886


Offices Nationwide


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS


**14**14 of 70 sheets


MAR 14, 2011 8:49 AM HAGLO00382

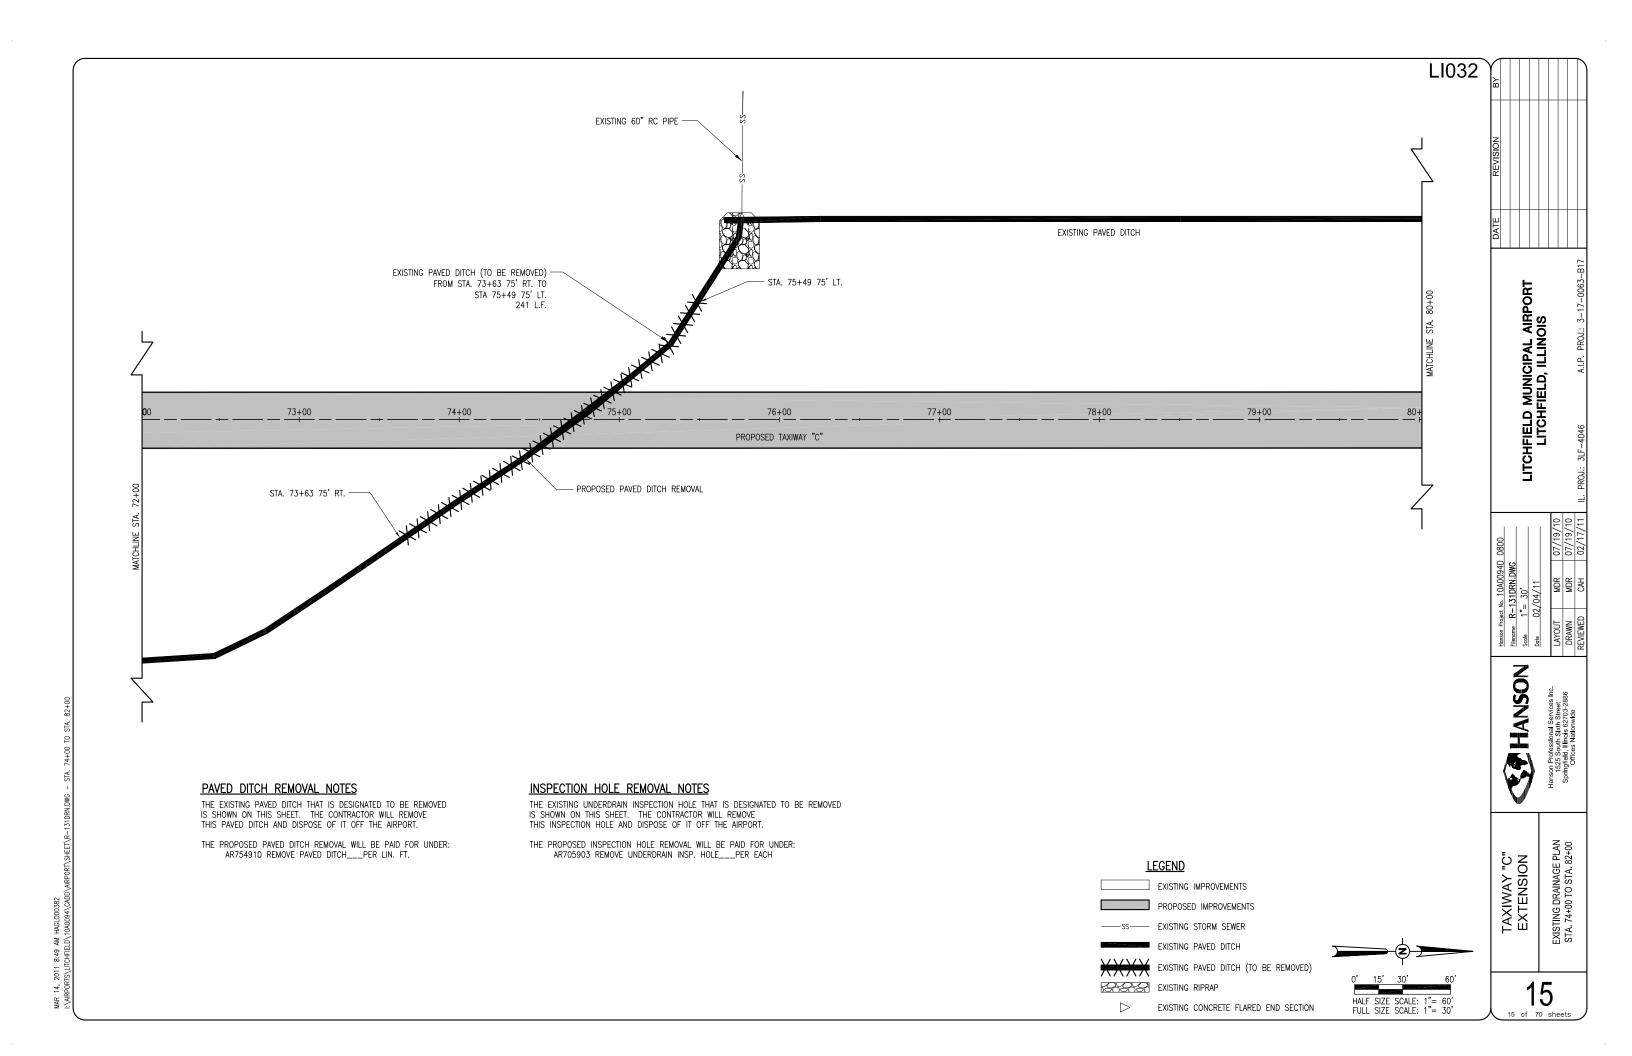

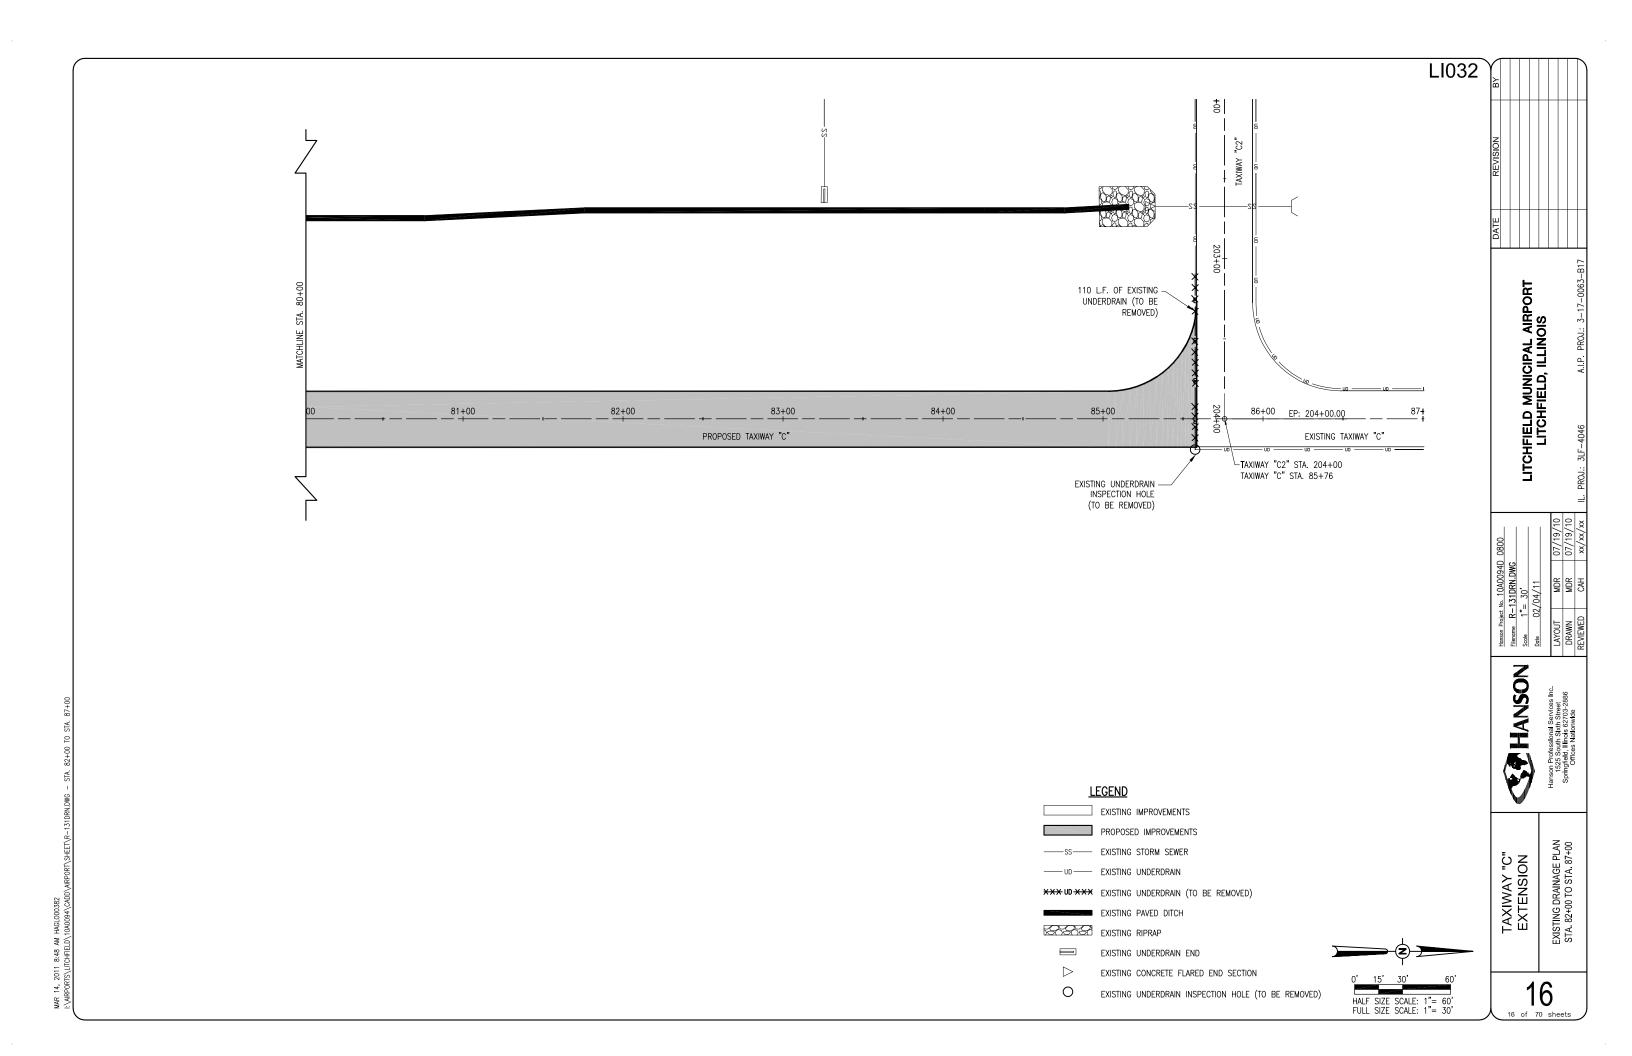


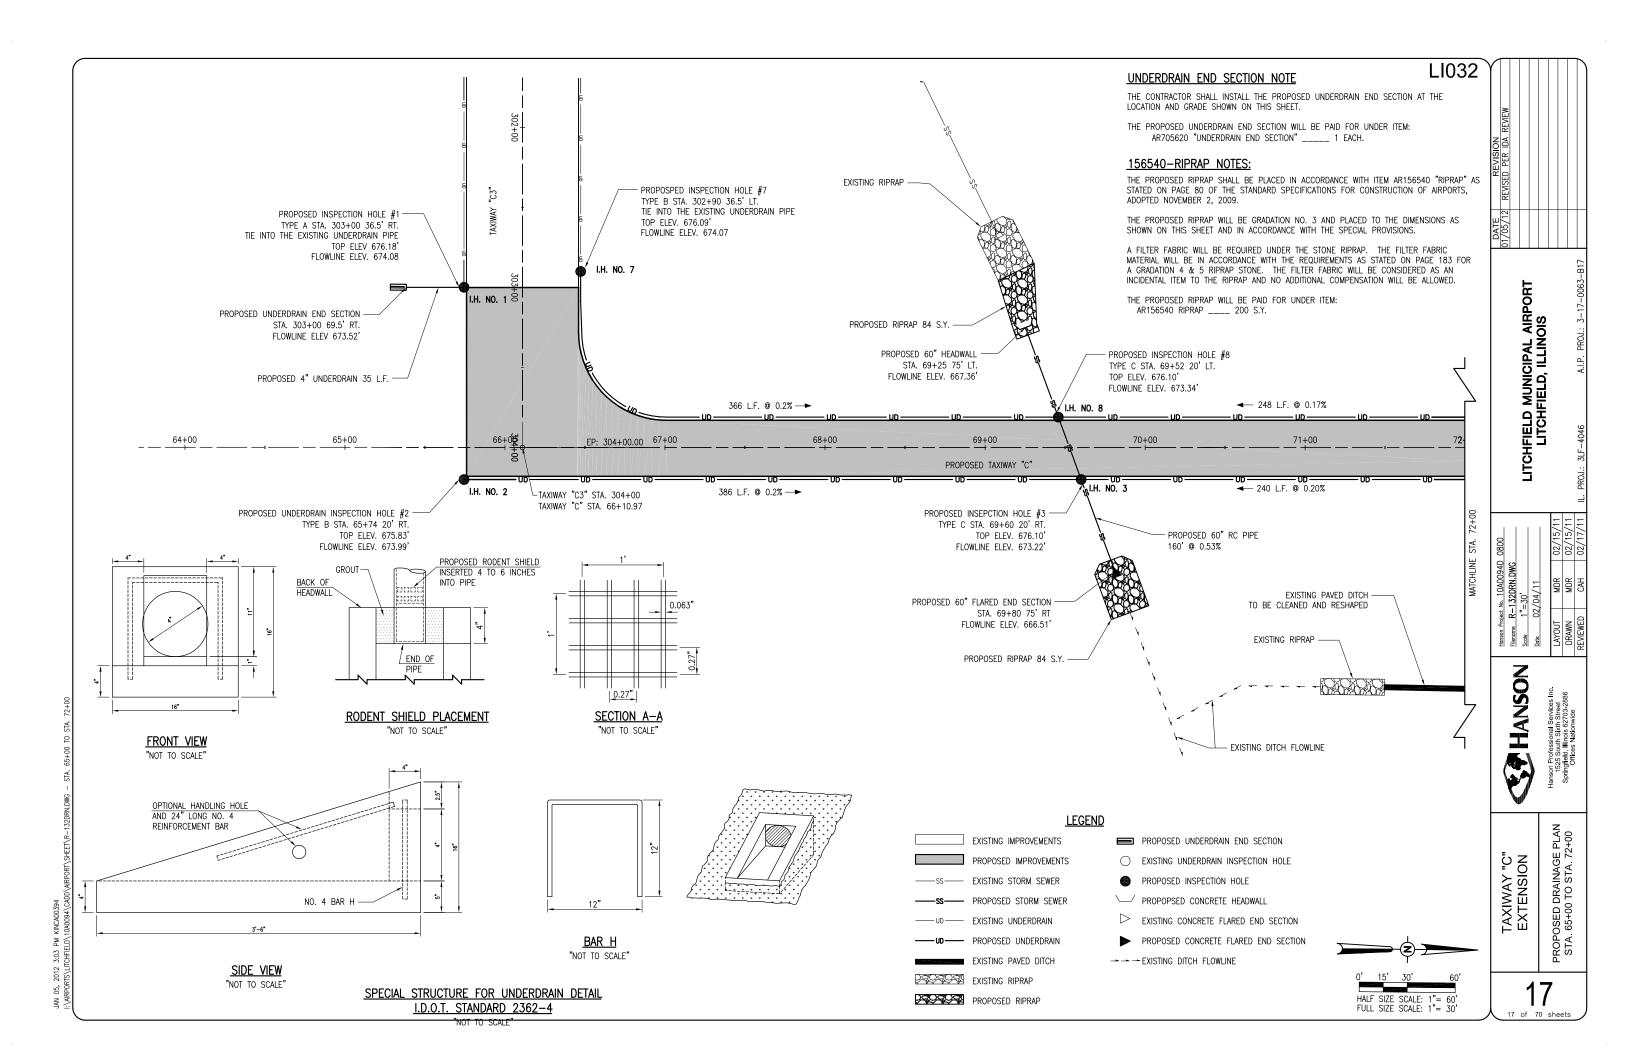

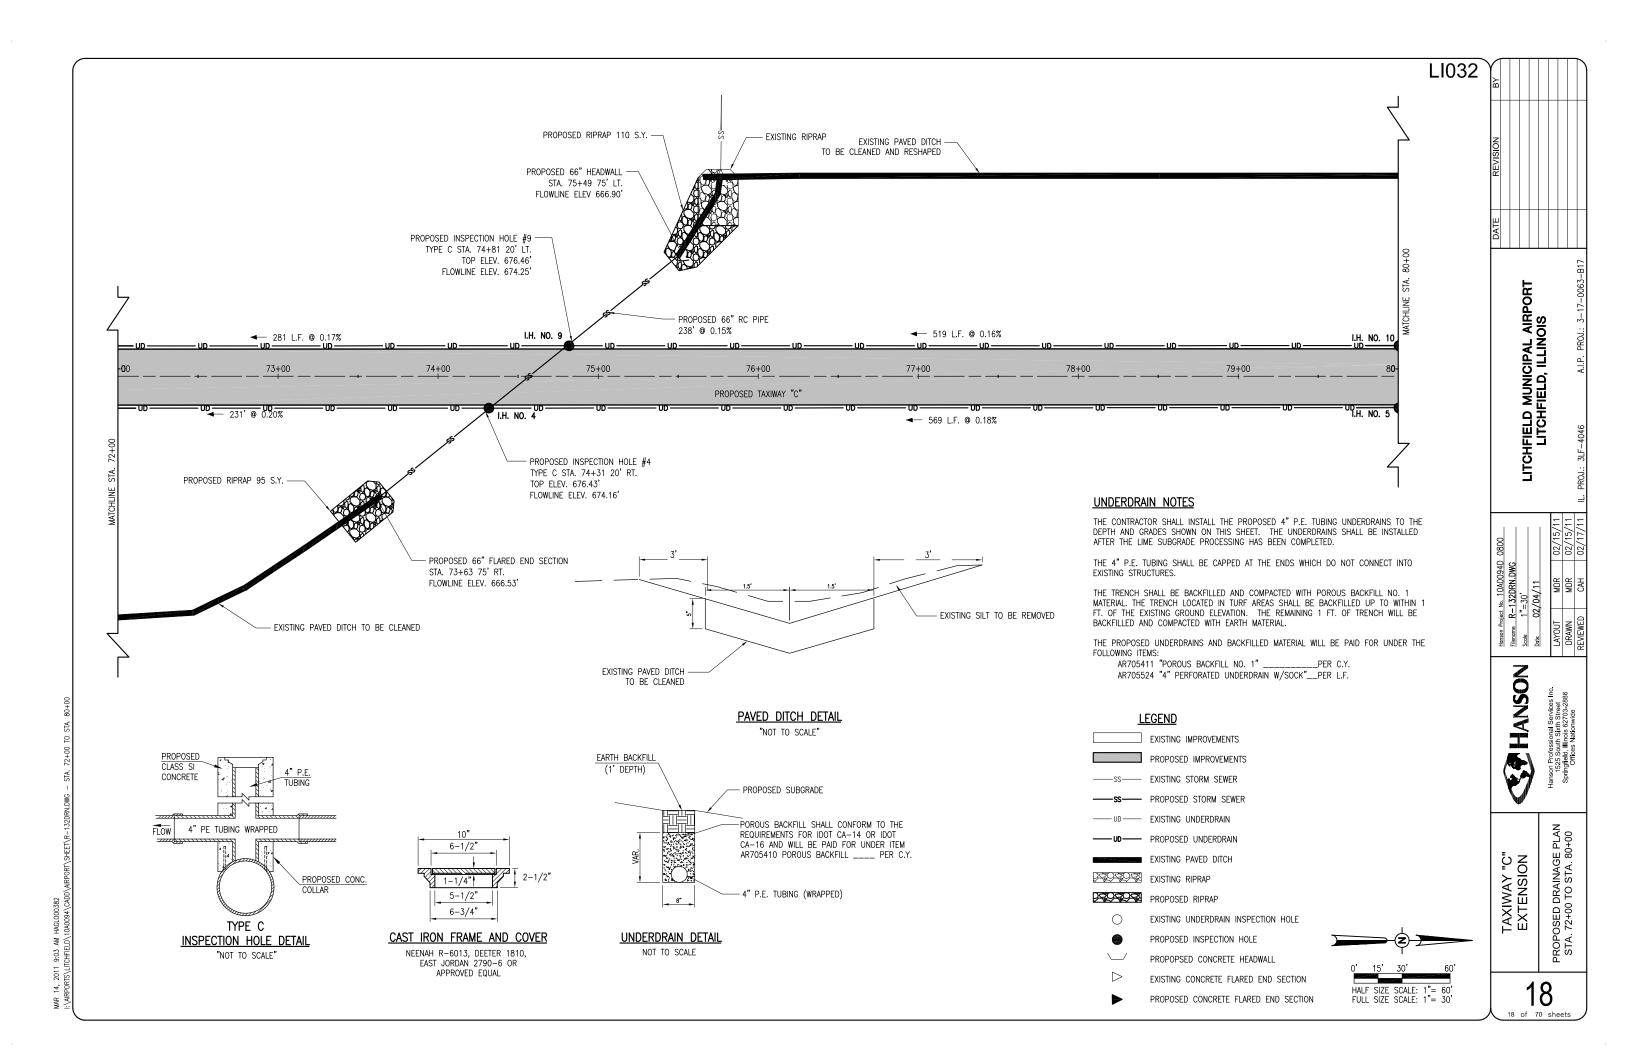

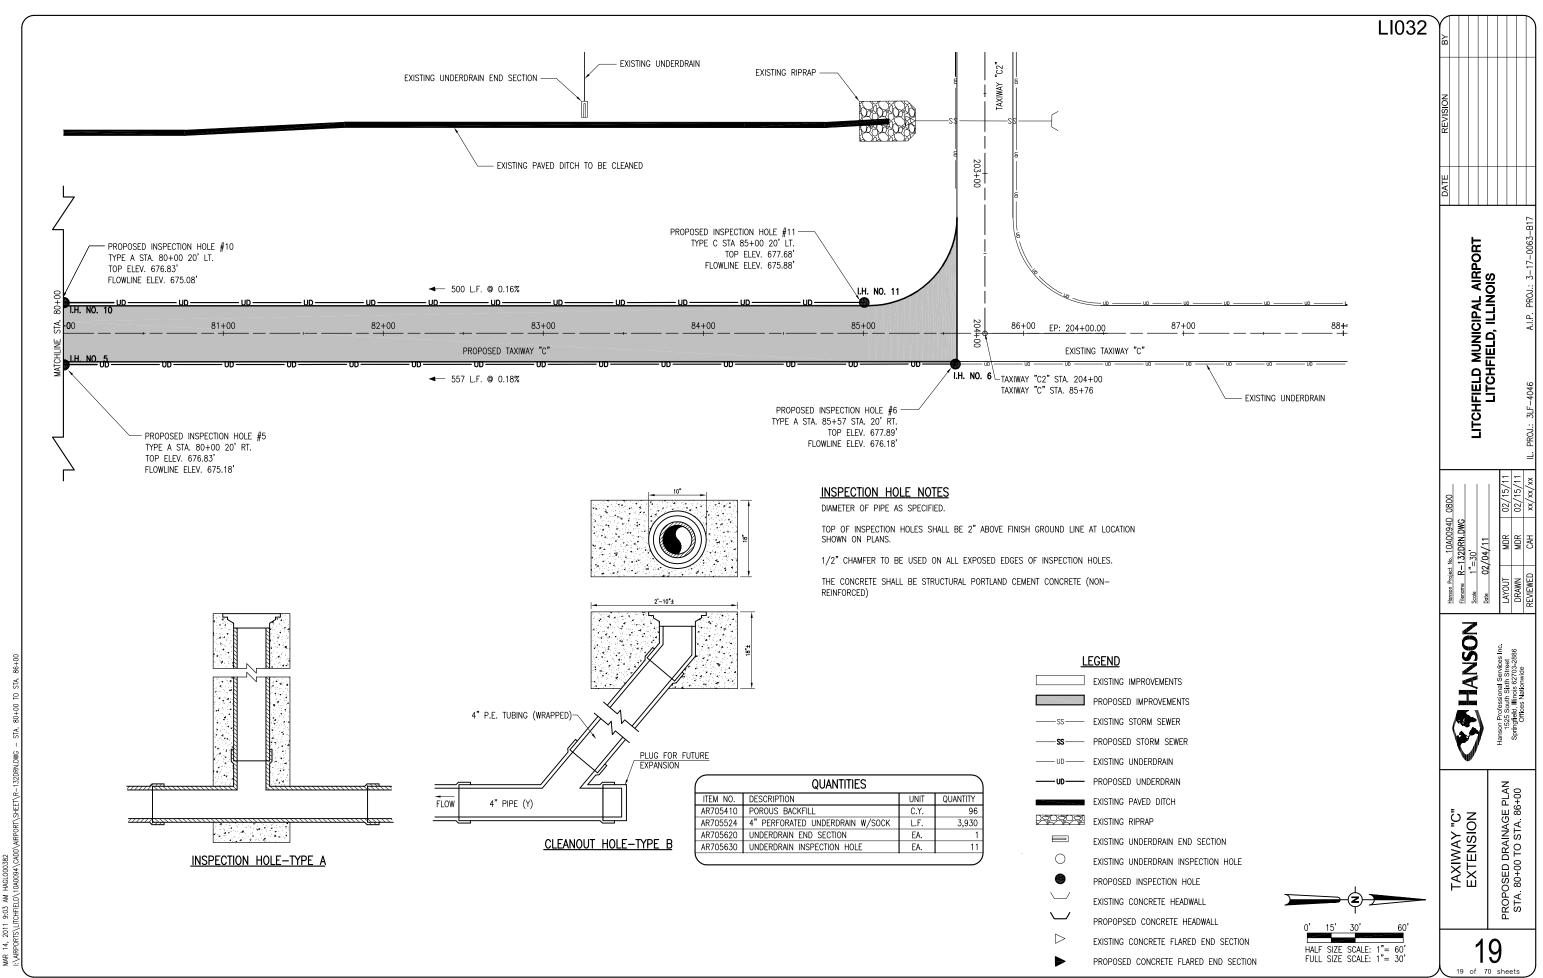

MAB 14 2011 0:03 AM HACLOGOSS92

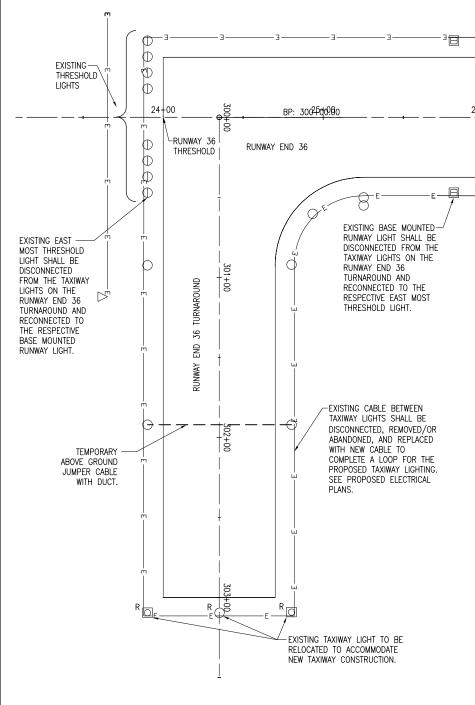


# LEGEND

EXISTING IMPROVEMENTS E EXISTING ELECTRICAL CABLES EXISTING STAKE MOUNTED RUNWAY LIGHT Ш EXISTING BASE MOUNTED RUNWAY LIGHT EXISTING STAKE MOUNTED RUNWAY THRESHOLD LIGHT 0 EXISTING STAKE MOUNTED TAXIWAY LIGHT  $\bigcirc$  R EXISTING STAKE MOUNTED TAXIWAY LIGHT (TO BE RELOCATED) 0 EXISTING BASE MOUNTED TAXIWAY LIGHT  $\bigcirc$  R EXISTING BASE MOUNTED TAXIWAY LIGHT (TO BE RELOCATED) EXISTING TAXI GUIDANCE SIGN TEMPORARY ABOVE GROUND JUMPER CABLE


# LIGHT REMOVAL/RELOCATION NOTES

- 1. ALL WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT DIRECTOR/MANAGER. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- 2. CONTRACTOR SHALL FIELD VERIFY EXISTING SITE CONDITIONS.
- 3. ALL EXISTING TAXIWAY LIGHTS THAT ARE DESIGNATED FOR RELOCATION SHALL BE DISCONNECTED AND CAREFULLY REMOVED BY THE CONTRACTOR AS NOT TO DAMAGE THE LIGHT. THE LIGHT ASSEMBLY AND ISOLATION TRANSFORMERS SHALL BE RELOCATED AND INSTALLED IN THE LOCATIONS SHOWN.
- 4. THE EXISTING AIRFIELD LIGHTING CABLES ASSOCIATED WITH AIRFIELD LIGHTING REMOVALS SHALL BE ABANDONED IN PLACE UNLESS IT CONFLICTS WITH THE INSTALLATION OF THE PROPOSED LIGHT OR CABLE, PAVEMENT OR OTHER WORK, THEN IT SHALL BE DISCONNECTED, REMOVED AND DISPOSED OF OFF SITE AT NO ADDITIONAL COST TO THE CONTRACT. CONTRACTOR MAY REMOVE ABANDONED CABLES AT NO ADDITIONAL COST TO THE CONTRACT AND SHALL HAVE THE SALVAGE RIGHTS TO ABANDONED CABLES
- 5. THE CONTRACTOR IS REQUIRED TO FILL IN ALL HOLES AND DEPRESSIONS RESULTING FROM THE LIGHT REMOVAL, WITH EARTH FROM WITHIN THE CONSTRUCTION LIMITS. THE AREAS SHALL BE COMPACTED TO PREVENT FUTURE SETTLEMENT AND FERTILIZED, SEEDED, AND MULCHED IN ACCORDANCE WITH ITEMS 901 AND 908 RESPECTIVELY.
- 6. THE CONTRACTOR IS ENCOURAGED TO INSPECT EACH EXISTING LIGHT PRIOR TO RELOCATION AND IDENTIFY TO THE RESIDENT ENGINEER ANY DAMAGED OR INOPERATING PARTS. ONCE THE EXISTING LIGHT IS REMOVED, THE CONTRACTOR IS RESPONSIBLE FOR ALL FIXTURES DAMAGED DURING THE RELOCATION. ALL LIGHTS WILL BE REINSTALLED IN PROPER WORKING ORDER, OR REPLACED AT THE CONTRACTOR'S EXPENSE.
- 7. RUNWAY 18-36 LIGHTING CIRCUIT WILL BE ACTIVE AT THE END OF EACH CONSTRUCTION DAY. THE CONTRACTOR WILL INSTALL AND MAINTAIN THE TWO TEMPORARY ABOVE GROUND JUMPERS SHOWN ON THIS SHEET. THE JUMPERS WILL REMAIN IN PLACE UNTIL THEY ARE NO LONGER NEEDED. WHEN THE JUMPERS ARE REMOVED THEY WILL BECOME THE PROPERTY OF THE CONTRACTOR.
- 8. THE PROPOSED JUMPER CABLE WILL BE 1/C #8 5KV UG CABLE IN UD.
- 9. ALL ABOVE GROUND JUMPERS SHALL BE IN A DUCT WITH ALL CONNECTIONS SEALED. THE CONTRACTOR SHALL SECURE, IDENTIFY AND PLACE ALL TEMPORARY EXPOSED WIRING IN CONDUIT, DUCT OR UNIT DUCT TO PREVENT ELECTROCUTION AND FIRE IGNITION SOURCES AS PER THE REQUIREMENTS OF FAA 150/5370-2F, - OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION, PART 218, b (1)(f).
- 10. THE ABOVE GROUND JUMPER CONDUITS WILL BE SECURELY FASTENED TO THE PAVEMENT AND WILL BE ORANGE IN COLOR (OR PAINTED ORANGE) FOR GREATER VISIBILITY. THE CONDUIT WILL BE THE SMALLEST DIAMETER THAT WILL ALLOW THE NUMBER OF CABLES TO BE PLACED INSIDE OF IT.
- 11.NO CONNECTION TO AN ACTIVE LIGHTING CIRCUIT WILL BE BROKEN UNTIL THE CIRCUIT HAS BEEN TURNED OFF IN ACCORDANCE WITH NOTE 1.

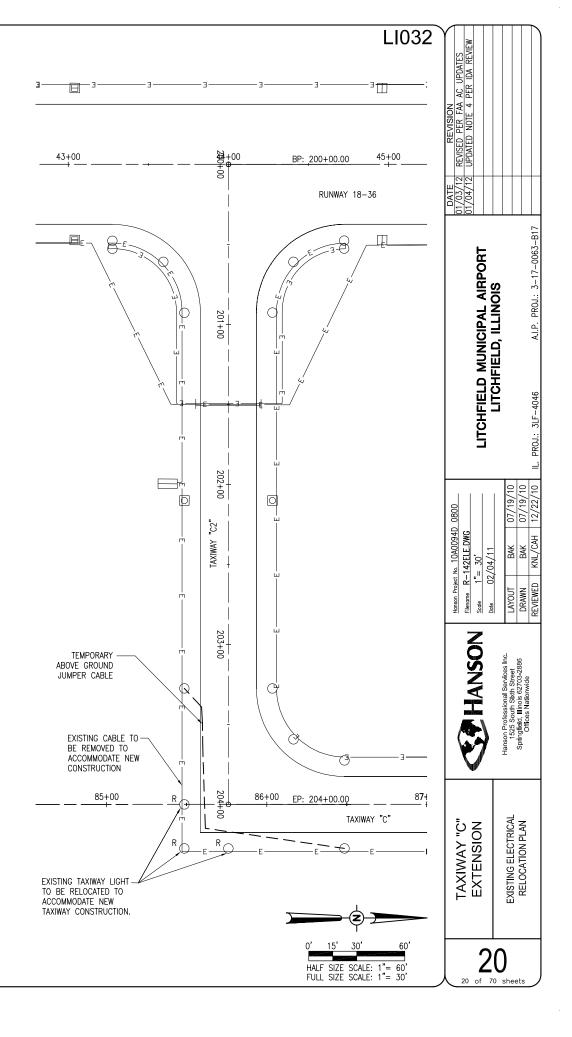


CADD\AIRPORT\SHEET\R-142ELE.DWG - EXISTING ELECTRICAL RELOCATION


2012 10:27 AM HAGLOUGSSZ SS/ITCHEIEI DY 10AAOGA/ CADD AIRDORT/ SHEET/ P—143EI F DWG — EXIS

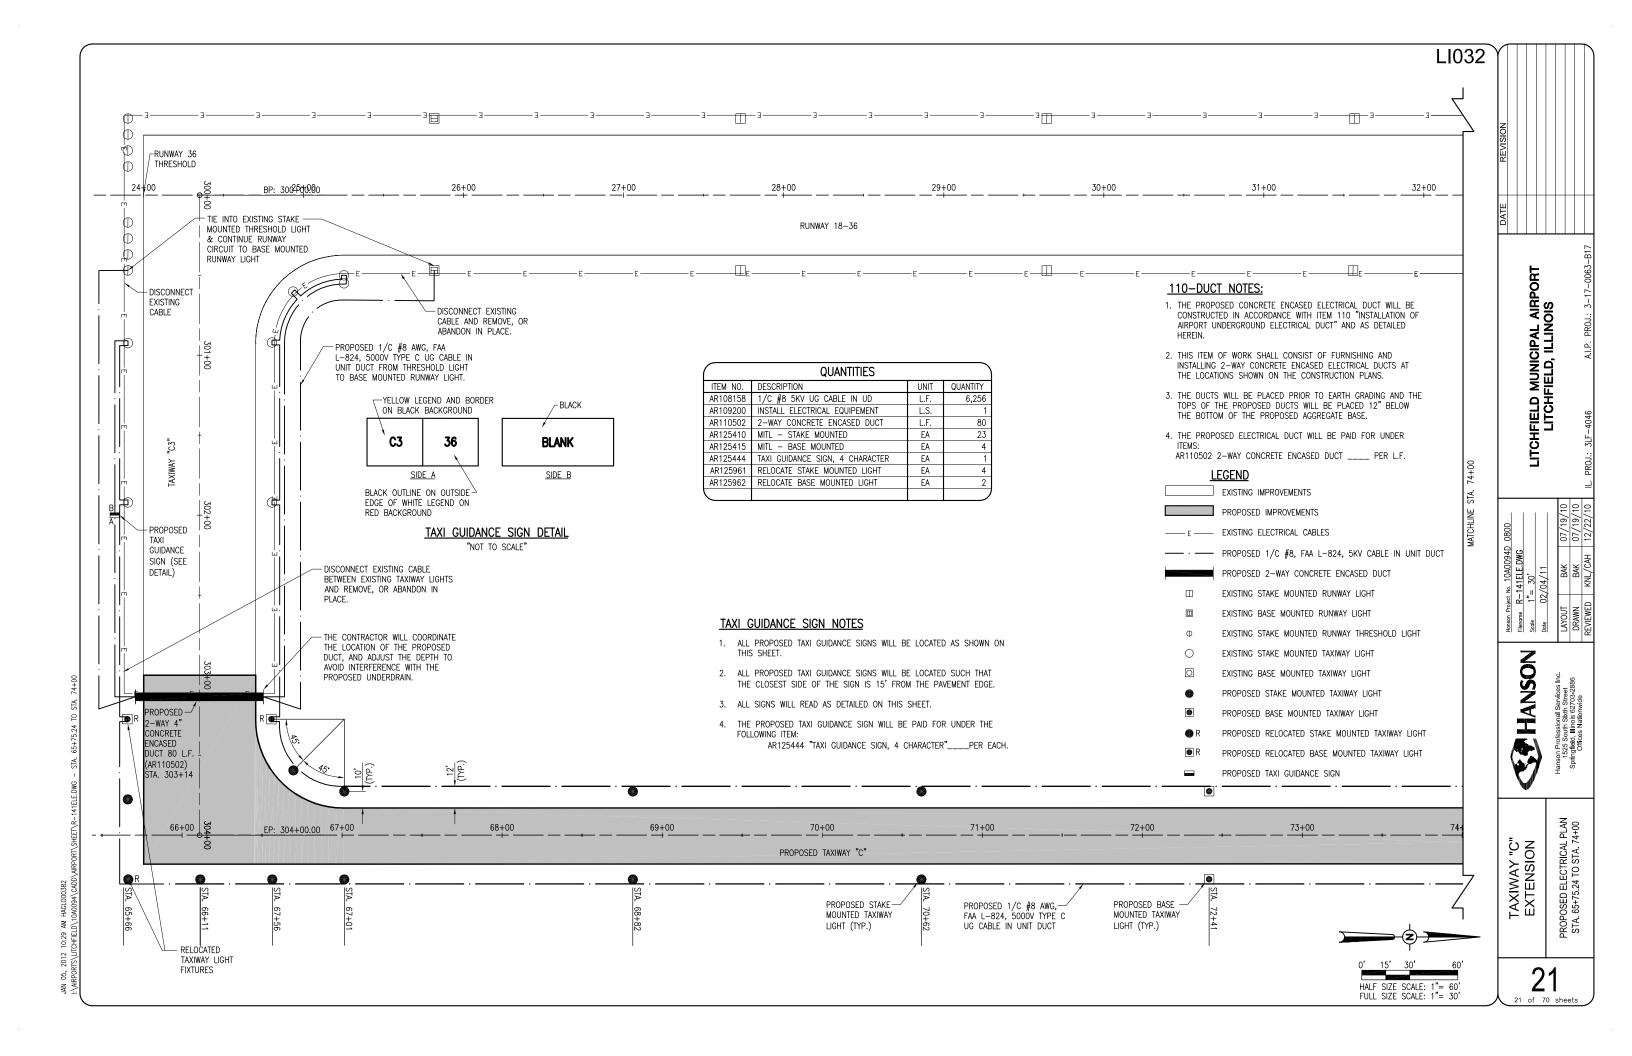


IAN US, 2012 10:31 AM HAGLUOUSSZ Naponpisylinchenin/innanga/Caph/Amponpi/Shefty P=14/file DWC = STA 24+00 TO STA 8:

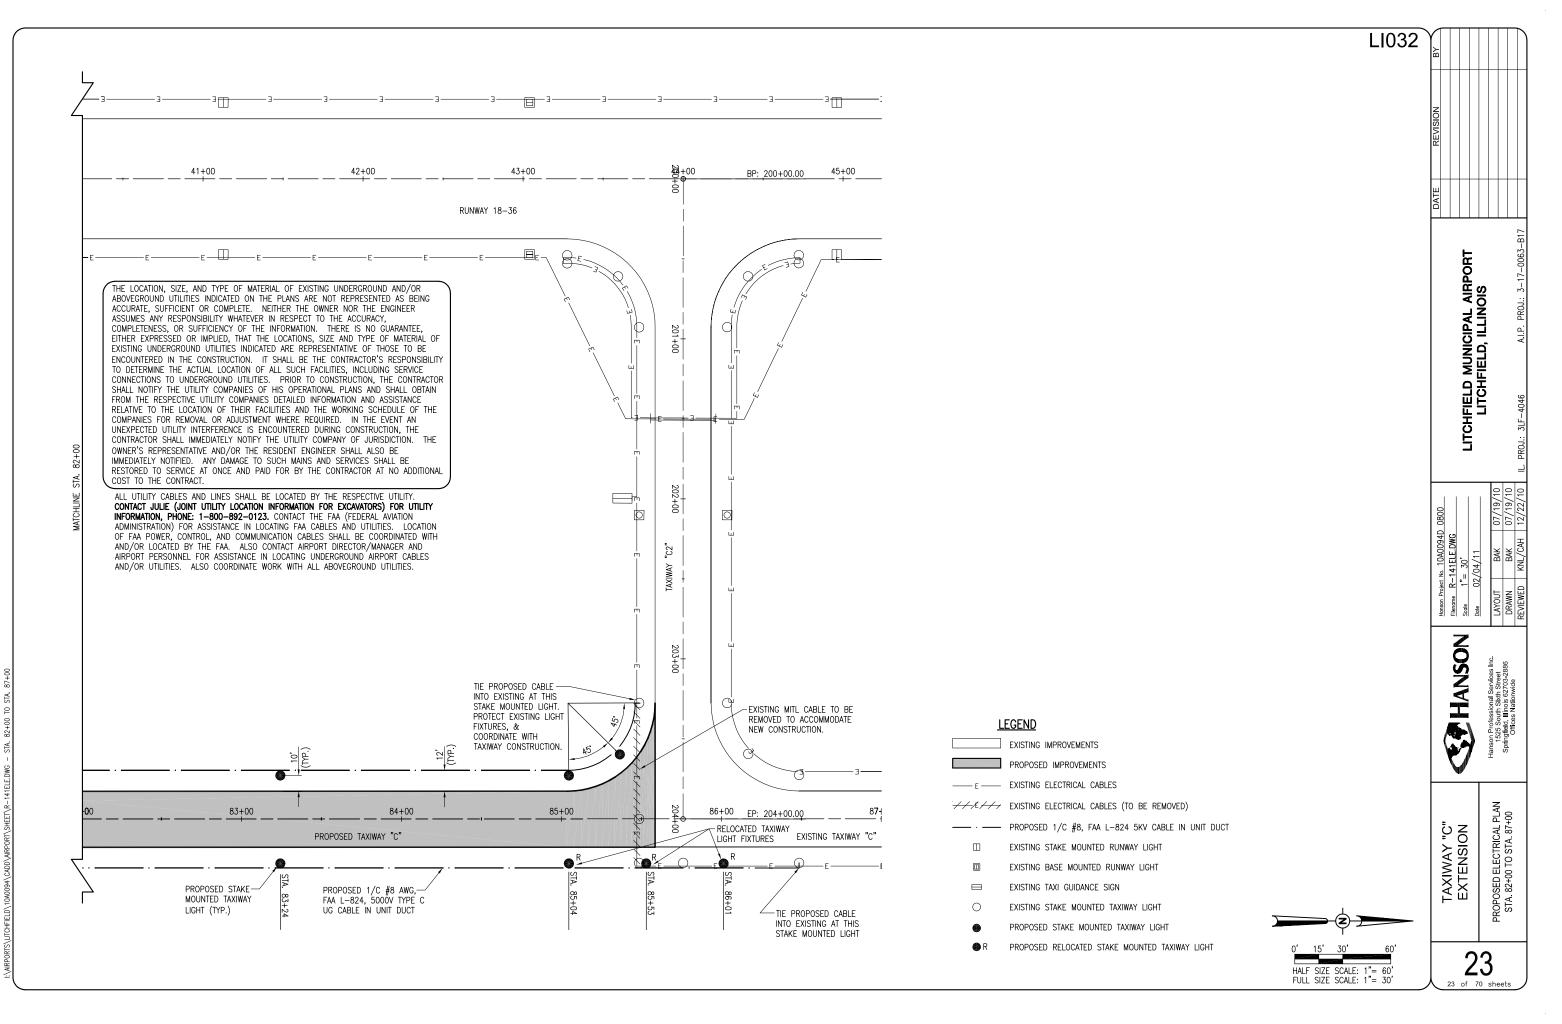

4R 14, 2011 9:13 AM HAGLO00382

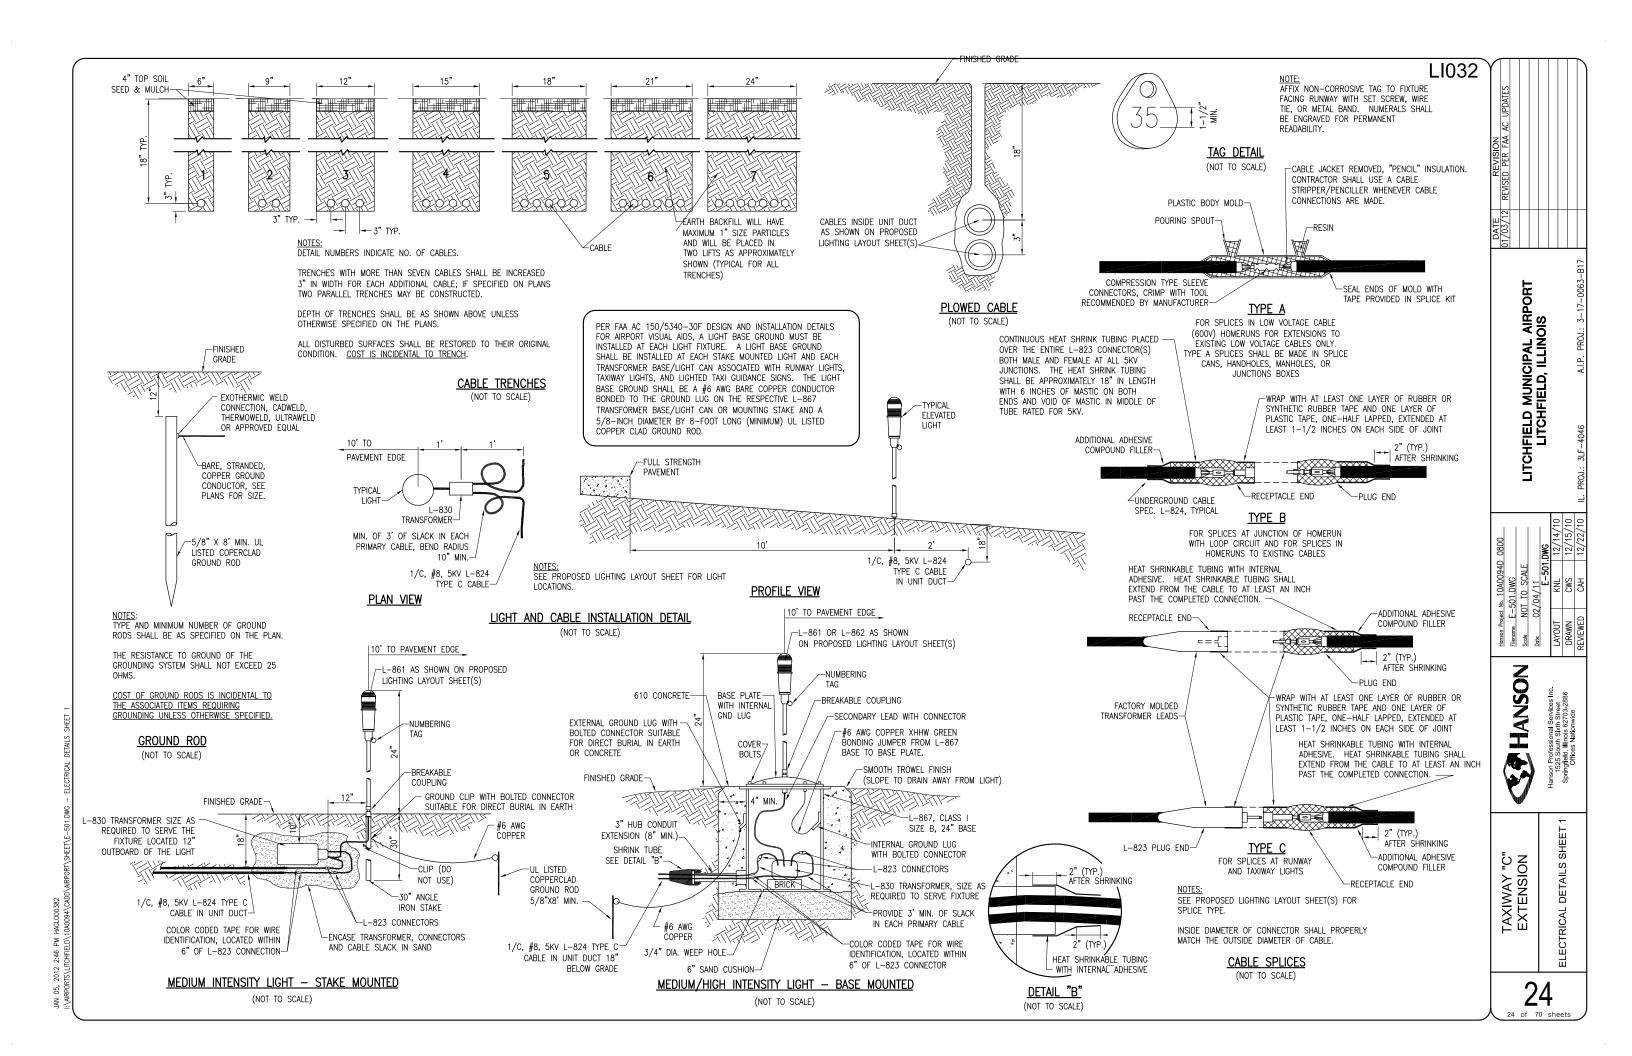

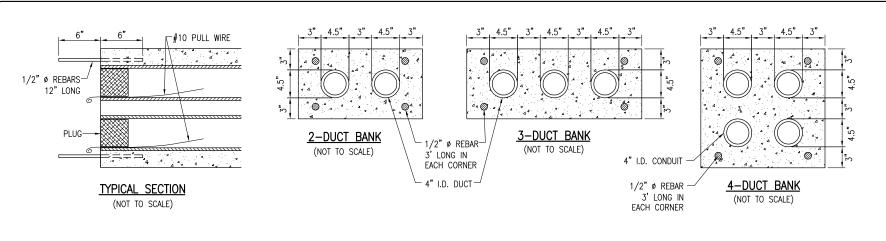

-DUCT BANK SHALL TRANSITION TO (OR BE)

AT INTERFACE TO HANDHOLE.

REINFORCED CONCRETE ENCASED DUCT WHERE

3 FT. MIN. BEYOND HANDHOLE. DIRECT BURY

DUCT (WITHOUT CONCRETE ENCASEMENT) DOES

NOT RÈQUIRE REBAR & CONCRETE ENCASEMENT

-#3 TIE BARS.


#4 REBAR.

# TOP VIEW PRESTAMPED OR-CHISELED ON THE JOB DUCT (%" HIGH LETTERING MIN.) 3/16" R. ENTERING A HANDHOLE. PROVIDE REINFORCEMENT 0.15"--

# BITUMINOUS PAVEMENT DUCT MARKERS "NOT TO SCALE

INDICATES NUMBER AND SIZE OF DUCT BANK

- TOP OF MARKER SHALL BE FLUSH WITH FINISHED PAVEMENT SURFACE. MARKER MAY BE INSTALLED IN A DRILLED HOLE AND SECURED WITH EPOXY GLUE.
- 2. BRASS DUCT MARKERS ARE AVAILABLE FROM G & S FOUNDRY & MANUFACTURER CO., INC., 210 KASKASKIA DRIVE, RED BUD, IL. 62278, PHONE: (618) 282-4114.

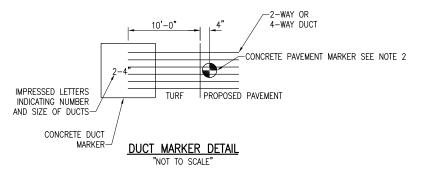


# **DUCT BANK NOTES:**

- 1. DIMENSIONS FOR CONCRETE COVERAGE AND SEPARATION BETWEEN DUCTS ARE MINIMUM.
- 2. INCLUDE DUCT SPACERS AS MANUFACTURED BY UNDERGROUND DEVICES INC., OR APPROVED EQUAL TO MAINTAIN PROPER SEPARATION OF CONDUITS
- 3. REBAR IS REQUIRED TO ACCOMMODATE FUTURE DUCT EXTENSIONS & INTERFACE AT DUCT BANK TERMINATIONS. CONCRETE ENCASED DUCT BANKS TERMINATING IN HANDHOLES REQUIRE REBAR AT TERMINATIONS.
- 4. CONDUITS FOR CONCRETE ENCASED DUCT SHALL BE SCHEDULE 40 PVC CONFORMING TO ITEM 110.
- 5. MINIMUM DEPTH OF TOP OF DUCT ENCASEMENT SHALL BE 18" BELOW FINISHED GRADE.
- 6. HIGH VOLTAGE AND LOW VOLTAGE CIRCUITS SHALL NOT BE INSTALLED IN THE SAME RACEWAY, CONDUIT, DUCT, HANDHOLE, OR MANHOLE,
- 7. HOMERUN CABLES FOR A RESPECTIVE CIRCUIT SHALL BE INSTALLED IN THE SAME RACEWAY OR DUCT.
- 8. DUCT INTERFACE TO HANDHOLES OR MANHOLES WILL BE CONSIDERED INCIDENTAL TO THE RESPECTIVE DUCT PAY


# CABLE & DUCT MARKER NOTES:

- 1. THE COST OF ALL TURF AND PAVEMENT DUCT MARKERS SHALL BE INCIDENTAL TO THE DUCT. THE COST OF ALL CABLE MARKERS SHALL BE INCIDENTAL TO THE CABLE.
- 2. BITUMINOUS PAVEMENT DUCT MARKER AND CONCRETE DUCT MARKER TO BE PROVIDED AT EACH END OF EACH DUCT AS SHOWN ON THE LOCATION PLAN. FOR CONCRETE PAVEMENT. THE LETTER "D" SHALL BE IMPRESSED IN THE PAVEMENT INSTEAD OF THE MARKER. THE LETTER SHALL BE FORMED AS DESCRIBED IN NOTE 4.
- 3. CABLE MARKERS SHALL BE PLACED AT CHANGES OF DIRECTION AND APPROXIMATELY EVERY 200' ALONG CABLE
- 4. CONCRETE CABLE MARKERS AND DUCT MARKERS SHALL HAVE LETTERS 4" HIGH, 3" WIDE WITH WIDTH OF STROKE ½" AND ¼" DEEP. ALL LETTERS, NUMBERS AND ARROWS

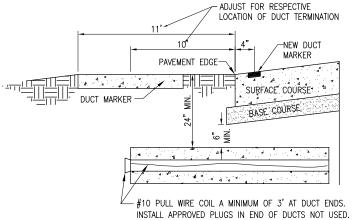


# UNDERGROUND ELECTRICAL DUCT

(NOT TO SCALE)



"NOT TO SCALE"



CONTRACTORS OPTION.

SMOOTH TROWEL FINISH

(SLOPE TO DRAIN)

6" SCHED 40 PVC DRAIN

PIPE. FILL WITH PEA GRAVEL

TO ACCOMODATE DRAINAGE. NOTE 6" OF CA-7 GRAVEL

MAY BE PROVIDED, INSTEAD

OF 6" CONCRETE FLOOR

NOTES:

**ELECTRICAL HANDHOLE** 

ADDITIONAL COMPENSATION WILL BE ALLOWED.

 $\bigcirc$  $\bigcirc$ 

 $\bigcirc$ 

6" SAND CUSHION

LIDS FOR LOW VOLTAGE HANDHOLES SHALL BE LABELED "LOW VOLTAGE". LIDS FOR HIGH VOLTAGE

HANDHOLES MAY BE CAST IN PLACE OR PRECAST. PRECAST MANUFACTURERS MUST BE ON THE IDOT (ILLINOIS DEPT. OF TRANSPORTATION) APPROVED LIST OF CERTIFIED PRECAST CONCRETE PRODUCERS.

ALL CORING, INTERFACE, AND LABOR ASSOCIATED WITH CONDUIT, DUCT, CABLE IN UNIT DUCT, AND / OR

CABLE ENTRIES WILL BE CONSIDERED INCIDENTAL TO THE INSTALLATION OF THE HANDHOLE AND NO

HANDHOLES SHALL BE LABELED "HIGH VOLTAGE". COORDINATE LETTERING WITH MFR.

LI032

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

TAXIWAY "C" EXTENSION

25

-EXTEND NO. 4 REBAR INTO HANDHOLE APPROX 3". PROVIDE 90" "L" HOOK

ON REBAR TERMINATION IN HANDHOLE

PROVIDE CONDUIT BUSHING OR BELL

AT TERMINATION IN HANDHOLE (TYP.)

(TYP.) OR EXTEND REBAR EPOXY ANCHORED INTO HANDHOLE WITH 4"

EMBEDMENT.

-WAY, 3-WAY, OR 4-WAY

DUCT BANK AS APPLICABLE

ADD "HIGH" OR "LOW" PER PLANS


-WAY, 3-WAY, OR 4-WAY

DUCT BANK AS APPLICABLE

HEAVY DUTY FRAME & LID SUITABLE FOR

-610 P.C.C.


H-20 LOADING, NEENAH CAT. NO.

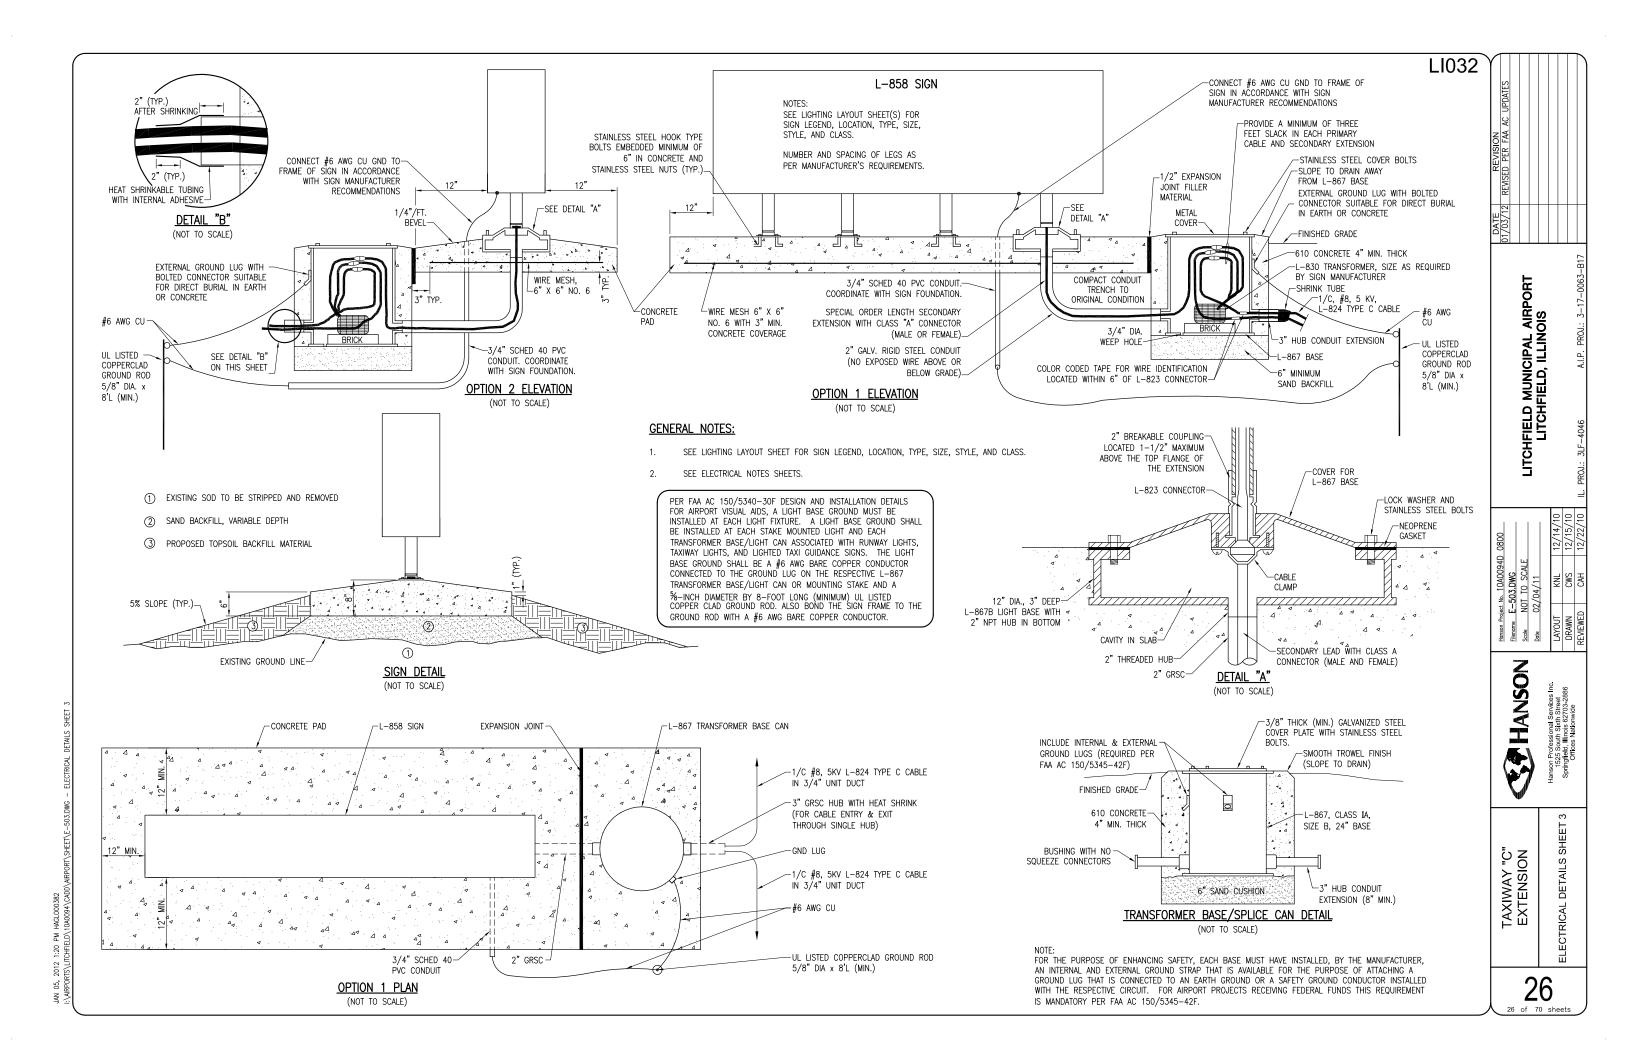

(NOT TO SCALE)

# <u>NOTES</u>

- GROUNDING FOR RUNWAY LIGHTS, TAXIWAY LIGHTS, AND LIGHTED TAXI GUIDANCE SIGNS SHALL BE AS DETAILED ON THE PLANS AND AS SPECIFIED HEREIN. PER FAA AC 150/5340-30F DESIGN AND INSTALLATION DETAILS FOR AIRPORT VISUAL AIDS. CHAPTER 12. PART 12.6; A GROUND MUST BE INSTALLED AT EACH LIGHT FIXTURE. THE PURPOSE OF THE LIGHT BASE GROUND IS TO PROVIDE A DEGREE OF PROTECTION FOR MAINTENANCE PERSONNEL FROM POSSIBLE CONTACT WITH AN ENERGIZED LIGHT BASE OR MOUNTING STAKE THAT MAY RESULT FROM A SHORTED POWER CABLE OR ISOLATION TRANSFORMER. A LIGHT BASE GROUND SHALL BE INSTALLED AT EACH TRANSFORMER BASE/LIGHT CAN ASSOCIATED WITH RUNWAY LIGHTS, TAXIWAY LIGHTS, AND LIGHTED TAXI GUIDANCE SIGNS. A LIGHT BASE GROUND SHALL ALSO BE INSTALLED AT EACH STAKE MOUNTED LIGHT FIXTURE. A LIGHT BASE GROUND SHALL BE INSTALLED AND CONNECTED TO THE METAL FRAME OF EACH TAXI GUIDANCE SIGN AS DETAILED ON THE PLANS AND IN ACCORDANCE WITH THE RESPECTIVE TAXI GUIDANCE SIGN MANUFACTURER RECOMMENDATIONS. THE LIGHT BASE GROUND SHALL BE A #6 AWG BARE COPPER CONDUCTOR BONDED TO THE GROUND LUG ON THE RESPECTIVE L-867 TRANSFORMER BASE/LIGHT CAN OR MOUNTING STAKE AND A 5/8-INCH DIAMETER BY 8-FEET LONG (MINIMUM) UL LISTED COPPER CLAD GROUND ROD. CONNECTIONS TO GROUND LUGS ON THE L-867 TRANSFORMER BASE/LIGHT CAN OR MOUNTING STAKE SHALL BE WITH A UL LISTED GROUNDING CONNECTOR. CONNECTIONS TO GROUND RODS SHÁLL BE MADE WITH EXOTHERMIC WELD TYPE CONNECTORS, CADWELD BY ERICO PRODUCTS, INC., SOLON, OHIO, (PHONE: 800-248-9353), THERMOWELD BY CONTINENTAL INDUSTRIES, INC., TULSA, OKLAHOMA (PHONE: 918-663-1440), ULTRAWELD BY HARGER, GRAYSLAKE, ILLINOIS (PHONE: 800-842-7437), OR APPROVED EQUAL. EXOTHERMIC WELD CONNECTIONS SHALL BE INSTALLED IN CONFORMANCE WITH THE RESPECTIVE MANUFACTURER'S DIRECTIONS USING MOLDS AS REQUIRED FOR EACH RESPECTIVE APPLICATION. BOLTED CONNECTIONS WILL NOT BE PERMITTED AT GROUND RODS. TOP OF GROUND RODS SHALL BE BURIED 12 INCHES MINIMUM BELOW GRADE, UNLESS SPECIFIED OTHERWISE HEREIN, FOR RESPECTIVE
- FOR BASE MOUNTED LIGHT FIXTURES THE LIGHT FIXTURE MUST BE BONDED TO THE LIGHT BASE INTERNAL GROUND LUG VIA A #6 AWG STRANDED COPPER WIRE RATED FOR 600 VOLTS WITH GREEN XHHW OR USE INSULATION. THE GROUND WIRE LENGTH MUST BE SUFFICIENT TO ALLOW THE REMOVAL OF THE LIGHT FIXTURE FROM THE LIGHT BASE FOR ROUTINE MAINTENANCE. SEE THE LIGHT FIXTURE MANUFACTURER'S INSTRUCTIONS FOR PROPER METHODS OF ATTACHING A BONDING WIRE.
- FOR TAXIWAY LIGHTS THAT ARE SPACED WITH LESS THAN 10 FEET OF SEPARATION BETWEEN THEM PROVIDE ONE 5/8-INCH DIAMETER BY 8-FOOT LONG GROUND ROD PER TWO ADJACENT TAXIWAY LIGHTS.
- 4. STEEL USED TO MANUFACTURE GROUND RODS SHALL BE 100% DOMESTIC STEEL.

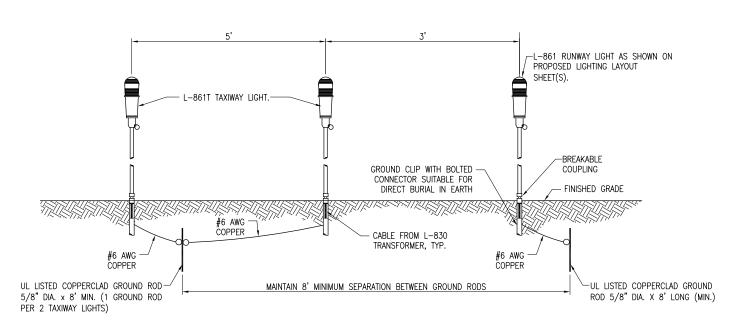

(NOT TO SCALE)

GROUNDING DETAIL FOR ADJACENT RUNWAY AND TAXIWAY LIGHTS (NOT TO SCALE)

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

TAXIWAY "C" EXTENSION

LI032

- CONTRACTOR SHALL KEEP A COPY OF THE LATEST NEC IN FORCE ON SITE AT ALL TIMES DURING CONSTRUCTION FOR USE AS A REFERENCE.
- CONTRACTOR SHALL COORDINATE WORK AND ANY POWER OUTAGES AND/OR SHUT DOWN OF SYSTEMS WITH THE RESPECTIVE FACILITY OWNER PERSONNEL AND THE AIRPORT MANAGER/DIRECTOR. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- THE CONTRACTOR SHALL ASCERTAIN THAT ALL LIGHTING SYSTEM COMPONENTS FURNISHED BY HIM, INCLUDING FAA APPROVED EQUIPMENT, ARE COMPATIBLE IN ALL RESPECTS WITH EACH OTHER AND THE REMAINDER OF THE NEW/EXISTING SYSTEM. ANY NONCOMPATIBLE COMPONENTS FURNISHED BY THIS CONTRACTOR SHALL BE REPLACED BY HIM AT NO ADDITIONAL COST TO THE AIRPORT SPONSOR WITH A SIMILAR UNIT, APPROVED BY THE ENGINEER (DIFFERENT MODEL OR DIFFERENT MANUFACTURER) THAT IS COMPATIBLE WITH THE REMAINDER OF THE AIRPORT LIGHTING SYSTEM.
- IN CASE THE CONTRACTOR ELECTS TO FURNISH AND INSTALL AIRPORT LIGHTING EQUIPMENT REQUIRING ADDITIONAL WIRING, TRANSFORMERS, ADAPTORS, MOUNTINGS, ETC., TO THOSE SHOWN ON THE DRAWINGS AND/OR LISTED IN THE SPECIFICATION, ANY COST FOR THESE ITEMS SHALL BE INCIDENTAL TO THE
- THE CONTRACTOR INSTALLED EQUIPMENT (INCLUDING FAA APPROVED) SHALL NOT GENERATE ANY ELECTROMAGNETIC INTERFERENCE IN THE EXISTING AND/OR NEW COMMUNICATIONS, WEATHER, AIR NAVIGATION, AND AIR TRAFFIC CONTROL
  EQUIPMENT. ANY EQUIPMENT GENERATING SUCH INTERFERENCE SHALL BE
  REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST WITH THE EQUIPMENT
  MEETING THE APPLICABLE SPECIFICATIONS AND NOT GENERATING ANY
- WHEN A SPECIFIC TYPE, STYLE, CLASS, ETC. OF FAA APPROVED EQUIPMENT IS SPECIFIED ONLY THAT TYPE, STYLE, CLASS, WILL BE ACCEPTABLE, EVEN THOUGH EQUIPMENT OF OTHER TYPES STYLES, CLASSES, ETC. MAY BE APPROVED.
- ANY AND ALL INSTRUCTIONS FROM THE RESIDENT ENGINEER TO THE CONTRACTOR REGARDING CHANGES IN OR DEVIATIONS FROM THE PLANS AND SPECIFICATIONS SHALL BE IN WRITING WITH COPIES SENT TO THE AIRPORT SPONSOR AND THE ILLINOIS DEPARTMENT OF TRANSPORTATION DIVISION OF AERONAUTICS. THE ILLINOIS DEPARTMENT OF TRANSPORTATION DIVISION OF AERONAUTICS. THE CONTRACTOR SHALL NOT ACCEPT ANY VERBAL INSTRUCTIONS FROM THE RESIDENT ENGINEER REGARDING ANY CHANGES FROM THE PLANS AND SPECIFICATIONS.
- A MINIMUM OF THREE COPIES OF THE INSTRUCTION BOOK SHALL BE SUPPLIED WITH EACH DIFFERENT TYPE OF EQUIPMENT. THE BOOKS DESCRIBING A MORE SOPHISTICATED TYPE OF EQUIPMENT, SUCH AS REGULATORS, PAPI, REIL, ETC. AS A MINIMUM SHALL CONTAIN THE FOLLOWING:
  - A DETAILED DESCRIPTION OF THE OVERALL EQUIPMENT AND ITS INDIVIDUAL
  - THEORY OF OPERATION INCLUDING THE FUNCTION OF EACH COMPONENT
  - INSTALLATION INSTRUCTION
  - START-UP INSTRUCTIONS.
  - PREVENTATIVE MAINTENANCE REQUIREMENTS.
  - CHART FOR TROUBLE-SHOOTING.
  - COMPLETE POWER AND CONTROL DETAILED WIRING DIAGRAM(S). SHOWING EACH CONDUCTOR/CONNECTION/COMPONENT - "BLACK" BOXES ARE NOT ACCEPTABLE. THE DIAGRAM OF THE NARRATIVE SHALL SHOW VOLTAGE/CURRENTS/WAVE SHAPES AT STRATEGIC LOCATIONS TO BE USED WHEN CHECKING AND/OR TROUBLE-SHOOTING THE EQUIPMENT. WHEN THE EQUIPMENT HAS SEVERAL MODES OF OPERATION, SUCH AS SEVERAL BRIGHTNESS STEPS, THESE PARAMETERS SHALL BE INDICATED FOR ALL DIFFERENT MODES.
  - PARTS LIST WHICH WILL INCLUDE ALL MAJOR AND MINOR COMPONENTS SUCH AS RESISTORS, DIODES, ETC. IT SHALL INCLUDE A COMPLETE NOMENCLATURE OF EACH COMPONENT AND, IF APPLICABLE, THE NAME OF ITS MANUFACTURER AND THE CATALOG NUMBER.
  - SAFETY INSTRUCTIONS.

# POWER AND CONTROL NOTES

- PROVIDE LEGEND PLATES FOR ALL ELECTRICAL EQUIPMENT TO IDENTIFY FUNCTION, CIRCUIT VOLTAGE AND PHASE. WHERE THE EQUIPMENT CONTAINS FUSES, ALSO IDENTIFY THE FUSE OR FUSE LINK AMPERE RATING. WHERE THE EQUIPMENT DOES NOT HAVE SUFFICIENT AREA TO INSTALL LEGEND PLATES, THE LEGEND PLATES SHALL BE INSTALLED ON THE WALL NEXT TO THE UNIT. LEGEND PLATES SHALL BE WEATHERPROOF ENGRAVED PLASTIC OR PHENOLIC MATERIAL, 1/4" HIGH BLACK LETTERS ON A WHITE BACKGROUND UNLESS NOTED OTHERWISE. SECURE WITH WEATHERPROOF ADHESIVE AND MACHINE SCREWS. FURNISH ADDITIONAL LEGEND PLATES WHERE REQUIRED BY CODE, FOR ADDITIONAL EQUIPMENT, AS DETAILED HEREIN ON THE PLANS, AND AS NOTED IN THE SPECIAL PROVISION SPECIFICATIONS.
- 2. COLOR CODE ALL PHASE WIRING BY THE USE OF COLORED WIRE INSULATION AND/OR COLORED TAPE. WHERE TAPE IS USED, THE WIRE INSULATION SHALL BE BLACK. BLACK AND RED SHALL BE USED FOR PHASE CONDUCTORS ON 120/240VAC SINGLE-PHASE, THREE WIRE SYSTEMS AND BLACK, ORANGE (FOR HIGH LEG) AND BLUE SHALL BE USED FOR PHASE CONDUCTORS ON 240/120VAC THREE-PHASE, FOUR WIRE SYSTEMS, NEUTRAL CONDUCTORS, SIZE NO. 6 AWG OR SMALLER, SHALL BE IDENTIFIED BY A CONTINUOUS WHITE OR NATURAL GRAY OUTER FINISH ALONG ITS ENTIRE LENGTH. NEUTRAL CONDUCTORS LARGER THAN NO. 6 AWG SHALL BE IDENTIFIED EITHER BY A CONTINUOUS WHITE OR NATURAL GRAY OUTER FINISH ALONG ITS ENTIRE LENGTH OR BY THE USE OF WHITE TAPE AT ITS TERMINATIONS AND INSIDE ACCESSIBLE WIREWAYS. INSULATED GROUND CONDUCTORS SHALL HAVE GREEN COLORED INSULATION FOR ALL CONDUCTOR SIZES (AWG OR KCMIL).
- ALL BRANCH CIRCUIT CONDUCTORS CONNECTED TO A PARTICULAR PHASE SHALL BE IDENTIFIED WITH THE SAME COLOR. THE COLOR CODING SHALL BE EXTENDED TO THE POINT OF UTILIZATION
- 4. IN CONTROL WIRING THE SAME COLOR SHALL BE USED THROUGHOUT THE SYSTEM FOR THE SAME FUNCTION, SUCH AS 10%, 30%, 100% BRIGHTNESS CONTROL,
- LOW VOLTAGE (600 V.) AND HIGH VOLTAGE (5000 V.) CONDUCTORS SHALL BE INSTALLED IN SEPARATE WIREWAYS.
- NEATLY LACE WIRING IN DISTRIBUTION PANELS, WIREWAYS, SWITCHES AND
- THE MINIMUM SIZE OF PULL/JUNCTION BOXES, REGARDLESS OF THE QUANTITY AND SIZE OF THE CONDUCTORS SHOWN, SHALL BE AS FOLLOWS:
  - IN STRAIGHT PULLS THE LENGTH OF THE BOX SHALL NOT BE LESS THAN EIGHT TIMES THE TRADE DIAMETER OF THE LARGER CONDUIT. THE TOTAL AREA (INCLUDING THE CONDUIT CROSS-SECTIONAL AREA) OF A BOX END SHALL BE AT LEAST 3 TIMES GREATER THAN THE TOTAL TRADE CROSS-SECTIONAL AREA OF THE CONDUITS TERMINATING AT THE END.
  - IN ANGLE PULLS OR 'U' PULLS THE DISTANCE BETWEEN EACH CONDUIT ENTRY INSIDE THE BOX AND THE OPPOSITE WALL OF THE BOX SHALL NOT BE LESS THAN SIX (6) TIMES THE TRADE DIAMETER OF THE LARGEST CONDUIT. THIS DISTANCE SHALL BE INCREASED FOR ADDITIONAL ENTRIES BY THE AMOUNT OF THE SUM OF THE DIAMETERS OF ALL OTHER CONDUIT ENTRIES ON THE SAME WALL AS THE BOX. THE DISTANCE BETWEEN CONDUIT ENTRIES ENCLOSING THE SAME CONDUCTOR SHALL NOT BE LESS THAN SIX TIMES THE TRADE DIAMETER OF THE LARGEST CONDUIT.
- A RUN OF CONDUIT BETWEEN TERMINATIONS AT EQUIPMENT ENCLOSURES, SQUARE DUCTS AND PULL/JUNCTION BOXES, SHALL NOT CONTAIN MORE THAN THE EQUIVALENT OF FOUR QUARTER BENDS (360 DEGREES TOTAL), INCLUDING THOSE BENDS LOCATED IMMEDIATELY AT THE TERMINATIONS, CAST, CONDUIT TYPE OUTLETS SHALL NOT BE TREATED AS PULL/JUNCTION BOXES.
- EQUIPMENT CABINETS SHALL NOT BE USED AS PULL/JUNCTION BOXES. ONLY WIRING TERMINATING AT THE EQUIPMENT SHALL BE BROUGHT INTO THESE
- SPLICES AND JUNCTION POINTS SHALL BE PERMITTED ONLY IN JUNCTION BOXES, DUCTS EQUIPPED WITH REMOVABLE COVERS, AND AT EASILY ACCESSIBLE
- CIRCUIT BREAKERS IN POWER DISTRIBUTION PANEL(S) SHALL BE THERMAL—MAGNETIC MOLDED CASE, PERMANENT TRIP WITH 100 AMPERE, MINIMUM
- DUAL LUGS SHALL BE USED WHERE TWO (2) WIRES, SIZE NO. 6 OR LARGER, ARE TO BE CONNECTED TO THE SAME TERMINAL
- ALL INTERIOR WALL MOUNTED EQUIPMENT ENCLOSURES SHALL BE MOUNTED ON HOT DIPPED GALVANIZED STEEL STRUT SUPPORT, OR STAINLESS STEEL STRUT SUPPORT, WITH CORROSION RESISTANT HARDWARE.
- SUPPORT FOR EXTERIOR MOUNTED EQUIPMENT SHALL USE HOT DIPPED GALVANIZED STEEL STRUT SUPPORT OR STAINLESS STEEL STRUT SUPPORT WITH STAINLESS STEEL HARDWARE. PROVIDE ZINC RICH PAINT APPLIED TO FIELD CUTS OF GALVANIZED STEEL SUPPORT TO MINIMIZE THE POTENTIAL FOR CORROSION PER THE RESPECTIVE STRUT SUPPORT MANUFACTURER'S RECOMMENDATIONS.

- 16. PROVIDE LIQUID TIGHT FLEXIBLE METAL CONDUIT AT CONNECTIONS TO EQUIPMENT SUBJECT TO VIBRATION OR WHERE FLEXIBILITY IS REQUIRED. LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE U.L. LISTED TO MEET THE REQUIREMENTS OF NEC 350.6, SUITABLE FOR GROUNDING, SUNLIGHT RESISTANT, AND RESISTANT TO OIL, GASOLINE, AND GREASE. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO MOTORS, TRANSFORMERS, & CONSTANT CURRENT REGULATORS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.60. DO NOT INSTALL LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS NOT UL. LISTED. CONFIRM LIQUID—TIGHT FLEXIBLE METAL CONDUIT BEARS THE UL LABEL PRIOR TO INSTALLING IT.
- UNLESS OTHERWISE SHOWN, ALL EXPOSED CONDUITS SHALL BE RUN PARALLEL TO OR AT RIGHT ANGLES WITH THE LINES OF THE STRUCTURE.
- 18. ALL STEEL CONDUITS, FITTINGS, NUTS, BOLTS, ETC. SHALL BE GALVANIZED.
- USE CONDUIT BUSHINGS AT EACH CONDUIT TERMINATION. WHERE NO. 4 AWG OR LARGER UNDERGROUND WIRE IS INSTALLED, USE INSULATED BUSHINGS.
- 20. USE DOUBLE LOCK NUTS AT EACH CONDUIT TERMINATION.
- 21. WRAP ALL PRIMARY AND SECONDARY POWER TRANSFORMER CONNECTIONS WITH SUFFICIENT LAYERS OF INSULATING TAPE (3M SCOTCH 23 ALL-VOLTAGE SPLICING TAPE, 3M SCOTCH 130C LINERLESS RUBBER SPLICING TAPE, OR APPROVED EQUAL) AND COVER WITH VINYL ELECTRICAL TAPE (3M SCOTCH 88 VINYL ELECTRICAL TAPE OR APPROVED EQUAL) FOR FULL VALUE OF CABLE INSULATION
- 22. UNLESS OTHERWISE NOTED, ALL SINGLE CONDUCTOR CONTROL WIRING SHALL BE NO. 12 AWG. COPPER MINUMUM.
- 23. THE FOLLOWING SHALL APPLY TO RELAY/CONTACTOR PANELS/ENCLOSURES:
  - FOR INTERIOR LOCATIONS ALL COMPONENTS SHALL BE MOUNTED IN NEMA 12 (DUST TIGHT) ENCLOSURE(S) WITH VERTICALLY HINGED COVERS. FOR EXTERIOR/OUTDOOR LOCATIONS ALL COMPONENTS SHALL BE MOUNTED IN NEMA 4X STAINLESS STEEL ENCLOSURE(S) WITH VERTICALLY HINGED COVERS. ALL CONDUIT ENTRIES INTO NEMA 4, 4X ENCLOSURES SHALL HAVE NEMA 4 HUBS LISTED SUITABLE FOR THE RESPECTIVE ENCLOSURE TO MAINTAIN THE NEMA 4, 4X RATING OF THE ENCLOSURE.
  - THE ENCLOSURE(S) SHALL HAVE AMPLE SPACE FOR THE CIRCUIT COMPONENTS, TÈRMINAL BLOCKS AND INCOMING AND INTERNAL WIRING.
  - ALL CONTROL CONDUCTOR TERMINATIONS SHALL BE OF THE OPEN-EYE CONNECTOR/SCREW TYPE. SOLDERED CLOSED—EYE TERMINATIONS, OR TERMINATIONS WITHOUT CONNECTORS ARE NOT ACCEPTABLE.
  - WHEN THE ENCLOSURE COVER IS OPENED, ALL CIRCUIT COMPONENTS, WIRING AND TERMINALS SHALL BE EXPOSED AND ACCESSIBLE WITHOUT REMOVAL OF ANY PANELS, COVERS, ETC., EXCEPT THOSE COVERING HIGH VOLTAGE COMPONENTS.
  - ACCESS TO, OR REMOVAL OF A CIRCUIT COMPONENT OR TERMINAL BLOCK WILL NOT REQUIRE THE REMOVAL OF ANY OTHER CIRCUIT COMPONENT OR
  - F. EACH CIRCUIT COMPONENT SHALL BE CLEARLY IDENTIFIED INDICATING ITS CORRESPONDING NUMBER SHOWN ON THE DRAWINGS AND ITS FUNCTION.
  - A COMPLETE WIRING DIAGRAM SHALL BE MOUNTED ON THE INSIDE OF THE COVER. THE DIAGRAM SHALL REPRESENT EACH CONDUCTOR BY A SEPARATE
  - THE DIAGRAM SHALL IDENTIFY EACH CIRCUIT COMPONENT AN NUMBERING AND COLOR OF EACH TERMINAL CONDUCTOR AND TERMINAL.
  - ALL WIRING SHALL BE NEATLY TRAINED AND LACED.
  - MINIMUM WIRE SIZE SHALL BE NO. 12 AWG.
- 24. FURNISH & INSTALL A WEATHERPROOF WARNING LABEL FOR EACH METER SOCKET, SERVICE DISCONNECT, SAFETY SWITCH, CUTOUT, PANELBOARD, & CONTROL PANEL TO WARN PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS, PER THE REQUIREMENTS OF NEC 110.16 "FLASH PROTECTION".

## AIRFIELD LIGHTING NOTES

- UNLESS OTHERWISE NOTED, ALL UNDERGROUND AIRFIELD LIGHTING SERIES CIRCUIT CONDUCTORS WHETHER DEB OR IN DUCT/CONDUIT SHALL BE FAA APPROVED 5000 VOLT L-824 TYPE. ALL UNDERGROUND FIELD POWER LOW VOLTAGE (600 VOLT & BELOW) CIRCUIT CONDUCTORS WHETHER DEB OR IN DUCT/CONDUIT SHALL BE UL LISTED 600 VOLT, TYPE XLP-USE-2 COPPER CONDUCTORS. CONDUCTOR SIZES SHALL BE AS SPECIFIED, HEREIN.
- NO COMPONENTS OF PRIMARY CIRCUIT SUCH AS CABLE, CONNECTORS AND TRANSFORMERS SHALL BE BROUGHT ABOVE GROUND AT EDGE LIGHTS, SIGNS, REIL,
- THERE SHALL BE NO EXPOSED POWER/CONTROL CABLES BETWEEN THE POINT WHERE THEY LEAVE THE UNDERGROUND (DEB OR L-867 BASES) AND WHERE THEY ENTER THE EQUIPMENT (SUCH AS TAXIWAY SIGNS, PAPI, REIL, ETC.) ENCLOSURES. THESE CABLES SHALL BE ENCLOSED IN RIGID CONDUIT OR IN FLEXIBLE, WATERTIGHT CONDUIT WITH BREAKABLE COUPLING(S) AT THE GRADE OR THE HOUSING COVER, AS SHOWN IN
- THE JOINTS OF THE L-823 PRIMARY CONNECTORS SHALL BE WRAPPED WITH AT LEAST ONE LAYER OF RUBBER OR SYNTHETIC RUBBER TAPE AND ONE LAYER OF PLASTIC TAPE, ONE-HALF LAPPED, EXTENDING AT LEAST 1-1/2 INCHES ON EACH SIDE OF THE JOINT, AS SHOWN ON ELECTRICAL DETAILS SHEET 1.
- 5. THE CABLE ENTRANCE INTO THE FIELD-ATTACHED L-823 CONNECTORS SHALL BE ENCLOSED BY A HEAT-SHRINKABLE TUBING WITH CONTINUOUS INTERNAL ADHESIVE, AS SHOWN ON ELECTRICAL DETAILS SHEET 1.
- L-823 TYPE II, TWO-CONDUCTOR SECONDARY CONNECTORS SHALL BE CLASS 'A' (FACTORY MOLDED).
- THERE SHALL BE NO SPLICES IN THE SECONDARY CABLE(S) WITHIN THE STEMS OF A RUNWAY/TAXIWAY EDGE/THRESHOLD LIGHTING FIXTURE AND THE WIREWAYS LEADING TO TAXIWAY SIGNS AND PAPI/REIL EQUIPMENT.
- ELECTRICAL INSULATING GREASE SHALL BE APPLIED WITHIN THE L-823, SECONDARY, TWO CONDUCTOR CONNECTORS TO PREVENT WATER ENTRANCE. THESE CONNECTORS
- DEB ISOLATION TRANSFORMERS SHALL BE BURIED AT A DEPTH OF TEN (10") INCHES ON A LINE CROSSING THE LIGHT AND PERPENDICULAR TO THE RUNWAY/TAXIWAY CENTERLINE AT A LOCATION TWELVE (12") INCHES FROM THE LIGHT OPPOSITE FROM THE RUNWAY/TAXIWAY
- 10. A SLACK OF THREE (3') FEET, MINIMUM, SHALL BE PROVIDED IN THE PRIMARY CABLE AT EACH TRANSFORMER/CONNECTOR TERMINATION. AT STAKE-MOUNTED LIGHTS, THE SLACK SHALL BE LOOSELY COILED IMMEDIATELY BELOW THE ISOLATION TRANSFORMER
- 11. DIRECTION OF PRIMARY CABLES SHALL BE IDENTIFIED BY COLOR CODING AS FOLLOWS: WHEN FACING LIGHT WITH BACK TO PAVEMENT, CABLE TO THE LEFT IS CODED RED AND CABLE TO RIGHT IS CODED BLUE. THIS APPLIES TO STAKE MOUNTED LIGHTS AND BASE MOUNTED LIGHTS WHERE THE BASE HAS ONLY ONE ENTRANCE.
- 12. L-867 BASES SHALL BE SIZE B, 24" DEEP, CLASS I, UNLESS OTHERWISE NOTED.
- 13. BASE MOUNTED BREAKABLE COUPLINGS SHALL NOT HAVE WEEP HOLES TO THE OUTSIDE. PLUGGED UP HOLES SHALL NOT BE ACCEPTABLE. IT SHALL BE A 1/4" DIAMETER, MINIMUM, OR EQUIVALENT OPENING FOR DRAINAGE FROM THE SPACE AROUND THE SECONDARY CONNECTOR INTO THE L-867 BASE.
- 14. THE ELEVATION OF THE BREAKABLE COUPLING GROOVE SHALL NOT EXCEED 1-1/2 ABOVE THE EDGE OF THE COVER IN CASE OF BASE MOUNTED COUPLINGS, OR THE TOP OF THE STAKE IN CASE OF STAKE MOUNTED COUPLINGS.
- WHERE THE BREAKABLE COUPLING IS NOT AN INTEGRAL PART OF THE LIGHT FIXTURE STEM OR MOUNTING LEG. A BEAD OF SILICON SEAL SHALL BE APPLIED COMPLETELY AROUND LIGHT STEM OR WIREWAY AT BREAKABLE COUPLING TO PROVIDE A WATERTIGHT
- 16. TOPS OF THE STAKES SUPPORTING LIGHT FIXTURES SHALL BE FLUSH WITH THE SURROUNDING GRADE
- PLASTIC LIGHTING FIXTURE COMPONENTS, SUCH AS LAMP HEADS, STEMS, BREAKABLE 17. COUPLINGS, BASE COVERS, BRACKETS, STAKES, SHALL NOT BE ACCEPTABLE.
- THE TOLERANCE FOR THE HEIGHT OF RUNWAY/TAXIWAY EDGE LIGHTS SHALL BE: ONE (1) INCH. IN CASE OF STAKE MOUNTED LIGHTS, THE SPECIFIED LIGHTING FIXTURE HEIGHT SHALL BE MEASURED BETWEEN THE TOP OF THE STAKE AND THE TOP OF THE LENS. IN CASE OF BASE MOUNTED LIGHTS, THE SPECIFIED LIGHTING FIXTURE HEIGHT SHALL BE MEASURED BETWEEN THE TOP OF THE BASE FLANGE AND THE TOP OF THE LENS, THUS INCLUDING THE BASE COVER, THE FRANGIBLE COUPLING, THE STEM, THE LAMP HOUSING AND THE LENS
- THE TOLERANCE FOR THE LATERAL SPACING (LIGHT LANE TO RUNWAY/TAXIWAY CENTERLINE) OF RUNWAY/TAXIWAY EDGE LIGHTS SHALL BE ONE (1) INCH. THIS ALSO APPLIES AT INTERSECTIONS TO LATERAL SPACING BETWEEN LIGHTS OF A RUNWAY/TAXIWAY AND THE INTERSECTING RUNWAY/TAXIWAY.

- 20. ENTRANCES INTO L-867 BASES SHALL HAVE CONDUIT COUPLINGS OR REDUCERS TO INTERFACE UNIT DUCT/CONDUIT TO L-867 BASE HUBS, OR SHALL BE SEALED WITH HEAT SHRINK AS SHOWN IN DETAIL "B" ON ELECTRICAL DETAILS SHEET 1.
- GALVANIZED/PAINTED EQUIPMENT/COMPONENT SURFACES SHALL NOT BE DAMAGED BY DRILLING, FILING, ETC. DRAIN HOLES IN METAL TRANSFORMER HOUSINGS SHALL BE MADE REFORE GALVANIZING
- 22. EDGE LIGHT NUMBERING TAGS SHALL BE FACING THE PAVEMENT.
- 23. CABLE/SPLICE/DUCT MARKERS SHALL BE PRECAST CONCRETE OF THE SIZE SHOWN. LETTERS/NUMBERS/ARROWS FOR THE LEGEND TO BE IMPRESSED INTO THE TOPS OF THE MARKERS SHALL BE PRE-ASSEMBLED AND SECURED IN THE MOLD BEFORE THE CONCRETE IS POURED. LEGEND INSCRIBED BY HAND IN WET CONCRETE SHALL NOT BE
- 24. ALL UNDERGROUND CABLE RUNS SHALL BE IDENTIFIED BY CABLE MARKERS AT 200 FEET MAXIMUM SPACING, WITH AN ADDITIONAL MARKER AT EACH CHANGE OF DIRECTION OF THE CABLE RUN. CABLE MARKERS SHALL BE INSTALLED IMMEDIATELY ABOVE THE
- THERE SHALL BE NO SPLICES BETWEEN THE ISOLATION TRANSFORMERS. L-823 CONNECTORS ARE ALLOWED AT TRANSFORMER CONNECTIONS ONLY, UNLESS OTHERWISE
- 26. APPLY AN OXIDE INHIBITING, ANTI-SEIZING COMPOUND TO ALL SCREWS, NUTS AND BREAKAGE COUPLING THREADS.
- 27. LOCATIONS OF ENDS OF ALL UNDERGROUND DUCTS SHALL BE IDENTIFIED BY DUCT
- 28. WHERE A PARALLEL, CONSTANT VOLTAGE PAPI SYSTEM IS PROVIDED, THE "T" SPLICES SHALL BE OF THE CAST TYPE.
- CONCRETE USED FOR SLABS, FOOTINGS, BACKFILL AROUND TRANSFORMER HOUSINGS, MARKINGS, ETC. SHALL BE 3500 PSI, AIR-ENTRAINED, MEETING THE REQUIREMENT OF ITEM 610 STRUCTURAL PORTLAND CEMENT CONCRETE.
- 30. ALL POWER AND CONTROL CABLES IN MAN/HAND HOLES SHALL BE TAGGED. USE EMBOSSED COPPER STRIPS TO BE ATTACHED AT BOTH ENDS TO THE CABLE BY THE USE OF PLASTIC STRAPS. MINIMUM OF TWO TAGS SHALL BE PROVIDED ON EACH CABLE IN A MAN/HAND HOLE-ONE AT THE CABLE ENTRANCE AND ONE AT THE CABLE
- 31. THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND AND/OR ABOVEGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. NEITHER THE OWNER NOR THE ENGINEER ASSUMES ANY RESPONSIBILITY WHATEVER IN RESPECT TO ACCURACY, COMPLETENESS, OR SUFFICIENCY OF THE INFORMATION. THERE IS NO GUARANTEE EITHER EXPRESSED OR IMPLIED, THAT THE LOCATIONS, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ARE REPRESENTATIVE OF THOSE TO BE ENCOUNTERED IN THE CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES. INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE OWNER'S REPRESENTATIVE AND/OR THE RESIDENT ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY DAMAGE TO SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT. ALL UTILITY CABLES AND LINES SHALL BE LOCATED BY THE RESPECTIVE UTILITY. CONTACT J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123. ALSO CONTACT AIRPORT DIRECTOR/MANAGER AND AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING UNDERGROUND AIRPORT CABLES AND/OR UTILITIES. ALSO COORDINATE WORK WITH ALL ABOVEGROUND UTILITIES.
- 32. WHEN PREPARING CABLE FOR SPLICES, THE CONTRACTOR SHALL USE A CABLE STRIPPER/PENCILLER WHENEVER CABLE CONNECTIONS ARE MADE.

# GROUNDING NOTES FOR AIRFIELD LIGHTING

- GROUNDING FOR RUNWAY LIGHTS, TAXIWAY LIGHTS, AND LIGHTED TAXI GUIDANCE SIGNS SHALL BE AS DETAILED ON THE PLANS AND AS SPECIFIED HEREIN. PER FAA AC 150/5340-30F DESIGN AND INSTALLATION DETAILS FOR AIRPORT VISUAL AIDS, CHAPTER 12. PART 12.6: A GROUND MUST BE INSTALLED AT EACH LIGHT FIXTURE. THE PURPOSE OF THE LIGHT BASE GROUND IS TO PROVIDE A DEGREE OF PROTECTION FOR MAINTENANCE PERSONNEL FROM POSSIBLE CONTACT WITH AN ENERGIZED LIGHT BASE OR MOUNTING STAKE THAT MAY RESULT FROM A SHORTED POWER CABLE OR ISOLATION TRANSFORMER. A LIGHT BASE GROUND SHALL BE INSTALLED AT EACH TRANSFORMER BASE/LIGHT CAN ASSOCIATED WITH RUNWAY LIGHTS, TAXIWAY LIGHTS, AND LIGHTED TAXI GUIDANCE SIGNS. A LIGHT BASE GROUND SHALL ALSO BE INSTALLED AT EACH STAKE MOUNTED LIGHT FIXTURE. A LIGHT BASE GROUND SHALL BE INSTALLED AND CONNECTED TO THE METAL FRAME OF EACH TAXI GUIDANCE SIGN AS DETAILED ON THE PLANS AND IN ACCORDANCE WITH THE RESPECTIVE TAXI GUIDANCE SIGN MANUFACTURER RECOMMENDATIONS. THE LIGHT BASE GROUND SHALL BE A #6 AWG BARE COPPER CONDUCTOR BONDED TO THE GROUND LUG ON THE RESPECTIVE L-867 TRANSFORMER BASE/LIGHT CAN OR MOUNTING STAKE AND A 5/8-INCH DIAMETER BY 8-FOOT LONG (MINIMUM) UL LISTED COPPER CLAD GROUND ROD. CONNECTIONS TO GROUND LUGS ON THE L-867 TRANSFORMER BASE/LIGHT CAN OR MOUNTING STAKE SHALL BE WITH A UL LISTED GROUNDING CONNECTOR. CONNECTIONS TO GROUND RODS SHALL BE MADE WITH EXOTHERMIC WELD TYPE CONNECTORS, CADWELD BY ERICO PRODUCTS, INC., SOLON, OHIO, (PHONE: 800-248-9353), THERMOWELD BY CONTINENTAL INDUSTRIES, INC., TULSA, OKLAHOMA (PHONE: 918-663-1440), ULTRAWELD BY HARGER, GRAYSLAKE, ILLINOIS (PHONE: 800-842-7437), OR APPROVED EQUAL. EXOTHERMIC WELD CONNECTIONS SHALL BE INSTALLED IN CONFORMANCE WITH THE RESPECTIVE MANUFACTURER'S DIRECTIONS USING MOLDS AS REQUIRED FOR EACH RESPECTIVE APPLICATION. BOLTED CONNECTIONS WILL NOT BE PERMITTED AT GROUND RODS. TOP OF GROUND RODS SHALL BE BURIED 12 INCHES MINIMUM BELOW GRADE, UNLESS SPECIFIED OTHERWISE HEREIN, FOR RESPECTIVE APPLICATIONS.
- FOR BASE MOUNTED LIGHT FIXTURES THE LIGHT FIXTURE MUST BE BONDED TO THE LIGHT BASE INTERNAL GROUND LUG VIA A #6 AWG STRANDED COPPER WIRE RATED FOR 600 VOLTS WITH GREEN XHHW OR USE INSULATION. THE GROUND WIRE LENGTH MUST BE SUFFICIENT TO ALLOW THE REMOVAL OF THE LIGHT FIXTURE FROM THE LIGHT BASE FOR ROUTINE MAINTENANCE. SEE THE LIGHT FIXTURE MANUFACTURER'S INSTRUCTIONS FOR PROPER METHODS OF ATTACHING A BONDING WIRE.
- CLEAN ALL METAL SURFACES BEFORE MAKING GROUND CONNECTIONS. METALLIC SURFACES TO BE JOINED SHALL BE PREPARED BY THE REMOVAL OF ALL NON-CONDUCTIVE MATERIAL PER 2011 NATIONAL ELECTRICAL CODE ARTICLE 250-12
- PER FAA 150/5340-30F THE RESISTANCE TO GROUND OF THE RESPECTIVE MOUNTING STAKE OR LIGHT BASE (WITH GROUND ROD CONNECTED) MUST BE 25 OHMS OR LESS.

LI032

	OTDIONI LEOFNID ONE LINE DIAODAM
ELEC	CTRICAL LEGEND — ONE—LINE DIAGRAM
	CABLE TERMINATOR/LUG
***	TRANSFORMER
_\_	DISCONNECT SWITCH
->=	FUSIBLE DISCONNECT SWITCH
	CIRCUIT BREAKER
~~	THERMAL MAGNETIC CIRCUIT BREAKER
	FUSE
<b>↓</b>	TRANSIENT VOLTAGE SURGE SUPPRESSOR OR SURGE PROTECTOR DEVICE
#	GROUND — GROUND ROD, GROUNDING ELECTRODE, OR AT EARTH POTENTIAL
a	INDICATING LIGHT
W	MOTOR
#	LOAD, MOTOR, # = HORSEPOWER
0	ELECTRIC UTILITY METER BASE
·	JUNCTION BOX WITH SPLICE
XXX	EQUIPMENT, XXX = DEVICE DESCRIPTION
GND	GROUND BUS OR TERMINAL
S/N	NEUTRAL BUS
#	PANELBOARD WITH MAIN LUGS
- - - - -	PANELBOARD WITH MAIN BREAKER
<b>♣</b>	FUSE PANEL WITH MAIN FUSE PULLOUT
	DUPLEX RECEPTACLE 120V SINGLE PHASE GROUNDING TYPE
8	CONTROL STATION
N EM	TRANSFER SWTICH
G	ENGINE GENERATOR SET

	ELECTRICAL LEGEND — SCHEMATIC
<b>⊢</b>	NORMALLY OPEN (N.O.) CONTACT
<del></del>	NORMALLY CLOSED (N.C.) CONTACT
(\$*)	STARTER COIL, * = STARTER NUMBER
0L	OVERLOAD RELAY CONTACT
(CR*)	CONTROL RELAY, * = CONTROL RELAY NUMBER
(R*)	RELAY, * = RELAY NUMBER
~°	TOGGLE SWITCH / 2 POSITION SWITCH
OFF AUTO	2-POSITION SELECTOR SWITCH
HAND T AUTO  O O O  O OOX	3-POSITION SELECTOR SWITCH (H-O-A SHOWN)
Щ	2 POLE DISCONNECT SWITCH
<u>-</u>	3 POLE DISCONNECT SWITCH
<u>_</u>	PHOTOCELL
<b>-</b> ₹-	TERMINAL BLOCK, * = TERMINAL NUMBER
<b>-</b>	DEVICE TERMINAL, * = DEVICE TERMINAL NUMBER
	INTERNAL PANEL WIRING
	FIELD WIRING
	FUSE
GND	GROUND BUS OR TERMINAL
S/N	NEUTRAL BUS
#	GROUND, GROUND ROD, GROUND BUS
0 0	INDUSTRIAL CONTROL RELAY OR LIGHTING CONTACTOR
<del>                                      </del>	S1 CUTOUT HANDLE REMOVED
+1+1 <b>₹</b> ¶ <b>₹</b>	S1 CUTOUT HANDLE INSERTED
%	N.O. THERMAL SWITCH
~ <u>T</u> °	N.C. THERMAL SWITCH
(#)	L-830 SERIES ISOLATION TRANSFORMER

	ELECTRICAL ABBREVIATIONS
A.F.F.	ABOVE FINSHED FLOOR
A, AMP	AMPERES
ATS	AUTOMATIC TRANSFER SWITCH
AWG	AMERICAN WIRE GAUGE
BKR	BREAKER
С	CONDUIT
СВ	CIRCUIT BREAKER
CKT	CIRCUIT
CR	CONTROL RELAY
CU	COPPER
DPDT	DOUBLE POLE DOUBLE THROW
DPST	DOUBLE POLE SINGLE THROW
ЕМ	EMERGENCY
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
EP	EXPLOSION PROOF
ES	EMERGENCY STOP
ETL	INTERTEK - ELECTRICAL TESTING LABS
ETM	ELAPSE TIME METER
GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFI	GROUND FAULT INTERRUPTER
GND	GROUND
GRSC	GALVANIZED RIGID STEEL CONDUIT
HID	
	HIGH INTENSITY DISCHARGE
HOA	HAND OFF AUTOMATIC
HP	HORSEPOWER
HPS	HIGH PRESSURE SODIUM
J	JUNCTION BOX
KVA	KILOVOLT AMPERE(S)
KW	KILOWATTS
LC	LIGHTING CONTACTOR
LTFMC	LIQUID TIGHT FLEXIBLE METAL CONDUIT (UL LISTED)
LTG	LIGHTING
LP	LIGHTING PANEL
MAX	MAXIMUM
MCB	MAIN CIRCUIT BREAKER
МСМ	THOUSAND CIRCLUAR MIL
MDP	MAIN DISTRIBUTION PANEL
MFR	MANUFACTURER
МН	METAL HALIDE
MIN	MINIMUM
MLO	MAIN LUGS ONLY
NEC	NATIONAL ELECTRICAL CODE (NFPA 70)
NC	NORMALLY CLOSED
NO	NORMALLY OPEN
NTS	NOT TO SCALE
OHE	OVERHEAD ELECTRIC
	1

OVERLOAD

EL	ECTRICAL ABBREVIATIONS (CONTINUED)
PB	PULL BOX
PC	PHOTO CELL
PDB	POWER DISTRIBUTION BLOCK
PNL	PANEL
RCPT	RECEPTACLE
R	RELAY
s	STARTER
SPD	SURGE PROTECTION DEVICE
SPST	SINGLE POLE SINGLE THROW
TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
TYP	TYPICAL
UG	UNDERGROUND
UGE	UNDERGROUND ELECTRIC
UL	UNDERWRITER'S LABORATORIES
٧	VOLTS
W/	WITH
<b>w</b> /0	without
WP	WEATHER PROOF
XFER	TRANSFER
XFMR	TRANSFORMER

XFMR	TRANSFORMER
AIRPO	ORT EQUIPMENT/FACILITY ABBREVIATIONS
ASOS	AUTOMATED SURFACE OBSERVING SYSTEM
ATCT	AIR TRAFFIC CONTROL TOWER
AWOS	AUTOMATED WEATHER OBSERVING SYSTEM
CCR	CONSTANT CURRENT REGULATOR
DME	DISTANCE MEASURING EQUIPMENT
FAR	FEDERAL AVIATION REGULATION
GS	GLIDE SLOPE FACILITY
HIRL	HIGH INTENSITY RUNWAY LIGHT
ILS	INSTRUMENT LANDING SYSTEM
IM	INNER MARKER
LIR	LOW IMPACT-RESISTANT
LOC	LOCALIZER FACILITY
MALS	MEDIUM INTENSITY APPROACH LIGHTING SYSTEM
MALSR	MEDIUM INTENSITY APPROACH LIGHTING SYSTEM WITH RUNWAY ALIGNMENT INDICATING LIGHTS
MIRL	MEDIUM INTENSITY RUNWAY LIGHT
MITL	MEDIUM INTENSITY TAXIWAY LIGHT
NDB	NON-DIRECTIONAL BEACON
PAPI	PRECISION APPROACH PATH INDICATOR
PLASI	PULSE LIGHT APPROACH SLOPE INDICATOR
RAIL	RUNWAY ALIGNMENT INDICATING LIGHTS
REIL	RUNWAY END IDENTIFIER LIGHT
RVR	RUNWAY VISUAL RANGE
VADI	VISUAL APPROACH DESCENT INDICATOR
VASI	VISUAL APPROACH SLOPE INDICATOR
VOR	VERY HIGH FREQUENCY OMNIDIRECTIONAL RANGE FACILITY
WC	WIND CONE

LI032

# NOTES:

- 1. ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 NATIONAL ELECTRICAL CODE (NEC) MOST CURRENT ISSUE IN FORCE, THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE WILL NOT BE PERMITTED.
- ALL VAULT WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT MANAGER. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- 3. COLOR CODE PHASE AND NEUTRAL CONDUCTOR INSULATION FOR NO. 6 AWG OR SMALLER. PROVIDE COLORED INSULATION OR COLORED MARKING TAPE FOR PHASE AND NEUTRAL CONDUCTORS FOR NO. 4 AWG AND LARGER. INSULATED GROUND CONDUCTORS SHALL HAVE GREEN COLORED INSULATION FOR ALL CONDUCTOR AWG AND/OR KCMIL TO COMPLY WITH NEC 250.119. NEUTRAL CONDUCTORS SHALL HAVE WHITE COLORED INSULATION FOR NO. 6 AWG AND SMALLER TO MEET THE REQUIREMENTS OF NEC 200.6. STANDARD COLORS FOR POWER WIRING AND BRANCH CIRCUITS SHALL BE AS FOLLOWS:

# 120/240 VAC. 1 PHASE, 3 WIRE PHASE A BLACK PHASE B RED NEUTRAL WHITE GROUND GREEN

- 4. SEE RESPECTIVE SITE PLANS FOR SITE LEGEND INFORMATION.
- 5. LTFMC DENOTES LIQUID TIGHT FLEXIBLE METAL CONDUIT UL LISTED, SUNLIGHT RESISTANT, & SUITABLE FOR GROUNDING. LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE U.L. LISTED TO MEET THE REQUIREMENTS OF NEC 350.6. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO CCR'S & TRANSFORMERS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.60. EXTERNAL BONDING JUMPERS USED WITH CCR INSTALLATIONS SHALL BE #6 AWG COPPER (MINIMUM). DO NOT INSTALL LIFMC THAT IS NOT UL LISTED. CONFIRM LIFMC BEARS THE UL LABEL PRIOR TO INSTALLATION.
- 6. ALL ENCLOSURES RATED NEMA 4, 4X SHALL HAVE WATERTIGHT HUBS AT CONDUIT ENTRANCES U.L. LISTED NEMA 4, 4X FOR THE RESPECTIVE ENCLOSURE, TO MAINTAIN THE NEMA 4, 4X RATING.
- HIGH VOLTAGE AND LOW VOLTAGE CIRCUITS SHALL NOT BE INSTALLED IN THE SAME WIREWAY, CONDUIT, DUCT, OR HANDHOLE.

REVISION					
DATE					
					_

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

i

Discription of the control of the co

Hanson Professional Sarvices Inc. 1725 South Stark Street Facts South Stark Street Springfiel, Illinois 82703-2886

TAXIWAY "C"
EXTENSION
ELECTRICAL LEGEND AND
ABBREVIATIONS

JAN 05, 2012 10:46 AM HAGLO00382

### **NOTES**

- ALL WORK, POWER OUTAGES AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT DIRECTOR/MANAGER. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- CONTRACTOR SHALL FIELD VERIFY EXISTING SITE CONDITIONS. CONTRACTOR SHALL FIELD VERIFY RESPECTIVE CIRCUITS AND POWER SOURCES PRIOR TO REMOVING, DISCONNECTING, OR WORKING ON THE RESPECTIVE AIRFIELD LIGHTING, NAVAID, OR
- EXISTING RWY 18-36 AND TAXIWAY C CCR SHALL BE REPLACED WITH A NEW 15KW CCR. EXISTING CCR SHALL BE RELOCATED TO STORAGE.
- THE CONTRACTOR SHALL SECURE, IDENTIFY AND PLACE ANY TEMPORARY EXPOSED WIRING IN CONDUIT TO PREVENT ELECTROCUTION AND FIRE IGNITION SOURCES AS PER THE REQUIREMENTS OF FAA AC 150/5370-2F OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION, PART 218, b (1)(f).
- THE RUNWAY 9-27 MEDIUM INTENSITY RUNWAY LIGHTING REPLACEMENT PROJECT IS UNDER A SEPARATE CONTRACT AND MIGHT BE UNDERWAY DURING THE CONSTRUCTION OF THIS PROJECT. COORDINATE WORK WITH OTHER CONTRACTORS WHERE APPLICABLE.


THE LOCATION, SIZE, AND TYPE OF MATERIAL OF EXISTING UNDERGROUND AND/OR ABOVEGROUND UTILITIES INDICATED ON THE PLANS ARE NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. NEITHER THE OWNER NOR THE ENGINEER ASSUMES ANY RESPONSIBILITY WHATEVER IN RESPECT TO THE ACCURACY, COMPLETENESS, OR SUFFICIENCY OF THE INFORMATION. THERE IS NO GUARANTEE, EITHER EXPRESSED OR IMPLIED. THAT THE LOCATIONS. SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ARE REPRESENTATIVE OF THOSE TO BE ENCOUNTERED IN THE CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE OWNER'S REPRESENTATIVE AND/OR THE RESIDENT ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY DAMAGE TO SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

ALL UTILITY CABLES AND LINES SHALL BE LOCATED BY THE RESPECTIVE UTILITY. CONTACT JULIE (JOINT UTILITY LOCATION INFORMATION FOR EXCAVATORS) FOR UTILITY INFORMATION, PHONE: 1-800-892-0123. CONTACT THE FAA (FEDERAL AVIATION ADMINISTRATION) FOR ASSISTANCE IN LOCATING FAA CABLES AND UTILITIES. LOCATION OF FAA POWER, CONTROL, AND COMMUNICATION CABLES SHALL BE COORDINATED WITH AND/OR LOCATED BY THE FAA. ALSO CONTACT AIRPORT DIRECTOR/MANAGER AND AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING UNDERGROUND AIRPORT CABLES AND/OR UTILITIES. ALSO COORDINATE WORK WITH ALL ABOVEGROUND UTILITIES.

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

TAXIWAY "C" EXTENSION ISTING FLOOR F FOR VAULT

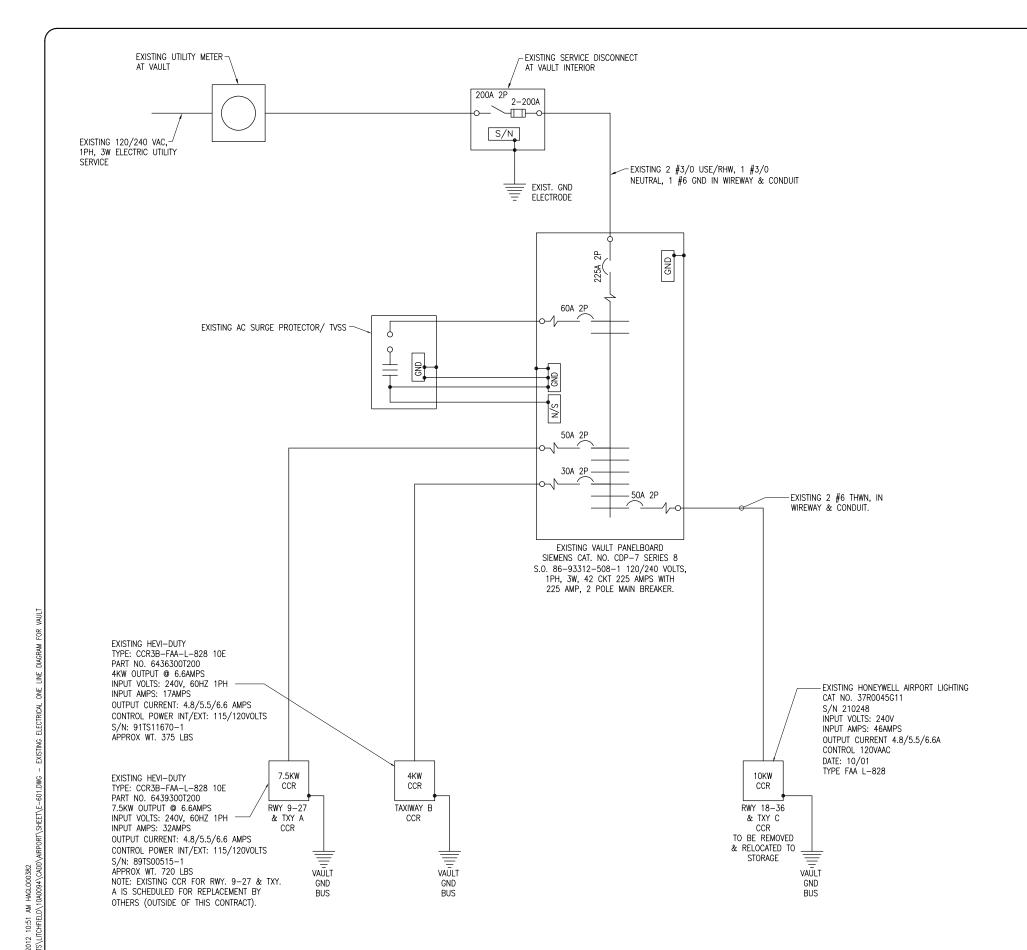

LI032

- ALL VAULT WORK AND/OR POWER OUTAGES SHALL BE COORDINATED WITH THE AIRPORT MANAGER.
- CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS TO CONFIRM POWER A
- ALL VAULT WORK, POWER OUTAGES AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT MANAGER. ONCE SHUT DOWN, THICKICUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SEC 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- EXISTING CONTROL CIRCUITS SHALL BE LOCATED, IDENTIFIED, DISCONNECTED, REROUTED & RECONNECTED TO THE NEW CONSTANT CURRENT REGULATOR FOR RWY 18-36 AND TAXIWAY C, AS DETAILED HEREIN. EXISTING INPUT AND OUTPUT POWER CIRCUITS TO/FROM THE CONSTANT CURRENT REGULATORS SHALL BE REPLACED WITH NEW CABLES AS DETAILED HEREIN. ALL EXISTING AIRFIELD LIGHTING SYSTEMS SHALL BE OPERABLE DURING NIGHTFALL UNLESS OTHERWISE APPROVED BY THE AIRPORT MANAGER AND/OR OTHERWISE DETAILED HEREIN. CONTRACTOR SHALL PROVIDE ALL TEMPORÁRY WORK AS NECESSARY TO MAINTAIN OPERATION OF THE AIRFIELD LIGHTING SYSTEMS AT NIGHTFALL. CONTRACTOR SHALL COORDINATE TRANSFER OF EXISTING AIRFIELD CIRCUITS TO MINIMIZE DOWN
- CCR DENOTES CONSTANT CURRENT REGULATOR.

E AND MS HE OF T OF RT	REVISION					
AND CTION	DATE	01/03/12				


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

EXISTING ELECTRICAL ONE-LINE DIAGRAM FOR VAULT TAXIWAY "C" EXTENSION

32

EXISTING ELECTRICAL ONE-LINE DIAGRAM FOR VAULT

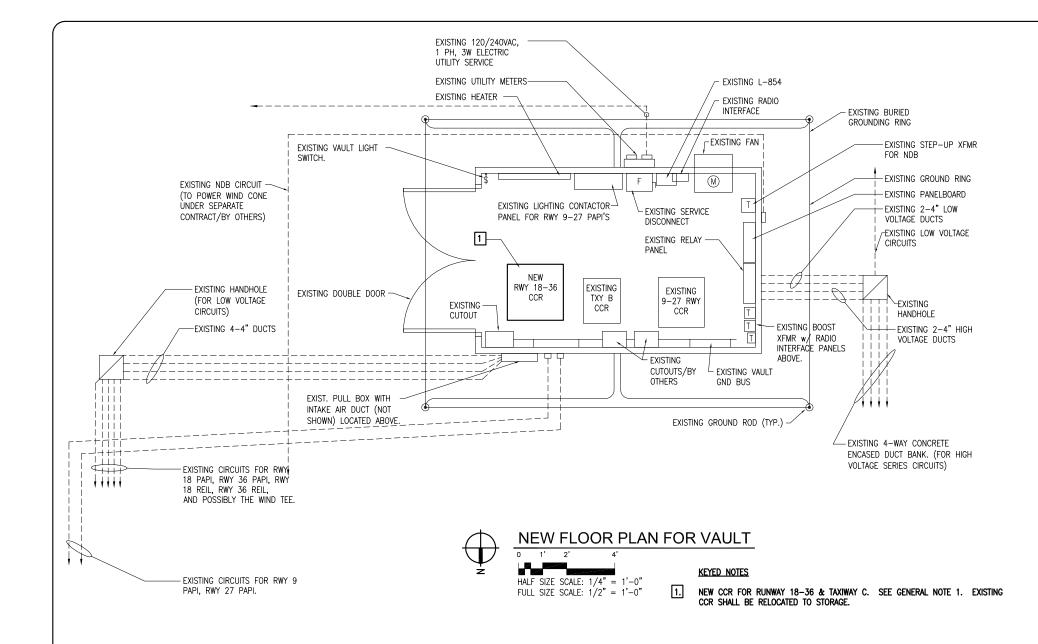

GENERAL NOTES

- SEE "NEW ELECTRICAL ONE-LINE DIAGRAM FOR VAULT" FOR LOW VOLTAGE INPUT POWER WIRING REQUIREMENTS TO CONSTANT CURRENT REGULATORS. SEE "HIGH VOLTAGE WIRING SCHEMATIC" FOR CCR OUTPUT WIRING REQUIREMENTS. SEE "RUNWAY 18-36 LIGHTING CONTROL SCHEMATIC" FOR CONTROL WIRING REQUIREMENTS TO RUNWAY 18-36 & TAXIWAY "C" CCR.
- MAINTAIN SEPARATION OF HIGH VOLTAGE WIRING FROM LOW VOLTAGE WIRING TO COMPLY WITH NEC 300.3(c)(2). HIGH VOLTAGE AND LOW VOLTAGE WIRING SHALL NOT BE INSTALLED IN THE SAME RACEWAY, CONDUIT, WIREWAY, PULL BOX, SPLICE CAN OR HANDHOLE.
- CONSTANT CURRENT REGULATORS AND THEIR RESPECTIVE SERIES PLUG CUTOUTS SHALL BE CLEARLY LABELED TO IDENTIFY THE RESPECTIVE REGULATOR DESIGNATION, RUNWAY OR TAXIWAY SERVED, POWER SOURCE OR CIRCUIT, AND
- BOND NEW RWY. 18-36 CCR FRAME/HOUSING TO VAULT GROUND BUS WITH #6
- MAINTAIN SEPARATION OF HIGH VOLTAGE AND LOW VOLTAGE CIRCUITS. LOW VOLTAGE WIRING SHALL ENTER THE RESPECTIVE CCR AT THE LOW VOLTAGE SECTION. HIGH VOLTAGE WIRING SHALL ENTER THE RESPECTIVE CCR AT THE HIGH
- THE CONTRACTOR SHALL SECURE, IDENTIFY AND PLACE ANY TEMPORARY EXPOSED WIRING IN CONDUIT TO PREVENT ELECTROCUTION AND FIRE IGNITION SOURCES AS PER THE REQUIREMENTS OF FFA AC 150/5370-2F OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION, PART 218, b (1)(f).

THE LOCATION, SIZE, AND TYPE OF MATERIAL OF EXISTING UNDERGROUND AND/OR ABOVEGROUND UTILITIES INDICATED ON THE PLANS ARE NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. NEITHER THE OWNER NOR THE ENGINEER ASSUMES ANY RESPONSIBILITY WHATEVER IN RESPECT TO THE ACCURACY, COMPLETENESS, OR SUFFICIENCY OF THE INFORMATION. THERE IS NO GUARANTEE. EITHER EXPRESSED OR IMPLIED. THAT THE LOCATIONS. SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ARE REPRESENTATIVE OF THOSE TO BE ENCOUNTERED IN THE CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE OWNER'S REPRESENTATIVE AND/OR THE RESIDENT ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY DAMAGE TO SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.


ALL UTILITY CABLES AND LINES SHALL BE LOCATED BY THE RESPECTIVE UTILITY. CONTACT JULIE (JOINT UTILITY LOCATION INFORMATION FOR EXCAVATORS) FOR UTILITY INFORMATION, PHONE: 1-800-892-0123. CONTACT THE FAA (FEDERAL AVIATION ADMINISTRATION) FOR ASSISTANCE IN LOCATING FAA CABLES AND UTILITIES. LOCATION OF FAA POWER, CONTROL, AND COMMUNICATION CABLES SHALL BE COORDINATED WITH AND/OR LOCATED BY THE FAA. ALSO CONTACT AIRPORT DIRECTOR/MANAGER AND AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING UNDERGROUND AIRPORT CABLES AND/OR UTILITIES. ALSO COORDINATE WORK WITH ALL ABOVEGROUND UTILITIES.

LI032

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

TAXIWAY "C" EXTENSION POSED F

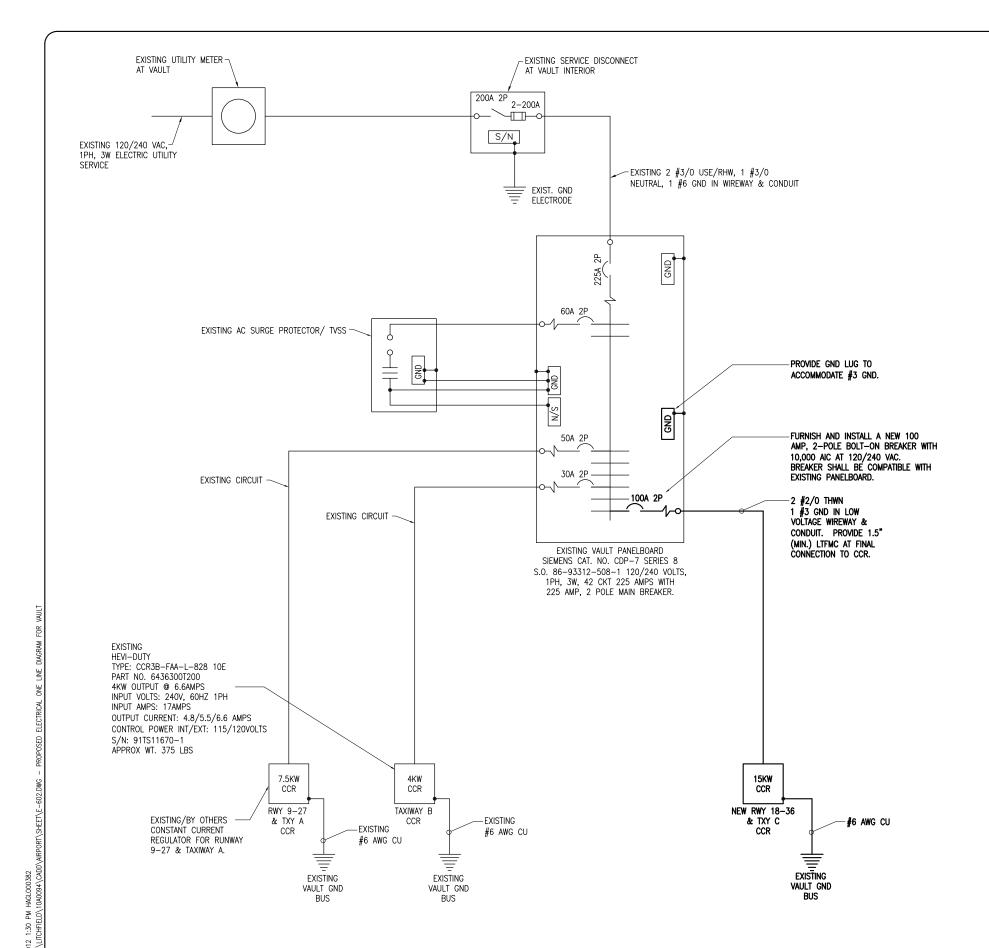

LI032

- ALL VAULT WORK AND/OR POWER OUTAGES SHALL BE COORDINATED WITH THE
- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70-NATIONAL ELECTRIC CODE (NEC) MOST CURRENT ISSUE IN FORCE, THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL LISTING, (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE WILL NOT
- 3. ALL EQUIPMENT SHOWN NOT LABELED AS EXISTING IS NEW.
- CONTRACTOR SHALL CONFIRM POWER REQUIREMENTS WITH THE ACTUAL NAMEPLATE ON EACH CONSTANT CURRENT REGULATOR (OR OTHER RESPECTIVE EQUIPMENT) AND ADJUST CIRCUIT BREAKER, WIRE SIZES & CONDUIT SIZES TO CONFORM WITH NEC & MANUFACTURER'S RECOMMENDATIONS WHERE APPLICABLE. WIRE SIZES SHOWN ON THE PLANS ARE MINIMUM.
- HIGH VOLTAGE & LOW VOLTAGE CIRCUITS SHALL NOT BE INSTALLED IN THE SAME RACEWAY OR JUNCTION BOX.
- 6. ALL CONDUCTORS/WIRING SHALL BE COPPER.
- BRANCH CIRCUITS TO NEW REGULATOR SHALL BE INSTALLED IN THE RESPECTIVE LOW VOLTAGE WIREWAY/DUCT, WITH GRSC AT TRANSITIONS AND UL LISTED LIQUID TIGHT FLEXIBLE METAL CONDUIT AT FINAL CONNECTIONS TO THE REGULATOR. CONDUITS SHALL BE SIZED IN ACCORDANCE WITH NEC.
- BOND NEW REGULATORS TO THE RESPECTIVE VAULT GROUND BUS WITH A DEDICATED #6 AWG BONDING JUMPER.
- LITIMC DENOTES LIQUID TIGHT FLEXIBLE METAL CONDUIT UL LISTED, SUNLIGHT RESISTANT, & SUITABLE FOR GROUNDING. LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE UL LISTED TO MEET THE REQUIREMENTS OF NEC 350. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO CCR'S & TRANSFORMERS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.6. EXTERNAL BONDING JUMPERS USED WITH CCR INSTALLATIONS SHALL BE #6 AWG COPPER (MINIMUM). DO NOT INSTALL LIFMC THAT IS NOT UL LISTED. CONFIRM LTFMC BEARS THE UL LABEL PRIOR TO INSTALLING IT.
- 10. LOW VOLTAGE INPUT POWER WIRING AND CONTROL WIRING SHALL ENTER THE CCR AT THE LOW VOLTAGE SECTION IN ACCORDANCE WITH THE CCR MANUFACTURER'S INSTRUCTIONS. HIGH VOLTAGE OUTPUT SERIES CIRCUIT WIRING SHALL EXIT THE CCR AT THE HIGH VOLTAGE SECTION IN ACCORDANCE WITH THE CCR MANUFACTURER'S INSTRUCTIONS.
- 11. VAULT WORK WILL BE PAID FOR UNDER ITEM AR109200 INSTALL ELECTRICAL

`		UPDATED PER IDA DIRECTIONS				
	DATE	01/03/12				
	Ι -					


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

NEW ELECTRICAL ONE-LINE DIAGRAM FOR VAULT TAXIWAY "C" EXTENSION

34

NEW ELECTRICAL ONE-LINE DIAGRAM FOR VAULT

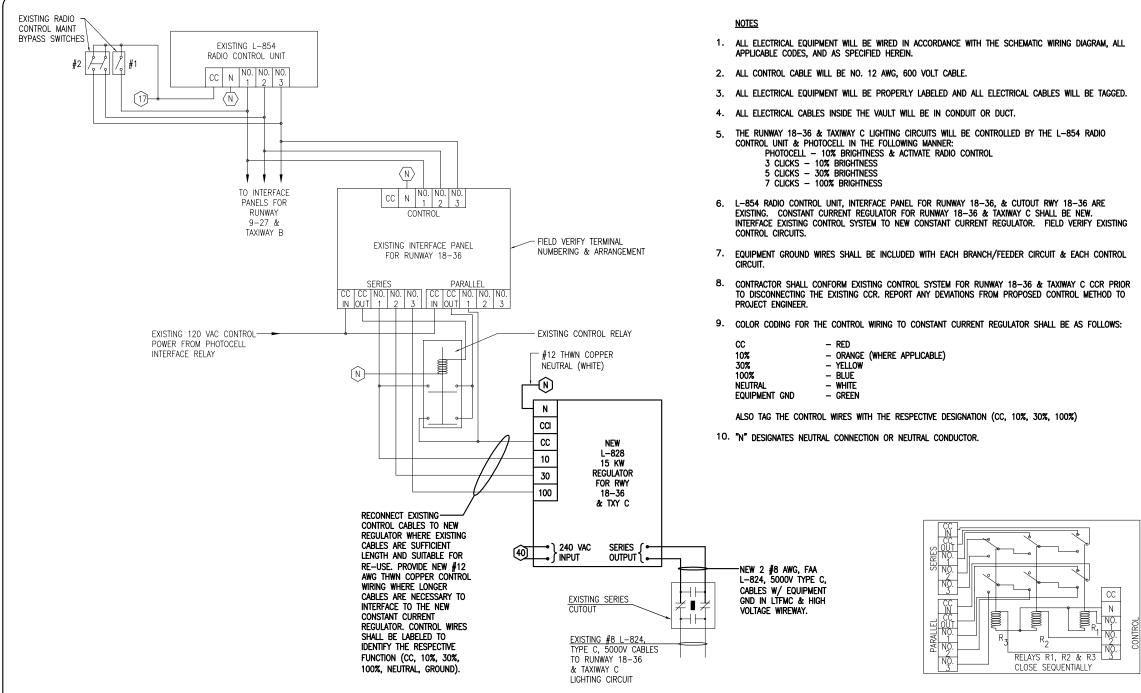

TYP. INTERFACE PANEL DETAIL

# SHEET LEGEND

- (17) EXISTING 120 VAC CONTROL POWER CIRCUIT FOR L-854 RADIO FROM VAULT PANELBOARD CKT 17. INTERFACE TO NEW LIGHTING CONTACTOR PANEL FOR RWY 9-27 PAPI UNITS.
- NEW 240 VAC FEEDER CIRCUIT FOR RUNWAY 18-36 & TAXIWAY C CCR FROM VAULT PANEL CKT 40, 42.
- $\widehat{\mbox{N}}$  N designates neutral from the respective PANEL THAT POWERS THE DEVICE. FOR CONTROL CIRCUIT INPUTS TO CCR'S N SHALL BE FROM THE RESPECTIVE INTERFACE PANEL CIRCUIT NEUTRAL CONNECTION.


LI032

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

RUNWAY 18-36 LIGHT CONTROL SCHEMAT

TAXIWAY "C" EXTENSION

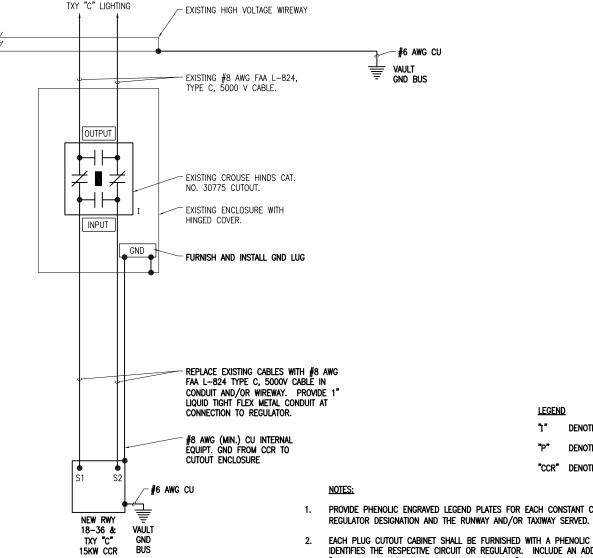

TO RWY 18/36 &

**LEGEND** 

- DENOTES PLUG CUTOUT WITH PLUG INSERTED
- DENOTES PLUG CUTOUT WITH PLUG PULLED
- "CCR" DENOTES CONSTANT CURRENT REGULATOR


PROVIDE PHENOLIC ENGRAVED LEGEND PLATES FOR EACH CONSTANT CURRENT REGULATOR NOTING THE


- EACH PLUG CUTOUT CABINET SHALL BE FURNISHED WITH A PHENOLIC ENGRAVED LEGEND PLATE THAT IDENTIFIES THE RESPECTIVE CIRCUIT OR REGULATOR. INCLUDE AN ADDITIONAL LEGEND PLATE LABELED "CAUTION OPERATE CUTOUTS WITH CCR SHUT OFF". FURNISH & INSTALL A WARNING LABEL FOR CUTOUT ENCLOSURE TO WARN PERSONS OF POTENTIAL ARC FLASH HAZARDS, PER THE REQUIREMENTS OF NEC 110.16 "FLASH PROTECTION".
- PROVIDE PHENOLIC ENGRAVED LEGEND PLATES FOR EACH CUTOUT TO IDENTIFY THE RESPECTIVE CUTOUT INPUT CONNECTION AND THE RESPECTIVE CUTOUT OUTPUT CONNECTION.
- BOND REGULATOR FRAME TO VAULT GROUND BUS WITH A DEDICATED #6 AWG COPPER BONDING JUMPER.
- PROVIDE ADEQUATE WORKING SPACE IN FRONT OF EACH CUTOUT ENCLOSURE TO MEET NEC CLEARANCE
- LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE U.L. LISTED TO MEET THE REQUIREMENTS OF NEC 350.6, SUITABLE FOR GROUNDING AND SUNLIGHT RESISTANT. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO CCR'S & TRANSFORMERS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.60. EXTERNAL BONDING JUMPERS USED WITH CCR INSTALLATIONS SHALL BE #6 AWG COPPER (MINIMUM). DO NOT INSTALL LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS NOT UL LISTED. CONFIRM LIQUID TIGHT FLEXIBLE METAL CONDUIT BEARS THE UL LABEL PRIOR TO INSTALLING IT.
- HIGH VOLTAGE & LOW VOLTAGE CIRCUITS SHALL NOT BE INSTALLED IN THE SAME WIREWAY.
- SPLICES FOR RUNWAY AND TAXIWAY SERIES CIRCUITS SHALL BE FAA APPROVED TYPE L-823 CONNECTORS AND SHALL BE INSTALLED IN SPLICE BOXES OR THE HIGH VOLTAGE WIREWAY.

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS


HANSON


TAXIWAY "C" EXTENSION I VOLTAGE WIRIN SCHEMATIC







CABLE TO GROUND ROD













<u>CABLE TO CABLE</u> <u>HORIZONTAL PARALLEL TAP</u>



### DETAIL NOTES

- . ALL BELOW GRADE CONNECTIONS TO GROUND RODS & GROUND RING CONDUCTORS SHALL BE EXOTHERMIC WELD TYPE CONNECTIONS. EXOTHERMIC WELDS SHALL BE CADWELD AS MANUFACTURED BY ERICO PRODUCTS, SOLON, OHIO, ULTRAWELD AS MANUFACTURED BY HARGER LIGHTNING PROTECTION & GROUNDING EQUIPMENT, GRAYSLAKE, IL, THERMOWELD AS MANUFACTURED BY CONTINENTAL INDUSTRIES, TULSA, OKLAHOMA, OR APPROVED EQUAL VERIFY PROPER SIZES, MOLDS, TYPES, AND REQUIREMENTS FOR THE RESPECTIVE APPLICATION WITH THE MANUFACTURER, AND INSTALL PER THEIR DIRECTIONS.
- 2. FOR APPLICATIONS TO GALVANIZED STEEL OR PAINTED STEEL, REMOVE GALVANIZING AND/OR PAINT & CLEAN THE SURFACE TO EXPOSE BARE STEEL BEFORE MAKING EXOTHERMIC WELD CONNECTION.
- 3. INDIVIDUAL GROUNDING ELECTRODE CONDUCTORS SHALL NOT BE INSTALLED IN METAL CONDUIT. INSTALL GROUNDING ELECTRODE CONDUCTORS IN SCHED 40 PVC CONDUIT AS REQUIRED IN FOUNDATIONS, FOR PROTECTION, WHERE ENTERING ENCLOSURES, ETC. WHERE PLASTIC CONDUIT IS USED FOR INDIVIDUAL GROUND WIRES, DO NOT COMPLETELY ENCIRCLE THE CONDUIT WITH FERROUS AND/OR MAGNETIC MATERIALS. WHERE METAL CLAMPS ARE INSTALLED USE NYLON BOLTS, NUTS, WASHERS, & SPACERS TO INTERRUPT A COMPLETE METALLIC PATH FROM ENCIRCLING THE CONDUIT.

EXOTHERMIC WELD DETAILS

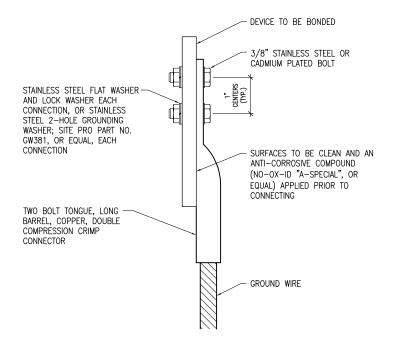



2 HOLE LONG BARREL COMPRESSION LUG TABLE					
WIRE SIZE	BURNDY CAT. NO.	THOMAS & BETTS CAT. NO.	PENN-UNION CAT. NO.		
#8 AWG STRANDED	YA8C-2TC38	256-30695-1157	BBLU-8D-2TC38		
#6 AWG SOLID	YA8C-2TC38 OR YGA6C-2TC38E2G1				
#6 AWG STRANDED	YA6C-2TC38	256-30695-1158	BBLU-6D-2TC38		
#4 AWG STRANDED	YA4C-2TC38	256-30695-1159	BBLU-4D-2TC38		
#2 AWG STRANDED	YA2C-2TC38	256-30695-1160	BBLU-2D-2TC38		
#2 AWG SOLID	YA3C-2TC38	256-30695-1160	BBLU-3D-2TC38		
#1/0 AWG STRANDED	YA25-2TC38	256-30695-1162	BBLU-1/0D-2TC38		
#2/0 AWG STRANDED	YA26-2TC38	256-30695-1116	BBLU-2/0D-2TC38		
#3/0 AWG STRANDED	YA27-2TC38	54816BE	BBLU-3/0D-2TC38		
#4/0 AWG STRANDED	YA28-2TC38	256-30695-1117	BBLU-4/0D-2TC38		

## NOTES

- ALL CONNECTIONS TO GROUND BUS BAR SHALL BE WITH 2 HOLE TONGUE LONG BARREL COMPRESSION LUGS BOLTED TO THE BUS BAR.
- GROUND WIRE CONNECTIONS TO EQUIPMENT SHALL BE WITH 2 HOLE TONGUE LONG BARREL COMPRESSION LUGS BOLTED TO THE DEVICE OR WITH THE RESPECTIVE EQUIPT MANUFACTURER'S LUG OR TERMINAL WHERE APPLICABLE
- 3. GROUNDING ELECTRODE CONDUCTORS, BONDING JUMPERS, & INDIVIDUAL GROUND WIRES SHALL NOT BE INSTALLED IN METAL CONDUIT. WHERE PLASTIC CONDUIT IS USED FOR INDIVIDUAL GROUND WIRES, DO NOT COMPLETELY ENCIRCLE THE CONDUIT WITH FERROUS AND/OR MAGNETIC MATERIALS. WHERE METAL CLAMPS ARE INSTALLED USE NYLON BOLTS, NUTS, WASHERS, & SPACERS TO INTERRUPT A COMPLETE METALLIC APTH FROM ENCIRCLING THE CONDUIT.
- 4. ALL CONNECTIONS SHALL BE COATED WITH A CORROSION PREVENTATIVE COMPOUND (SANCHEM INC. NO-OX-ID "A-SPECIAL", BURNDY PENETROX E, OR EQUAL) BEFORE JOINING. ALL COPPER BUS BARS SHALL BE CLEANED PRIOR TO MAKING CONNECTIONS TO REMOVE SURFACE OXIDATION. CLEAN SURFACES, OF RESPECTIVE DEVICES TO BE BONDED, TO BARE METAL, PER NEC 250-12.

GROUNDING LUG CONNECTION DETAIL

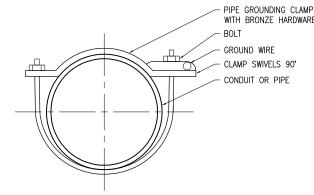

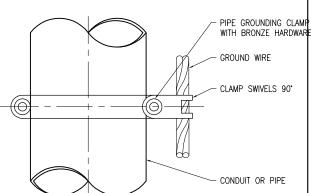


PIPE GROUNDING CLAMP TABLE				
BURNDY CAT. NO.	PIPE SIZE			
GAR3902-BU	1/2" - 1"			
GAR3903-BU	1 1/4" - 2"			
GAR3904-BU	2 1/2" - 3 1/2"			
GAR3905-BU	4" - 5"			
GAR3906-BU	6"			

#### <u>NOTES</u>

. PIPE GROUNDING CLAMPS SHALL HAVE BRONZE HARDWARE, BE CORROSION RESISTANT, SUITABLE FOR DIRECT BURIAL IN EARTH OR CONCRETE, & UL467 LISTED.

PIPE/CONDUIT GROUNDING CLAMP DETAIL

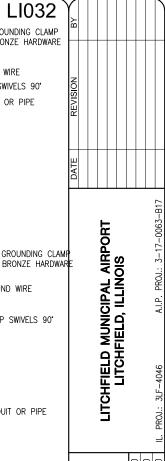

Hanson Professional Services Inc. 1525 South Skith Street Springfield, Illinois 62703-2886

TAXIWAY "C"
EXTENSION

37

of 70 sheets

4, 2011 10:00 AM INSCLOODS PORTS/LITCHFIELD\10A0094\CADD\AIRPORT\SHEET\E-504.DWG - GROUNDING DETAI **GROUNDING NOTES** 

- THE CONTRACTOR SHALL FURNISH AND INSTALL ALL GROUNDING AS MAY BE NECESSARY OR REQUIRED TO MAKE A COMPLETE GROUNDING SYSTEM AS REQUIRED BY THE LATEST NATIONAL ELECTRICAL CODE (NFPA 70) IN FORCE AND AS DETAILED HEREIN. THE RELIABILITY OF THE GROUNDING SYSTEM IS DEPENDENT ON CAREFUL, PROPER INSTALLATION AND CHOICE OF MATERIALS. IMPROPER PREPARATION OF SURFACES TO BE JOINED TO MAKE AN ELECTRICAL PATH. LOOSE JOINTS OR CORROSION CAN INTRODUCE IMPEDANCE THAT WILL SERIOUSLY IMPAIR THE ABILITY OF THE GROUND PATH TO PROTECT PERSONNEL AND EQUIPMENT AND TO ABSORB TRANSIENTS THAT CAN CAUSE NOISE IN COMMUNICATIONS CIRCUITS. THE FOLLOWING FUNCTIONS ARE PARTICULARLY IMPORTANT TO ENSURE A RELIABLE GROUND SYSTEM:
- FURNISH AND INSTALL GROUND RODS AS DETAILED HEREIN. GROUND RODS FOR AIRFIELD LIGHTING (RUNWAY LIGHTING, TAXIWAY LIGHTING, TAXI GUIDANCE SIGNS, & DISTANCE REMAINING SIGNS) SHALL BE MINIMUM 5/8-IN. DIAMETER BY 8-FT LONG, UL-LISTED COPPER CLAD WITH 10-MIL MINIMUM COPPER COATING. GROUND RODS FOR OTHER APPLICATIONS SHALL BE MINIMUM 3/4-IN. DIAMETER BY 10-FT LONG, UL-LISTED, COPPER CLAD WITH 10-MIL MINIMUM COPPER COATING. GROUND RODS SHALL BE SPACED OR AS DETAILED ON THE RESPECTIVE PLANS. AND IN NO CASE SPACED LESS THAN ONE ROD LENGTH APART. ALL CONNECTIONS TO GROUND RODS AND THE GROUND RING SHALL BE MADE WITH EXOTHERMIC WELD TYPE CONNECTORS, CADWELD BY ERICO PRODUCTS, INC., SOLON, OHIO, (PHONE 1-800-248-9353), THERMOWELD BY CONTINENTAL INDUSTRIES, INC., TULSA, OKLAHOMA (PHONE 918-663-1440), ULTRAWELD BY HARGER, GRAYSLAKE, ILLINOIS (PHONE 1-800-842-7437), OR APPROVED EQUAL. EXOTHERMIC WELD CONNECTIONS SHALL BE INSTALLED IN CONFORMANCE WITH THE RESPECTIVE MANUFACTURER'S DIRECTIONS USING MOLDS AS REQUIRED FOR EACH RESPECTIVE APPLICATION. BOLTED CONNECTIONS WILL NOT BE PERMITTED AT GROUND RODS OR AT BURIED GROUNDING ELECTRODE
- CONTRACTOR SHALL TEST EACH MADE ELECTRODE GROUND ROD/GROUND FIELD/GROUND RING WITH AN INSTRUMENT SPECIFICALLY DESIGNED FOR TESTING GROUND FIELD SYSTEMS. IF GROUND RESISTANCE EXCEEDS 10 OHMS, CONTACT THE ENGINEER FOR FURTHER DIRECTION. COPIES OF GROUND FIELD TEST RESULTS SHALL BE FURNISHED TO THE RESIDENT ENGINEER, UPON REQUEST, FOR REVIEW AND RECORD PURPOSES.
- ALL PRODUCTS ASSOCIATED WITH THE GROUNDING SYSTEM SHALL BE UL-LISTED AND
- ALL BOLTED OR MECHANICAL CONNECTIONS SHALL BE COATED WITH A CORROSION PREVENTATIVE COMPOUND BEFORE JOINING, SANCHEM INC. "NO-OX-ID "A-SPECIAL" COMPOUND, BURNDY PENETROX E, OR EQUAL.
- METALLIC SURFACES TO BE JOINED SHALL BE PREPARED BY THE REMOVAL OF ALL NON-CONDUCTIVE MATERIAL, PER 2008 NATIONAL ELECTRICAL CODE ARTICLE 250-12. ALL COPPER BUS BARS MUST BE CLEANED PRIOR TO MAKING CONNECTIONS TO
- METALLIC RACEWAY FITTINGS SHALL BE MADE UP TIGHT TO PROVIDE A PERMANENT LOW IMPEDANCE PATH FOR ALL CIRCUITS. METAL CONDUIT TERMINATIONS IN ENCLOSURES SHALL BE BONDED TO THE ENCLOSURE WITH UL-LISTED FITTINGS SUITABLE FOR GROUNDING. PROVIDE GROUNDING BUSHINGS WITH BONDING JUMPERS FOR ALL METAL CONDUITS ENTERING SERVICE EQUIPMENT (METER BASE, CT CABINET, MAIN SERVICE BREAKER ENCLOSURE, ETC.). PROVIDE GROUNDING BUSHINGS WITH BONDING JUMPERS FOR ALL METAL CONDUITS ENTERING AN ENCLOSURE THROUGH CONCENTRIC OR ECCENTRIC KNOCKOUTS THAT ARE PUNCHED OR OTHERWISE FORMED SO AS TO IMPAIR THE ELECTRICAL CONNECTION TO GROUND. STANDARD LOCKNUTS OR BUSHINGS SHALL NOT BE THE SOLE MEANS FOR BONDING WHERE A CONDUIT ENTERS AN ENCLOSURE THROUGH A CONCENTRIC OR ECCENTRIC KNOCKOUT
- ALL CONNECTIONS, LOCATED ABOVE GRADE, BETWEEN THE DIFFERENT TYPES OF GROUNDING CONDUCTORS SHALL BE MADE USING UL-LISTED DOUBLE COMPRESSION CRIMP TYPE CONNECTORS OR UL-LISTED BOLTED GROUND CONNECTORS. FOR GROUND CONNECTIONS TO ENCLOSURES, CASES AND FRAMES OF ELECTRICAL EQUIPMENT NOT SUPPLIED WITH GROUND LUGS THE CONTRACTOR SHALL DRILL REQUIRED HOLES FOR MOUNTING A BOLTED GROUND CONNECTOR. ALL BOLTED GROUND CONNECTORS SHALL BE BURNDY, THOMAS AND BETTS, OR EQUAL. TIGHTEN CONNECTIONS TO COMPLY WITH TIGHTENING TORQUES IN UL STANDARD 486A TO ASSURE PERMANENT AND EFFECTIVE
- ALL METAL EQUIPMENT ENCLOSURES, CONDUITS, CABINETS, BOXES, RECEPTACLES, MOTORS, ETC. SHALL BE BONDED TO THE RESPECTIVE GROUNDING SYSTEM.
- 10. PROVIDE ALL BOXES FOR PROPOSED OUTLETS, SWITCHES, CIRCUIT BREAKERS, ETC. WITH GROUNDING SCREWS. PROVIDE ALL PANELBOARD, SWITCHGEAR, ETC., ENCLOSURES WITH GROUNDING BARS WITH INDIVIDUAL SCREWS, LUGS, CLAMPS, ETC., FOR EACH OF THE GROUNDING CONDUCTORS THAT ENTER THEIR RESPECTIVE ENCLOSURES.
- 11. EACH NEW FEEDER CIRCUIT AND/OR BRANCH CIRCUIT SHALL INCLUDE AN EQUIPMENT GROUND WIRE. METAL RACEWAY OR CONDUIT SHALL NOT MEET THIS REQUIREMENT. THE EQUIPMENT GROUND WIRE FROM EQUIPMENT SHALL NOT BE SMALLER THAN ALLOWED BY 2008 NEC TABLE 250-122 "MINIMUM SIZE CONDUCTORS OR GROUNDING RACEWAY AND EQUIPMENT." WHEN CONDUCTORS ARE ADJUSTED IN SIZE TO COMPENSATE FOR VOLTAGE DROP, EQUIPMENT-GROUNDING CONDUCTORS SHALL BE ADJUSTED PROPORTIONATELY ACCORDING TO CIRCULAR MIL AREA. ALL EQUIPMENT GROUND WIRES SHALL BE COPPER, EITHER BARE OR INSULATED GREEN IN COLOR. WHERE THE FOLIPMENT GROUNDING CONDUCTORS ARE INSULATED. THEY SHALL BE IDENTIFIED BY THE COLOR GREEN, AND SHALL BE THE SAME INSULATION TYPE AS THE PHASE CONDUCTORS.

- ALL EXTERIOR METAL CONDUIT, WHERE NOT ELECTRICALLY CONTINUOUS BECAUSE OF MANHOLES, HANDHOLES, NON-METALLIC JUNCTION BOXES, ETC., SHALL BE BONDED TO ALL OTHER METAL CONDUIT IN THE RESPECTIVE DUCT RUN. AND AT EACH END. WITH A COPPER-BONDING JUMPER SIZED IN CONFORMANCE WITH 2008 NEC 250-102 WHERE METAL CONDUITS TERMINATE IN AN ENCLOSURE (SUCH AS A MOTOR CONTROL CENTER, SWITCHBOARD, ETC) WHERE THERE IS NOT ELECTRICAL CONTINUITY WITH THE CONDUIT AND THE RESPECTIVE ENCLOSURE, PROVIDE A BONDING JUMPER FROM THE RESPECTIVE ENCLOSURE GROUND BUS TO THE CONDUIT SIZED PER 2008 NEC 250-102.
- IT IS THE INTENT OF THIS SPECIFICATION THAT ALL MOTOR FRAMES, PUMP BASES ELECTRICAL EQUIPMENT ENCLOSURES, PANEL HOUSINGS, CONDUITS, BOXES, ETC. HAVE A CONTINUOUS COPPER WIRE GROUND CONNECTION AND SHALL BE POSITIVELY BONDED TO THE RESPECTIVE GROUNDING SYSTEM. CONDUIT CONNECTORS WILL NOT BE CONSIDERED AS ADEQUATE GROUNDING.
- PROVIDE A POSITIVE GROUND BOND FOR ALL OUTLET BOXES, ELECTRICAL EQUIPMENT ENCLOSURES, GROUNDING RECEPTACLES, TOGGLE SWITCHES, ETC. INSTALL A GROUNDING CONDUCTOR IN ALL WIRE AND CABLE RACEWAYS. GROUND CONDUCTOR TO HAVE 600-VOLT INSULATION AND BE IDENTIFIED BY A CONTINUOUS GREEN COLOR COATING. THEY SHALL BE USED SOLELY FOR GROUNDING PURPOSES AND BE ENTIRELY SEPARATE FROM WHITE GROUNDED NEUTRAL CONDUCTOR, EXCEPT AT SUPPLY SIDE OF SERVICE DISCONNECTING MEANS, WHERE GROUNDING AND NEUTRAL SYSTEMS ARE TO BE
- 15. EACH AND ALL GROUNDED CASED AND METAL PARTS ASSOCIATED WITH ELECTRICAL EQUIPMENT SHALL BE TESTED FOR CONTINUITY OF CONNECTION WITH GROUND BUS SYSTEM BY CONTRACTOR IN PRESENCE OF OWNER'S REPRESENTATIVE.
- 16. ALL CONNECTIONS BETWEEN THE DIFFERENT TYPES OF GROUNDING CONDUCTORS ABOVE GRADE SHALL BE MADE USING BOLTED GROUND CONNECTORS. GROUND LUGS SHALL BE PROVIDED IN ALL ENCLOSURES AND WIRING TERMINATION JUNCTION BOXES. EQUIPMENT GROUNDS AND GROUNDING CONDUCTOR SHALL BE CONNECTED TO THESE GROUND LUGS. FOR GROUND CONNECTIONS TO ENCLOSURES, CASES AND FRAMES OF ELECTRICAL EQUIPMENT NOT SUPPLIED WITH GROUND LUGS THE CONTRACTOR SHALL DRILL REQUIRED HOLES FOR MOUNTING A BOLTED GROUND CONNECTOR. ALL BOLTED GROUND CONNECTORS SHALL BE BURNDY, OR FOUAL.
- BOND ALL NONCURRENT-CARRYING PARTS OF METAL EQUIPMENT TO GROUND SYSTEM.
- BUILDING STRUCTURAL STEEL SYSTEM SHALL BE BONDED TO ELECTRICAL GROUND
- INSTALL GROUNDING ELECTRODE CONDUCTORS, LIGHTNING PROTECTION DOWN CONDUCTORS AND SEPARATE GROUND CONDUCTORS IN SCHEDULE 40 OR SCHEDULE 80 PVC CONDUIT OR EXPOSED WHERE ACCEPTABLE TO LOCAL CODES. WHERE GROUNDING ELECTRODE CONDUCTORS, LIGHTNING PROTECTION DOWN CONDUCTORS OR INDIVIDUAL GROUND CONDUCTORS ARE RUN IN PVC CONDUIT,  $\underline{DO}$  NOT COMPLETELY ENCIRCLE CONDUIT WITH FERROUS AND/OR MAGNETIC MATERIALS. USE NON-METALLIC REINFORCED FIBERGLASS STRUT SUPPORT. WHERE METAL CONDUIT CLAMPS ARE INSTALLED. USE NYLON BOLTS, NUTS, WASHERS AND SPACERS TO INTERRUPT A COMPLETE METALLIC PATH FROM ENCIRCLING THE CONDUIT. THIS IS REQUIRED TO AVOID GIRDLING OF GROUND CONDUCTORS. GIRDLING OF A GROUND CONDUCTOR IS THE RESULT OF PLACING THE CONDUCTOR IN A RING OF MAGNETIC MATERIAL. THIS RING COULD BE A METALLIC CONDUIT, U-BOLT OR STRUT SUPPORT PIPE CLAMP, OR OTHER SUPPORT HARDWARE. THE RESULT OF GIRDLING GROUND CONDUCTORS SIGNIFICANTLY INCREASES THE INDUCTIVE IMPEDANCE OF THE GROUND CONDUCTOR. INDUCTIVE AND CAPACITIVE IMPEDANCE IS A TYPE OF RESISTANCE THAT OPPOSES THE FLOW OF ALTERNATING CURRENT. ANY INCREASE IN THE IMPEDANCE OF A GROUND CONDUCTOR REDUCES ITS ABILITY TO EFFECTIVELY MITIGATE RADIO FREQUENCY NOISE IN THE GROUND SYSTEM. THE CONDITION WHERE A GROUND CONDUCTOR IS GIRDLED DURING A LIGHTNING STRIKE RESULTS IN PHENOMENA KNOWN AS SURGE IMPEDANCE LOADING. SURGE IMPEDANCE LOADING IS A RESULT OF VOLTAGE AND CURRENT REACHING 500,000 VOLTS AND 10,000 AMPS FOR A SHORT DURATION. GIRDLING FURTHER INCREASES THE IMPEDANCE AT LIGHTNING FREQUENCIES OF 100 KILOHERTZ TO 100 MEGAHERTZ. AT THESE POWER AND FREQUENCY LEVELS ANY INCREASE IN THE IMPEDANCE OF THE GROUND CONDUCTOR MUST BE CONTROLLED. DURING LIGHTNING DISCHARGE CONDITIONS A LOW INDUCTIVE IMPEDANCE PATH IS MORE IMPORTANT THAN A LOW DC RESISTANCE PATH.
- IF LOCAL CODES DICTATE THAT INDIVIDUAL GROUNDING CONDUCTORS MUST BE RUN IN METAL CONDUIT OR RACEWAY. THEN THE CONDUIT OR RACEWAY MUST BE BONDED AT EACH END OF THE RUN WITH A BONDING JUMPER SIZED EQUAL TO THE INDIVIDUAL GROUNDING CONDUCTOR OR AS REQUIRED BY 2008 NEC 250-102. NOTE THIS DOES NOT APPLY TO AC FOUIPMENT GROUNDING CONDUCTORS RUN WITH AC CIRCUITS
- WHERE A CONFLICT IS DETERMINED WITH RESPECT TO GROUNDING REQUIREMENTS PER MANUFACTURER INSTALLATION INSTRUCTIONS, NEC, AND/OR THE CONTRACT DOCUMENTS, CONTACT THE RESIDENT ENGINEER OR PROJECT ENGINEER FOR FURTHER DIRECTIONS.

LEGEND PLATE SCHEDULE			
DEVICE	LABEL		
RUNWAY 18-36 & TAXIWAY C CCR	RUNWAY 18-36 & TAXIWAY C		

- NOTES

  1. PROVIDE PHENOLIC ENGRAVED LEGEND PLATES FOR THE NEW CONSTANT CURRENT REGULATOR. NOTING THE RUNWAY AND/OR TAXIWAY
- 2. LEGEND PLATES SHALL BE WEATHERPROOF ENGRAVED PLASTIC OR PHENOLIC MATERIAL, 1/4" HIGH BLACK LETTERS ON A WHITE BACKGROUND UNLESS NOTED OTHERWISE. SECURE WITH WEATHERPROOF BACKGROUND ONLESS NOTED OTHERWISE. SECURE WITH WEATHERPRO ADDESIVE AND/OR MACHINE SCREWS. FURNISH ADDITIONAL LEGEND PLATES WHERE REQUIRED BY CODE, FOR ADDITIONAL EQUIPMENT, AS DETAILED HEREIN ON THE PLANS, AND AS NOTED IN THE SPECIAL PROVISION SPECIFICATIONS.
- 3. FURNISH & INSTALL A WEATHERPROOF WARNING LABEL FOR EACH SAFETY SWITCH, PANELBOARD, LOAD CENTER, CUTOUT, & CONTROL PANEL TO WARN PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS, PER THE REQUIREMENTS OF NEC 110.16 "FLASH PROTECTION". LABELS SHALL BE HAZARD COMMUNICATION SYSTEMS, LLC (190 OLD MILFORD RD., BOX 1174, MILFORD, PA 18337, PHONE: 1–877–748–0244) PART NO. H6010–9VWHBJ OR APPROVED EQUAL.



"DANGER - HIGH VO

PROVIDE WARNING SIGN ON VAU "DANGER — HIGH VOLTAGE — KE OF NEC 110.34 (C). PROVIDE I EACH DOOR TO THE VAULT).




"DANGER - HIGH VOLTAGE" SIGN


FURNISH AND INSTALL "DANGER - HIGH VOLTAGE" LABELS/SIGNS FOR THE NEW CONSTANT CURRENT REGULATOR, TO COMPLY WITH FAA AC 150/5340-26B "MAINTENANCE OF AIRPORT VISUAL AID FACILITIES".

	REVISION UPTDATED PER IDA DIRECTIONS
VOLTAGE P OUT	ICIPAL AIRPORT
VOLTAGE KEEP OUT" SIGN  AULT EXTERIOR DOORS LABELED  KEEP OUT" PER THE REQUIREMENTS  E MINIMUM OF 2 SIGNS (ONE ON	LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS
NGFR	40 0800 E E D5.DWG


HANSON

LEGEND PLATE SCHEDULE TAXIWAY "C" EXTENSION

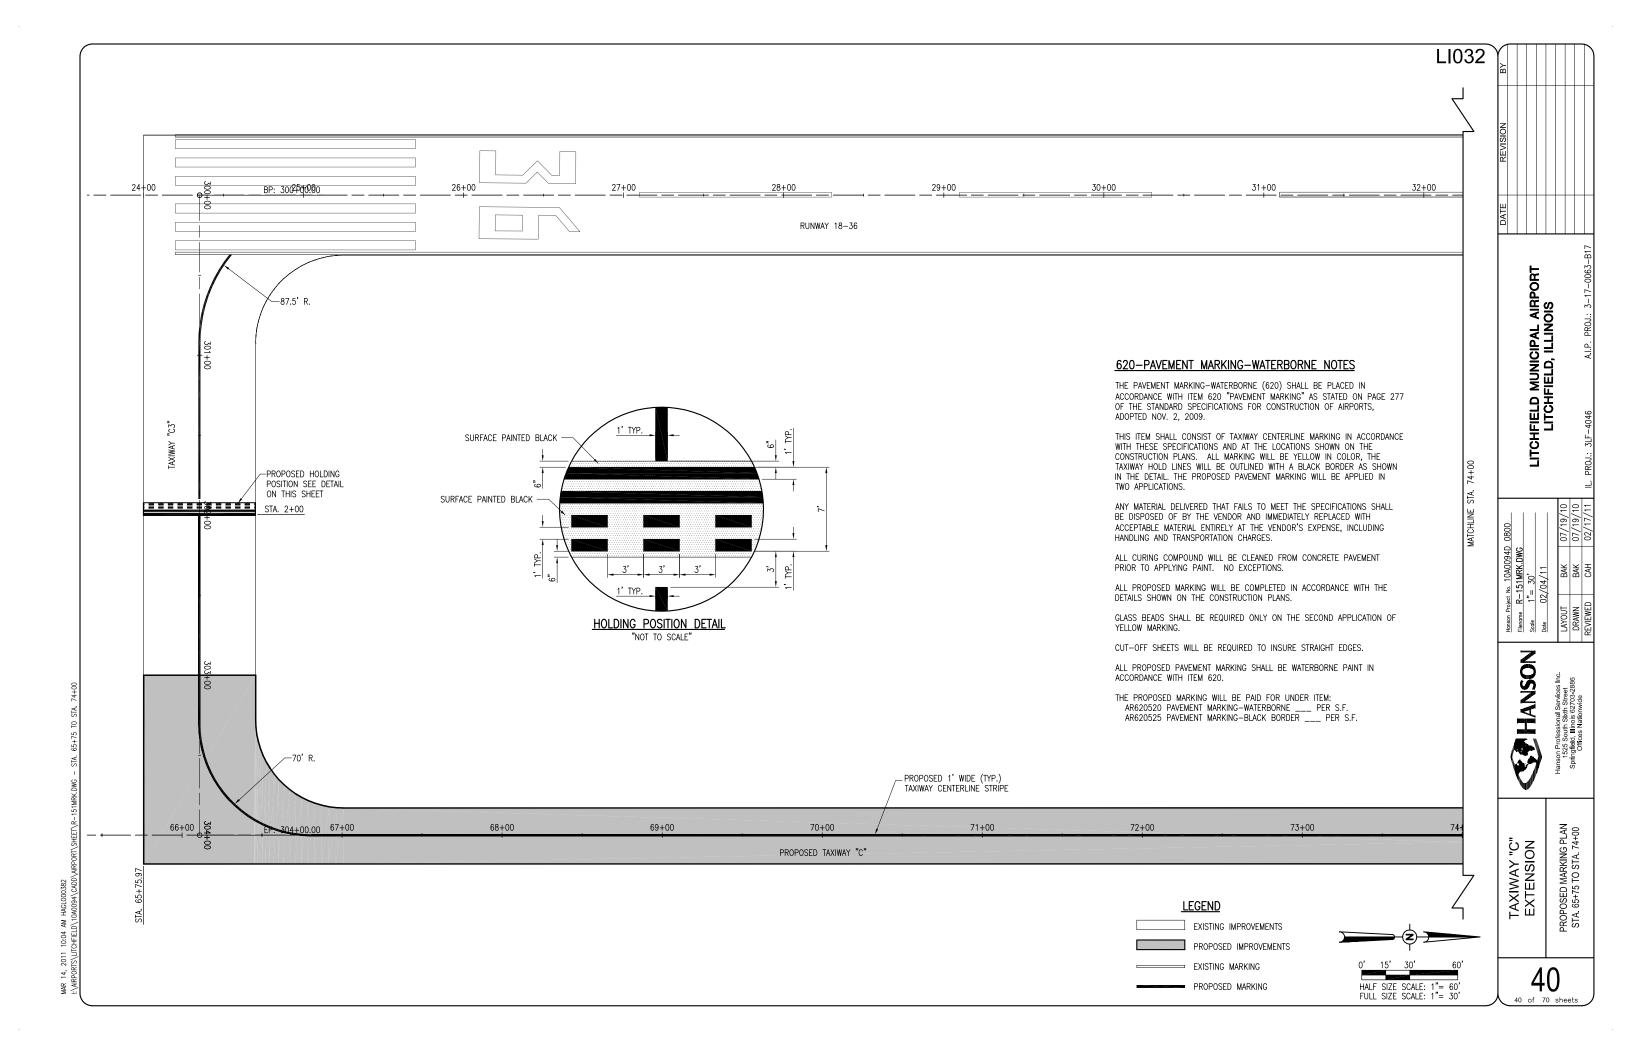

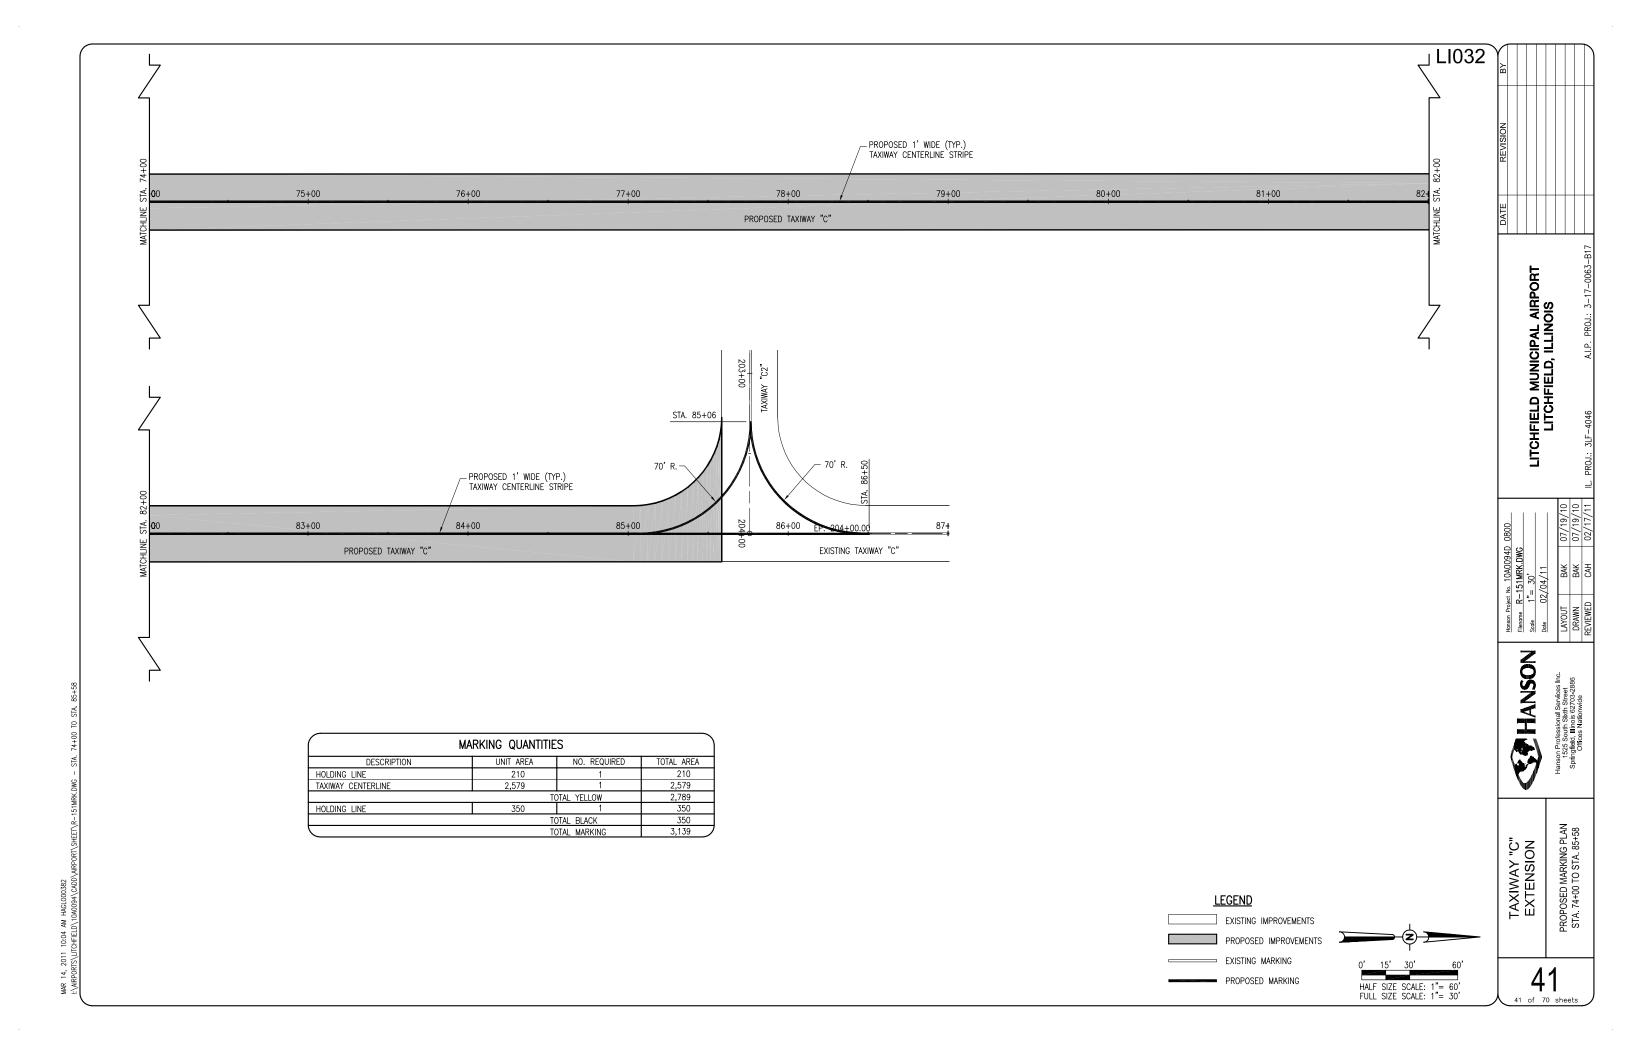

LI032 LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Human Project No. 10A0094D 0800
Fletome R-301-XSEC.DWG
Scole V. 1"=2', H. 1"=20'
Date 02/04/11 HANSON 672

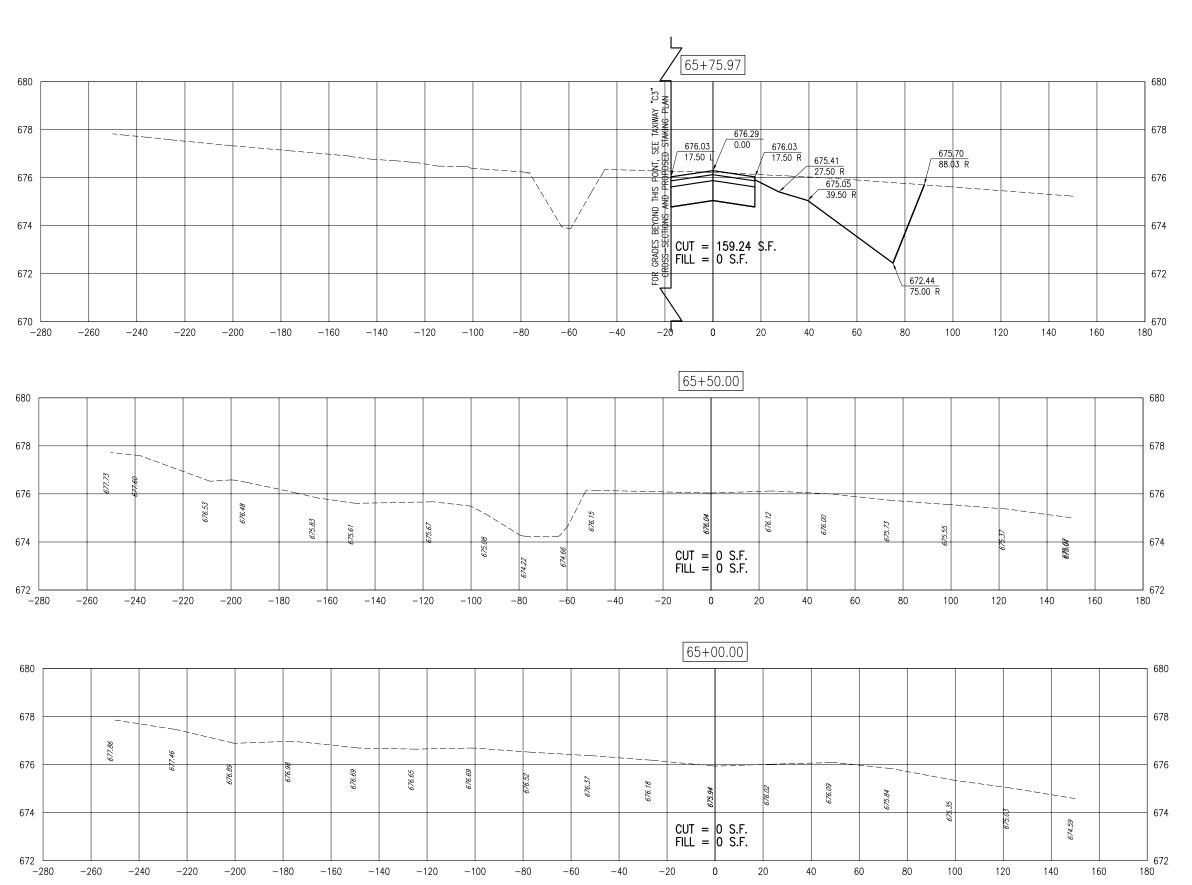

-260

-240

-220

-200

-180

-160

-140

-120

-100

-80

-60

-40

-20

20

0

40

60

80

100


120


140

160

180

CROSS-SECTIONS FOR TAXIWAY C STA. 65+00 TO STA. 65+75.97

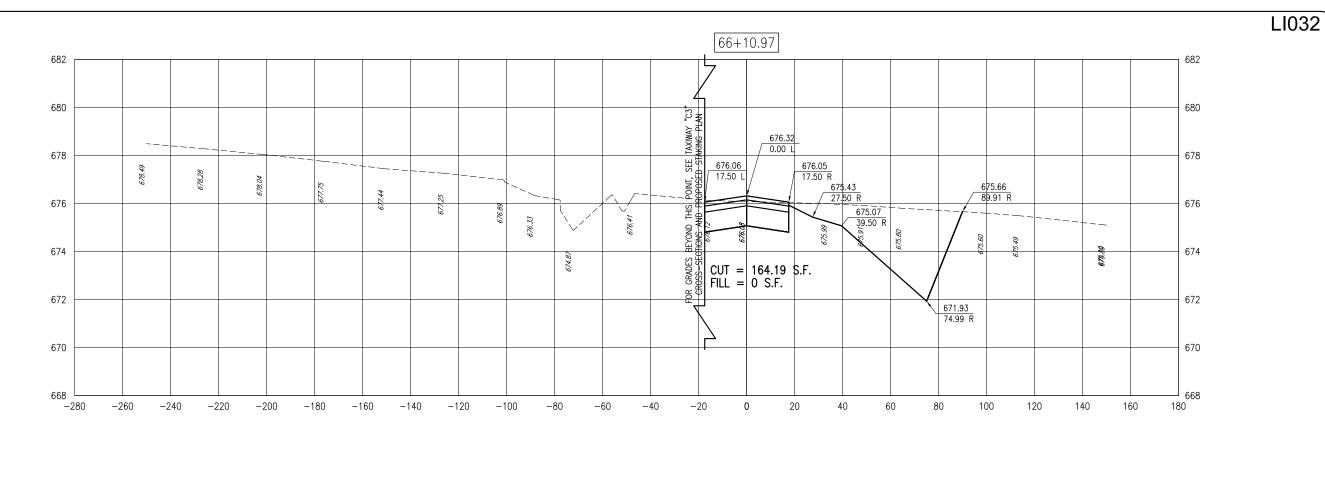

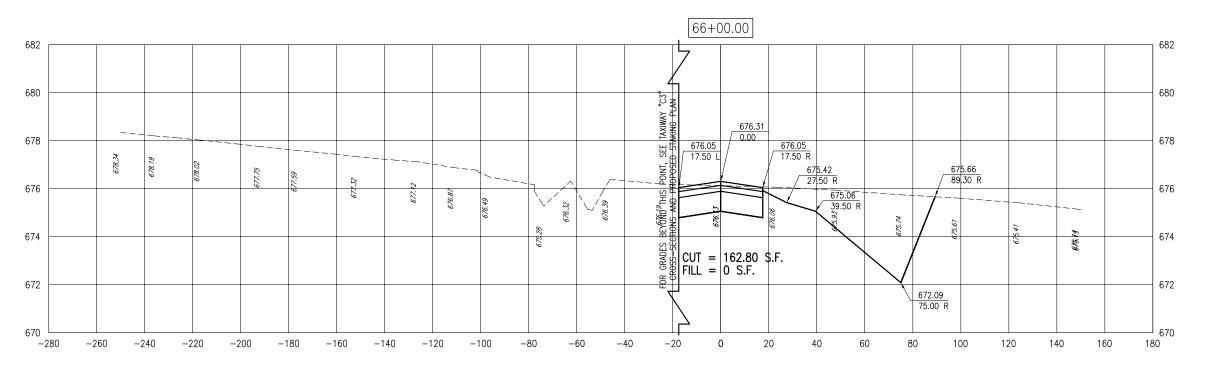



LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Henson Project No. 10A0094D 0800 Fleronne R-301-XSEC.DWG Scale V. 1"=2', H. 1"=20' Date 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY C STA. 66+00 TO STA. 66+10.97

43

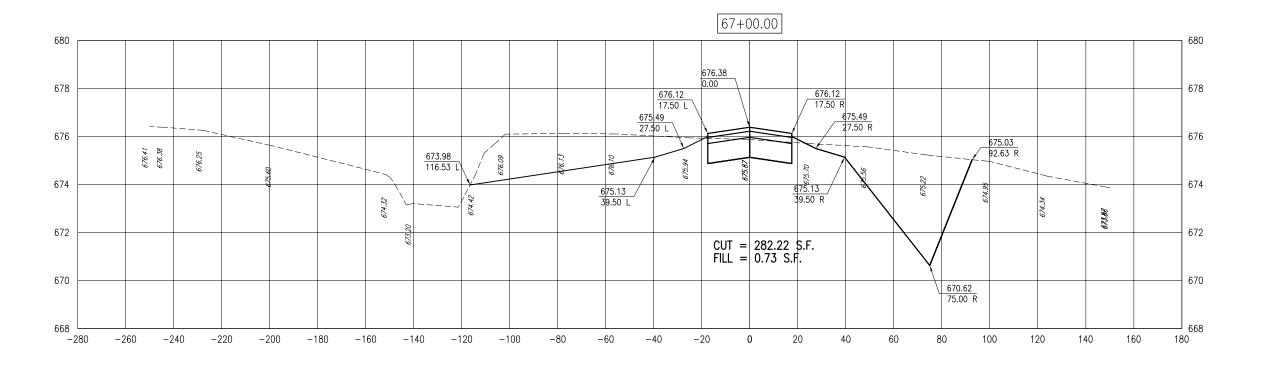

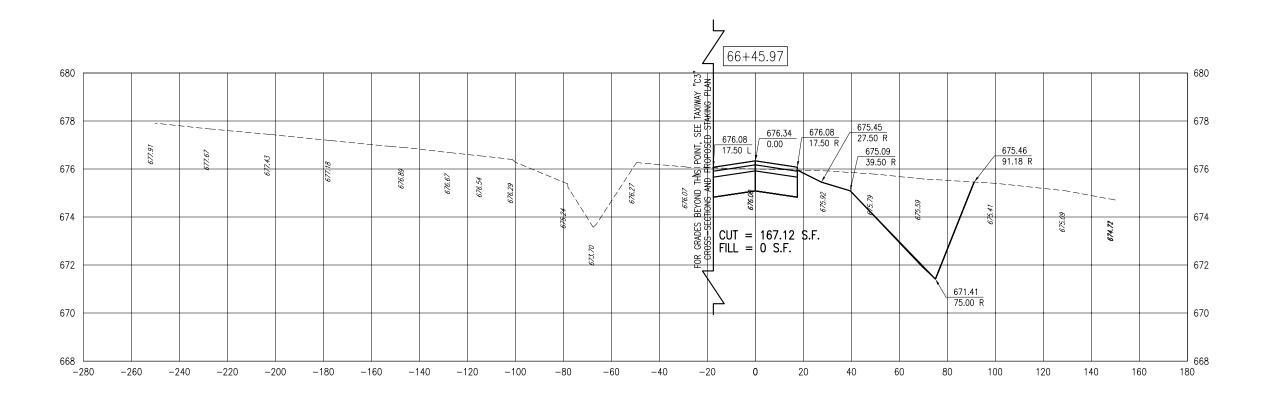

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

Hurson Project No. 10A0094D 0800
Fletome R-301-XSEC.DWG
Scole V. 1"=2", H. 1"=20"
Date 02/04/11

HANSON


CROSS-SECTIONS FOR TAXIWAY C STA. 66+45.97 TO STA. 67+00


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

Hurson Project No. 10A0094D 0800
Fletome R-301-XSEC.DWG
Scole V. 1"=2", H. 1"=20"
Date 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY C STA. 67+50 TO STA. 68+00

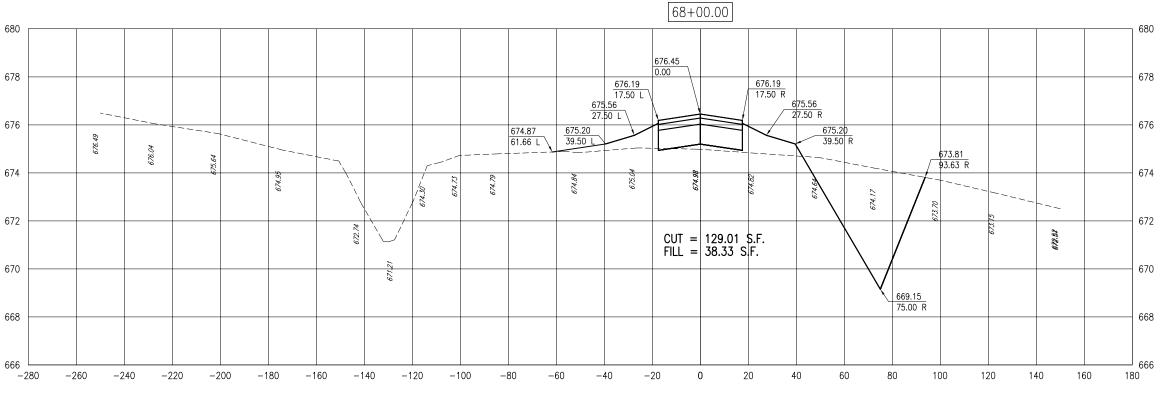

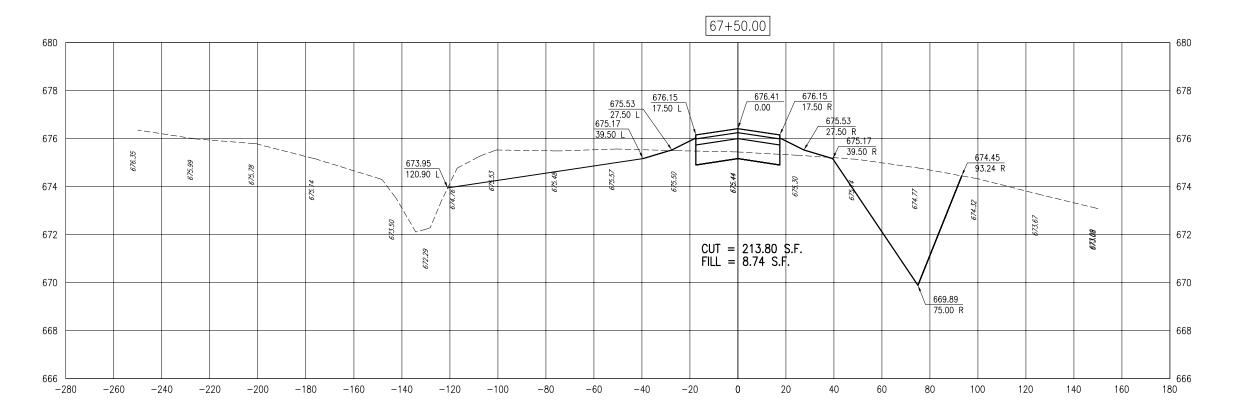



LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS


Henson Project No. 10A0094D 0800 Fleronne R-301-XSEC.DWG Scale V. 1"=2', H. 1"=20' Date 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY C STA 68+50 TO STA 69+00

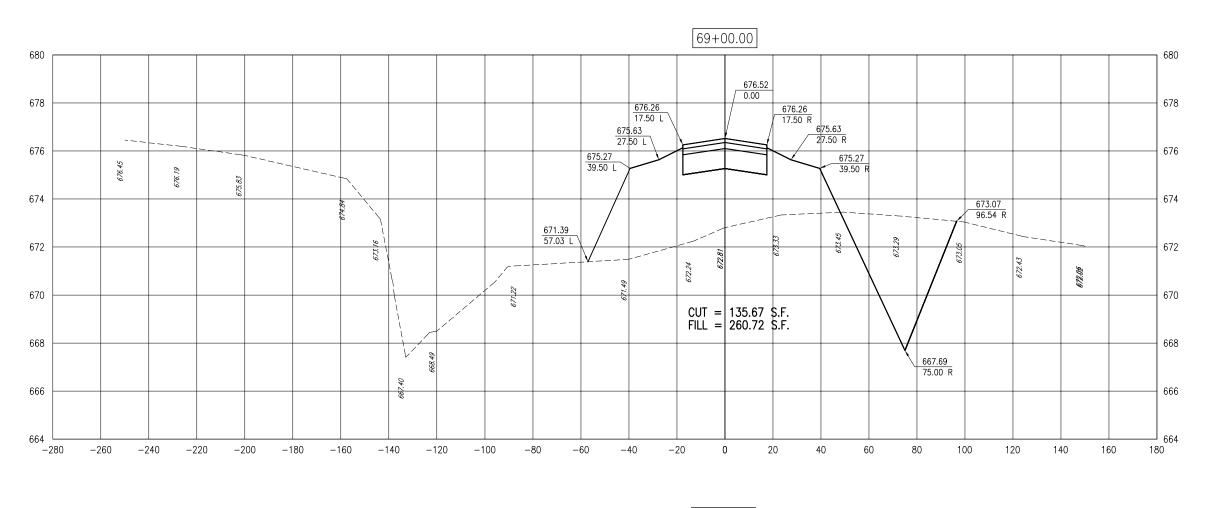

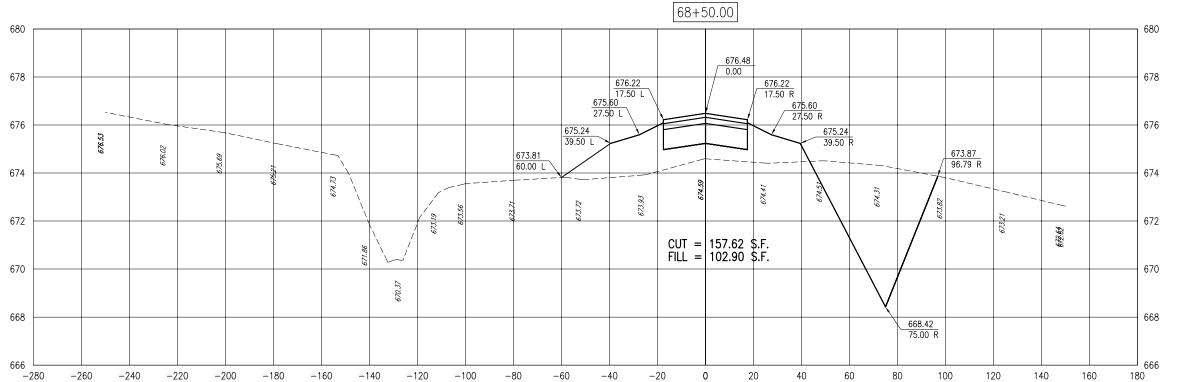

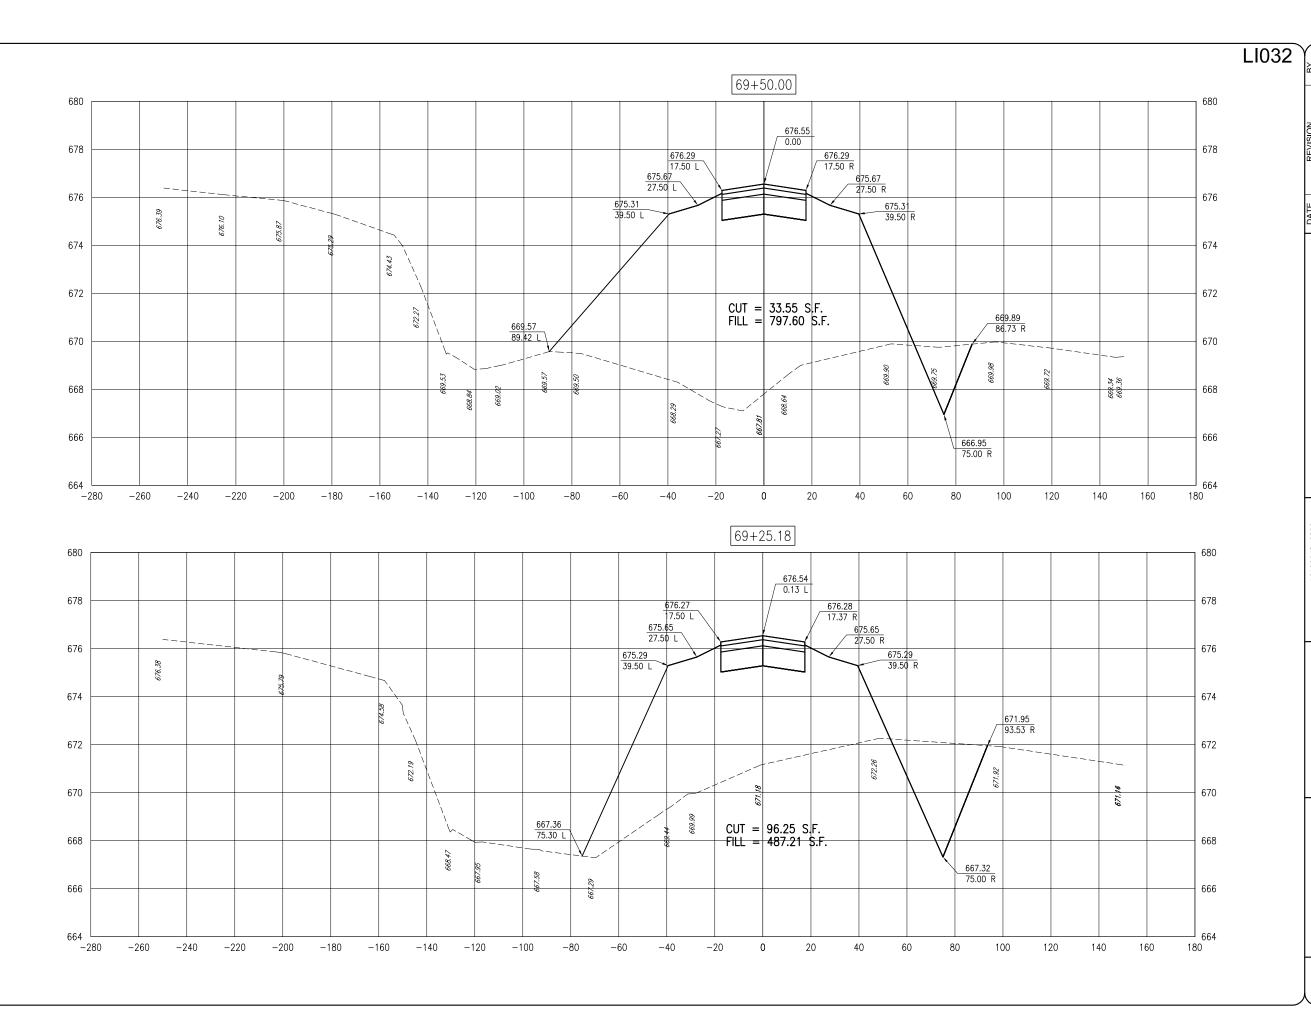

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Hunson Project No. 10A0094D 0800
Filenome R=301-XSEC.DWG
Scale V. 1"=2', H, 1"=20'
Dote 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY C STA. 69+25.18 TO STA. 69+50

TAXIWAY "C" EXTENSION

LI032 70+00.00 680 676.59 0.00 676.33 17.50 R 675.70 27.50 R 678 676.33 17.50 L 27.50 L 678 676 676 675.34 39.50 R 674 674 672 672 670.08 60.54 L 670 670 668.49 66.90 R 670.18 668 668 91.899 668.14 CUT = 0 S.F. FILL = 600.47 S.F. 666 666 664 664 -280 -260 -240 -220 -200 -180 -160 -140-120 -100-80 -60 -40 -20 20 40 60 80 100 120 140 160 180 0 69+80.28 680 680 676.58 676.31 17.50 R 675.69 / 27.50 R 678 678 676.31 17.50 L 675.69 27.50 L 676 676 675.33 39.50 L 675.33 39.50 R 676.37 676.34 674 674 672 672 669.96 63.72 L 670 670 669.93 16.699 668 668 75.00 R CUT = 0 S.F. FILL = 694.70 S.F. 666 666 664 664 -280 -260 -240 -220 -200 -180 -160 -140 -120 -100 -80 -60 -40 -20 20 40 60 80 100 120 140 160 180 0

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Hunson Project No. 10A0094D 0800
Filename R-302-XSEC.DWG
Scale V. 1"=2', H. 1"=20'
Date 02/04/11 HANSON TAXIWAY "C" EXTENSION

48

48 of 70 sheets


CROSS-SECTIONS FOR TAXIWAY C STA. 69+80.28 TO STA. 70+00


LI032 LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

Hurson Project No. 10A0094D 0800 Fleronne R-302-XSEC.DWG Scale V. 1"=2', H. 1"=20' Date 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY C STA. 70+50 TO STA. 71+00

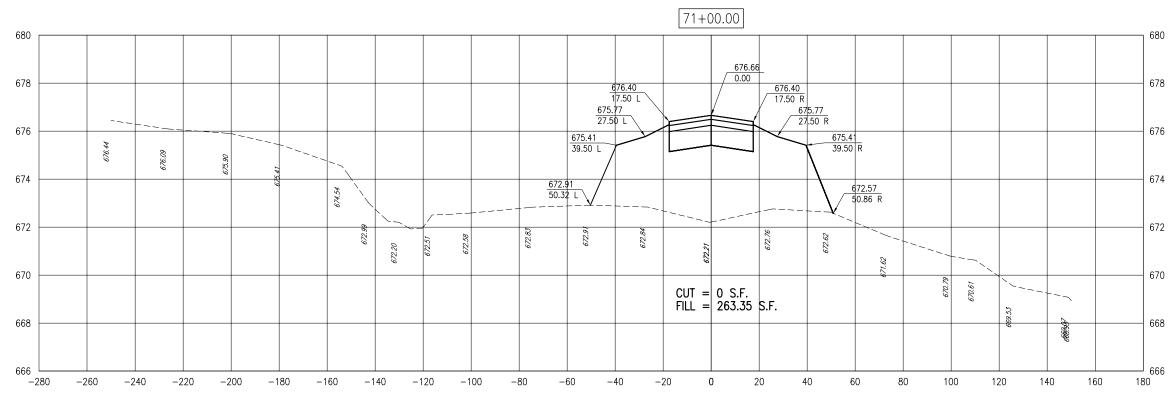

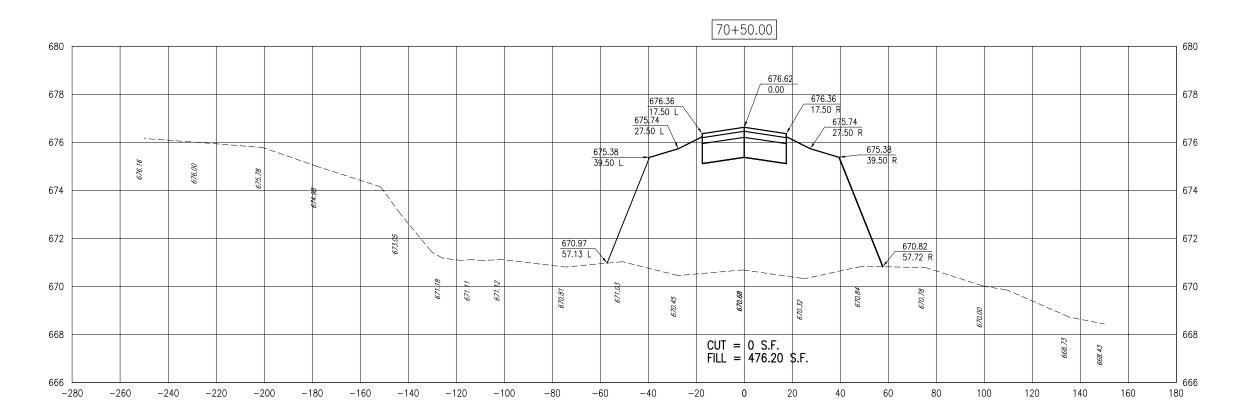


LI032 72+00.00 680 680 676.73 0.00 676.47 17.50 R 675.84 27.50 R 678 678 676.47 17.50 L 675.84 27.50 L 676 676 675.48 39.50 R 674.49 105.77 L 675.48 39.50 L 674 674 91 674 22 74 44.57 R 672 672 670 670 CUT = 6.66 S.F. FILL = 112.29 S.F. 668 668 666 666 664 664 -280 -260-240 -220 -200 -180 -160-140-120 -100-80 -60 -40 -20 20 40 60 80 100 120 140 160 180 71+50.00 680 680 676.69 678 678 676.43 17.50 L 676.43 17.50 R 675.81 27.50 L 676 676 675.45 39.50 675.45 39.50 R 674 674 674.27 674.01 673.81 46.06 R 672 672 672.53 672.41 670 670 CUT = 0 S.F. FILL = 159.96 S.F. 668 668 666 666 666.33 ᆜ 664 180 664 └─ -280 -260-240-220 -200-180 -160-140-120-10020 40 60 80 100 120 140 160 -80 -60-40 -20 0

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Hunson Project No. 10A0094D 0800
Filenome R=302=XSEC.DWG
Scale V. 1"=2', H. 1"=20'
Dote 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY STA. 71+50 TO STA. 72+00

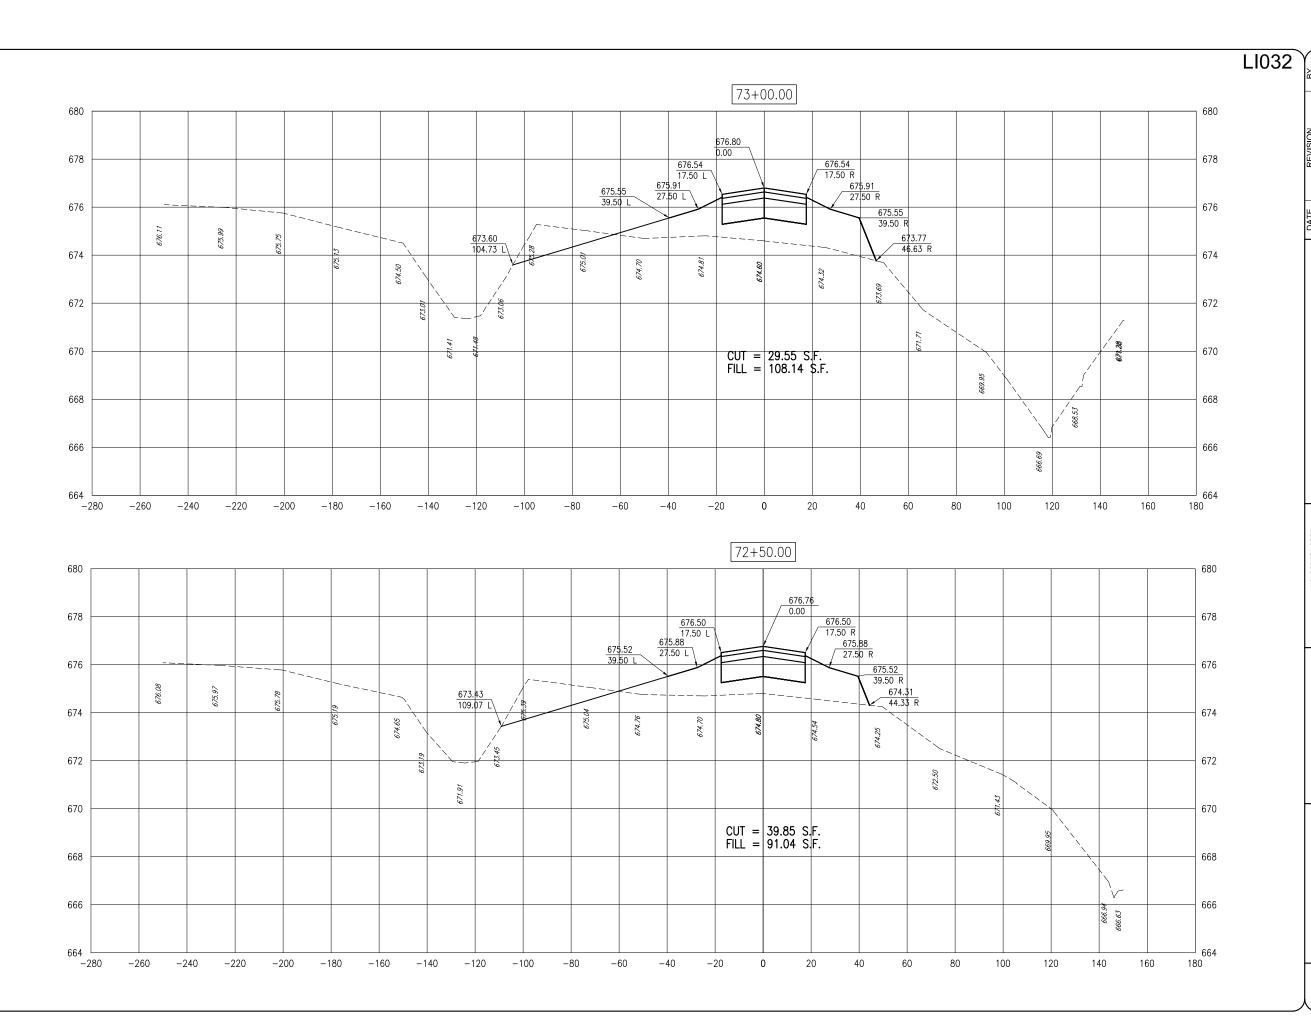


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

Honson Project No. 10A0094D 0800 Flavoure R-302-XSEC.DWG Scole V. 1"=2', H. 1"=20' Date 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY STA. 72+50 TO STA. 73+00

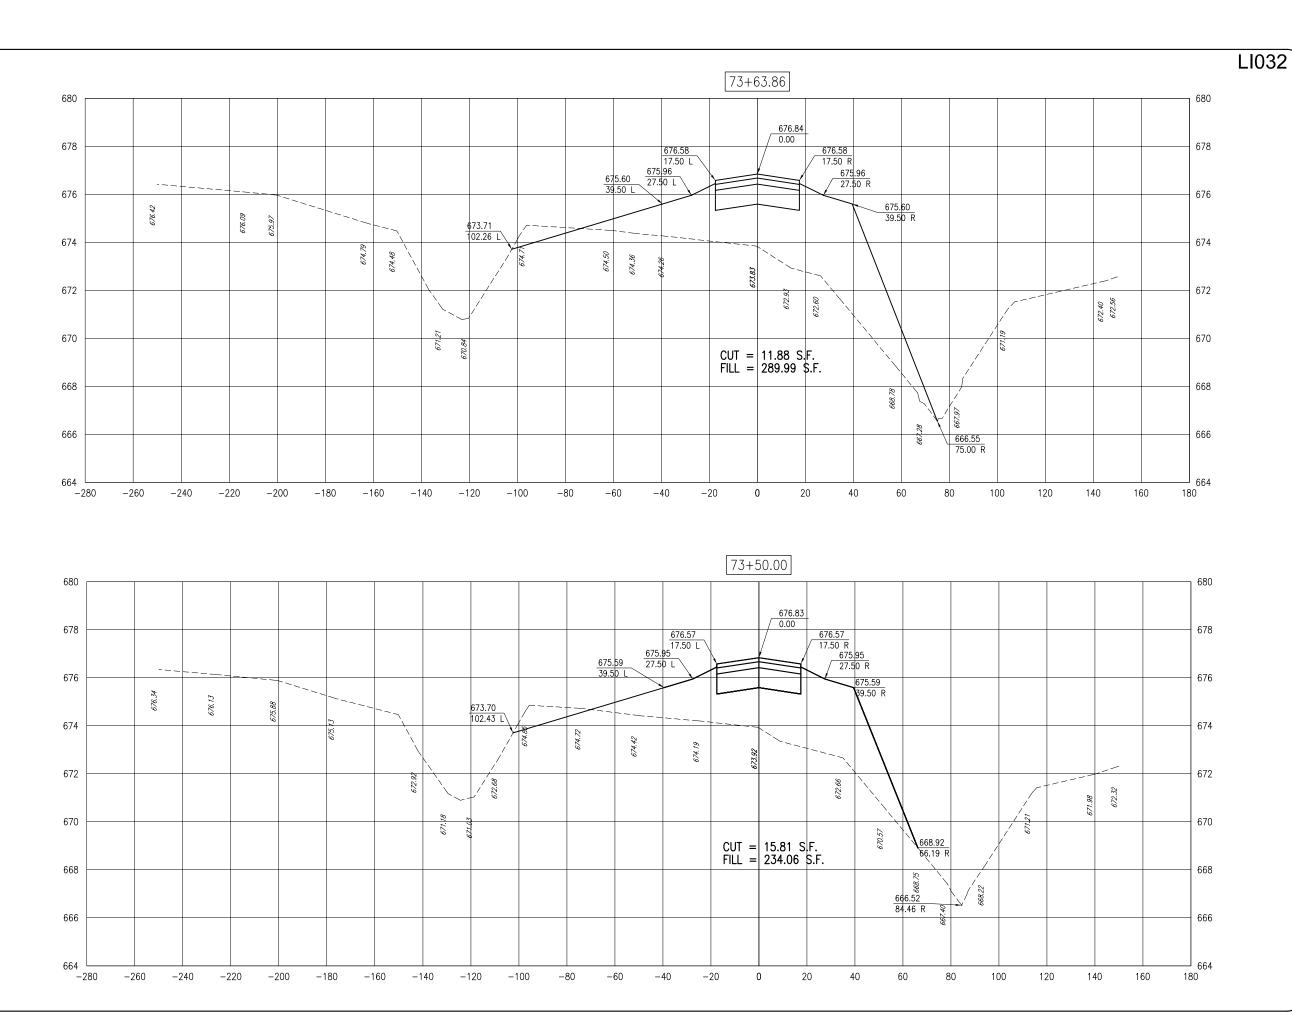

7 14, 2011 10:55 AM HAGLO00382

TAXIWAY "C" EXTENSION

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

Humon Project No. 10A0094D 0800
Flerome R-302-XSEC.DWG
Scale V. 1"=2', H. 1"=20'
Date 02/04/11

HANSON

52

CROSS-SECTIONS FOR TAXIWAY C STA. 73+50 TO STA. 73+63.86

LI032 74+50.00 680 676.90 678 678 676.64 17.50 L 676.64 17.50 R 676.02 27.50 R 676 676 675.66 39.50 R 673.24 97.88 R 675.66 39.50 L 674.09 91.74 L 674 674 674.36 CUT = 104.98 \$.F. FILL = 541.97 \$.F. 672 672 670 670 668 668 667.52 75.00 R 666 666 664 664 -280 -260 -160 -100 -60 -40 20 40 60 80 100 120 140 160 -240-220 -200 -180 -140-120 -80 -200 180 74+00.00 680 680 676.87 676.61 17.50 R 675.98 / 27.50 R 678 678 676.61 17.50 L 676 676 675.62 39.50 R 676.23 675.62 39.50 L 673.82 99.73 L 674 674 671.82 93.43 R 672 672 670 670 670.91 CUT = 58.41 S.F. FILL = 430.17 S.F. 668 668 667.22 75.00 R 666 666 664 664 -280 -260 -240 -220 -200 -180 -160 -140-120 -100 -80 -60-40 -20 0 20 40 60 80 100 120 140 160 180


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Henson Project No. 10A0094D 0800 Fleronne R-303-XSEC.DWG Scale V. 1"=2', H. 1"=20' Date 02/04/11 HANSON

CROSS-SECTIONS FOR TAXIWAY C STA. 74+00 TO STA. 74+50

53

53 of 70 sheets

MAR 14, 2011 11:17 AM HACLO00382

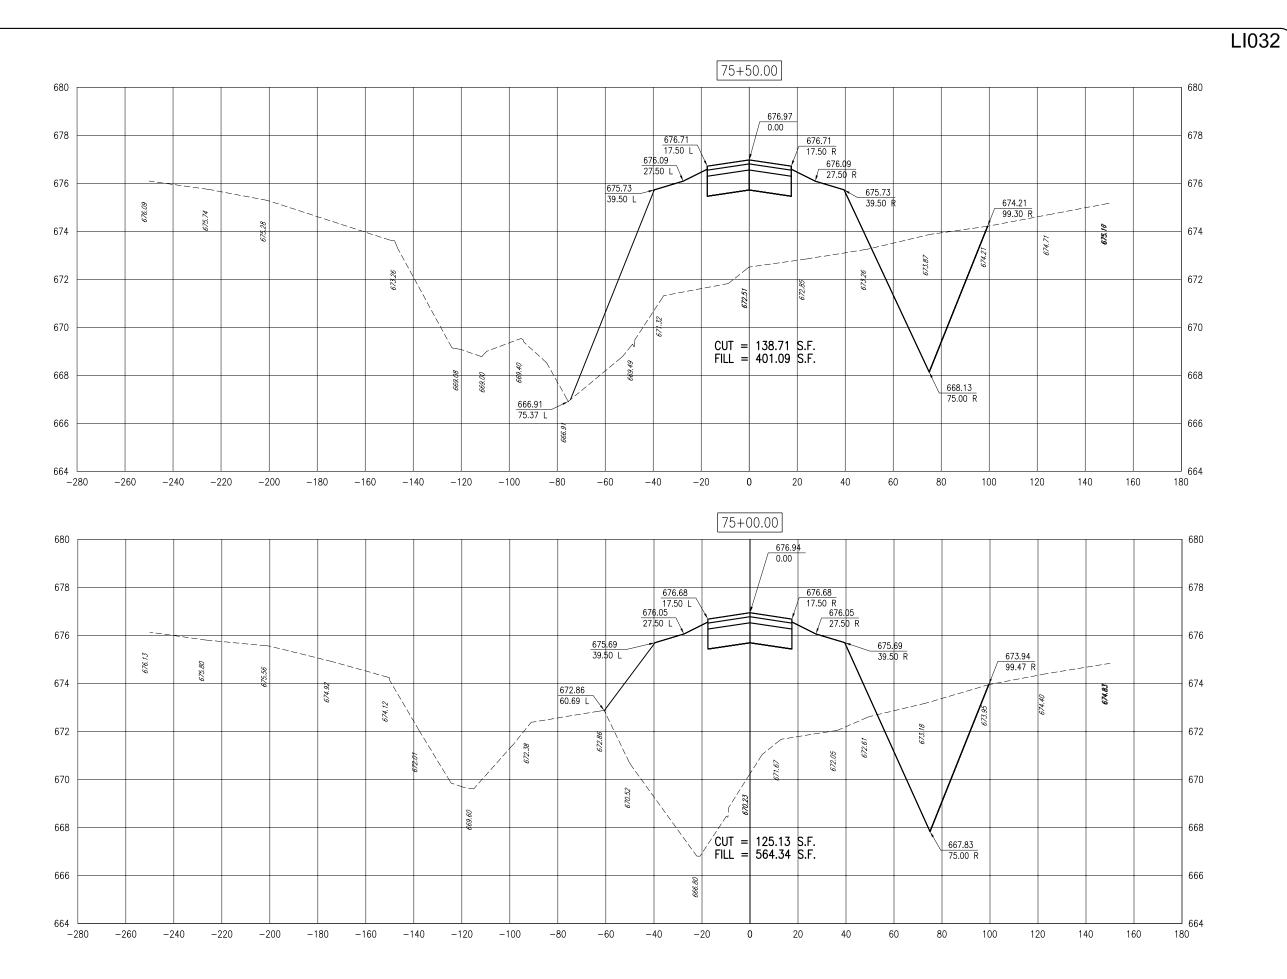

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Hunson Project No. 10A0094D 0800
Filenome R=303-XSEC.DWG
Scale V. 1"=2', H, 1"=20'
Dote 02/04/11

HANSON


CROSS-SECTIONS FOR TAXIWAY C STA. 75+00 TO STA. 75+50

LI032 76+50.00 680 680 676.78 17.50 L 676.16 27.50 L 676.78 17.50 R 676.16 7 27.50 R 678 678 676.06 104.26 R 675.80 39.50 R 675.80 39.50 L 676 676 673.59 48.35 L 674 674 672 672 670 670 CUT = 203.54 \$.F. FILL = 162.19 \$.F. 668 668 668.75 75.00 R 666 666 664 -280 -260-240-220 -200-180-160-140-120 -100-80 -60 -40 -20 0 20 40 60 80 100 120 140 160 180 76+00.00 680 680 677.01 676.75 17.50 L 678 678 676.75 17.50 R 676 12 27.50 L 676.12 27.50 R 675.76 39.50 L 676 676 675.00 101.23\_R 675.76 39.50 R 674 674 672.65 51.96 L 672 672 670 670 CUT = 166.39 S.F. FILL = 222.90 S.F. 668 668 668.44 75.00 R 666 666 99 664 -280 -260 -240-220 -200 -180 -160-140-120-100 -80 -60 -40-20 0 20 40 60 80 100 120 140 160 180

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Humson Project No. 10A0094D 0800
Fletnome R-303-XSEC.DWG
Scole V. 1"=2', H. 1"=20'
Date 02/04/11 HANSON

CROSS-SECTIONS FOR TAXIWAY STA. 76+00 TO STA. 76+50

55

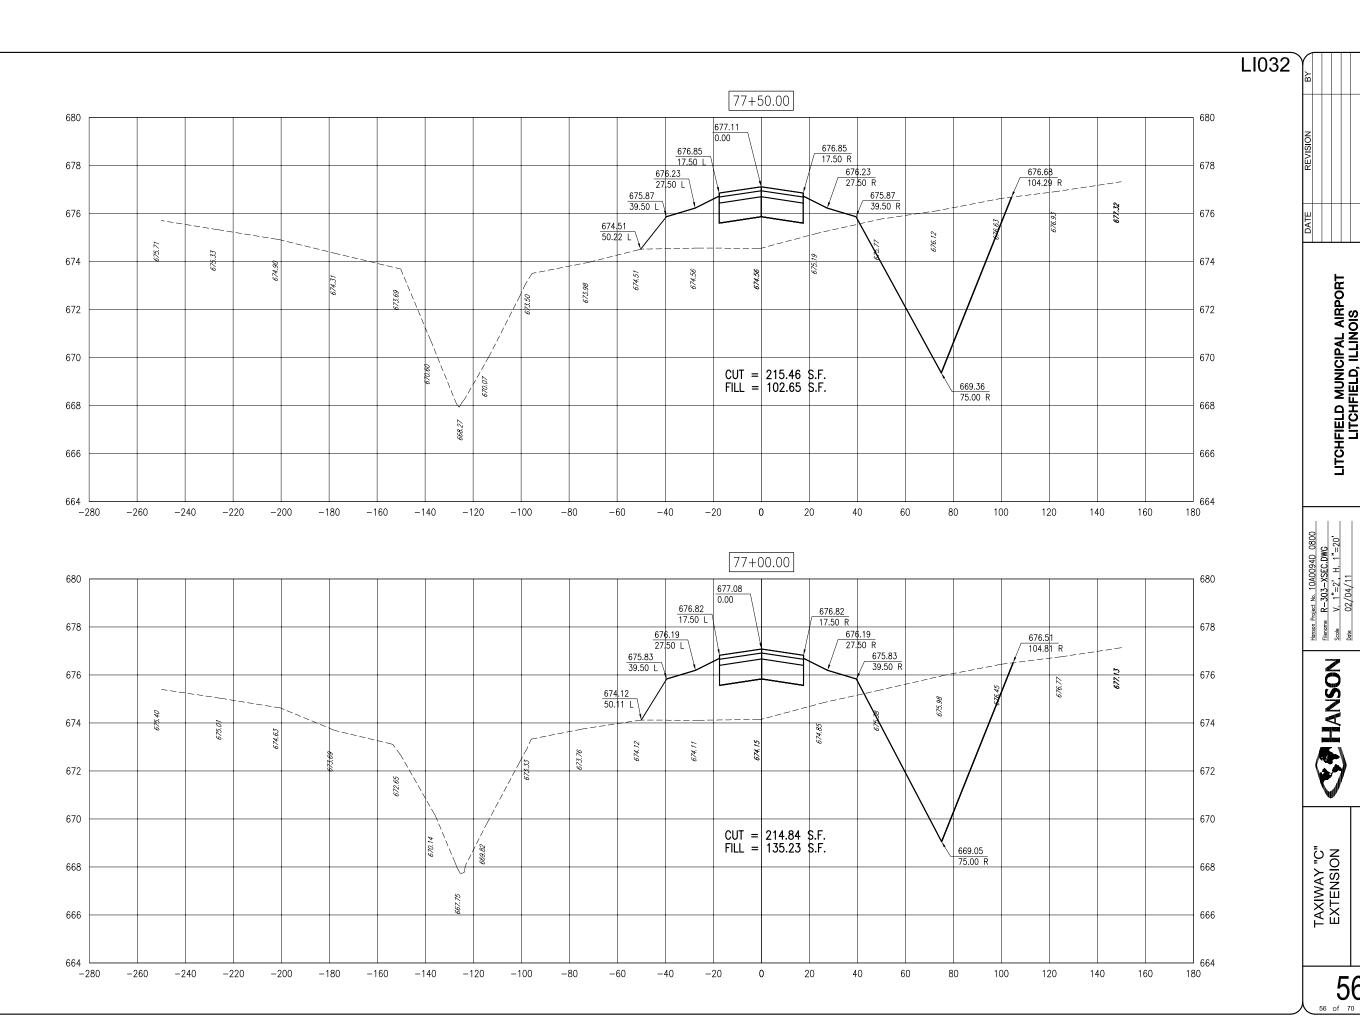

CROSS-SECTIONS FOR TAXIWAY STA. 77+00 TO STA. 77+50 TAXIWAY "C" EXTENSION

HANSON


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS


LI032 LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Hurson Project No. 10A0094D 0800
Flerome R-303-XSEC.DWG
Scale V. 1"=2", H. 1"=20"
Date 02/04/11


HANSON


TAXIWAY "C" EXTENSION

CROSS-SECTIONS FOR TAXIWAY STA. 78+00 TO STA. 78+50

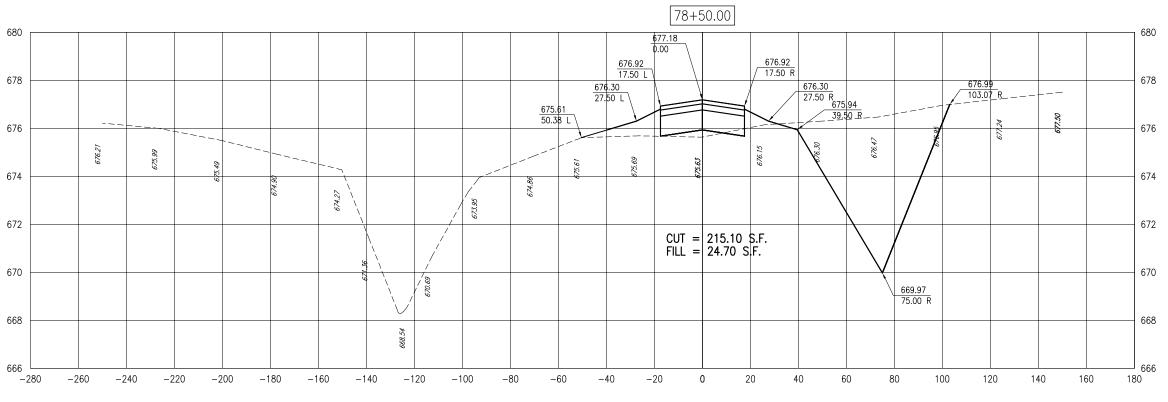

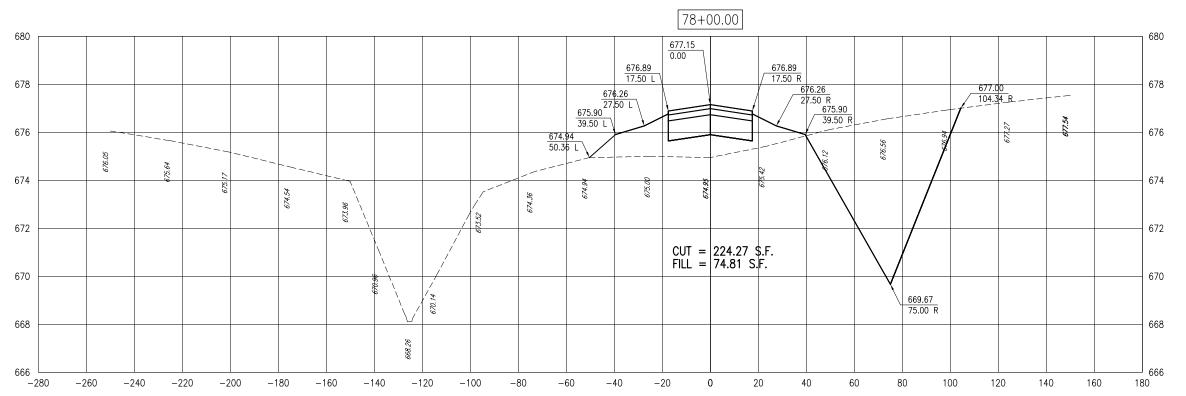

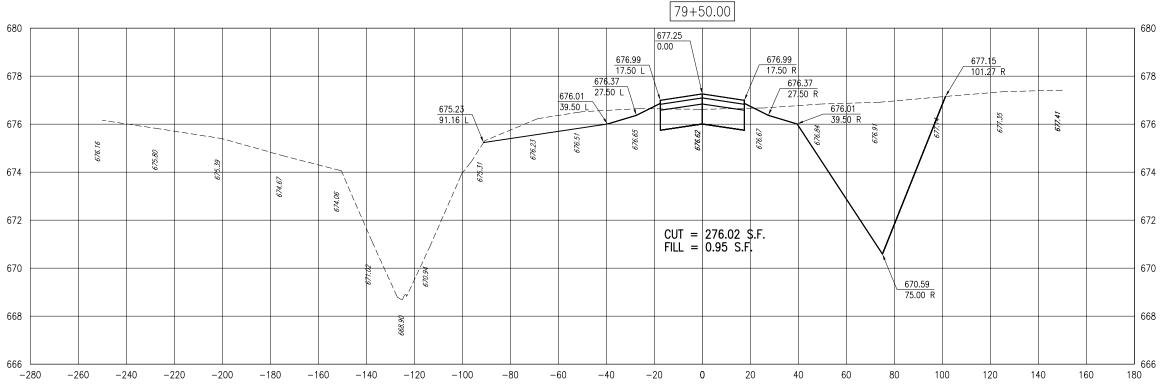

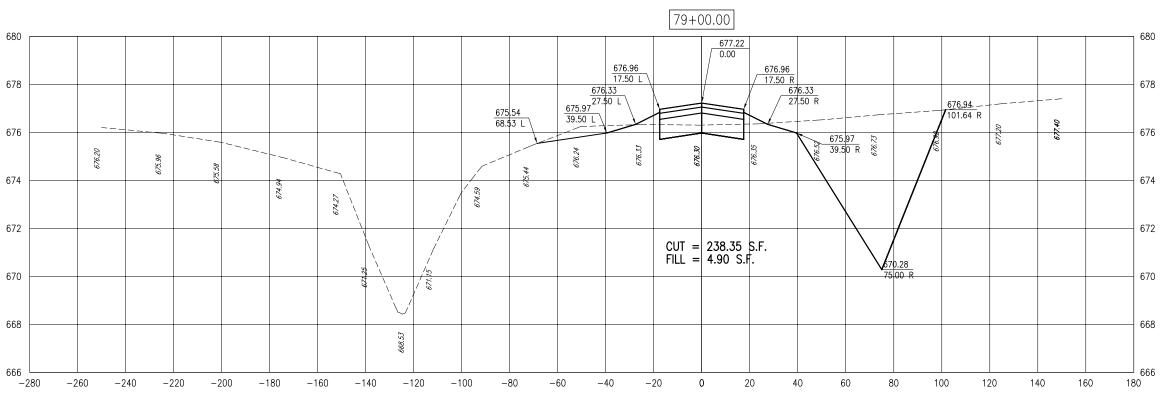

TAXIWAY "C"
EXTENSION
CROSS-SECTIONS FOR TAXIWAY C
STA. 79+00 TO STA. 79+50

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

Hurson Project No. 10A0094D 0800 Fleronne R-304-XSEC.DWG Scale V. 1"=2', H. 1"=20' Date 02/04/11

HANSON

58

\AIRPORTS\LITCHFIELD\10A0094\CADD\AIRPORT\SHEET\R-304-XSEC.DWG - STA. 79+00 TO ST

LI032 80+50.00 680 680 677.32 0.00 677.06 17.50 L 677.71 101.06 R 678 678 676.44 27.50 L 675.24 95.06 L 676 676 676.08 39.50 R 676.08 39.50 L 674 674 672 672 671.20 75.00 R 670 670 CUT = 347.14 S.F. FILL = 0 S.F. 668 668 666 -280-260-240-220-200-180-160-140-120-100-80 -60 -40-20 0 20 40 60 80 100 120 140 160 180

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Horson Project No. 10A0094D 0800
Flerume R-304-XSEC.DWG
Scale V. 1"=2', H. 1"=20'
Date 02/04/11 HANSON CROSS-SECTIONS FOR TAXIWAY STA. 80+00 TO STA. 80+50


59

80+00.00 680 680 677.29 677.03 17.50 R 676.40 / 27.50 R 677.03 17.50 L 677.45 101.24 R 676.04 27.50 L 678 678 676.04 39.50 R 675.22 94.46 L 676 676 674 674 672 672 CUT = 307.84 S.F. FILL = 0.35 S.F. 670.89 75.00 R 670 670 668 668 666 666 -280 -260 -240-220 -200 -180 -160-140-100-80 -60-40-20 20 40 60 80 100 120 140 160 180 -120 0

LI032 81+50.00 682 682 677.39 0.00 680 680 677.13 17.50 R 677.13 17.50 L 678.13 676.51 27.50 R 678 678 676.15 39,50 F 676.15 39.50 L 675.23 100.87 L\ 676 676 674 674 CUT = 442.31 S.F. FILL = 0 S.F. 672 672 671.81 75.00 R 672.13 670 670 668 668 666 666 60 80 -280 -260-240-220-200 -180 -160-140-120-100-80 -60 -40-20 20 40 100 120 140 160 180 81+00.00 680 680 677.36 677.90 100.59 R 677.10 17.50 L 677.10 17.50 R 17.50 R 27.50 R 676.47 27.50 R 676.11 39.50 R 678 678 676.11 39.50 L 675.24 97.81 L 676 676 676.47 27.50 L 674 674 CUT = 403.19 S.F. FILL = 0 S.F. 672 672 671.51 75.00 R 670 670 668 668 666 666 120 -280 -260 -240 -220 -200 -180 -160 -140-120 -100-80 -60 -40 -20 20 40 60 80 100 140 160 0 180

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Hurson Project No. 10A0094D 0800 Fleronne R-304-XSEC.DWG Scale V. 1"=2', H. 1"=20' Date 02/04/11 HANSON

CROSS-SECTIONS FOR TAXIWAY STA. 81+00 TO STA. 81+50

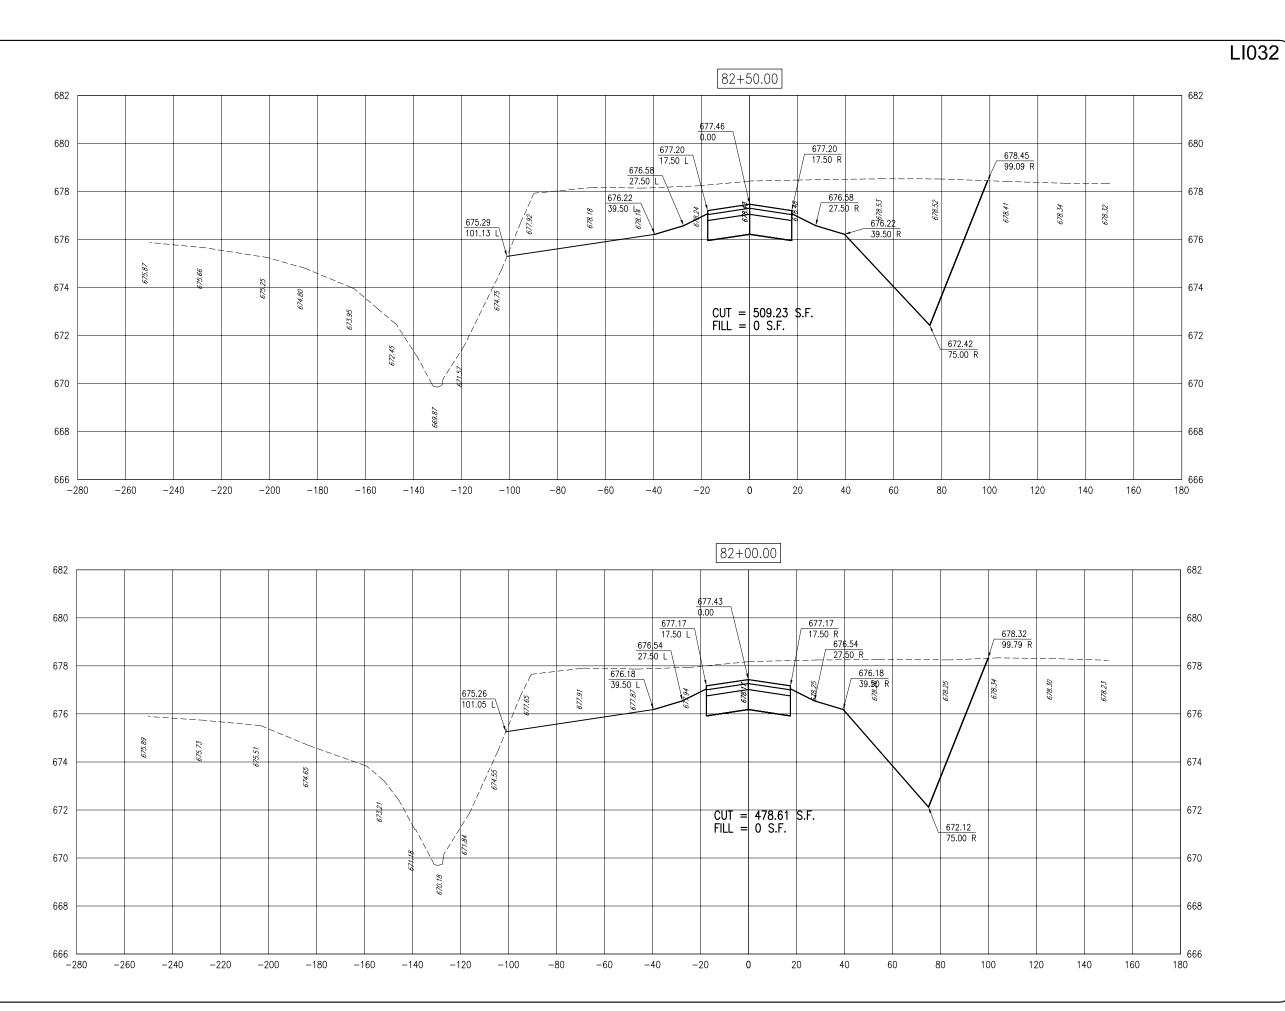

MAR 14, 2011 11:21 AM HAGL000382

TAXIWA

61

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

Honson Project No. 10A0094D 0800 Flavoure R-304-XSEC.DWG Scole V. 1"=2', H. 1"=20' Date 02/04/11

HANSON

LI032 83+50.00 682 682 677.66 0.00 680 680 677.40 17.50 R 678.70 97.64 R 677.40 17.50 L 678 678 675.45 103.78 L\ 676.41 39.50 R 676 676 676.41 676.77 39.50 L 27.50 L 674 674 674.82 672 672 CUT = 528.65 S.F. FILL = 0 S.F. 673.04 75.00 R 670 670 668 -280 668 -260 -240 -220 -200 -180 -160 -140-120 -100 -80 -60-40 -20 0 20 40 60 80 100 120 140 160 180

Hanson Professional Services Inc.


| Hanson Professional Services Inc. | LAYOUT | MDR | 01/04/11 | MDR | 01/04/


83+00.00 682 682 677.50 0.00 680 680 677.24 / 17.50 R 677.24 17.50 L 678.54 98.23 R 676.61 27.50 L 678 678 675.29 103.37 L 676.25 39.50 676 676 676.25 39.50 L 674 674 CUT = 519.49 S.F. FILL = 0 S.F. 674.64 672 672 672.73 75.00 R 670 670 668 668 -280 -260-240-220 -200 -180 -160-140-120-100-80 -60 -40 -20 0 20 40 60 80 100 120 140 160 180

:\AIRPORTS\LITCHFIELD\10A0094\CADD\AIRPORT\SHEET\R-304-XSEC.DWG - STA. 83+00 TO S

62 62 of 70 sheets

TAXIWAY "C" EXTENSION CROSS-SECTIONS FOR TAXIWAY C STA. 83+00 TO STA. 83+50

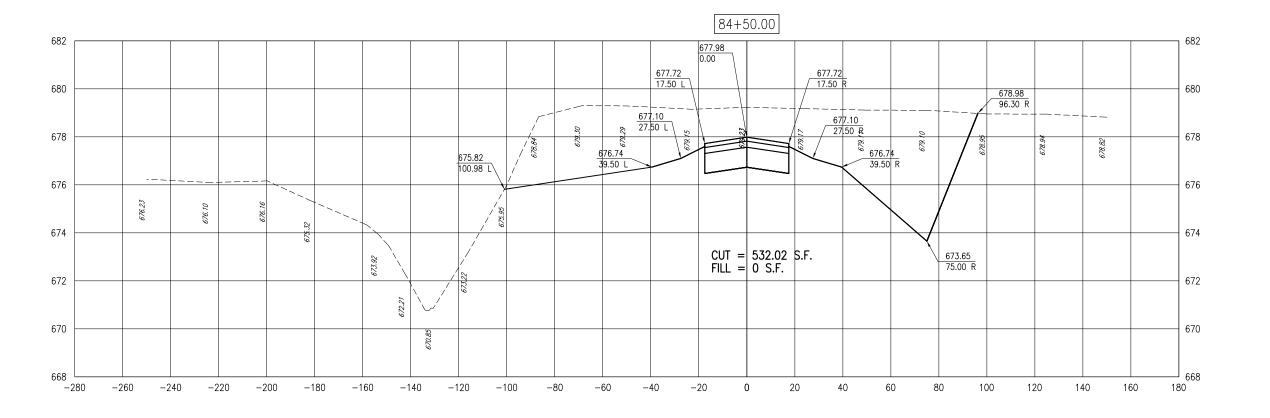

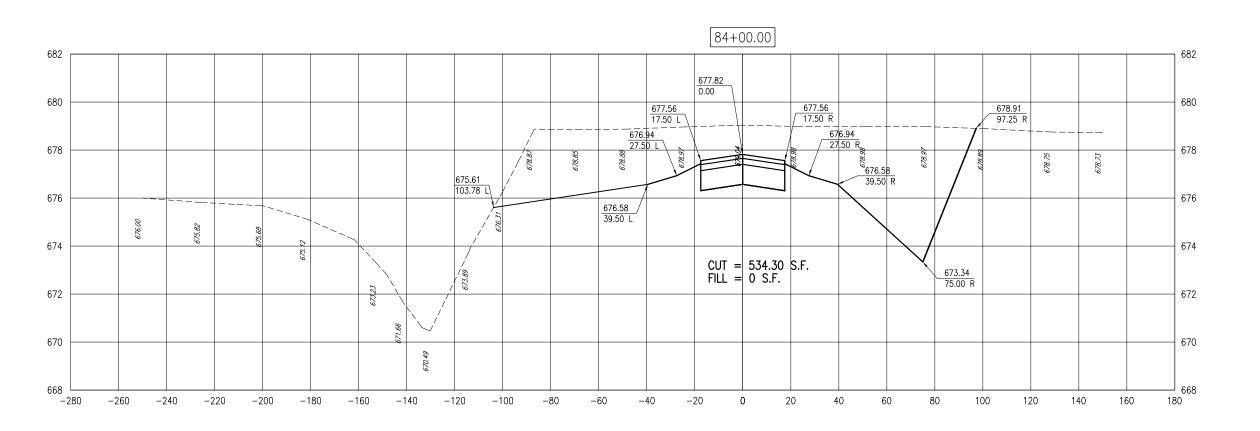



Henson Project No. 10A0094D 0800 Fleronne R-305-XSEC.DWG Scale V. 1"=2", H. 1"=20" Date 02/04/11 HANSON

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

CROSS-SECTIONS FOR TAXIWAY C STA. 84+00 TO STA. 84+50

63

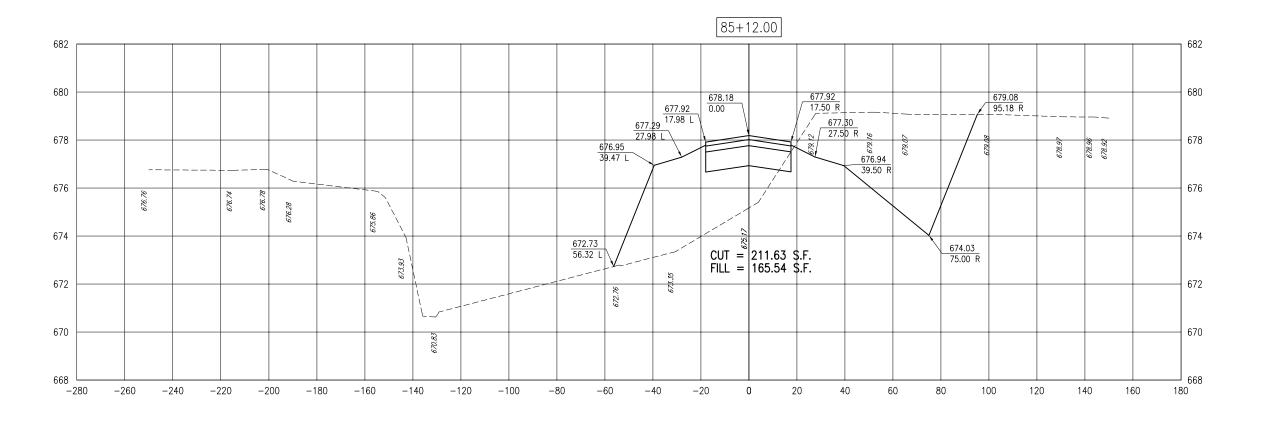


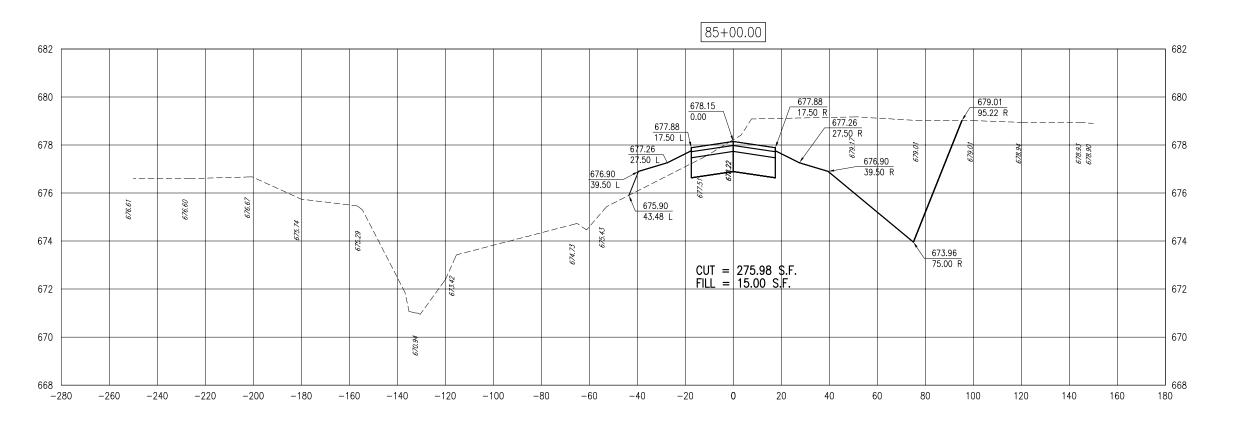


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS Horson Project No. 10A0094D 0800
Fleroure R-305-XSEC.DWG
Scale V. 1"=2", H. 1"=20"
Date 02/04/11

HANSON

CROSS-SECTIONS FOR TAXIWAY C STA. 85+00 TO STA. 85+12 TAXIWAY "C" EXTENSION

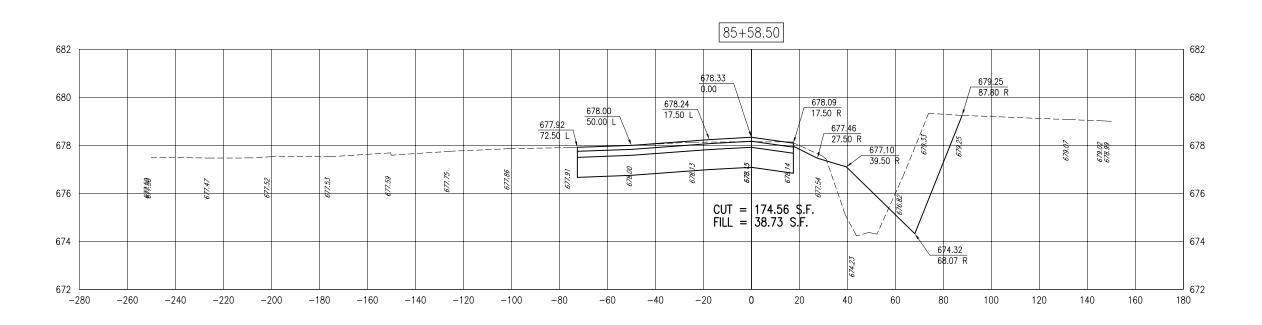

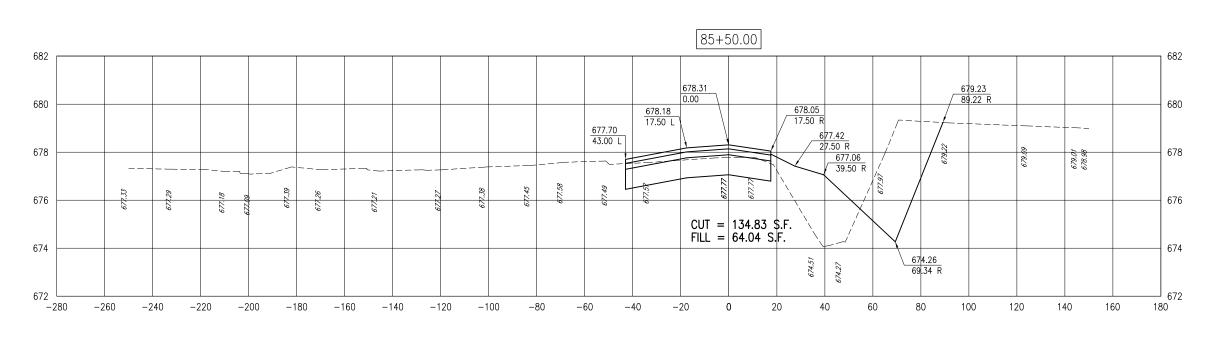

XIWAY "C"

(TENSION

| Comparison | Comparis

LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

MAR 14, 2011 11:28 AM HAGLO00382 I:\ABPORTS\!ITCHFIEID\10A0094\CAND\ARPORT\\$HFT\R-305-XSFC.DWG - ST

65 of 70 shee


CROSS-SECTIONS FOR TAXIWAY C STA. 85+50 TO STA. 85+58.50


LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS


HANSON

TAXIWAY "C" EXTENSION

CROSS-SECTIONS FOR TAXIWAY C STA. 86+00 66

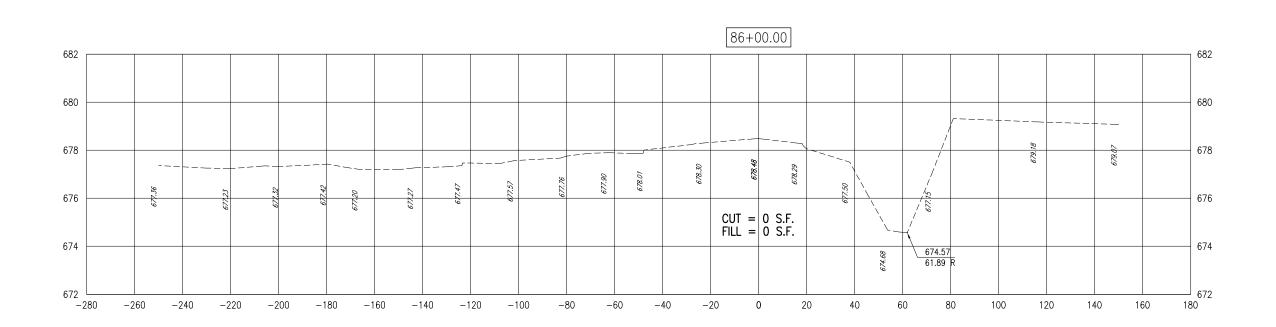

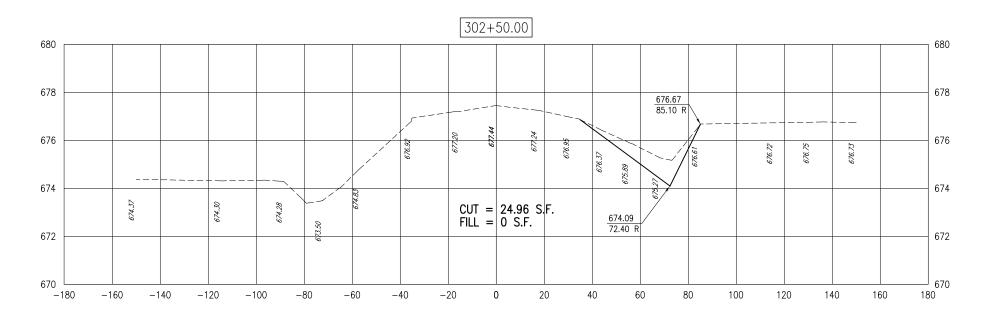

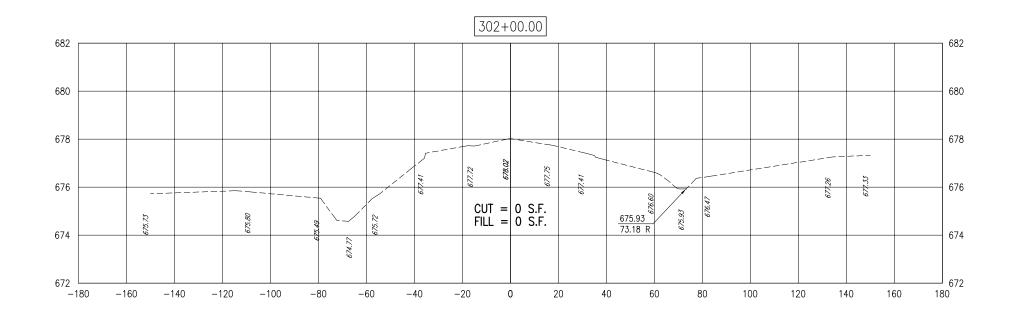

LITCHFIELD MUNICIPAL AIRPORT

LITCHFIELD, ILLINOIS


Hanson Professional Services Inc.


EXTENSION

CROSS-SECTIONS FOR TAXIWAY C3
STA. 302+50

67

MAR 14, 2011 11:37 AM HACLON0382 I:\AIRPORTS\LITCHFIELD\10A0094\CADD\AIRPORT\SHEET\R-306-XSEC.DWG - STA, 302+

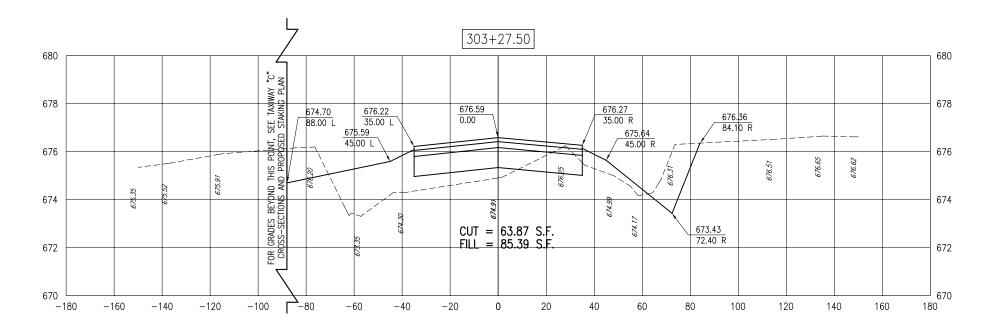

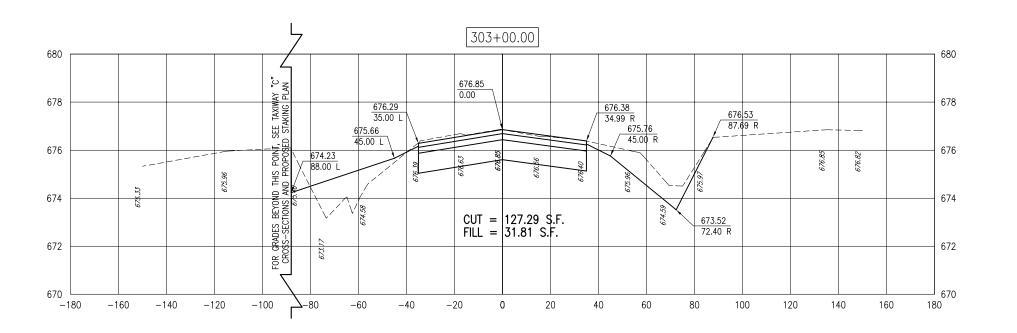

JNICIPAL AIRPORT

LITCHFIELD MUNICIPAL AIRPORT
LITCHFIELD, ILLINOIS

Hunson Project No. 10A0034D 0800 Flecome R-306-XSEC.DWG Scole V. 1"=2', H. 1"=20' Date 02/04/11


HANSON
HANSON
HANSON Professional Services Inc.
1525 South Skirk Street


TENSION

CROSS-SECTIONS FOR TAXIWAY C3 STA, 303+00 TO STA, 303+27.50

68 68 of 70 sheets

:\airports\Litchfield\10a0094\Cad0\airport\SHET\R-306-XSEC.DWG - STA. 303+00 T0

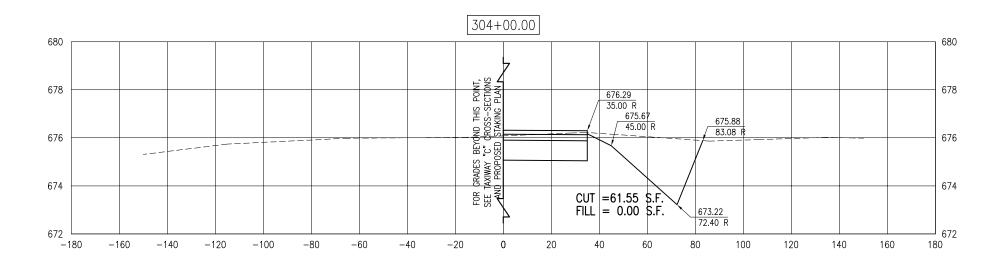

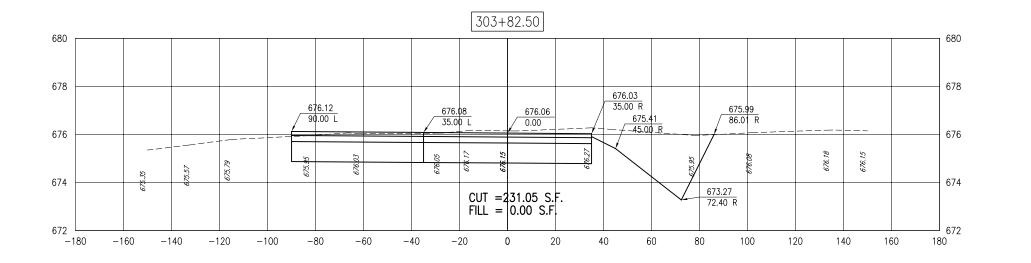



LITCHFIELD MUNICIPAL AIRPORT LITCHFIELD, ILLINOIS

HANSON

CROSS-SECTIONS FOR TAXIWAY C3 STA, 303+82.50 TO STA, 304+00 TAXIWAY "C" EXTENSION

# FOR GRADES BEYOND THIS POINT, SEE TAXIWAY "C" CROSS-SECTIONS AND PROPOSED STAKING PLAN

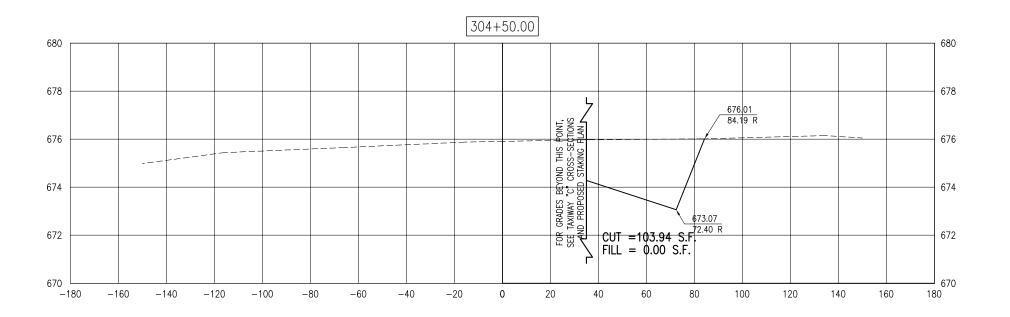

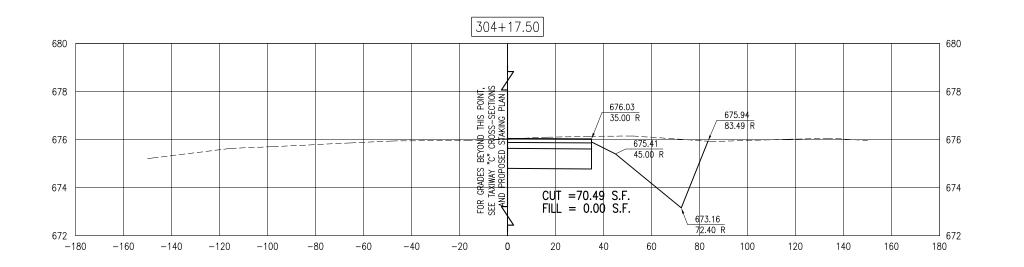

LITCHFIELD MUNICIPAL AIRPORT
LITCHFIELD, ILLINOIS

DN Scale V. 1"=2". H. 1"=20".

Date 02/04/11

C. LAYOUT MDR 01/04/11

DDAMMIN IEO 01/04/14

Hanson Professional Services Inc. 1525 South Skith Street Springfield, Illinois 62703-2886

TAXIWAY "C"
EXTENSION
CROSS-SECTIONS FOR TAXIWAY C3
STA. 304+17.50 TO STA. 304+50

70

MAR 14, 2011 11:34 AM HAGLOO0382