**TOTAL SHEETS: 29** 

# **CONSTRUCTION PLANS**

**FOR** 

# MT. VERNON AIRPORT


MT. VERNON, JEFFERSON COUNTY, ILLINOIS **RUNWAY 15-33: POROUS FRICTION COURSE OVERLAY** 

## SCOPE OF WORK

BASE BID: CONSISTS OF APPLYING A POROUS FRICTION COURSE OVERLAY (0.10 FT) TO RUNWAY 15-33. ASSOCIATED WORK INCLUDES REMOVAL AND REPLACEMENT OF BITUMINOUS PAVEMENT, CRACK CLEANING AND SEALING, PAVEMENT MARKING, TOPSOILING. SEEDING, MULCHING, AND A LIGHTED WIND CONE AND ASSOCIATED CABLE IN UNIT DUCT INSTALLATION.

ADDITIVE ALTERNATE 1: CONSISTS OF THE INSTALLATION OF ELECTRICAL EQUIPMENT IN THE FBO HANGAR BUILDING, INCLUDING GROUNDING UPGRADES AND ADDITION OF SURGE PROTECTION.

ADDITIVE ALTERNATE 2: CONSISTS OF THE INSTALLATION OF ELECTRICAL EQUIPMENT TO FENCE GATES AND IN THE TERMINAL BUILDING, INCLUDING GROUNDING UPGRADES AND ADDITION OF SURGE PROTECTION.

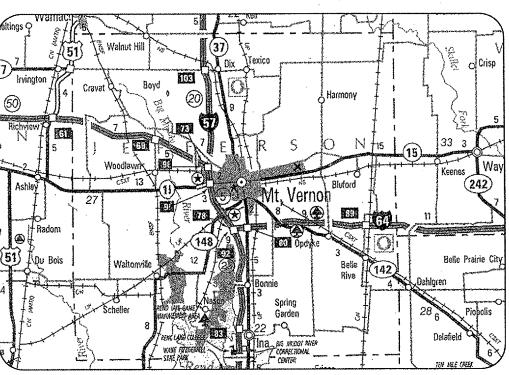

**LOCATION** 

MVN-3539

88° 51' 30"

480.0' M.S.L.

DEC. 16, 2005

3-17-0074-B12 38° 19' 24"

ILL. PROJ.:


LATITUDE: LONGITUDE:


DATE:

A.I.P. PROJ.:

**ELEVATION:** 












MT. VERNON AIRPORT AUTHO	ORITY	
Approved Worldgle  Date 1/17/1000	CHAIRMAN	
Approved Ale Ha	SEORETARY G	-
Date Date		

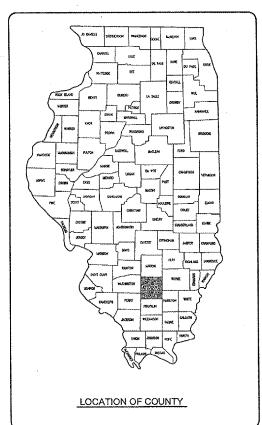

HANSON

SUMMARY OF QUANTITIES - BASE BID						
ITEM NO.	DESCRIPTION	UNIT	TOTAL QUANTITIES	AS BUILT QUANTITIES		
AR107408	L-806 WIND CONE-8' LIGHTED	EA.	1			
AR108658	3/C #8 600V UG CABLE IN UD	Ļ.F.	2027			
AR150510	ENGINEER'S FIELD OFFICE	L.S.	1			
AR150530	150530 TRAFFIC MAINTENANCE		1			
AR201661	CLEAN & SEAL BITUMINOUS CRACKS		13,000			
AR401655	BUTT JOINT CONSTRUCTION		2,186			
AR401910	REMOVE AND REPLACE BITUMINOUS PAVEMENT		350			
AR402622	POROUS FRICTION COURSE, 0.10'		36,618			
AR603510	510 BITUMINOUS TACK COAT		9,155			
AR620520	20 PAVEMENT MARKING-WATERBORNE		11,722			
AR901510	SEEDING		0.9	A STATE OF THE PARTY OF THE PAR		
AR905520	TOPSOILING (FROM OFF SITE)	Ç.Y,	100	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,		
AR908510	MULCHING	ACRE	0.9			

SUMMARY OF QUANTITIES — ADDITIVE ALTERNATE 1					
ITEM NO.	DESCRIPTION	UNIT	TOTAL QUANTITIES	AS BUILT QUANTITIES	
AS109200	INSTALL ELECTRICAL EQUIPMENT	L.S.	1		

	SUMMARY OF QUANTITIES - ADDITIVE ALTERNATE 2					
TOXO:	ITEM NO.	DESCRIPTION	UNIT	TOTAL QUANTITIES	AS BUILT QUANTITIES	
.[	AT109200	INSTALL ELECTRICAL EQUIPMENT	L.S.	1		
L						

	DESCRIPTION DESCRIPTION
—   L -	1 COVER SHEET
¥,	2 SUMMARY OF QUANTITIES, INDEX TO SHEETS
AIRPORT	3 PROPOSED SAFETY PLAN
一	4 PROPOSED PAVEMENT PREPARATION PLAN - STA. 100+00 TO 110+00
—— ₩ 「	5 PROPOSED PAVEMENT PREPARATION PLAN - STA. 110+00 TO 124+00
	6 PROPOSED PAVEMENT PREPARATION PLAN - STA. 124+00 TO 131+49
8	7 PROPOSED CONSTRUCTION PLAN - STA. 100+00 TO 110+00
VERNON	PROPOSED CONSTRUCTION PLAN - STA. 110+00 TO 124+00
——————————————————————————————————————	9 PROPOSED CONSTRUCTION PLAN - STA. 124+00 TO 131+49
15.	10 PROPOSED MARKING PLAN - STA. 100+00 TO 110+00
1. • [	11 PROPOSED MARKING PLAN - STA, 110+00 TO 124+00
\ <b>\_</b>	12 PROPOSED MARKING PLAN - STA, 124+00 TQ 131+49
	13 PROPOSED ELECTRICAL PLAN
	14 WIND CONE & ELECTRICAL DETAILS
	15 ELECTRICAL DETAILS
	16 ELECTRICAL NOTES
	17 ELECTRICAL NOTES
	18 ELECTRICAL LEGEND AND ABBREVIATIONS
	19 ELECTRICAL ONE LINE DIAGRAM FOR WIND CONE
	20 EXISTING ELECTRICAL ONE LINE DIAGRAM FOR FBO HANGAR
	21 NEW ELECTRICAL ONE LINE DIAGRAM FOR FBO HANGAR
<u>```</u> ≥	22 FBO HANGAR GROUND RISER
819-06RWYD COZFLP DWG	23 GROUNDING DETAILS
9-	24 ELECTRICAL ONE LINE DIAGRAM FOR TERMINAL BUILDING
8 200	25 GATE NO. 1 ELECTRICAL ONE LINE
	26 GATE NO. 2 ELECTRICAL ONE LINE
BB Project No.	27 GATE NO. 3 ELECTRICAL ONE LINE
4 5 E	28 GATE NO. 7 ELECTRICAL ONE LINE 29 FIRE STATION GATE ELECTRICAL ONE LINE DIAGRAM

Harson Protessional Services Inc.

Harson Roberts Services Inc.

1 avoil 1 CCC

RUNWAY 15-33
P.F.C. OVERLAY
SUMMARY OF QUANTITIES,
INDEX TO SHEETS

2

TES CO. ZOCO Z.T.I FWI FOWN

P. MEDORSKY MINGENON | 81G., GERMANN MIRRORY

BASE BID: CONSISTS OF APPLYING A POROUS FRICTION COURSE OVERLAY (0.10 FT) TO RUNWAY 15-33. ASSOCIATED WORK INCLUDES REMOVAL AND REPLACEMENT OF BITUMINOUS PAVEMENT, CRACK CLEANING AND SEALING. PAVEMENT MARKING, TOPSOILING, SEEDING, MULCHING, AND A LIGHTED WIND CONE AND ASSOCIATED CABLE IN UNIT DUCT INSTALLATION.

ADDITIVE ALTERNATE 1: CONSISTS OF THE INSTALLATION OF ELECTRICAL EQUIPMENT IN THE FBO HANGAR BUILDING, INCLUDING GROUNDING UPGRADES

ADDITIVE ALTERNATE 2: CONSISTS OF THE INSTALLATION OF ELECTRICAL EQUIPMENT TO FENCE GATES AND IN THE TERMINAL BUILDING, INCLUDING GROUNDING UPGRADES AND ADDITION OF SURGE PROTECTION.

#### AIRPORT SECURITY NOTE

AIRPORT SECURITY WILL BE MAINTAINED AT ALL TIMES. THE CONTRACTOR WILL CLOSE AND LOCK THE EXISTING GATE IN THE HAUL ROUTE AT THE END OF EACH WORKING DAY.

#### HEIGHT OF CONSTRUCTION EQUIPMENT

THE MAXIMUM ANTICIPATED HEIGHT OF THE CONSTRUCTION EQUIPMENT WILL BE 25 FEET. THE TALLEST EQUIPMENT IS EXPECTED TO BE A SEMI-TRAILER

#### HAUL ROUTE AND VEHICLE PARKING

THE CONTRACTOR WILL USE THE EXISTING DESIGNATED PAVED/TURF HAUL ROUTE AND PARKING AREA AS SHOWN ON THIS SHEET. THE PROPOSED PARKING AREA WILL BE 150' X 200'. THE CONTRACTOR WILL BE REQUIRED TO MAINTAIN THE PROPOSED HAUL ROUTE AND PARKING AREA THROUGHOUT THE COURSE OF THE PROJECT. ANY AREAS DAMAGED OUTSIDE OF THESE AREAS WILL BE REPAIRED BY THE CONTRACTOR AND AT THE CONTRACTOR'S OWN EXPENSE. AT THE CONCLUSION OF THE PROJECT THE CONTRACTOR WILL GRADE, FERTILIZE, SEED AND MULCH ALL DISTURBED AREAS AND PARKING AREAS (WHERE APPLICABLE) AS NEEDED TO RESTORE IT TO ITS ORIGINAL STATE. MAINTENANCE OF THE HAUL ROUTE AND RESTORATION OF THE PARKING AREA WILL BE CONSIDERED INCIDENTAL TO THE PROJECT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED. SEE ITEM AR150540 -HAUL ROUTE IN THE SPECIAL PROVISIONS FOR ADDITIONAL CLARIFICATION.

#### CONTRACTOR RESPONSIBILITIES

THE CONTRACTOR'S EQUIPMENT PARKING AND STORAGE AREA WILL BE AS SHOWN ON THIS SHEET. THE CONTRACTOR'S EMPLOYEES WILL PARK THEIR VEHICLES IN THIS AREA. ONLY CONTRACTOR VEHICLES WILL BE ALLOWED

THE CONTRACTOR AND HIS EMPLOYEES WILL BE RESTRICTED TO THE WORK AREA AND ALL OTHER AREAS OF THE AIRPORT ARE "OFF LIMITS" TO THEM

THE CONTRACTOR WIL BE REQUIRED TO LIMIT THE USE OF CONSTRUCTION EQUIPMENT ON ANY EXISTING PAVEMENTS. ONLY THAT EQUIPMENT NEEDED TO COMPLETE THE SPECIFIC WORK ON EXISTING PAVEMENTS WILL BE ALLOWED. NO EXCESSIVE TRAFFIC ACROSS THESE PAVEMENTS WILL BE PERMITTED. ANY DAMAGE TO THE EXISTING PAVEMENTS WILL BE REPAIRED BY THE CONTRACTOR TO THE SATISFACTION OF THE ENGINEER AT NO ADDITIONAL COST TO THE CONTRACT.

THE CONTRACTOR SHALL KEEP RUNWAY 5-23 OPEN AT ALL TIMES OTHER THAN WHEN WORKING WITHIN 200' OF THE RUNWAY 5-23 CENTERLINE AND MAINTAIN CONTINUOUS TAXIWAY ACCESS TO ALL HANGARS AND

ALL WORK PERFORMED SHALL BE DONE IN A ORDERLY AND EFFECTIVE MANNER TO MINIMIZE ANY RUNWAY CLOSURE.

WHENEVER THE NE-SW (5-23) RUNWAY IS OPEN AND THE CONTRACTOR IS CONDUCTING CONTINUOUS HAULING OPERATIONS ACROSS THIS ACTIVE RUNWAY, THE CONTRACTOR WILL FURNISH TWO FLAG PERSONNEL TO CONTROL THE VEHICLES CROSSING RUNWAY 5-23. ALL VEHICLES MUST COME TO A COMPLETE HALT PRIOR TO BEING DIRECTED ACROSS THE ACTIVE RUNWAY BY THE FLAG PERSONNEL

WHENEVER TAXIWAY "A" IS CAPABLE OF BEING UTILIZED, AND THE CONTRACTOR IS CONDUCTING CONTINUOUS HAULING OPERATIONS ON OR ACROSS THIS ACTIVE TAXIWAY, THE CONTRACTOR WILL FURNISH A SINGLE FLAG PERSON TO CONTROL THE VEHICLES UTILIZING TAXIWAY "A". ALI VEHICLES MUST COME TO A COMPLETE HALT PRIOR TO BEING DIRECTED ON TO OR ACROSS THE ACTIVE TAXIWAY BY THE FLAG PERSONNEL.

ALL FLAG PERSONNEL WILL BE EQUIPPED WITH A TWO-WAY RADIO (CHANNEL 123.0 MHz.) FOR MONITORING THE AIRPORT RADIO FREQUENCY. THEY ALSO SHALL BE IN CONTACT WITH EACH OTHER USING WALKIE-TALKIES, AND HAVE STOP AND GO SIGNS. THE FLAG PERSONNEL SHALL BE LOCATED AS SHOWN ON THIS SHEET

THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

THE CONTRACTOR SHALL CONTACT ALL UTILITY COMPANIES AND AGENCIES

WHICH HAVE LINES OR CONDUITS IN THE PROPOSED WORK AREA. ALL

BEFORE ANY EXCAVATION BEGINS. THE CONTRACTOR WILL CALL J.U.L.I.E.

(1-800-892-0123) TO ACCOMPLISH THE ABOVE. IT IS THE CONTRACTOR'S

UNDERGROUND IMPROVEMENTS WILL BE LOCATED AT THE CONTRACTOR'S OWN

LINES AND CONDUITS SHALL BE LOCATED AND IDENTIFIED FOR DEPTH

RESPONSIBILITY TO IDENTIFY ALL UNDERGROUND NON-JULIE UTILITIES

LOCATED WITHIN THE PROPOSED CONSTRUCTION LIMITS. THESE

EXPENSE PRIOR TO THE START OF CONSTRUCTION ACTIVITIES.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123.

EROSION CONTROL

NO. DESCRIPTION

THIS PROJECT WILL DISTURB LESS THAN 1 ACRE OF LAND, THEREFORE NO N.P.D.E.S. PERMIT WILL BE REQUIRED.

BRASS DISC 82' E. OF THE N-S PAVED ROAD CL, 3' S. OF HOUSE DRIVEWAY CL

BENCHMARK DATA

BRASS DISC IN THE CENTER OF THE SIDEWALK ON THE NORTH SIDE OF TERMINAL BUILDING

BRASS DISC 100.4' SE OF RUNWAY END 5 CORNER, 29.4' SW OF SW EDGE OF TAXIWAY

<u>LEGEND</u>

EXISTING IMPROVEMENTS PROPOSED IMPROVEMENTS EXISTING BUILDINGS

PROPOSED HAUL ROUTE AND EQUIPMENT PARKING AREA

(1) PROPOSED BENCHMARK PROPOSED BARRICADES OR TRAFFIC CONES

FLAG PROPOSED FLAG PERSON LOCATION  $\odot$ PROPOSED WIND CONE SEE PROPOSED SAFETY PLAN NOTE FOR ALLOWED CLOSURE

-FLAG

CRITICAL POINT DATA CRITICAL POINT 1 LATITUDE: 38' 19' 23.74" LONGITUDE: 88' 51' 34,49" ELEVATION: 468' M.S.L.

CRITICAL POINT 2 LATITUDE: 38' 19' 20.26" ELEVATION: 468' M.S.L.

LONGITUDE: 88' 51' 31.95"

PROPOSED WIND CONE CRITICAL POINT 1 FLAG

FLAG -

CRITICAL POINT PROPOSED HAUL ROUTE PROPOSED EQUIPMENT PARKING

FULL SIZE SCALE: 1"= 400' HALF SIZE SCALE: 1"= 800'

RUNWAY ( **EXISTING RUNWAY** -YELLOW IN COLOR

DETAIL OF CROSS FOR CLOSED RUNWAY

"NOT TO SCALE"

COST OF CONSTRUCTING, PLACING, MAINTAINING AND REMOVING CROSSES WILL BE CONSIDERED INCIDENTAL TO THE CONTRACT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED. THE CROSSES WILL BE YELLOW IN COLOR AND SHALL BE MADE OF A SUITABLE MATERIAL AS APPROVED BY THE AIRPORT MANAGER. THE CROSSES WILL BE PLACED OVER THE NUMERALS AND SECURED IN A MANNER APPROVED BY THE MANAGER. PROPOSED CROSSES WILL BE PLACED EACH DAY THE RUNWAY IS CLOSED AND REMOVED WHEN THE RUNWAY IS RE-OPENED. THE CONTRACTOR WILL BE RESPONSIBLE FOR THE PLACEMENT AND REMOVAL OF THE CROSSES. NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

#### J.U.L.I.E. INFORMATION

COUNTY: JEFFERSON CITY: MT. VERNON MT. VERNON **TOWNSHIP** SECTION NO: 22, 23, 26 & 27 MT. VERNON AIRPORT AUTHORITY ADDRESS:

MT. VERNON, ILLINOIS 62864

## PROPOSED SAFETY PLAN

ELEVATION

463.65

463.57

456.42

GENERAL - THE MT. VERNON AIRPORT IS COMPRISED OF TWO RUNWAYS. THE PROPOSED CONSTRUCTION WILL NECESSITATE CLOSING BOTH RUNWAYS AT VARIOUS TIMES. ANY TIME THE CONTRACTOR IS WORKING WITHIN 200' OF THE RUNWAY CENTERLINE OR 100' OF A TAXIWAY CENTERLINE. THE RUNWAY OR TAXIWAY WILL BE CLOSED. RUNWAY 5-23 WILL BE CLOSED ONLY DURING THE CONSTRUCTION DAY. RUNWAY 15-33 WILL BE CLOSED FOR THE DURATION OF THE PROJECT. ALL WORK INCLUDED IN OPENING AND CLOSING A RUNWAY WILL BE CONSIDERED INCIDENTAL TO THE PROJECT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED

IDENTIFICATION - WHEN THE CONTRACTORS VEHICLES AND EQUIPMENT ARE ON THE AIRPORT THEY SHALL BE PROPERLY MARKED WITH THREE (3') FOOT SQUARE CHECKERED FLAGS (INTERNATIONAL ORANGE AND WHITE). THE CONTRACTOR WILL ALSO PROVIDE WORKERS WITH SOME TYPE OF TAG OR GARMENT TO IDENTIFY THE PERSON AS BEING PART OF THE CONSTRUCTION CREW.

RADIO CONTROL - THE CONTRACTOR WILL BE REQUIRED TO BE IN TWO-WAY RADIO CONTACT (123.00 MHz.) WITH THE AIRPORT UNICOM. THIS WILL KEEP THE CONTRACTOR IN CONSTANT CONTACT WITH THE MT. VERNON AIRPORT AND ENABLE THE AIRPORT TO IMMEDIATELY CONTACT THE CONTRACTOR IN CASE OF AN AERONAUTIC EMERGENCY THAT WOULD REQUIRE ACTION BY THE CONTRACTOR AND/OR HIS PERSONNEL.

#### 150-ENGINEER'S FIELD OFFICE NOTES

THE PROPOSED ENGINEER'S FIELD OFFICE WILL BE FURNISHED, MAINTAINED, AND REMOVED IN ACCORDANCE WITH ITEM AR150510 "ENGINEER'S FIELD OFFICE" AS STATED ON PAGE 168 OF THE SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL PROVISIONS, ADOPTED JULY 1, 2004.

THE LOCATION OF THE PROPOSED ENGINEER'S FIELD OFFICE WILL BE DETERMINED AT THE PRE-CONSTRUCTION MEETING.

THE ENGINEERING FIRM WILL MAKE PAYMENT FOR ALL LONG DISTANCE TELEPHONE CALLS IN EXCESS OF ONE HUNDRED DOLLARS (\$100.00) PER MONTH.

THE PROPOSED ENGINEER'S FIELD OFFICE WILL BE PAID FOR UNDER ITEMS: AR150510 ENGINEER'S FIELD OFFICE \_\_\_\_\_ 1 L.S.

#### AIRCRAFT OPERATION LINE

200' 400'

THE CONTRACTOR WILL LOCATE THIS LINE 200' PARALLEL FROM EACH RUNWAY CENTERLINE WITHIN THE PROJECT AREA AT THE START OF CONSTRUCTION AND WILL PLACE FLAGGED LATHE EVERY 150' ALONG IT. THIS LINE WILL BE THE LIMITS THAT ALL CONTRACTOR PERSONNEL MAY VENTURE WHEN A RUNWAY IS NOT CLOSED. CONTRACTOR WILL MAINTAIN THE LATHE LINE FOR RUNWAYS 5-23 AND 15-33 FOR THE DURATION OF THE PROJECT.

## BARRICADES AND TRAFFIC CONES

IT WILL BE THE CONTRACTOR'S RESPONSIBILITY TO PLACE AND MAINTAIN BARRICADES AND TRAFFIC CONES AS DIRECTED BY THE AIRPORT DIRECTOR. THE BARRICADES WILL BE EQUIPPED WITH RED FLASHING OR STEADY BURN LIGHTS AND 20" SQUARE ORANGE FLAGS. THE BARRICADES, THEIR MAINTENANCE, PLACEMENT AND REMOVAL WILL BE CONSIDERED AS AN INCIDENTAL ITEM TO THE CONTRACT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

MV054

OR. VERNON 

HANSON (\*)

JAY 15-3 OVERL/ RUNW P.F.C.

THE PAVEMENT AREAS DESIGNATED AS ACCOMMODATE THE PROPOSED POROUS FRICTION COURSE OVERLAY. THIS ITEM WILL BE COMPLETED AS DETAILED IN THE SPECIAL PROVISIONS.

THE EXISTING PAVEMENT WILL BE SAWED AT THE LOCATIONS SHOWN ON THESE PLANS. THE SAWING WILL BE CONSIDERED AS AN INCIDENTAL ITEM TO "BUTT JOINT CONSTRUCTION" AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

ALL MILLED MATERIAL WILL BE DISPOSED OF BY THE CONTRACTOR, OFF THE AIRPORT SITE, UNLESS OTHERWISE DIRECTED BY THE AIRPORT DIRECTOR AT THE TIME OF

ANY ADJACENT PAVEMENT OR EQUIPMENT THAT IS DAMAGED BY THE MILLING OPERATIONS WILL BE REPAIRED AT THE CONTRACTOR'S OWN EXPENSE, TO THE SATISFACTION OF THE

PRIOR TO THE APPLICATION OF THE PFC OVERLAY, ALL MILLED AREAS WILL BE BROOMED AND BLOWN CLEAN OF LOOSE MATERIALS AND DEBRIS. A BITUMINOUS TACK COAT WILL BE APPLIED ACCORDING TO THE SUPPLEMENTAL SPECIFICATIONS FOR ITEM 603 DATED JULY 1, 2004 AT A RATE OF 0.25 GAL/SY. THE VERTICAL FACE OF ALL SAW CUTS WILL BE PAINTED WITH A LIQUID ASPHALT.

THE EXISTING PAVEMENT WILL BE MILLED TO A DEPTH OF 0.10' AT THE BUTT JOINT.

PAYMENT FOR THIS ITEM OF WORK WILL BE UNDER ITEM: AR401655 "BUTT JOINT CONSTRUCTION" - PER SQUARE YARD.

#### THRESHOLD LIGHT REMOVAL

THE CONTRACTOR MAY TEMPORARILY REMOVE THE STAKE MOUNTED THRESHOLD LIGHTS SHOWN ON THIS SHEET AND SHEET 6 FOR ACCESS TO THE RUNWAY ENDS FOR THE MILLING AND PAVING EQUIPMENT.

THE REMOVAL, STORAGE, AND REPLACEMENT OF THE LIGHTS WHEN THE TASK IS COMPLETE, AS WELL AS ANY DAMAGE SUSTAINED IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR, WILL BE CONSIDERED INCIDENTAL TO THE PROJECT, AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

THAN ONE INCH IN WIDTH AT THE TIME OF THE SURVEY, AND EXHIBITING ROLLED EDGES. ALL CRACKS TO RECEIVE REPAIR SHALL BE LOCATED AND MARKED BY THE RESIDENT FNGINFFR.

THE CRACKS SHALL BE REMOVED FROM THE PAVEMENT BY ONE OF TWO METHODS, OR A COMBINATION OF THE TWO. THE FIRST ALTERNATIVE IS TO SAWCUT THE WIDTH OF THE AREA TO BE REPAIRED BY USING A WHEEL SAW AND REMOVE THE PAVEMENT TO THE SPECIFIED DEPTH USING A BACKHOE OR OTHER MECHANICAL MEANS. THE SECOND ALTERNATIVE IS TO USE A SKID STEER (OR EQUIVALENT) MOUNTED MILLING HEAD TO REMOVE THE PAVEMENT TO THE REQUIRED DEPTH. REGARDLESS OF THE METHOD USED TO REMOVE THE PAVEMENT, THE EDGE OF THE TRENCH FORMED WILL HAVE A VERTICAL FACE PRIOR TO THE PLACEMENT OF THE BITUMINOUS MATERIAL. THE WIDTH OF REPAIR WILL BE 3' WIDE, CENTERED ON THE CRACK. THE DEPTH OF REPAIR WILL BE THE FULL DEPTH OF THE EXISTING PAVEMENT, 7 TO 8 INCHES ±.

THE CONTRACTOR WILL DISPOSE OF THE EXCAVATED MATERIAL OFF THE AIRPORT SITE AT NO ADDITIONAL COST TO THE CONTRACT.

THE BOTTOM OF THE TRENCH WILL BE CLEANED AND COMPACTED TO PREVENT FUTURE SETTLEMENT, AND ACCEPTED BY THE RESIDENT ENGINEER. ONCE THE TRENCH IS CLEANED, THE BASE AGGREGATE COMPACTED, AND ACCEPTED, AN APPLICATION OF BITUMINOUS TACK MATERIAL WILL BE APPLIED TO THE VERTICAL BITUMINOUS FACE AND THE AGGREGATE BASE. THE REPAIR TRENCH WILL BE BACKFILLED WITH BITUMINOUS SURFACE COURSE MATERIAL (401), IN 3 LIFTS OF 2 INCHES, 3 INCHES, AND 3 INCHES, RESPECTIVELY. THE FINAL LIFT SHALL BE FLUSH WITH THE SURFACE OF THE EXISTING BITUMINOUS PAVEMENT OR THE CONTRACTOR WILL BE REQUIRED TO MILL THE FINAL LIFT FLUSH AT HIS EXPENSE. EACH LIFT SHALL BE COMPACTED AND ACCEPTED BY THE

ANY DAMAGE TO THE EXISTING ADJACENT PAVEMENT WILL BE REPAIRED BY THE CONTRACTOR AT HIS EXPENSE. THE QUANTITY OF PAVEMENT REMOVAL, MILLING AND/OR SAWCUTS, IF UTILIZED, TACK MATERIAL, AND BITUMINOUS SURFACE COURSE MATERIAL (401) NECESSARY TO COMPLETE THIS TASK WILL BE CONSIDERED INCIDENTAL TO THE TASK, AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

THE QUANTITY OF BITUMINOUS CRACK REPAIR TO BE PAID FOR SHALL BE THE NUMBER OF SQUARE YARDS OF PAVEMENT REMOVED AND REPLACED, IN ACCORDANCE WITH THE SPECIAL PROVISIONS, CONSTRUCTION DRAWINGS, AND ACCEPTED BY THE ENGINEER. MEASUREMENT OF BITUMINOUS CRACK REPAIR FOR PAYMENT SHALL BE TO THE NEAREST

PAYMENT FOR THIS ITEM OF WORK WILL BE UNDER ITEM: AR401910 "REMOVE AND REPLACE BITUMINOUS PAVEMENT" - PER SQUARE YARD

#### CLEANING AND SEALING BITUMINOUS CRACKS

FOLLOWING A VISUAL SURVEY OF THE EXISTING RUNWAY SURFACE, A PROPOSED PLAN QUANTITY OF 13,000 LINEAR FEET OF CRACK CLEANING AND SEALING WAS ESTABLISHED. THE EXACT AMOUNT OF CRACKS TO BE CLEANED AND SEALED WILL BE THE NUMBER OF LINEAR FEET OF CRACKS MARKED BY THE RESIDENT ENGINEER.

0

0

ALL CRACKS DESIGNATED BY THE RESIDENT ENGINEER FOR CLEANING AND SEALING WILL BE DONE SO AS DESCRIBED IN THE RECURRING SPECIAL PROVISIONS, DATED JULY 1

THIS ITEM OF WORK WILL BE PAID FOR AT THE CONTRACT PRICE PER LINEAR FOOT OF CLEANING AND SEALING CRACKS, COMPLETE; WHICH PRICE AND PAYMENT SHALL CONSTITUTE FULL COMPENSATION FOR ALL ROUTING, CLEANING, PREPARATION AND DISPOSAL OF ALL LOOSE MATERIALS; AND FOR ALL MATERIALS, LABOR, EQUIPMENT, TOOLS AND INCIDENTALS NECESSARY TO COMPLETE THIS ITEM.

PAYMENT FOR THIS ITEM OF WORK WILL BE UNDER ITEM: AR201661 "CLEAN & SEAL BITUMINOUS CRACKS" - PER LINEAR FOOT.

# TYPICAL SECTION A-A "NOT TO SCALE"

100'

12.5

37.5

50'

(5)


MV054

AIRPO 

VERNON

08/16/05

HANSON



### LEGEND FOR EXISTING TYPICAL SECTION

- EXISTING POROUS FRICTION COURSE (5/8" DEPTH)
- EXISTING BITUMINOUS SURFACE COURSE (2"± DEPTH)
- EXISTING BITUMINOUS BASE COURSE (2"± DEPTH)
- EXISTING BITUMINOUS SURFACE COURSE (3"± DEPTH)
- (9 10" DEPTH)
- EXISTING EARTH SUBGRADE
- EXISTING EARTH FILLETS
- PROPOSED 401 BITUMINOUS SURFACE COURSE MATERIAL (2", 3", AND 3" DEPTHS, RESPECTIVELY, INCIDENTAL TO ITEM AR401910)
- PROPOSED 603 BITUMINOUS TACK COAT (AS NEEDED, INCIDENTAL TO ITEM AR401910)

#### **LEGEND**


EXISTING PAVEMENT PROPOSED BUTT JOINT CONSTRUCTION PROPOSED REMOVE & REPLACE

Œ EXISTING THRESHOLD LIGHTS

EXISTING RUNWAY/TAXIWAY LIGHTS


BITUMINOUS PAVEMENT

#### QUANTITIES - PAVEMENT PREPARATION ITEM NO. DESCRIPTION QUANTITY CUANTITY AR201661 CLEAN & SEAL BITUMINOUS CRACKS L.F. 13.000 AR401655 BUTT JOINT CONSTRUCTION S.Y. 2,186 AR401910 REMOVE AND REPLACE BITUMINOUS PAVEMENT Ş.Y. 350



RUNWAY 15-33 P.F.C. OVERLAY

of 29 sheets

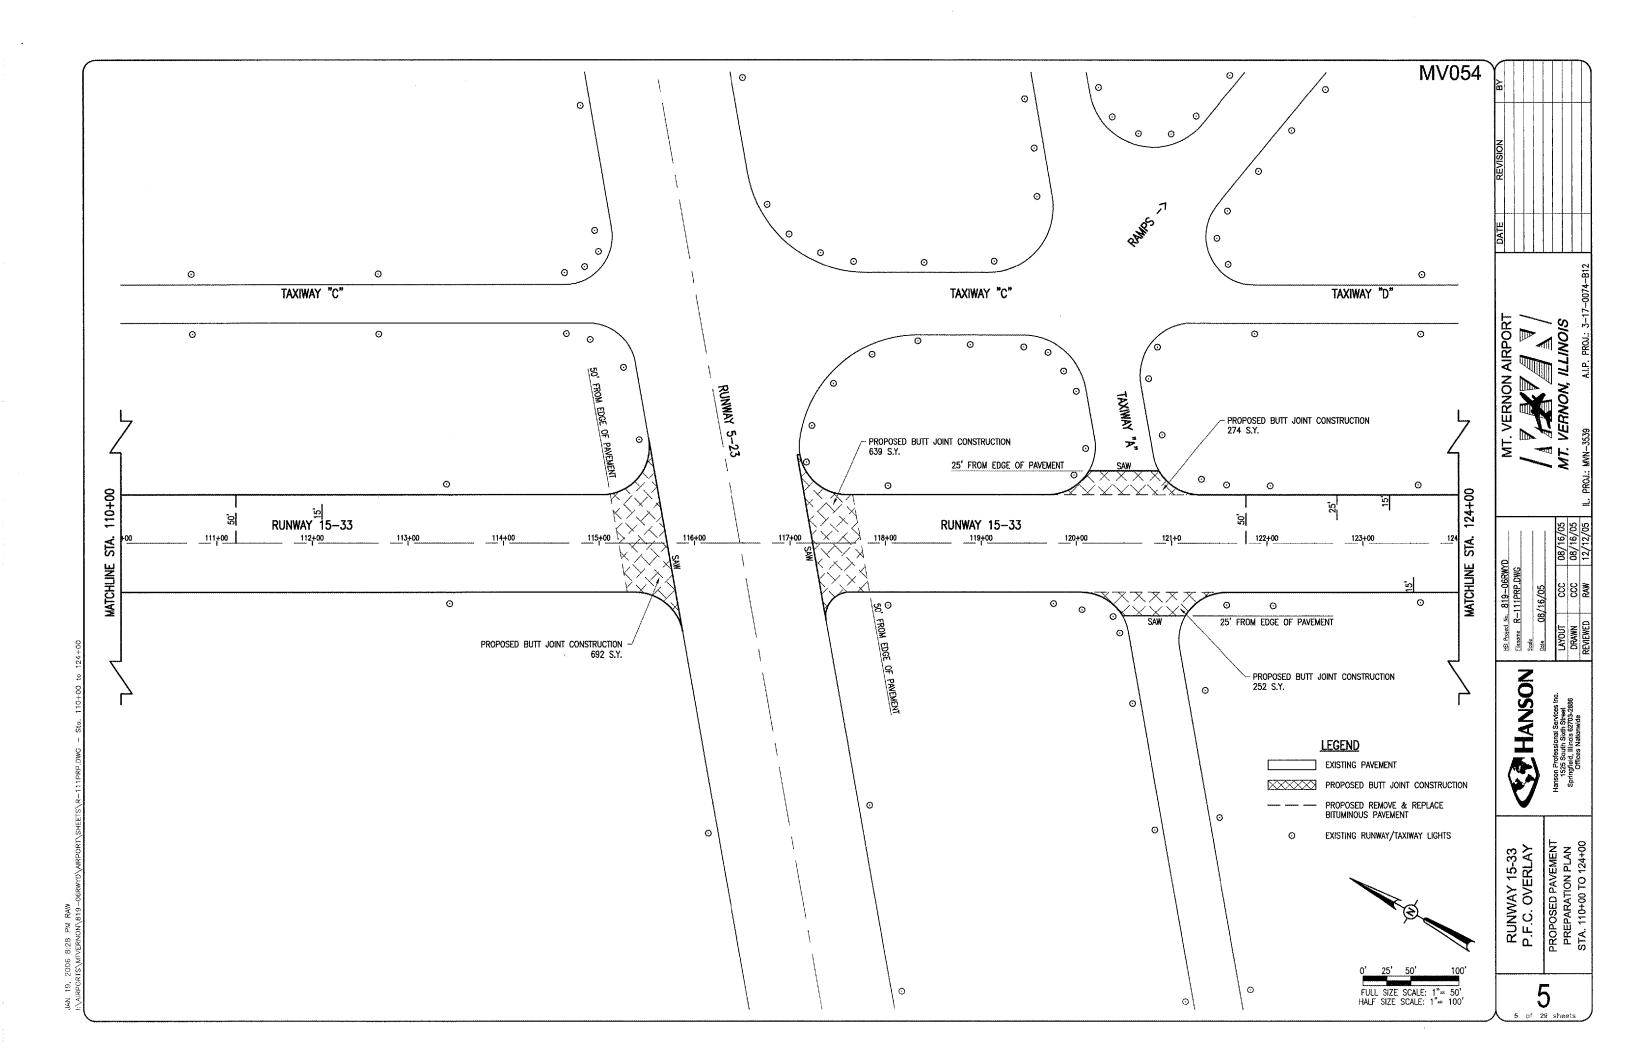

0 0 0 0 0 TAXIWAY "D" 0 0 0 0 PROPOSED BUTT JOINT CONSTRUCTION 165 S.Y. 25' FROM EDGE OF PAVEMENT RUNWAY END 33 STA. 131+49 20, STA. 131+00 130+00 127+00 420,+00 430+00 MATCHLINE RUNWAY 15-33 12.5 0 0 0

MV054

HANSON

RUNWAY 15-33 P.F.C. OVERLAY

6 6 of 29 sheets

EXISTING PAVEMENT

PROPOSED BUTT JOINT CONSTRUCTION

EXISTING THRESHOLD LIGHTS Φ

EXISTING RUNWAY/TAXIWAY LIGHTS



THE PROPOSED POROUS FRICTION COURSE WILL BE CONSTRUCTED IN ONE LAYER, HAVING A COMPACTED NOMINAL THICKNESS OF ONE TENTH OF A FOOT (0.10') IN ACCORDANCE WITH ITEM AR402622 AND THE SUPPLEMENTAL SPECIFICATIONS DATED JULY 1, 2004.

THE POROUS FRICTION COURSE SHALL BE PLACED ON A CLEAN AND PREPARED SURFACE ONLY AFTER THE APPROVAL OF THE RESIDENT

THE SURFACES TO BE OVERLAYED WILL BE SPRAYED WITH AN APPLICATION OF A BITUMINOUS TACK COAT. AN APPLICATION RATE OF 0.25 GAL/S.Y. (DILUTED) WAS USED FOR CALCULATING THE QUANTITY OF TACK FOR THIS APPLICATION. THE EXACT RATE OF APPLICATION WILL BE DETERMINED BY THE RESIDENT ENGINEER AT THE TIME OF CONSTRUCTION. TACKED AREAS WORN FROM HAULING OPERATIONS SHALL BE RETACKED AT THE DISCRETION OF THE RESIDENT ENGINEER. THE TACK COAT MUST BE DRY (CURED) TO THE SATISFACTION OF THE RESIDENT ENGINEER PRIOR TO THE PLACEMENT OF THE POROUS FRICTION COURSE.

PAYMENT FOR THIS ITEM OF WORK WILL BE UNDER ITEM: AR402622 "POROUS FRICTION COURSE, 0.10" - PER SQUARE YARD.

## **SHOULDER PREPARATION NOTES:**

PRIOR TO THE PAVING OPERATIONS THE EXISTING SOD ADJACENT TO THE EDGE OF PAVEMENT WITHIN THE PROJECT AREA SHALL BE GRADED AWAY FROM THE PAVEMENT A DISTANCE SUITABLE TO PREVENT THE SOD MATERIAL FROM AFFECTING THE PLACEMENT OF THE POROUS FRICTION COURSE. THE AMOUNT OF SOD DETERMINED TO REQUIRE REMOVAL SHALL BE SPRAYED WITH A HERBICIDE CAPABLE OF KILLING THE VEGETATION WITHIN THE WIDTH REMOVED. CARE SHALL BE TAKEN TO ENSURE THE HERBICIDE IS NOT APPLIED TO VEGETATION OUTSIDE OF THE GRADING AND SEEDING LIMITS. ANY DAMAGE TO VEGETATION OUTSIDE OF THE GRADING AND SEEDING LIMITS SHALL BE REPAIRED OR REPLACED BY THE CONTRACTOR AT HIS EXPENSE.

THE SOD REMOVAL AND HERBICIDE APPLICATION WILL BE CONSIDERED INCIDENTAL TO ITEM AR402622 "POROUS FRICTION COURSE" AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.

GRADED FROM ONE (1) INCH BELOW PROPOSED PAVEMENT ELEVATIONS TO EXISTING FARTH ELEVATIONS 6 FEET FROM THE PROPOSED PAVEMENT.

THE EARTH FILLETS WILL NOT REQUIRE COMPACTING OR GRADING, OTHER THAN LIGHT ROLLING AND SHAPING. THE TOPSOIL PLACED SHALL BE FROM AN OFF SITE SOURCE AND COMPLY WITH THE SUPPLEMENTAL SPECIFICATION FOR FOR ITEM 905 "TOPSOILING".

PAYMENT FOR THIS ITEM OF WORK WILL BE UNDER ITEM: AR905520 "TOPSOILING" -- PER CUBIC YARD.

#### MULCHING DATA

ALL EARTH FILLET AREAS WITHIN THE GRADING LIMITS WILL BE MULCHED IN ACCORDANCE WITH THE SUPPLEMENTAL SPECIFICATIONS DATED JULY 1, 2004. HYDROMULCH WILL BE USED EXCLUSIVELY.

PAYMENT FOR THIS ITEM OF WORK WILL BE UNDER ITEM: AR908510 "MULCHING" - PER ACRE.

(	QUANTITIES					
ITEM NO.	DESCRIPTION	UNIT	QUANTITY	as Built Quantity		
AR402622	POROUS FRICTION COURSE, 0.10'	S.Y.	36,618			
AR603510	BITUMINOUS TACK COAT	GAL.	9,155			
AR901510	SEEDING	ACRE	0.9			
AR905520	TOPSOILING (FROM OFF SITE)	C.Y.	100			
AR908510	MULCHING	ACRE	0.9			
•						

AND SHEETS 8 & 9 BY . . . . ALL AREAS (EXCEPT THE PAVEMENT) WITHIN THESE LIMITS SHALL BE LIMED, FERTILIZED, AND SEEDED IN ACCORDANCE WITH THE SUPPLEMENTAL SPECIFICATIONS DATED JULY 1, 2004 AND THE FOLLOWING FORMULA:

LIME . . . . . . . . . . . 2 TONS/ACRE

FERTILIZER (MINIMUM POUNDS OF AVAILABLE PLANT FOOD PER ACRE)

N . . . . . . . . . . . . . . . 90 LBS./ACRE TOTAL . . . . . . . . . . . . . 680 LBS./ACRE

SEEDING (MINIMUM POUNDS OF PURE LIVE SEED PER ACRE)

ALTA FESCUE . . . . . . . . . 100 LBS./ACRE PERENNIAL RYEGRASS . . . . . 50 LBS./ACRE CREEPING RED FESCUE . . . . 40 LBS./ACRE SPRING OATS . . . . . . . . 10 LBS./ACRE

PRIOR TO THE PLACEMENT OF THE SEED THE TOPSOIL ADJACENT TO THE PAVEMENT SHALL BE THOROUGHLY LOOSENED TO A DEPTH NOT LESS THAN 4 INCHES, THE ENTIRE WIDTH OF THE DISTURBED AREA. THE CONTRACTOR WILL USE DRAG BARS, HARROWS OR OTHER EQUIPMENT NECESSARY TO OBTAIN THE SMOOTH GRADE TO THE SATISFACTION OF THE RESIDENT ENGINEER. THE SEED BED SHALL BE SMOOTH AND TO GRADE UPON COMPLETION OF THE SEEDING OPERATION.

ALL AREAS WHICH ARE DISTURBED BY THE CONTRACTOR, OUTSIDE OF THE PROPOSED GRADING LIMITS, WILL BE LIMED, FERTILIZED, AND SEEDED IN ACCORDANCE WITH THE REQUIREMENTS OF ITEM AR901510 AT NO ADDITIONAL COST TO THE CONTRACT.

ALL ROCK, ASPHALT OR CONCRETE DEBRIS LEFT FROM THE PAVING OPERATION WILL BE REMOVED FROM THE AIRPORT SITE.

THE PRIME CONTRACTOR WILL BE RESPONSIBLE FOR COORDINATION BETWEEN ALL SUB-CONTRACTORS AS TO THEIR RESPONSIBILITIES PERTAINING TO THE SEEDING OPERATION.

# PROPOSED 603 BITUMINOUS TACK COAT

LEGEND FOR PROPOSED TYPICAL SECTION

TYPICAL SECTION A-A "NOT TO SCALE"

- EXISTING POROUS FRICTION COURSE (5/8" DEPTH)
- EXISTING BITUMINOUS SURFACE COURSE (2"± DEPTH)

PROPOSED POROUS FRICTION COURSE (0.10' DEPTH)

7

- EXISTING BITUMINOUS BASE COURSE (2"± DEPTH)
- EXISTING BITUMINOUS SURFACE COURSE (3"± DEPTH)
- EXISTING AGGREGATE BASE COURSE (9 10" DEPTH)
- (8) EXISTING EARTH SUBGRADE

37.5


PROPOSED EARTH FILLETS

### **LEGEND**

EXISTING PAVEMENT

PROPOSED PFC OVERLAY

PROPOSED GRADING/SEEDING LIMITS




HALF SIZE SCALE: 1"= 100'

MV054

-(9)

HANSON

RUNWAY 15-33 P.F.C. OVERLAY

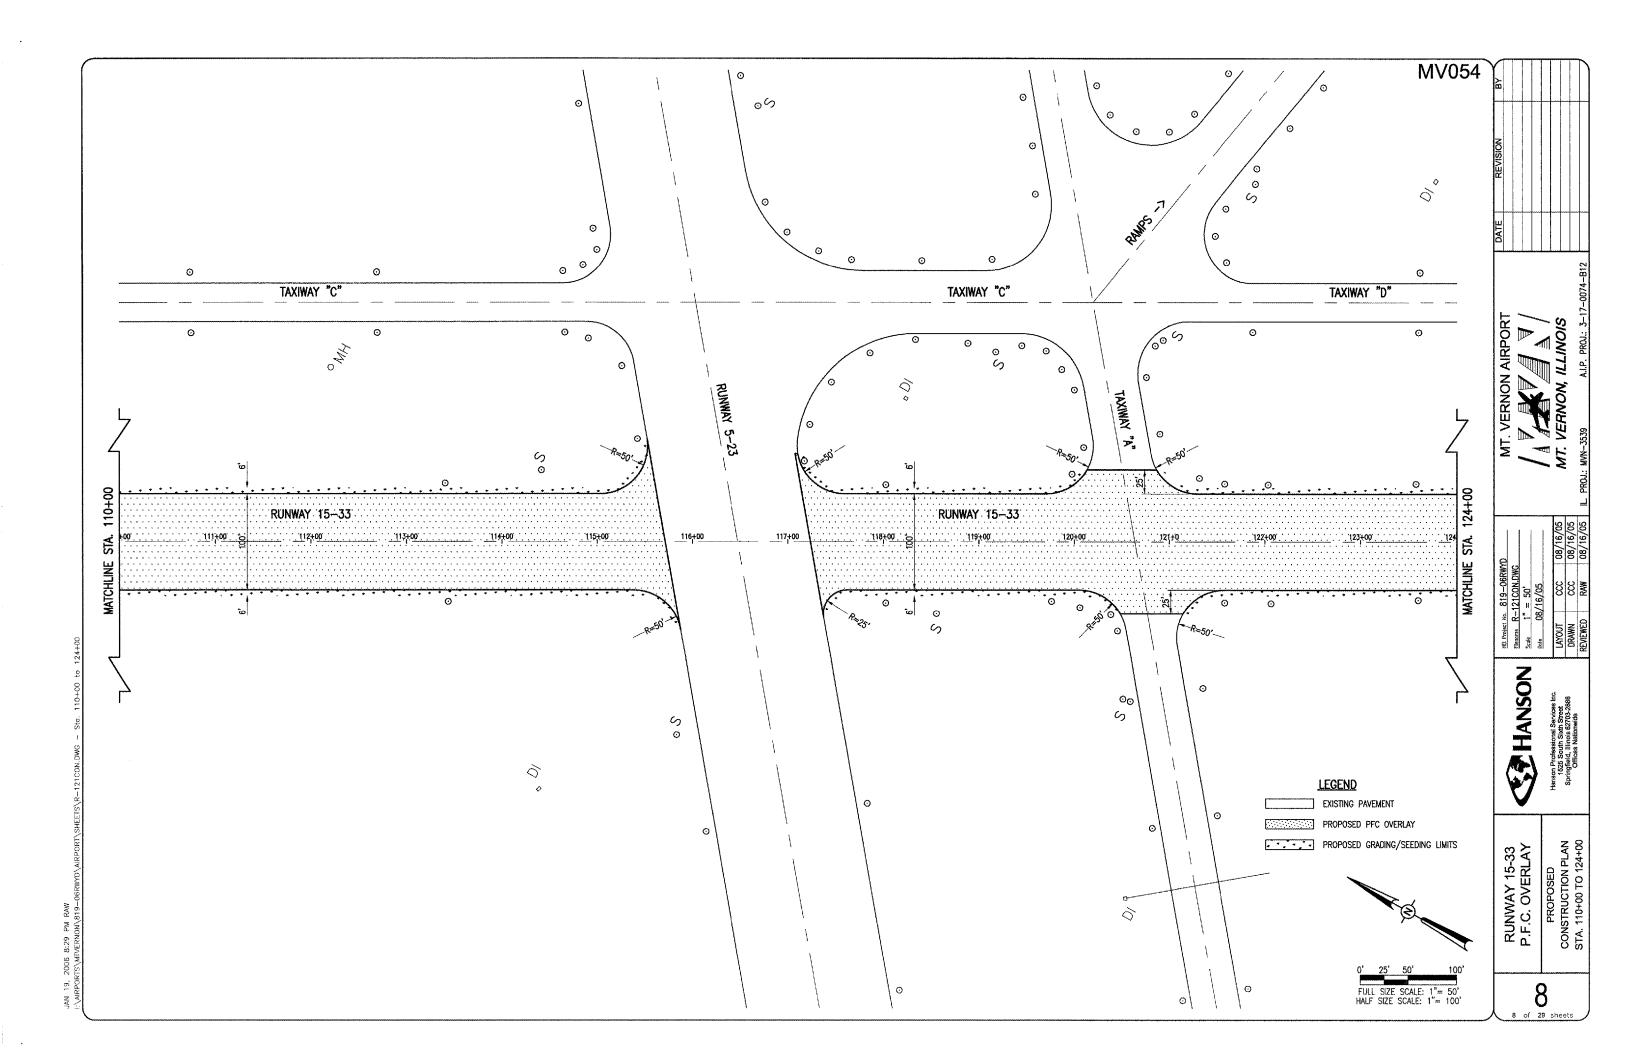

0 0 0 0 TAXIWAY "D" 0 0 0 06 RUNWAY END 33 STA. 131+49 RUNWAY 15-33 131+00 130+00 \_430+00\_


MV054

HANSON

**LEGEND** EXISTING PAVEMENT PROPOSED PFC OVERLAY

PROPOSED GRADING/SEEDING LIMITS

FULL SIZE SCALE: 1"= 50' HALF SIZE SCALE: 1"= 100'

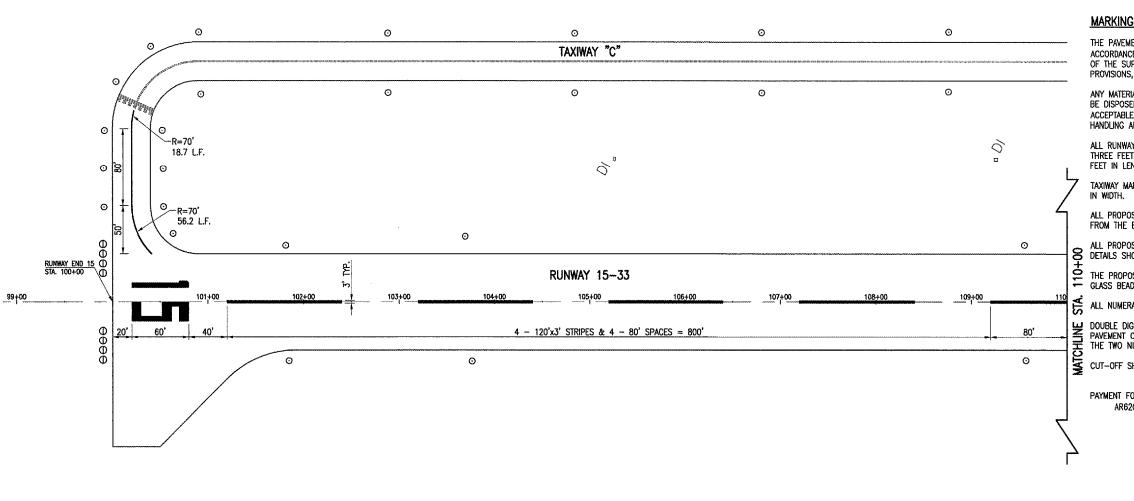

MARKING NOTES:

THE PAVEMENT MARKING-WATERBORNE (620) SHALL BE PLACED IN ACCORDANCE WITH ITEM 620 "PAVEMENT MARKING" AS STATED ON PAGE 77 OF THE SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL PROVISIONS, ADOPTED JULY 1, 2004.

MV054

ANY MATERIAL DELIVERED THAT FAILS TO MEET THE SPECIFICATIONS SHALL BE DISPOSED OF BY THE CONTRACTOR AND IMMEDIATELY REPLACED WITH ACCEPTABLE MATERIAL ENTIRELY AT THE CONTRACTOR'S EXPENSE, INCLUDING HANDLING AND TRANSPORTATION CHARGES.

ALL RUNWAY CENTERLINE STRIPES SHALL BE SOLID AND WHITE IN COLOR, THREE FEET WIDE, 120 FEET IN LENGTH AND THE SPACES SHALL BE 80 FEET IN LENGTH UNLESS OTHERWISE SHOWN.

TAXIWAY MARKING SHALL BE SOLID AND YELLOW IN COLOR AND BE 1 FOOT

ALL PROPOSED TAXIWAY CENTERLINE STRIPES WILL BE REMARKED TO 3 FEET FROM THE EXISTING HOLDING LINE.

ALL PROPOSED MARKING WILL BE COMPLETED IN ACCORDANCE WITH THE 8 DETAILS SHOWN ON THE CONSTRUCTION PLANS.

THE PROPOSED PAVEMENT MARKING WILL BE APPLIED IN TWO APPLICATIONS.

GLASS BEADS SHALL BE REQUIRED IN THE SECOND APPLICATION ONLY.


ALL NUMERALS ARE HORIZONTALLY SPACED 15 FEET APART.


DOUBLE DIGIT NUMERAL DESIGNATIONS ARE CENTERED ON THE RUNWAY PAVEMENT CENTERLINE BASED ON THE CENTER OF THE OUTER EDGES OF THE TWO NUMERALS.

CUT-OFF SHEETS WILL BE REQUIRED TO INSURE STRAIGHT EDGES. PAVEMENT CENTERLINE BASED ON THE CENTER OF THE OUTER EDGES OF


PAYMENT FOR THIS ITEM OF WORK WILL BE UNDER ITEM: AR620520 "PAVEMENT MARKING-WATERBORNE" -- PER SQ. FT

UNIT AREA	NUMBER REQUIRED	TOTAL AREA (S.F.)
360	13	4,680
156	1	156
318	1	318
360	2	720
516	1	516
609	1	609
322	1	322
634	2	1,268
750	11	750
	TOTAL (WHITE)	9,339
N/A	N/A	2,383
	TOTAL (YELLOW)	2,383
	360 156 318 360 516 609 322 634 750	UNIT AREA REQUIRED  360 13  156 1  318 1  360 2  516 1  609 1  322 1  634 2  750 1  TOTAL (WHITE)

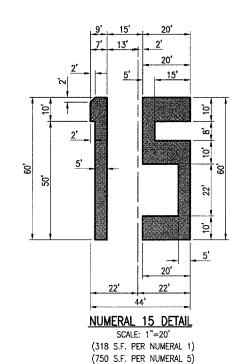

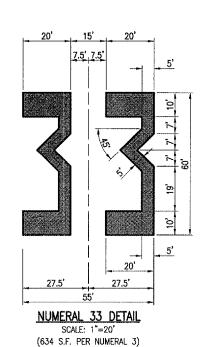


**LEGEND** EXISTING PAVEMENT EXISTING MARKING PROPOSED MARKING




FULL SIZE SCALE: 1"= 50" HALF SIZE SCALE: 1"= 100'

HANSON

RUNWAY 15-33 P.F.C. OVERLAY

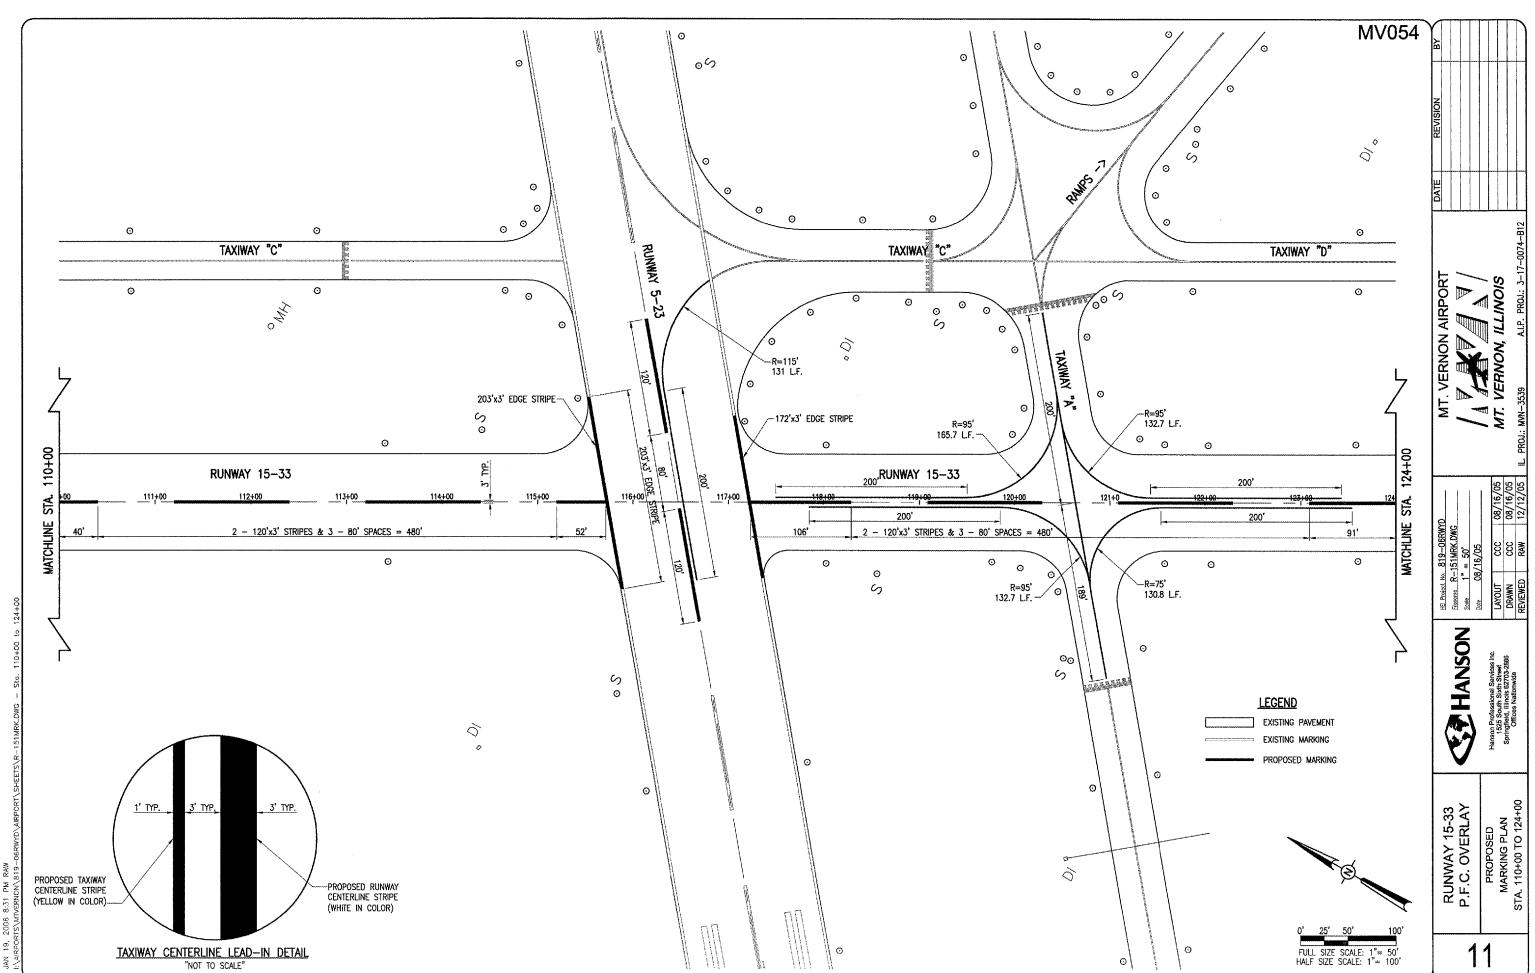



11 of 29 sheets

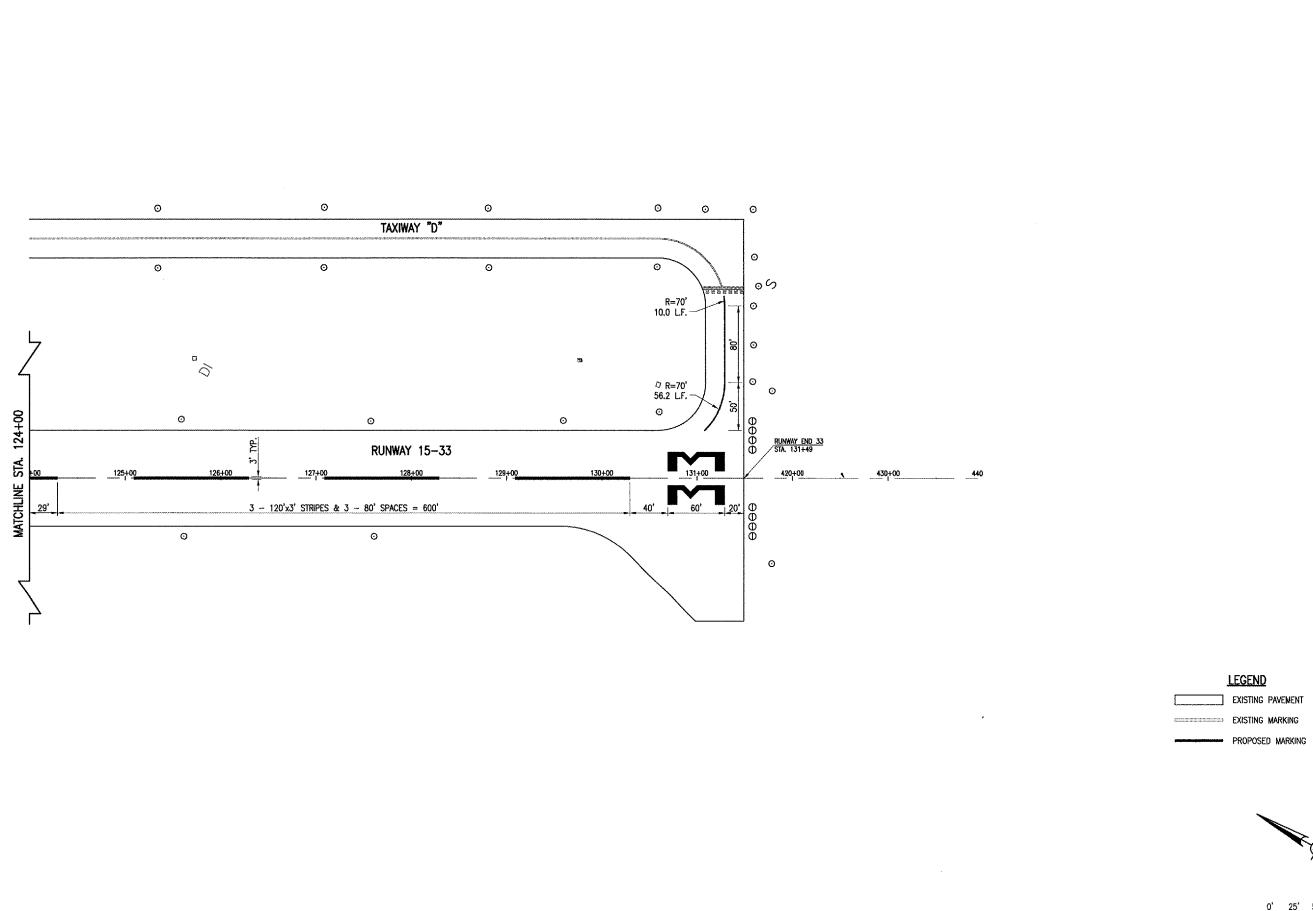



HANSON

MV054



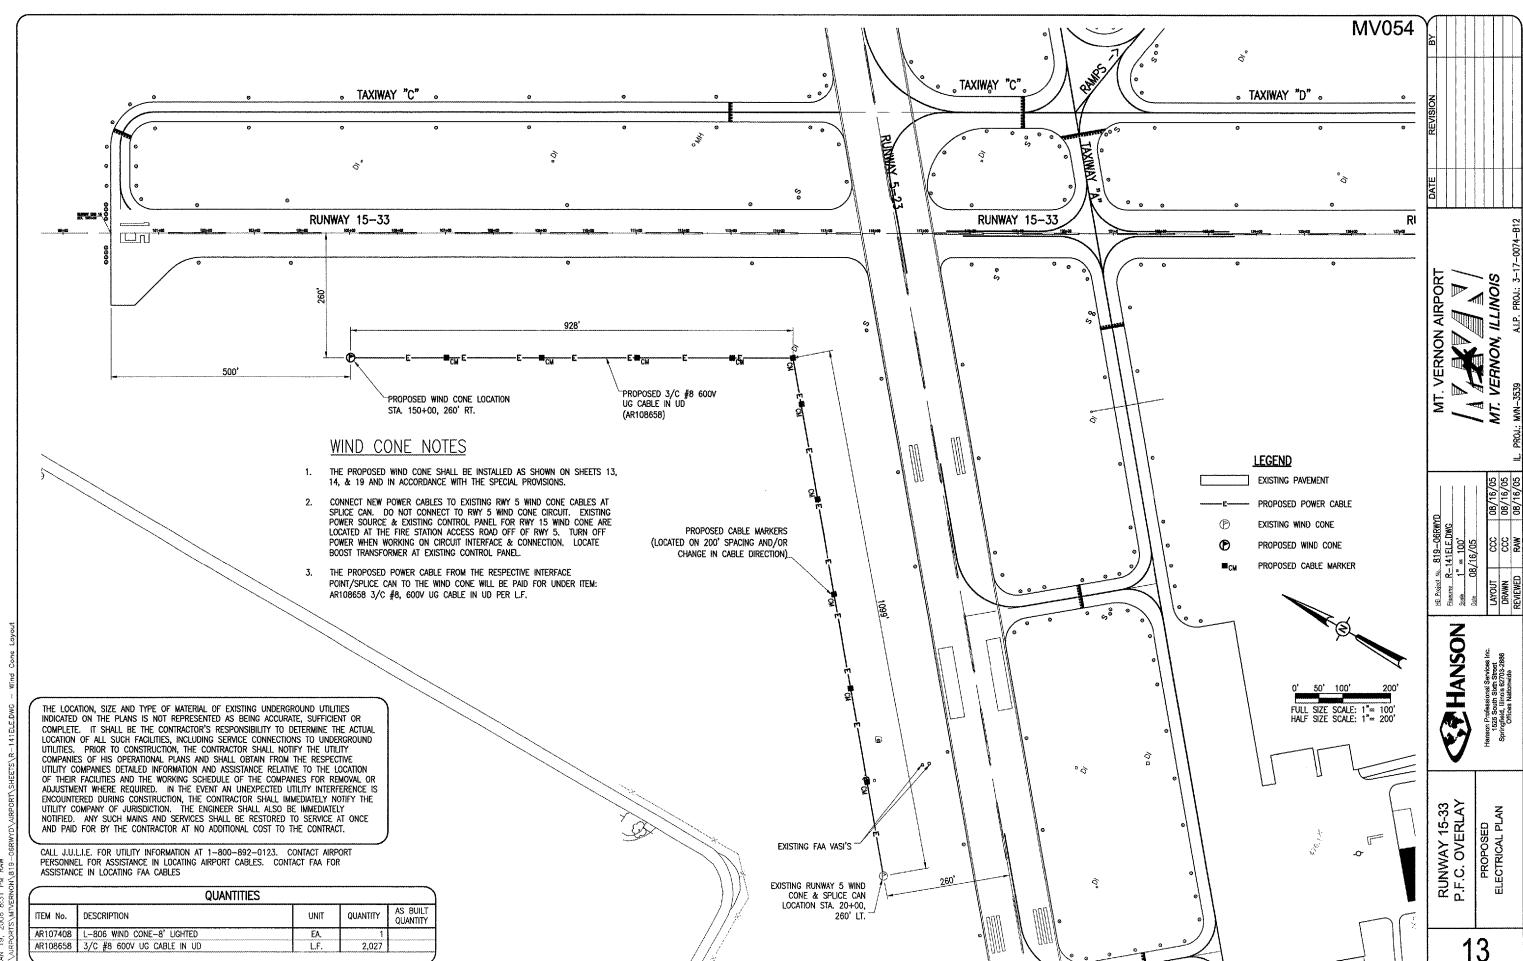

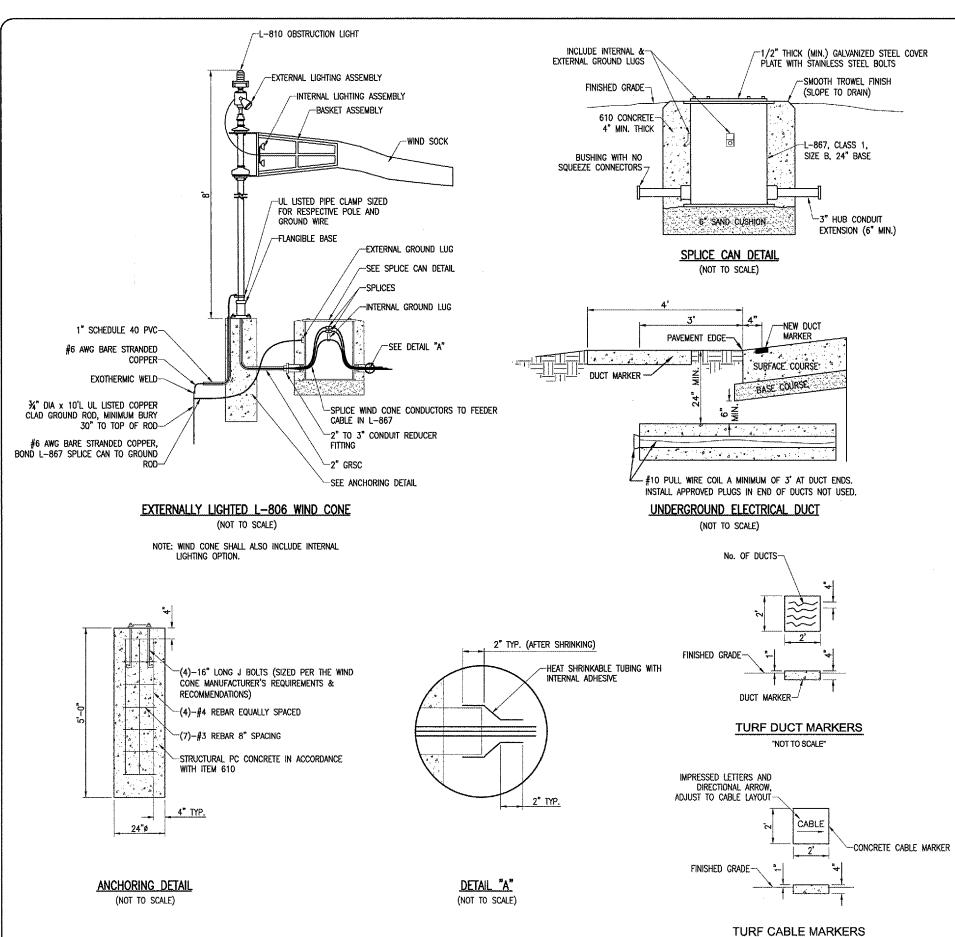




TOP VIEW

PRESTAMPED OR CHISELED ON THE JOB (1/2" LETTERING MIN.)

INDICATES NUMBER & SIZE OF DUCT BANK

NOTE: TOP OF MARKER SHALL BE FLUSH WITH FINISHED PAVEMENT SURFACE. MARKER MAY BE INSTALLED IN A DRILLED HOLE AND SECURED WITH EPOXY GLUE,



0.5"

2-DUCT BANK

(NOT TO SCALE)


0.15"

THE COST OF ALL TURF AND PAVEMENT DUCT MARKERS SHALL BE INCIDENTAL TO THE DUCT. THE COST OF ALL CABLE MARKERS SHALL BE INCIDENTAL TO THE CABLE.

BITUMINOUS PAVEMENT DUCT MARKER AND CONCRETE DUCT MARKER TO BE PROVIDED AT EACH END OF EACH DUCT AS SHOWN ON THE LOCATION PLAN. FOR CONCRETE PAVEMENT, THE LETTER "D" SHALL BE IMPRESSED IN THE PAVEMENT INSTEAD OF THE MARKER. THE LETTER SHALL BE INFORMED AS DESCIBED IN NOTE 4.

CABLE MARKERS SHALL BE PLACED AT CHANGES OF DIRECTION AND EVERY 200' ALONG CABLE

LETTERS 4" HIGH, 3" WIDE WITH WIDTH OF STROKE 光" AND 光" DEEP. ALL LETTERS, NUMBERS AND ARROWS TO BE IMPRESSED.



## PLAN VIEWS

#### MARKER NOTES

CABLE/SPLICE MARKERS SHALL BE PRECAST CONCRETE OF THE SIZE SHOWN. LETTERS/NUMBERS/ARROWS FOR THE LEGEND TO BE IMPRESSED INTO THE TOPS OF THE MARKERS SHALL BE PRE-ASSEMBLED AND SECURED IN THE MOLD BEFORE THE CONCRETE IS POURED. LEGEND INSCRIBED BY HAND IN WET CONCRETE SHALL NOT BE ACCEPTABLE.

ALL UNDERGROUND CABLE RUNS SHALL BE IDENTIFIED BY CABLE MARKERS AT 200 FEET MAXIMUM SPACING, WITH AN ADDITIONAL MARKER AT EACH CHANGE OF DIRECTION OF THE CABLE RUN. CABLE MARKERS SHALL BE INSTALLED IMMEDIATELY ABOVE THE CABLE.

LOCATIONS OF ALL UNDERGROUND CABLE SPLICES/CONNECTIONS, EXCEPT THOSE AT ISOLATION TRANSFORMERS, SHALL BE IDENTIFIED BY MARKERS. SPLICE MARKERS SHALL BE PLACED IMMEDIATELY ABOVE THE SPLICE/CONNECTIONS.

MARKERS SHALL BE PLACED WHERE SHOWN ON PLANS AND ELECTRICAL NOTES.

COST OF CONCRETE MARKERS IS INCIDENTAL TO THE CABLE.


MV054


Ш

HANSON 


RUNWAY 15-33 P.F.C. OVERLAY WIND CONE & ELECTRICAL DETAILS


14 of 29 shee



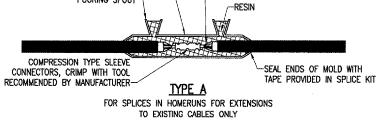

-CABLE JACKET REMOVED, "PENCIL" INSULATION

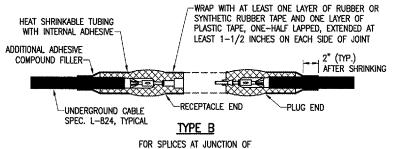

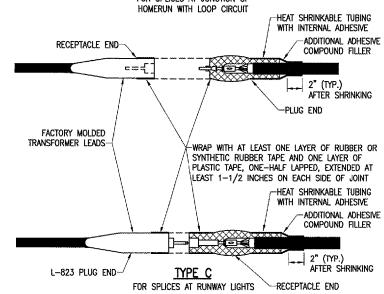

SEE PROPOSED LIGHTING LAYOUT SHEET(S) FOR

INSIDE DIAMETER OF CONNECTOR SHALL PROPERLY MATCH THE OUTSIDE DIAMETER OF CABLE.


CABLE SPLICES (NOT TO SCALE)

4" TOP SOIL SEED & MULCH-<u>Z</u> <sup>\*</sup> 00 0000 00000 000000 0000000 --- 3" TYP. EARTH BACKFILL WILL HAVE MAXIMUM 1" NOTES: DETAIL NUMBERS INDICATE NO. OF CABLES. SIZE PARTICLES AND WILL BE PLACED IN TWO LIFTS AS TRENCHES WITH MORE THAN SEVEN CABLES SHALL BE INCREASED APPROXIMATELY SHOWN 3" IN WIDTH FOR EACH ADDITIONAL CABLE; IF SPECIFIED ON PLANS (TYPICAL FOR ALL TWO PARALLEL TRENCHES MAY BE CONSTRUCTED. TRENCHES) DEPTH OF TRENCHES SHALL BE AS SHOWN ABOVE UNLESS OTHERWISE SPECIFIED ON THE PLANS.

ALL DISTURBED SURFACES SHALL BE RESTORED TO THEIR ORIGINAL

CONDITION. COST IS INCIDENTAL TO TRENCH.

**CABLE TRENCHES** (NOT TO SCALE)

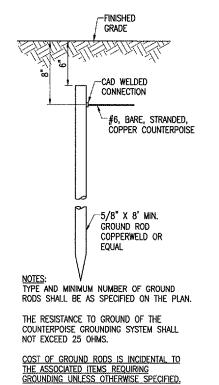

-FINISHED GRADE CABLES INSIDE UNIT DUCT AS SHOWN ON PROPOSED LIGHTING LAYOUT SHEET(S) PLOWED CABLE

(NOT TO SCALE)

GROUND ROD (NOT TO SCALE)

> THE LOCATION OF UNDERGROUND UTILITIES AS INDICATED ON THE PLANS HAS BEEN OBTAINED FROM EXISTING RECORDS. NEITHER THE OWNER NOR THE ENGINEER ASSUMES ANY RESPONSIBILITY WHATSOEVER. IN RESPECT TO THE ACCURACY OR SUFFICIENCY OF THE INFORMATION AND THERE IS NO GUARANTEE, EITHER EXPRESSED OR IMPLIED, THAT THE CONDITIONS ARE REPRESENTATIVE OF THOSE TO BE ENCOUNTERED IN THE CONSTRUCTION.

. DETAILS

ELECTRICAL

HANSON

RUNWAY 15-33 P.F.C. OVERLAY

15 of **29** sheet:

#### **GENERAL**

- THE ELECTRICAL INSTALLATION, AS A MINIMUM, SHALL MEET THE NATIONAL ELECTRICAL CODE (LATEST RECOGNIZED VERSION) AND LOCAL REGULATIONS.
- THE CONTRACTOR SHALL ASCERTAIN THAT ALL LIGHTING SYSTEM COMPONENTS FURNISHED BY HIM, INCLUDING FAA APPROVED EQUIPMENT,
  ARE COMPATIBLE IN ALL RESPECTS WITH EACH OTHER AND THE REMAINDER
  OF THE NEW/EXISTING SYSTEM. ANY NONCOMPATIBLE COMPONENTS
  FURNISHED BY THIS CONTRACTOR SHALL BE REPLACED BY HIM AT NO
  ADDITIONAL COST TO THE AIRPORT SPONSOR WITH A SIMILAR UNIT,
  APPROVED BY THE ENGINEER (DIFFERENT MODEL OR DIFFERENT
  MANUFACTURED) THAT IS COMPATIBLE WITH THE PERMAINER OF THE AIRPORT MANUFACTURER) THAT IS COMPATIBLE WITH THE REMAINDER OF THE AIRPORT LIGHTING SYSTEM.
- IN CASE THE CONTRACTOR ELECTS TO FURNISH AND INSTALL AIRPORT LIGHTING EQUIPMENT REQUIRING ADDITIONAL WIRING, TRANSFORMERS, ADAPTORS, MOUNTINGS, ETC., TO THOSE SHOWN ON THE DRAWINGS AND/OR LISTED IN THE SPECIFICATION, ANY COST FOR THESE ITEMS SHALL BE INCIDENTAL TO THE EQUIPMENT COST.
- THE CONTRACTOR INSTALLED EQUIPMENT (INCLUDING FAA APPROVED) SHALL NOT GENERATE ANY ELECTROMAGNETIC INTERFERENCE IN THE EXISTING AND/OR NEW COMMUNICATIONS, WEATHER, AIR NAVIGATION, AND AIR TRAFFIC CONTROL EQUIPMENT. ANY EQUIPMENT GENERATING SUCH INTERFERENCE SHALL BE REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST WITH THE EQUIPMENT MEETING THE APPLICABLE SPECIFICATIONS AND NOT GENERATING ANY INTERFERENCE.
- WHEN A SPECIFIC TYPE, STYLE, CLASS, ETC. OF FAA APPROVED EQUIPMENT IS SPECIFIED ONLY THAT TYPE, STYLE, CLASS, WILL BE ACCEPTABLE, EVEN THOUGH EQUIPMENT OF OTHER TYPES STYLES, CLASSES, ETC. MAY BE
- ANY AND ALL INSTRUCTIONS FROM THE ENGINEER TO THE CONTRACTOR REGARDING CHANGES IN OR DEVIATIONS FROM THE PLANS AND SPECIFICATIONS SHALL BE IN WRITING WITH COPIES SENT TO THE AIRPORT SPONSOR AND THE FAA FIELD OFFICE (ADO/AFO), THE CONTRACTOR SHALL NOT ACCEPT ANY VERBAL INSTRUCTIONS FROM THE RESIDENT ENGINEER REGARDING ANY CHANGES FROM THE PLANS AND SPECIFICATIONS.
- A MINIMUM OF THREE COPIES OF THE INSTRUCTION BOOK SHALL BE SUPPLIED WITH EACH DIFFERENT TYPE OF EQUIPMENT. THE BOOKS DESCRIBING A MORE SOPHISTICATED TYPE OF EQUIPMENT, SUCH AS REGULATORS, PAPI, REIL, ETC. AS A MINIMUM SHALL CONTAIN THE
  - A DETAILED DESCRIPTION OF THE OVERALL EQUIPMENT AND ITS INDIVIDUAL COMPONENTS.
  - THEORY OF OPERATION INCLUDING THE FUNCTION OF EACH COMPONENT.
- C. INSTALLATION INSTRUCTIONS.
- START-UP INSTRUCTIONS.
- PREVENTATIVE MAINTENANCE REQUIREMENTS.
- CHART FOR TROUBLE-SHOOTING.
- COMPLETE POWER AND CONTROL DETAILED WIRING DIAGRAM(S) SHOWING EACH CONDUCTOR/CONNECTION/COMPONENT - "BLACK BOXES ARE NOT ACCEPTABLE. THE DIAGRAM OF THE NARRATIVE SHALL SHOW VOLTAGE/CURRENTS/WAVE SHAPES AT STRATEGIC LOCATIONS TO BE USED WHEN CHECKING AND/OR TROUBLE-SHOOTING THE EQUIPMENT. WHEN THE EQUIPMENT HAS SEVERAL MODES OF OPERATION, SUCH AS SEVERAL BRIGHTNESS STEPS, THESE PARAMETERS SHALL BE INDICATED FOR ALL DIFFERENT MODES.
- PARTS LIST WHICH WILL INCLUDE ALL MAJOR AND MINOR COMPONENTS SUCH AS RESISTORS, DIODES, ETC. IT SHALL INCLUDE A COMPLETE NOMENCLATURE OF EACH COMPONENT AND, IF APPLICABLE, THE NAME OF ITS MANUFACTURER AND THE CATALOG NUMBER.
- SAFETY INSTRUCTIONS.

#### POWER AND CONTROL

- 1. STENCIL ALL ELECTRICAL EQUIPMENT TO IDENTIFY FUNCTION, CIRCUIT VOLTAGE AND PHASE. WHERE THE EQUIPMENT CONTAINS FUSES, ALSO STENCIL. THE FUSE OR FUSE LINK AMPERE RATING. WHERE THE EQUIPMENT DOES NOT HAVE SUFFICIENT STENCILING AREA, THE STENCILING SHALL BE DONE ON THE WALL NEXT TO THE UNIT. THE LETTERS SHALL BE ONE INCH HIGH AND PAINTED IN WHITE OR BLACK TO PROVIDE THE HIGHEST CONTRACT WITH THE BACKGROUND.
- COLOR CODE ALL PHASE WIRING BY THE USE OF COLORED WIRE INSULATION AND/OR COLORED TAPE. WHERE TAPE IS USED, THE WIRE INSULATION SHALL BE BLACK, BLACK AND RED SHALL BE USED FOR SINGLE-PHASE, THREE WIRE SYSTEMS AND BLACK, RED AND BLUE SHALL BE USED FOR THREE-PHASE SYSTEMS. NEUTRAL CONDUCTORS, SIZE NO. 6 AWG OR SMALLER. SHALL BE IDENTIFIED BY A CONTINUOUS WHITE OR NATURAL GRAY OUTER FINISH ALONG ITS ENTIRE LENGTH. NEUTRAL CONDUCTORS LARGER THAN NO. 6 AWG SHALL BE IDENTIFIED EITHER BY A CONTINUOUS WHITE OR NATURAL GRAY OUTER FINISH ALONG ITS ENTIRE LENGTH OR BY THE USE OF WHITE TAPE AT ITS TERMINATIONS AND INSIDE ACCESSIBLE WIREWAYS.
- ALL BRANCH CIRCUIT CONDUCTORS CONNECTED TO A PARTICULAR PHASE SHALL BE IDENTIFIED WITH THE SAME COLOR. THE COLOR CODING SHALL BE EXTENDED TO THE POINT OF UTILIZATION.
- 4. IN CONTROL WIRING THE SAME COLOR SHALL BE USED THROUGHOUT THE SYSTEM FOR THE SAME FUNCTION, SUCH AS 10%, 30%, 100% BRIGHTNESS
- LOW VOLTAGE (600 V.) AND HIGH VOLTAGE (5000 V.) CONDUCTORS SHALL BE INSTALLED IN SEPÁRATE WIREWAYS.
- NEATLY LACE WIRING IN DISTRIBUTION PANELS, WIREWAYS, SWITCHES AND JUNCTION/PULL BOXES.
- THE MINIMUM SIZE OF PULL/JUNCTION BOXES, REGARDLESS OF THE QUANTITY AND SIZE OF THE CONDUCTORS SHOWN, SHALL BE AS FOLLOWS:
  - IN STRAIGHT PULLS THE LENGTH OF THE BOX SHALL NOT BE LESS THAN EIGHT TIMES THE TRADE DIAMETER OF THE LARGER CONDUIT. THE TOTAL AREA (INCLUDING THE CONDUIT CROSS—SECTIONAL AREA) OF A BOX END SHALL BE AT LEAST 3 TIMES GREATER THAN THE TOTAL TRADE CROSS-SECTIONAL AREA OF THE CONDUITS TERMINATING AT THE END.
  - IN ANGLE PULLS OR 'U' PULLS THE DISTANCE BETWEEN EACH CONDUIT ENTRY INSIDE THE BOX AND THE OPPOSITE WALL OF THE BOX SHALL NOT BE LESS THAN SIX (6) TIMES THE TRADE DIAMETER OF THE LARGEST CONDUIT. THIS DISTANCE SHALL BE INCREASED FOR ADDITIONAL ENTRIES BY THE AMOUNT OF THE SUM OF THE DIAMETERS OF ALL OTHER CONDUIT ENTRIES ON THE SAME WALL AS THE BOX. THE DISTANCE BETWEEN CONDUIT ENTRIES ENCLOSING THE SAME CONDUCTOR SHALL NOT BE LESS THAN SIX TIMES THE TRADE DIAMETER OF THE LARGEST CONDUIT.
- A RUN OF CONDUIT BETWEEN TERMINATIONS AT EQUIPMENT ENCLOSURES, SQUARE DUCTS AND PULL/JUNCTION BOXES, SHALL NOT CONTAIN MORE THAN THE EQUIVALENT OF FOUR QUARTER BENDS (360 DEGREES TOTAL), INCLUDING THOSE BENDS LOCATED IMMEDIATELY AT THE TERMINATIONS. CAST. CONDUIT TYPE OUTLETS SHALL NOT BE TREATED AS PULL/JUNCTION BOXES.
- EQUIPMENT CABINETS SHALL NOT BE USED AS PULL/JUNCTION BOXES, ONLY WIRING TERMINATING AT THE EQUIPMENT SHALL BE BROUGHT INTO THESE ENCLOSURES.
- 10. SPLICES AND JUNCTION POINTS SHALL BE PERMITTED ONLY IN JUNCTION BOXES, DUCTS EQUIPPED WITH REMOVABLE COVERS, AND AT EASILY ACCESSIBLE LOCATIONS.
- 11. CIRCUIT BREAKERS IN POWER DISTRIBUTION PANEL(S) SHALL BE THERMAL-MAGNETIC MOLDED CASE, PERMANENT TRIP WITH 100 AMPERE,

- 12. DUAL LUGS SHALL BE USED WHERE TWO (2) WIRES, SIZE NO. 6 OR LARGER, ARE TO BE CONNECTED TO THE SAME TERMINAL.
- 13. ALL WALL MOUNTED EQUIPMENT ENCLOSURES SHALL BE MOUNTED ON WOODEN MOUNTING BOARDS.
- WOODEN EQUIPMENT MOUNTING BOARDS SHALL BE PLYWOOD, EXTERIOR TYPE, 3/4 INCH, MINIMUM, THICKNESS, BOTH SIDES PAINTED WITH ONE COAT OF PRIMER AND TWO COATS OF GRAY OIL-BASED PAINT.
- RIGID STEEL CONDUIT SHALL BE USED THROUGHOUT THE INSTALLATION UNLESS OTHERWISE SPECIFIED. THE MINIMUM TRADE SIZE SHALL BE 3/4
- ALL RIGID CONDUIT SHALL BE TERMINATED AT CONSTANT CURRENT REGULATORS WITH A SECTION (10" MINIMUM) OF FLEXIBLE CONDUIT.
- UNLESS OTHERWISE SHOWN, ALL EXPOSED CONDUITS SHALL BE RUN PARALLEL TO OR AT RIGHT ANGLES WITH THE LINES OF THE STRUCTURE.
- 18. ALL STEEL CONDUITS, FITTINGS, NUTS, BOLTS, ETC. SHALL BE GALVANIZED.
- USE CONDUIT BUSHINGS AT EACH CONDUIT TERMINATION. WHERE NO. 4 AWG OR LARGER UNDERGROUND WIRE IS INSTALLED, USE INSULATED BUSHINGS.
- 20. USE DOUBLE LOCK NUTS AT EACH CONDUIT TERMINATION.
- WRAP ALL PRIMARY AND SECONDARY POWER TRANSFORMER CONNECTIONS WITH SUFFICIENT LAYERS OF INSULTING TAPE AND COVER WITH INSULATING varnish for full value of cable insulation voltage.
- 22. UNLESS OTHERWISE NOTED, ALL INDOOR SINGLE CONDUCTOR CONTROL WIRING SHALL BE NO. 12 AWG. MINUMUM.
- 23. THE FOLLOWING SHALL APPLY TO RELAY/CONTACTOR PANELS/ENCLOSURES:
  - ALL COMPONENTS SHALL BE MOUNTED IN DUST PROOF ENCLOSURE(S) WITH VERTICALLY HINGED COVERS.
  - THE ENCLOSURE(S) SHALL HAVE AMPLE SPACE FOR THE CIRCUIT COMPONENTS, TERMINAL BLOCKS AND INCOMING AND INTERNAL WIRING.
  - ALL CONTROL CONDUCTOR TERMINATIONS SHALL BE OF THE OPEN-EYE CONNECTOR/SCREW TYPE. SOLDERED CLOSED-EYE TERMINATIONS, OR TERMINATIONS WITHOUT CONNECTORS ARE NOT ACCEPTABLE.
  - WHEN THE ENCLOSURE COVER IS OPENED, ALL CIRCUIT COMPONENTS. WIRING AND TERMINALS SHALL BE EXPOSED AND ACCESSIBLE WITHOUT REMOVAL OF ANY PANELS, COVERS, ETC., EXCEPT THOSE COVERING HIGH VOLTAGE COMPONENTS.
  - ACCESS TO, OR REMOVAL OF A CIRCUIT COMPONENT OR TERMINAL BLOCK WILL NOT REQUIRE THE REMOVAL OF ANY OTHER CIRCUIT COMPONENT OR TERMINAL BLOCK.
  - EACH CIRCUIT COMPONENT SHALL BE CLEARLY IDENTIFIED INDICATING ITS CORRESPONDING NUMBER SHOWN ON THE DRAWINGS AND ITS FUNCTION.
  - A COMPLETE WIRING DIAGRAM (NOT A SCHEMATIC DIAGRAM) SHALL BE MOUNTED ON THE INSIDE OF THE COVER. THE DIAGRAM SHALL. REPRESENT EACH CONDUCTOR BY A SEPARATE LINE.
  - THE DIAGRAM SHALL IDENTIFY EACH CIRCUIT COMPONENT AN NUMBERING AND COLOR OF EACH TERMINAL CONDUCTOR AND TERMINAL.
  - ALL WIRING SHALL BE NEATLY TRAINED AND LACED.
  - MINIMUM WIRE SIZE SHALL BE NO. 12 AWG.

16

- NO COMPONENTS OF PRIMARY CIRCUIT SUCH AS CABLE, CONNECTORS AND TRANSFORMERS SHALL BE BROUGHT ABOVE GROUND AT EDGE LIGHTS, SIGNS, REIL PAPI. ETC.
- 3. THERE SHALL BE NO EXPOSED POWER/CONTROL CABLES BETWEEN THE POINT WHERE THEY LEAVE THE UNDERGROUND (DEB OR L-867 BASES) AND WHERE THEY ENTER THE EQUIPMENT (SUCH AS TAXIWAY SIGNS, PAPI, REIL, ETC.) ENCLOSURES. THESE CABLES SHALL BE ENCLOSED IN RIGID CONDUIT OR IN FLEXIBLE, WATERTIGHT CONDUIT WITH BREAKABLE COUPLING(S) AT THE GRADE OR THE HOUSING COVER, AS SHOWN IN APPLICABLE DETAILS.
- 4. THE JOINTS OF THE L-823 PRIMARY CONNECTORS SHALL BE WRAPPED WITH AT LEAST ONE LAYER OF RUBBER OR SYNTHETIC RUBBER TAPE AND ONE LAYER OF PLASTIC TAPE, ONE-HALF LAPPED, EXTENDING AT LEAST 1-1/2 INCHES ON EACH SIDE OF THE JOINT.
- THE CABLE ENTRANCE INTO THE FIELD-ATTACHED L-823 CONNECTORS SHALL BE ENCLOSED BY A HEAT-SHRINKABLE TUBING WITH CONTINUOUS INTERNAL ADHESIVE.
- L-823 TYPE II, TWO-CONDUCTOR SECONDARY CONNECTORS SHALL BE CLASS 'A' (FACTORY MOLDED).
- THERE SHALL BE NO SPLICES IN THE SECONDARY CABLE(S) WITHIN THE STEMS OF A RUNWAY/TAXIWAY EDGE/THRESHOLD LIGHTING FIXTURE AND THE WIREWAYS LEADING TO TAXIWAY SIGNS AND PAPI/REIL EQUIPMENT.
- ELECTRICAL INSULATING GREASE SHALL BE APPLIED WITHIN THE L-823, SECONDARY, TWO CONDUCTOR CONNECTORS TO PREVENT WATER ENTRANCE. THESE CONNECTORS SHALL NOT BE TAPED.
- DEB ISOLATION TRANSFORMERS SHALL BE BURIED AT A DEPTH OF TEN (10")
  INCHES ON A LINE CROSSING THE LIGHT AND PERPENDICULAR TO THE
  RUNWAY/TAXIWAY CENTERLINE AT A LOCATION TWELVE (12") INCHES FROM
  THE LIGHT OPPOSITE FROM THE RUNWAY/TAXIWAY.
- 10. A SLACK OF THREE (3') FEET, MINIMUM, SHALL BE PROVIDED IN THE PRIMARY CABLE AT EACH TRANSFORMER/CONNECTOR TERMINATION. AT STAKE—MOUNTED LIGHTS, THE SLACK SHALL BE LOOSELY COILED IMMEDIATELY BELOW THE ISOLATION TRANSFORMER.
- 11. DIRECTION OF PRIMARY CABLES SHALL BE IDENTIFIED BY COLOR CODING AS FOLLOWS: WHEN FACING LIGHT WITH BACK TO PAVEMENT, CABLE TO THE LEFT IS CODED RED AND CABLE TO RIGHT IS CODED BLUE. THIS APPLIES TO STAKE MOUNTED LIGHTS AND BASE MOUNTED LIGHTS WHERE THE BASE HAS ONLY ONE ENTRANCE.
- 12. L-867 BASES SHALL BE SIZE B, 24" DEEP, CLASS I, UNLESS OTHERWISE NOTED.
- 13. BASE MOUNTED BREAKABLE COUPLINGS SHALL NOT HAVE WEEP HOLES TO THE OUTSIDE. PLUGGED UP HOLES SHALL NOT BE ACCEPTABLE. IT SHALL BE A 1/4" DIAMETER, MINIMUM, OR EQUIVALENT OPENING FOR DRAINAGE FROM THE SPACE AROUND THE SECONDARY CONNECTOR INTO THE L-867 BASE.
- 14. THE ELEVATION OF THE BREAKABLE COUPLING GROOVE SHALL NOT EXCEED 1-1/2" ABOVE THE EDGE OF THE COVER IN CASE OF BASE MOUNTED COUPLINGS, OR THE TOP OF THE STAKE IN CASE OF STAKE MOUNTED COUPLINGS.
- 15. WHERE THE BREAKABLE COUPLING IS NOT AN INTEGRAL PART OF THE LIGHT FIXTURE STEM OR MOUNTING LEG, A BEAD OF SILICON SEAL SHALL BE APPLIED COMPLETELY AROUND LIGHT STEM OR WIREWAY AT BREAKABLE COUPLING TO PROVIDE A WATERTIGHT SEAL.

- TOPS OF THE STAKES SUPPORTING LIGHT FIXTURES SHALL BE FLUSH WITH THE SURROUNDING GRADE.
- 17. PLASTIC LIGHTING FIXTURE COMPONENTS, SUCH AS LAMP HEADS, STEMS, BREAKABLE COUPLINGS, BASE COVERS, BRACKETS, STAKES, SHALL NOT BE ACCEPTABLE
- 18. THE TOLERANCE FOR THE HEIGHT OF RUNWAY/TAXIWAY EDGE LIGHTS SHALL BE: ONE (1) INCH. IN CASE OF STAKE MOUNTED LIGHTS, THE SPECIFIED LIGHTING FIXTURE HEIGHT SHALL BE MEASURED BETWEEN THE TOP OF THE STAKE AND THE TOP OF THE LENS. IN CASE OF BASE MOUNTED LIGHTS, THE SPECIFIED LIGHTING FIXTURE HEIGHT SHALL BE MEASURED BETWEEN THE TOP OF THE BASE FLANGE AND THE TOP OF THE LENS, THUS INCLUDING THE BASE COVER, THE FLANGIBLE COUPLING, THE STEM, THE LAMP HOUSING AND THE LENS.
- 19. THE TOLERANCE FOR THE LATERAL SPACING (LIGHT LANE TO RUNWAY/TAXIWAY CENTERLINE) OF RUNWAY/TAXIWAY EDGE LIGHTS SHALL BE ONE (1) INCH. THIS ALSO APPLIES AT INTERSECTIONS TO LATERAL SPACING BETWEEN LIGHTS OF A RUNWAY/TAXIWAY AND THE INTERSECTING RUNWAY/TAXIWAY.
- 20. ENTRANCES INTO L-867 BASES SHALL BE SEALED WITH HEAT SHRINK.
- GALVANIZED/PAINTED EQUIPMENT/COMPONENT SURFACES SHALL NOT BE DAMAGED BY DRILLING, FILING, ETC. DRAIN HOLES IN METAL TRANSFORMER HOUSINGS SHALL BE MADE BEFORE GALVANIZING.
- 22. EDGE LIGHT NUMBERING TAGS SHALL BE FACING THE PAVEMENT.
- 23. CABLE/SPLICE/DUCT MARKERS SHALL BE PRECAST CONCRETE OF THE SIZE SHOWN. LETTERS/NUMBERS/ARROWS FOR THE LEGEND TO BE IMPRESSED INTO THE TOPS OF THE MARKERS SHALL BE PRE—ASSEMBLED AND SECURED IN THE MOLD BEFORE THE CONCRETE IS POURED. LEGEND INSCRIBED BY HAND IN WET CONCRETE SHALL NOT BE ACCEPTABLE.
- 24. ALL UNDERGROUND CABLE RUNS SHALL BE IDENTIFIED BY CABLE MARKERS AT 200 FEET MAXIMUM SPACING, WITH AN ADDITIONAL MARKER AT EACH CHANGE OF DIRECTION OF THE CABLE RUN. CABLE MARKERS SHALL BE INSTALLED IMMEDIATELY ABOVE THE CABLES.
- THERE SHALL BE NO SPLICES BETWEEN THE ISOLATION TRANSFORMERS, L-823 CONNECTORS ARE ALLOWED AT TRANSFORMER CONNECTIONS ONLY, UNLESS OTHERWISE SHOWN.
- APPLY AN OXIDE INHIBITING, ANTI-SEIZING COMPOUND TO ALL SCREWS, NUTS AND BREAKAGE COUPLING THREADS.
- LOCATIONS OF ENDS OF ALL UNDERGROUND DUCTS SHALL BE IDENTIFIED BY DUCT MARKERS.
- WHERE A PARALLEL, CONSTANT VOLTAGE PAPI SYSTEM IS PROVIDED, THE "T" SPLICES SHALL BE OF THE CAST TYPE.
- CONCRETE USED FOR SLABS, FOOTINGS, BACKFILL AROUND TRANSFORMER HOUSINGS, MARKINGS, ETC. SHALL BE 3000 PSI, AIR-ENTRAINED.
- 30. ALL POWER AND CONTROL CABLES IN MAN/HAND HOLES SHALL BE TAGGED. USE EMBOSSED COPPER STRIPS TO BE ATTACHED AT BOTH ENDS TO THE CABLE BY THE USE OF PLASTIC STRAPS. MINIMUM OF TWO TAGS SHALL BE PROVIDED ON EACH CABLE IN A MAN/HAND HOLE-ONE AT THE CABLE ENTRANCE AND ONE AT THE CABLE EXIT.

# GROUNDING NOTES

- ALL GROUND CONNECTIONS TO GROUND RODS, BUSSES, PANELS, ETC. SHALL BE MADE WITH PRESSURE TYPE SOLDERLESS LUGS AND GROUND CLAMPS SOLDERED OR BOLT AND WASHER TYPE CONNECTIONS ARE NOT ACCEPTABLE. CLEAN ALL METAL SURFACES BEFORE MAKING GROUND CONNECTIONS.
- 2. TOP OF GROUND RODS SHALL BE TEN (10) INCHES BELOW GRADE.
- THE RESISTANCE TO GROUND OF THE VAULT GROUNDING SYSTEM WITH THE COMMERCIAL POWER LINE NEUTRAL DISCONNECTED SHALL NOT EXCEED 10 OHMS.

DATE REVISION BY

NON, ILLINOIS

6/05 MT. 1

| Plances | R-541ELE.DWG | Scale | N/A | Scale | O8/16/05 | AYOUT | CCC | O8/16/05 | AYOUT | CCC | O8/16/05 | CCC | CCCC | CCC | CCC | CCC | CCCC | C

HANSON

Innson Professional Services Inc.

1025 South State Street

1025 South State Street

RUNWAY 15-33 P.F.C. OVERLAY

ELEC

17

	ELECTRICAL LEGEND — SCHEMATIC
	NORMALLY OPEN (N.O.) CONTACT
	NORMALLY CLOSED (N.C.) CONTACT
œ	CONTROL RELAY, * = CONTROL RELAY NUMBER
₽	RELAY, * ≃ RELAY NUMBER
· ~ °	TOGGLE SWITCH / 2 POSITION SWITCH
OFF AUTO	2-position selector switch
HAND T AUTO  SOO OOX	3-position selector switch (H-O-A Shown)
7	2 POLE DISCONNECT SWITCH
144	3 POLE DISCONNECT SWITCH
<del></del>	PHOTOCELL
	TERMINAL BLOCK, * = TERMINAL NUMBER
	DEVICE TERMINAL, * = DEVICE TERMINAL NUMBER
	INTERNAL, PANEL WIRING
	FIELD WIRING
<u> </u>	FUSE
GND	GROUND BUS OR TERMINAL
S/N	NEUTRAL BUS
争	GROUND, GROUND ROD
0 0	INDUSTRIAL CONTROL RELAY OR LIGHTING CONTACTOR
CCR	S1 CUTOUT HANDLE REMOVED
CCR	S1 CUTOUT HANDLE INSERTED

	ELECTRICAL ABBREVIATIONS
A.F.F.	ABOVE FINSHED FLOOR
A, AMP	AMPERES
ATS	AUTOMATIC TRANSFER SWITCH
AWG	AMERICAN WIRE GAUGE
BKR	BREAKER
С	CONDUIT
СВ	CIRCUIT BREAKER
СКТ	CIRCUIT
CR	CONTROL RELAY
CU	COPPER
DPDT	DOUBLE POLE DOUBLE THROW
DPST	DOUBLE POLE SINGLE THROW
EM	EMERGENCY
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
EP	EXPLOSION PROOF
ES	EMERGENCY STOP
ETM	ELAPSE TIME METER
GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFI	GROUND FAULT INTERRUPTER
GND	GROUND
GRSC	GALVANIZED RIGID STEEL CONDUIT
HID	HIGH INTENSITY DISCHARGE
HOA	HAND OFF AUTOMATIC
HP	HORSEPOWER
HPS	HIGH PRESSURE SODIUM
J	JUNCTION BOX
KVA	KILOVOLT AMPERE(S)
KW	KILOWATTS
LC	LIGHTING CONTACTOR
LTFMC	LIQUID TIGHT FLEXIBLE METAL CONDUIT (UL LISTED)
ሆ	LIGHTING PANEL
MAX	MAXIMUM
WC8	MAIN CIRCUIT BREAKER
MCM	THOUSAND CIRCLUAR MIL
MDP	MAIN DISTRIBUTION PANEL
MH	METAL HALIDE
MIN	MINIMUM

Il	COMMONE ADDITENTIONS (COMMODE)
MLO	MAIN LUGS ONLY
NC	NORMALLY CLOSED
NEC	NATIONAL ELECTRICAL CODE (NFPA 70)
NO	NORMALLY OPEN
NTS	NOT TO SCALE
OHE	OVERHEAD ELECTRIC
OL.	OVERLOAD
PB	PULL BOX
PC	PHOTO CELL
PDB	POWER DISTRIBUTION BLOCK
PNL	PANEL
RCPT	RECEPTACLE
R	RELAY
S	STARTER
SPO	SURGE PROTECTION DEVICE
SPST	SINGLE POLE SINGLE THROW
TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
TYP	TYPICAL.
UG	UNDERGROUND
UGE	UNDERGROUND ELECTRIC
γ	VOLTS
w/	wmн
W/O	WITHOUT
WP	WEATHER PROOF
XFER	TRANSFER
XFMR	TRANSFORMER

**ELECTRICAL ABBREVIATIONS (CONTINUED)** 

	ELECTRICAL LEGEND — PLANS
	CONDUIT (EXPOSED)
	CONDUIT OR UNIT DUCT (CONCEALED OR BURIED)
	DUCT
E	BURIED/UNDERGROUND ELECTRIC
UGE	Underground Electric
OHE	OVERHEAD ELECTRIC
• <del>→</del> ¤	POLE MOUNTED HID FIXTURE
0	DUPLEX CONVENIENCE RECEPTACLE, 120V, SINGLE PHASE, GROUNDING TYPE, 48" A.F.F. EXCEPT AS NOTED
юo•	WALL OR CEILING MTD, JUNCTION BOX, CONFIGURATION VARIES WITH USE
чо	SINGLE THROW DISCONNECT SWITCH
421	SINGLE THROW, FUSIBLE DISCONNECT SWITCH
4(3)	ENCLOSED CIRCUIT BREAKER
<b>C2</b> 2	CONTROL PANEL
<b>Ø</b>	MOTOR. ESTIMATED H.P. AS INDICATED.
<u> </u>	MOTOR
T	TRANSFORMER
	ELECTRIC UTILITY METER
	ENCLOSURE
	CIRCUIT BREAKER PANEL-SEE SCHEDULES
•	GROUND ROD

MV054

- 1. ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 (MOST CURRENT ISSUE IN FORCE), THE RESPECTIVE EQUIPMENT
  MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS,
  ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- 2. CONTRACTOR SHALL COORDINATE WORK AND ANY POWER OUTAGES WITH THE RESPECTIVE FACILITY OWNER PERSONNEL AND THE AIRPORT MANAGER.
- COLOR CODE PHASE AND NEUTRAL CONDUCTOR INSULATION FOR NO. 6 AWG OR SMALLER. PROVIDE COLORED INSULATION OR COLORED MARKING TAPE FOR PHASE AND NEUTRAL CONDUCTORS FOR NO. 4 AWG AND LARGER. INSULATED GROUND CONDUCTORS SHALL HAVE GREEN COLORED INSULATION FOR ALL CONDUCTOR AWG AND/OR KCMIL, STANDARD COLORS FOR POWER WIRING AND BRANCH CIRCUITS SHALL BE AS FOLLOWS:

120/240 VAC, 1 PHASE, 3 WIRE BLACK RED PHASE B WHITE NEUTRAL GROUND 120/208 VAC. 1 PHASE, 3 WIRE PHASE A BLACK

PHASE B RED NEUTRAL WHITE

208/120 VAC, 3 PHASE, 4 WIRE PHASE A BLACK PHASE B RED PHASE C BLUE NEUTRAL. WHITE GROUND

	_
INFORMATION SHOWN ON THIS	
SHEET IS FOR BASE BID, BID	
ALTERNATE NO. 1 & BID	
ALTERNATE NO. 2	

RUNWAY 15-33 P.F.C. OVERLAY ELECTRICAL LEGEND AND ABBREVEATIONS

HANSON

18 18 of 29 sheets

FOR RUNWAY 15 WIND CONE

ELECTRICAL NOTES

- 1. ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA70 (MOST CURRENT ISSUE IN FORCE), THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL LISTING, (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- CONTRACTOR SHALL COORDINATE ANY POWER OUTAGES TO EXISTING EQUIPMENT WITH THE AIRPORT MANAGER, AND THE RESIDENT ENGINEER.
- 3. ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.
- PROVIDE NEMA 4 HUBS FOR ALL CONDUIT ENTRIES INTO NEMA 4 RATED ENCLOSURES.
- 5. ALL CONDUCTORS/WIRING SHALL BE COPPER.
- 6. WIND CONES SHALL BE PAID FOR UNDER AR107408.
- 7. BOOST TRANSFORMER FOR WIND CONE WITH A LOAD OF APPROXIMATELY 3.5 AMPS SHALL BE 250 VA, 120 VAC, TO 132 VAC UNIT, SQUARE D CAT. NO. 250S43B OR APPROVED EQUAL. BOOST TRANSFORMER FOR A WIND CONE WITH A LOAD OF APPROXIMATELY 7 AMPS SHALL BE 250 VA, 120 VAC, TO 144 VAC UNIT, SQUARE D CAT. NO. 250S43B OR APPROVED EQUAL. INTERFACE & CONNECT BOOST TRANSFORMER TO EXISTING CONTROL PANEL.
- 8. LTFMC DENOTES LIQUID TIGHT FLEXIBLE METAL CONDUIT. LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE U.L. LISTED TO MEET THE REQUIREMENTS OF NEC 350.6., SUITABLE FOR GROUNDING AND SUNLIGHT RESISTANT. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO TRANSFORMERS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.60. DO NOT INSTALL LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS NOT UL LISTED.

TH NFPA70
ACTURER'S NCES, AND JISTING, ETL
R'S
QUIPMENT

MT. VERNOR

-603.DWG

NRE
2/16/05

KNL 12/02/05

MV 12/05/05

Harson Professional Services Inc.

RUNWAY 15-33
P.F.C. OVERLAY
ELECTRICAL ONE LINE
IAGRAM FOR WIND CONE

10

19

19, 2006 8:33 PM RAW :PORTS\MTVERNON\819—06RWYD\AIRPORT\SHEETS\E—60 144 VAC OUPUT


120 VAC TO 144 VAC BOOST TRANSFORMER

CONFIRM WIRING WITH RESPECTIVE


CONNECTION DIAGRAM FOR SQUARE D
CAT. NO. 250SV43B TRANSFORMER

TRANSFORMER MFR.

WORK SHOWN ON THIS SHEET IS FOR BASE BID

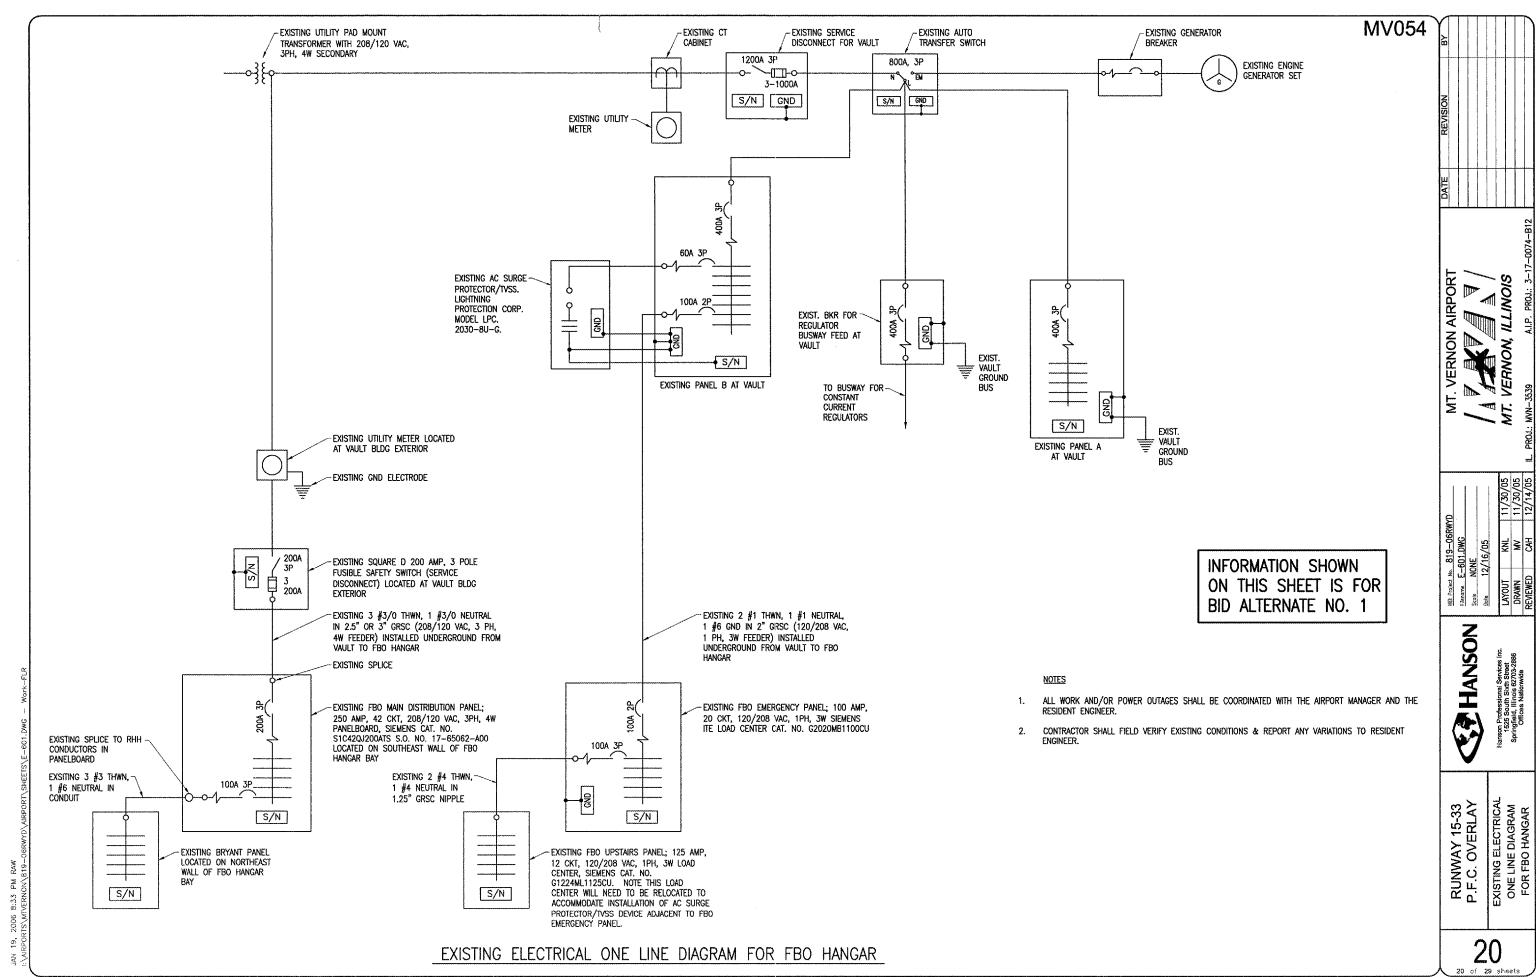

(E-3)

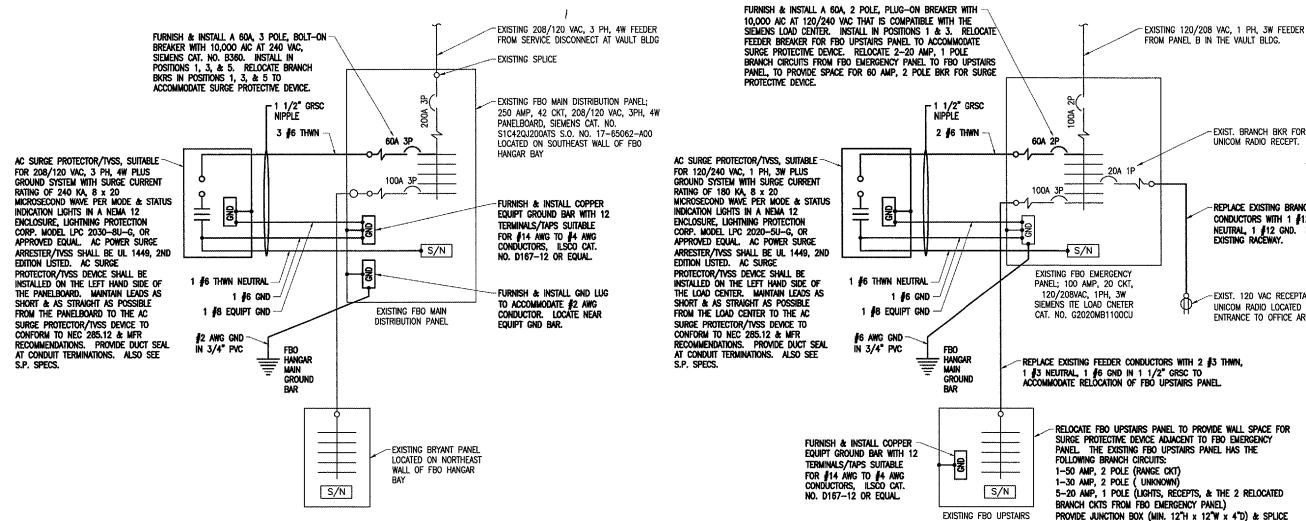

FXIST, BRANCH BKR FOR UNICOM RADIO RECEPT. REPLACE EXISTING BRANCH CIRCUIT CONDUCTORS WITH 1 #12 THWN, 1 #12 NEUTRAL, 1 #12 GND. INSTALL IN EXISTING RACEWAY. EXIST. 120 VAC RECEPTACLE FOR UNICOM RADIO LOCATED IN LOBBY/MAIN ENTRANCE TO OFFICE AREA REPLACE EXISTING FEEDER CONDUCTORS WITH 2 #3 THWN, 1 #3 NEUTRAL, 1 #6 GND IN 1 1/2" GRSC TO ACCOMMODATE RELOCATION OF FBO UPSTAIRS PANEL RELOCATE FBO UPSTAIRS PANEL TO PROVIDE WALL SPACE FOR SURGE PROTECTIVE DEVICE ADJACENT TO FBO EMERGENCY PANEL. THE EXISTING FBO UPSTAIRS PANEL HAS THE FOLLOWING BRANCH CIRCUITS: 1-50 AMP, 2 POLE (RANGE CKT) 1-30 AMP, 2 POLE ( UNKNOWN) 5-20 AMP, 1 POLE (LIGHTS, RECEPTS, & THE 2 RELOCATED BRANCH CKTS FROM FBO EMERGENCY PANEL) PROVIDE JUNCTION BOX (MIN. 12"H x 12"W x 4"D) & SPLICE RESPECTIVE BRANCH CIRCUITS TO ACCOMMODATE RELOCATION OF FBO UPSTAIRS PANEL. 20 AMP BRANCH CIRCUITS SHALL USE #12 AWG THWN (MIN. 30 AMP BRANCH CIRCUITS SHALL USE \$10 AWG THWN (MIN.) 50 AMP BRANCH CIRCUITS SHALL USE #6 AWG THWN (MIN.)

# NEW ELECTRICAL ONE LINE DIAGRAM FOR FBO HANGAR

WORK SHOWN ON THIS

SHEET IS FOR BID

ALTERNATE NO. 1

DEVICE	LABEL
FBO MAIN DIST. PANEL	FBO MAIN DIST. PANEL 208/120VAC, 3PH, 4W FED FROM SERVICE DISCONNECT AT VAULT
FBO MAIN DIST PANEL	NOTE THERE IS A SECOND FEEDER DISCONNECT TO THIS BUILDING LOCATED IN THE FBO EMERGENCY PANEL ON THE SOUTHWEST WALL OF THE HANGAR
FBO EMERGENCY PANEL	FBO EMERGENCY PANEL 120/208VAC, 1PH, 3W FED FROM PANEL B IN THE VAULT
FBO EMERGENCY PANEL	NOTE THERE IS A SECOND FEEDER DISCONNECT TO THIS BUILDING LOCATED IN THE FBO MAIN DIST. PANEL LOCATED AT THE SOUTH CORNER OF THE HANGAR
FBO UPSTAIRS PANEL	FBO UPSTAIRS PANEL 120/208VAC, 1PH, 3W FED FROM FBO EMERGENCY PANEL

LEGEND PLATE SCHEDULE

LEGEND PLATES SHALL BE WEATHERPROOF ENGRAVED PLASTIC OR PHENOLIC MATERIAL, 1/4" HIGH BLOCK LETTERS ON A WHITE BACKGROUND, SECURE WITH WEATHERPROOF ADHESIVE AND/OR MACHINE SCREWS.

- ALL WORK AND/OR POWER OUTAGES SHALL BE COORDINATED WITH THE AIRPORT MANAGER AND THE
- CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS & REPORT ANY VARIATIONS TO RESIDENT
- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 (NEC MOST CURRENT ISSUE IN FORCE). THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL LISTING, (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- PER NEC 513 THE ENTIRE AREA OF THE HANGAR INCLUDING ANY ADJACENT AND COMMUNICATING AREAS NOT SUITABLY CUT OFF FROM THE HANGAR, SHALL BE CLASSIFIED AS A CLASS I, DIVISION 2 HAZARDOUS LOCATION UP TO A LEVEL 18 INCHES ABOVE THE FLOOR. AREAS IN THE VICINITY OF AIRCRAFT ARE ALSO CLASSIFIED AS HAZARDOUS AS DEFINED BY NEC 513. ALL ELECTRICAL ARCARF ARE ALSO CLASSIFIED AS HAZARDOUS AS DEFINED BY NEC 513. ALL ELECTRICAL
  INSTALLATIONS IN CLASSIFIED HAZARDOUS LOCATIONS SHALL BE AVOIDED UNLESS SPECIFICALLY
  APPROVED FOR SUCH LOCATIONS AND INSTALLED IN CONFORMANCE WITH NEC 500, 501, AND 513 AS WELL AS ANY OTHER APPLICABLE CODES AND REQUIREMENTS.
- ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.
- GRSC DENOTES GALVANIZED RIGID STEEL CONDUIT.
- WORK SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER ITEM AS109200.
- FURNISH & INSTALL A WEATHERPROOF WARNING LABEL FOR EACH PANELBOARD & LOAD CENTER (NEW & EXISTING), LOCATED IN THE FBO HANGAR, TO WARN PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS, PER THE REQUIREMENTS OF NEC 110,16 "FLASH PROTECTION". LABELS SHALL BE HAZARD COMMUNICATION SYSTEMS, LLC (190 OLD MILFORD RD., P.O. BOX 1174, MILFORD, PA 18337, PHONE: 1-877-748-0244) PART NO. H6010-9VWHBJ OR APPROVED EQUAL.


MV054

HANSON

RUNWAY 15-33 P.F.C. OVERLAY NEW ELECTRICAL ONE LINE DIAGRAM FOR FBO HANGAR

21 of 29 sheets

(E-4)

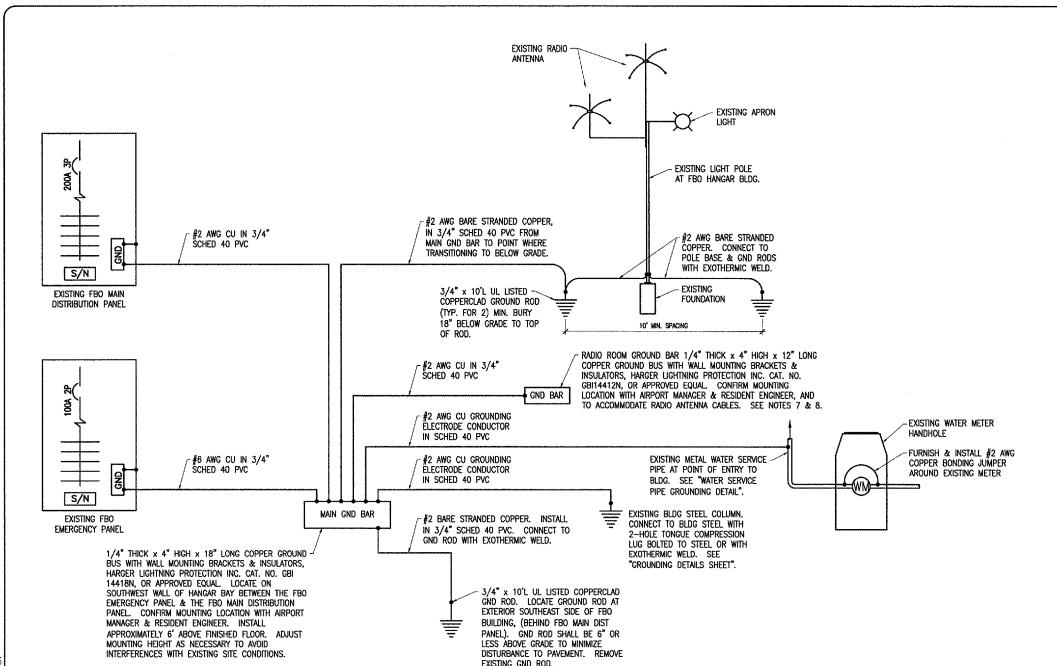

FBO HANGAR GROUND RISER

WORK SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 1

#### NOTES

- CONTRACTOR SHALL FIELD VERIFY EXISTING SITE CONDITIONS, EXISTING EQUIPMENT LOCATIONS, AND CONDUIT & GROUND WIRE ROUTING.
- ALL CONNECTIONS TO GROUND BUS BARS SHALL BE WITH 2 HOLE TONGUE LONG BARREL COMPRESSION LUGS BOLTED TO THE BUS BAR. ALL GROUND CONDUCTORS, TERMINATED ON THE MAIN GROUND BAR, SHALL BE CLEARLY LABELED WITH PERMANENTLY STAMPED/ENGRAVED FIBER IDENTIFICATION TAGS TO INDICATE THEIR FUNCTION AND FAR END TERMINATING POINT AND SHALL BE EQUIPPED WITH BRASS TAGS WITH THE WORDS "DO NOT DISCONNECT" EMBOSSED.
- GROUNDING ELECTRODE CONDUCTORS, BONDING JUMPERS, & INDIVIDUAL GROUND WIRES SHALL NOT BE INSTALLED IN METAL CONDUIT.
- ALL CONNECTIONS SHALL BE COATED WITH A CORROSION PREVENTATIVE COMPOUND (SANCHEM INC. NO-OX-ID "A-SPECIAL" OR EQUAL) BEFORE JOINING. ALL COPPER BUS BARS SHALL BE CLEANED PRIOR TO MAKING CONNECTION TO REMOVE SURFACE OXIDATION. CLEAN SURFACES, OF RESPECTIVE DEVICES TO BE BONDED, TO BARE METAL, PER NEC
- 5, ALL CONNECTIONS TO GND RODS AND/OR BELOW GRADE SHALL BE EXOTHERMIC WELD, CADWELD, THERMOWELD, OR ULTRAWELD,
- INSULATED GROUND WIRES SHALL HAVE GREEN COLORED INSULATION, FOR ALL CONDUCTOR AWG.
- FURNISH & INSTALL COAXIAL IMPULSE SUPPRESSOR/ARRESTOR FOR THE UNICOM RADIO (123.00 MHZ) ANTENNA CABLE. LOCATE AT THE RADIO. COAXIAL IMPULSE SUPPRESSOR SHALL BE INDUSTRIAL COMMUNICATION ENGINEERS, LTD. MODEL 304/N OR APPROVED EQUAL. MOUNT/BOND TO RADIO ROOM GROUND BAR. INSTALL PER MFR. DIRECTIONS. GROUND SHIELD OF COAXIAL CABLE TO GROUND TERMINALS ON
- 8. FURNISH & INSTALL COAXIAL IMPULSE SUPPRESSOR/ARRESTOR FOR THE KANSAS CITY CENTER RADIO MONITOR (127.7 MHz) ANTENNA CABLE. LOCATE AT THE RADIO. COAXIAL IMPULSE SUPPRESSOR SHALL BE INDUSTRIAL COMMUNICATION ENGINEERS, LTD. MODEL 304/N OR APPROVED EQUAL. MOUNT/BOND TO RADIO ROOM GROUND BAR. INSTALL PER MFR. DIRECTIONS. GROUND SHIELD OF COAXIAL CABLE TO GROUND TERMINALS ON SUPPRESSOR.
- REMOVE ABANDONED ANTENNAS & ASSOCIATED CABLE MOUNTED ON THE LIGHT POLE. CONFIRM ABANDONED ANTENNAS WITH AIRPORT MANAGER
- UPON COMPLETION OF INSTALLATION OF NEW GROUND RODS AT THE APRON LIGHT POLE, REMOVE THE EXISTING GND ROD.
- 11. WORK SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER ITEM

MV054


AIRPOR

HANSON

RUNWAY 15-33 P.F.C. OVERLAY

22 of 29 sheets


(E-5)

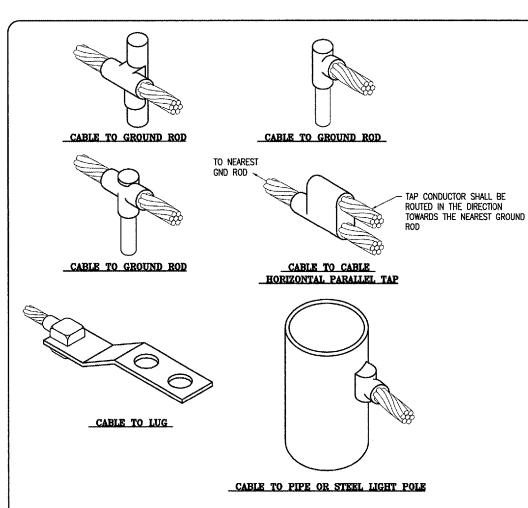

#### DETAIL NOTES

- 1. EXOTHERMIC WELDS SHALL BE CADWELD AS MANUFACTURED BY ERICO PRODUCTS, SOLON, OHIO, ULTRAWELD AS MANUFACTURED BY HARGER LIGHTNING PROTECTION & GROUNDING EQUIPMENT, GRAYSLAKE, IL, OR THERMOWELD AS MANUFACTURED BY CONTINENTAL INDUSTRIES, TULSA, OKLAHOMA. VERIFY PROPER SIZES, MOLDS, TYPES, AND REQUIREMENTS FOR THE RESPECTIVE APPLICATION WITH THE MANUFACTURER, AND INSTALL PER THEIR DIRECTIONS.
- FOR APPLICATIONS TO GALVANIZED STEEL OR PAINTED STEEL, REMOVE GALVANIZING AND/OR PAINT & CLEAN THE SURFACE TO EXPOSE BARE STEEL BEFORE MAKING EXOTHERMIC WELD CONNECTION.
- INDIVIDUAL GROUNDING ELECTRODE CONDUCTORS SHALL NOT BE INSTALLED IN METAL CONDUIT. INSTALL GROUNDING ELECTRODE CONDUCTORS IN SCHED 40 PVC CONDUIT AS REQUIRED IN FOUNDATIONS, FOR PROTECTION, WHERE ENTERING ENCLOSURES, ETC.

# EXOTHERMIC WELD DETAILS

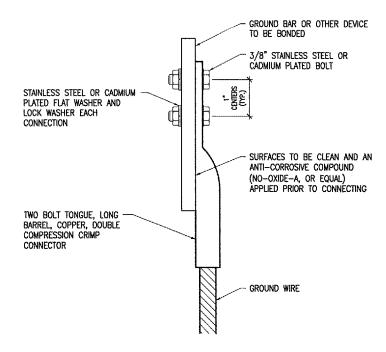


2 HOLE LONG BARREL COMPRESSION LUG TABLE		
WIRE SIZE	BURNDY CAT. NO.	THOMAS & BETTS CAT. NO.
#6 AWG STRANDED	YA6C-2TC38	256-30695-1158
#2 AWG STRANDED	YA2C-2TC38	256-30695-1160
#1/0 AWG STRANDED	YA25~2TC38	256-30695-1162
#2/0 AWG STRANDED	YA26-2TC38	256-30695-1116
#3/0 AWG STRANDED	YA27-2TC38	54816BE

#### NOTES

- ALL CONNECTIONS TO GROUND BUS BAR SHALL BE WITH 2 HOLE TONGUE LONG BARREL COMPRESSION LUGS BOLTED TO THE BUS BAR.
- GROUND WIRE CONNECTIONS TO EQUIPMENT SHALL BE WITH 2 HOLE TONGUE, LONG BARREL COMPRESSION LUGS BOLTED TO THE DEVICE OR WITH THE RESPECTIVE EQUIPMENT MANUFACTURER'S LUG OR TERMINAL WHERE APPLICABLE.
- 3. GROUNDING ELECTRODE CONDUCTORS, BONDING JUMPERS, & INDIVIDUAL GROUND WIRES SHALL NOT BE INSTALLED IN METAL CONDUIT.
- 4. ALL CONNECTIONS SHALL BE COATED WITH A CORROSION PREVENTATIVE COMPOUND (SANCHEM INC. NO-OX-ID "A-SPECIAL" OR APPROVED EQUAL) BEFORE JOINING. ALL COPPER BUS BARS SHALL BE CLEANED PRIOR TO MAKING CONNECTIONS TO REMOVE SURFACE OXIDATION. CLEAN SURFACES, OF RESPECTIVE DEVICES TO BE BONDED, TO BARE METAL, PER NEC 250-12.

# GROUNDING LUG CONNECTION DETAIL

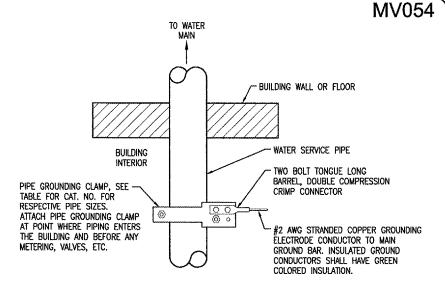

PIPE GROUNDING CLAMP TABLE		
BURNDY CAT. NO.	PIPE SIZE	
GAR3902TC	1/2" - 1"	
GAR3903TC	1 1/4" - 2"	
GAR3904TC	2 1/2" - 3 1/2"	
GAR3905TC	4" - 5"	
GAR3906TC	6"	
GAR3907TC	8*	
GAR3908TC	10"	
GAR3909TC	12"	

#### NOTES


- 1. PROVIDE PIPE GROUNDING CLAMPS AT BOTH SIDES OF WATER METER WITH #2 AWG COPPER BONDING JUMPER ACROSS THE METER.
- FOR DAMP OR WET LOCATIONS USE PIPE CLAMPS WITH ALL BRONZE HARDWARF.


WATER SERVICE PIPE GROUNDING DETAIL

WORK & DETAILS SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 1 & BID ALTERNATE NO. 2 GROUNDING DETAILS

HANSON

RUNWAY 15-33 P.F.C. OVERLAY

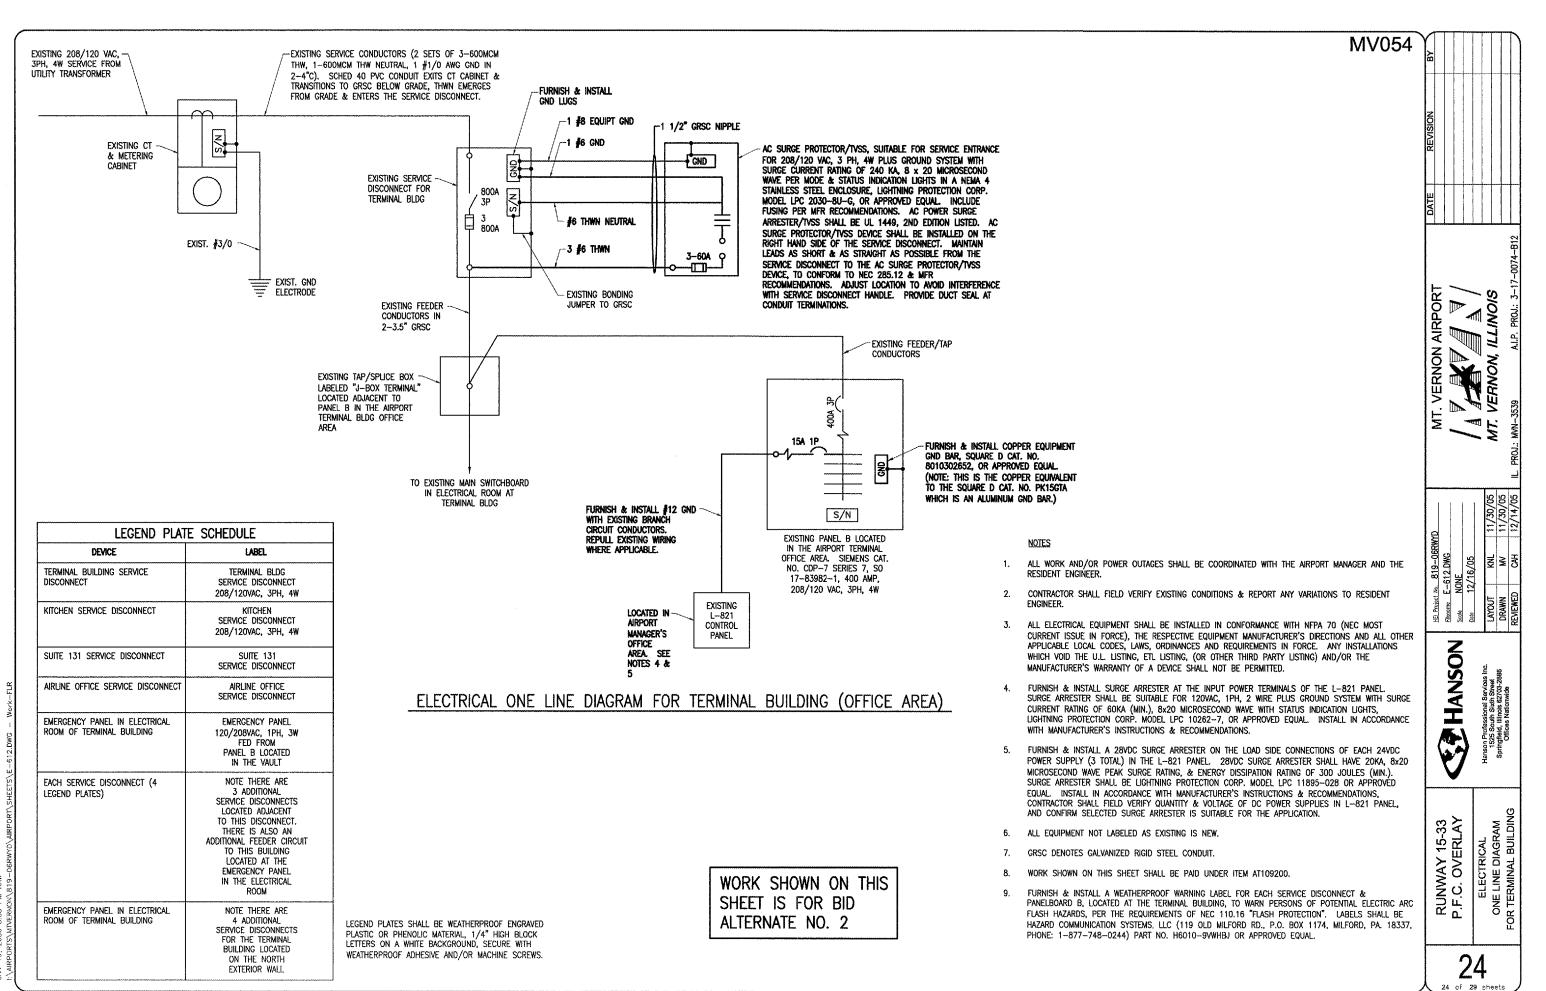




HANSON

RUNWAY 15-33 P.F.C. OVERLAY

25

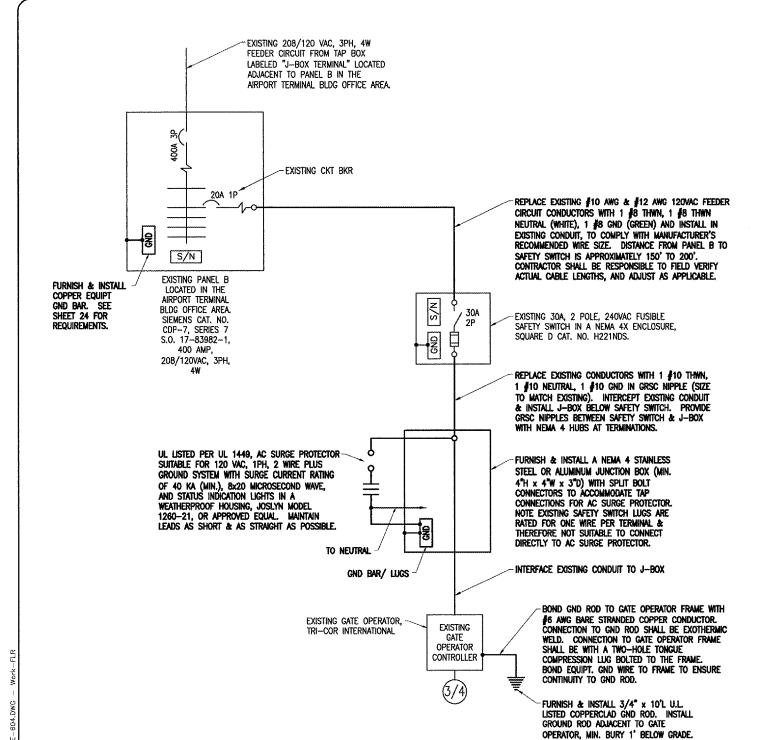


#### ELECTRICAL NOTES

- 1. ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 (MOST CURRENT ISSUE IN FORCE), THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL. LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- CONTRACTOR SHALL COORDINATE NEW WORK AND ANY POWER OUTAGES TO EXISTING EQUIPMENT WITH THE RESPECTIVE USER PERSONNEL & THE AIRPORT MANAGER.
- ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.
- PROVIDE A WEATHERPROOF ENGRAVED PHENOLIC OR PLASTIC LEGEND PLATE FOR THE SAFETY SWITCH AT THE RESPECTIVE GATE OPERATOR LABELED "GATE NO. 1, 120 VAC, FED FROM TERM
- FURNISH AND INSTALL A #12 AWG EQUIPMENT GROUND WIRE FROM THE GATE OPERATOR TO THE CARD READER UNIT IN THE EXISTING CONTROL WIRING CONDUIT.
- CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.
- WORK SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER ITEM AT109200.

WORK SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 2

GATE NO. 1 ELECTRICAL ONE LINE


26 of 29 sheets

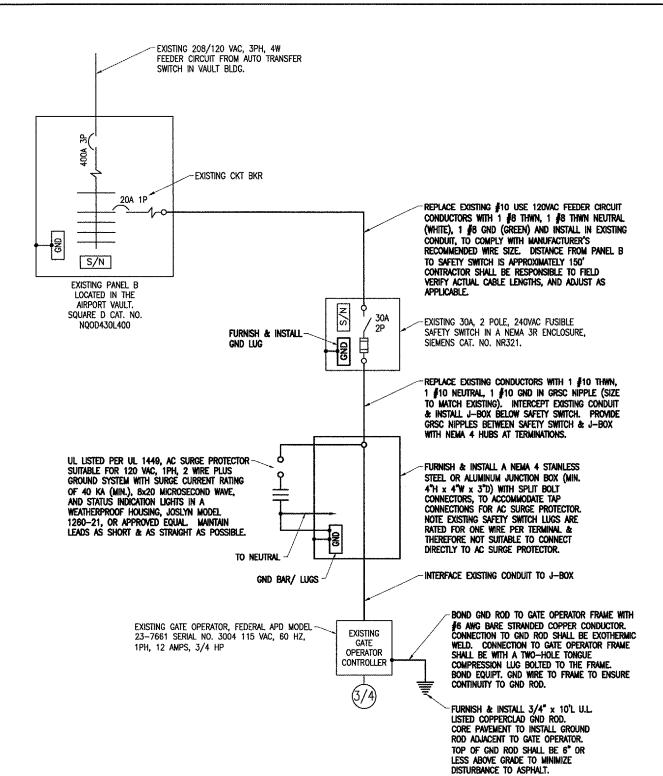

#### **ELECTRICAL NOTES**

- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 (MOST CURRENT ISSUE IN FORCE), THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL. LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- CONTRACTOR SHALL COORDINATE NEW WORK AND ANY POWER OUTAGES TO EXISTING EQUIPMENT WITH THE RESPECTIVE USER PERSONNEL & THE AIRPORT MANAGER.
- ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.
- PROVIDE A WEATHERPROOF ENGRAVED PHENOLIC OR PLASTIC LEGEND PLATE FOR THE SAFETY SWITCH AT THE RESPECTIVE GATE OPERATOR LABELED "GATE NO. 2, 120 VAC, FED FROM VAULT
- FURNISH AND INSTALL A #12 AWG EQUIPMENT GROUND WIRE FROM THE GATE OPERATOR TO THE CARD READER UNIT IN THE EXISTING CONTROL WIRING CONDUIT.
- CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.
- WORK SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER ITEM AT109200.

WORK SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 2

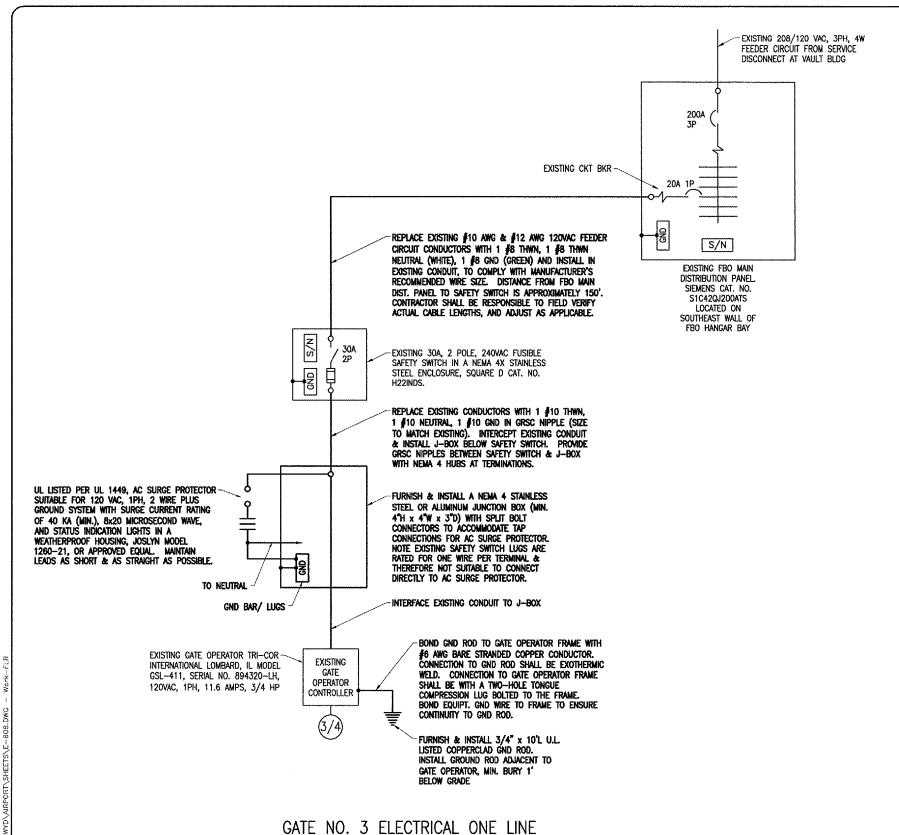

MV054

#### ELECTRICAL NOTES

- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 (MOST CURRENT ISSUE IN FORCE), THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL. LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- CONTRACTOR SHALL COORDINATE NEW WORK AND ANY POWER OUTAGES TO EXISTING EQUIPMENT WITH THE RESPECTIVE USER PERSONNEL & THE AIRPORT MANAGER.
- ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.
- PROVIDE A WEATHERPROOF ENGRAVED PHENOLIC OR PLASTIC LEGEND PLATE FOR THE SAFETY SWITCH AT THE RESPECTIVE GATE OPERATOR LABELED "GATE NO. 3, 120 VAC, FED FROM FBO MOP".
- FURNISH AND INSTALL A #12 AWG EQUIPMENT GROUND WIRE FROM THE GATE OPERATOR TO THE CARD READER UNIT IN THE EXISTING CONTROL WIRING CONDUIT.
- CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.
- WORK SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER ITEM AT109200.


WORK SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 2

HANSON


RUNWAY 15-33 P.F.C. OVERLAY

27 of 29 sheets

(E-10)

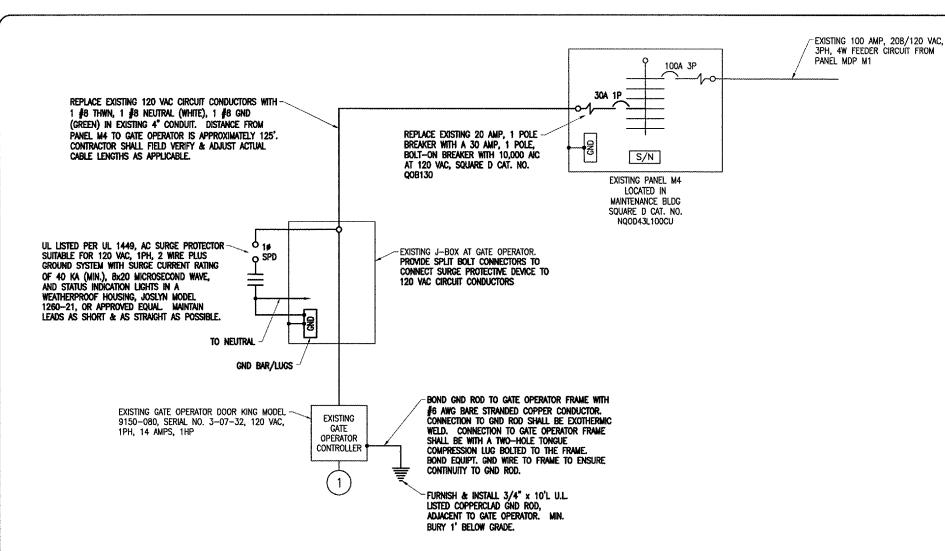

# GATE NO. 7 ELECTRICAL ONE LINE

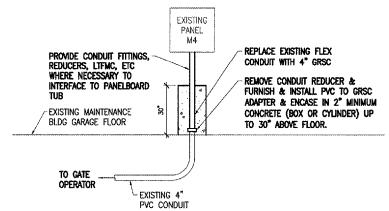

# PANEL M4 & GATE NO. 7 CONDUIT ELEVATION DETAIL

REQUIRED TO COMPLY WITH NEC 511.4 & NEC 501.5(A)(4) EXCEPTION NO. 1. ALSO SEE NEC 230.6(2).

MV054

#### ELECTRICAL NOTES

- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 (MOST CURRENT ISSUE IN FORCE), THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL. LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- CONTRACTOR SHALL COORDINATE NEW WORK AND ANY POWER OUTAGES TO EXISTING EQUIPMENT WITH THE RESPECTIVE USER PERSONNEL & THE AIRPORT MANAGER.
- ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.
- PROVIDE A WEATHERPROOF ENGRAVED PHENOLIC OR PLASTIC LEGEND PLATE FOR THE SAFETY SWITCH AT THE RESPECTIVE GATE OPERATOR LABELED "GATE NO. 7, 120 VAC, FED FROM PANEL M4".
- FURNISH AND INSTALL A LOW VOLTAGE LINE PROTECTOR FOR THE EXISTING CARD READER UNIT. LOW VOLTAGE LINE PROTECTOR SHALL BE SUITABLE FOR USE ON THE RESPECTIVE CONTROL VOLTAGE SYSTEM USED IN THE CARD READER UNIT, AC OR DC PROTECTION MODES (AS APPLICABLE) ON ALL LINES WITH A SURGE CURRENT RATING OF 2000 AMPS (MINIMUM). LOW VOLTAGE LINE PROTECTOR FOR 12 VDC, 24 VDC, OR 24 VAC APPLICATIONS SHALL BE DITEK CORPORATION, MODEL DTK-4LVLP-CR, OR APPROVED EQUAL. LOCATE INSIDE GATE OPERATOR HOUSING.
- FURNISH AND INSTALL A #12 AWG EQUIPMENT GROUND WIRE FROM THE GATE OPERATOR TO THE CARD READER UNIT IN THE EXISTING CONTROL WIRING CONDUIT.
- CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.
- WORK SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER ITEM AT109200.

WORK SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 2


HANSON

RUNWAY 15-33 P.F.C. OVERLAY

28 28 of 29 sheet

(E-11)

NOTE: TRANSITION FROM PVC TO GRSC & 2" CONCRETE ENCASEMENT

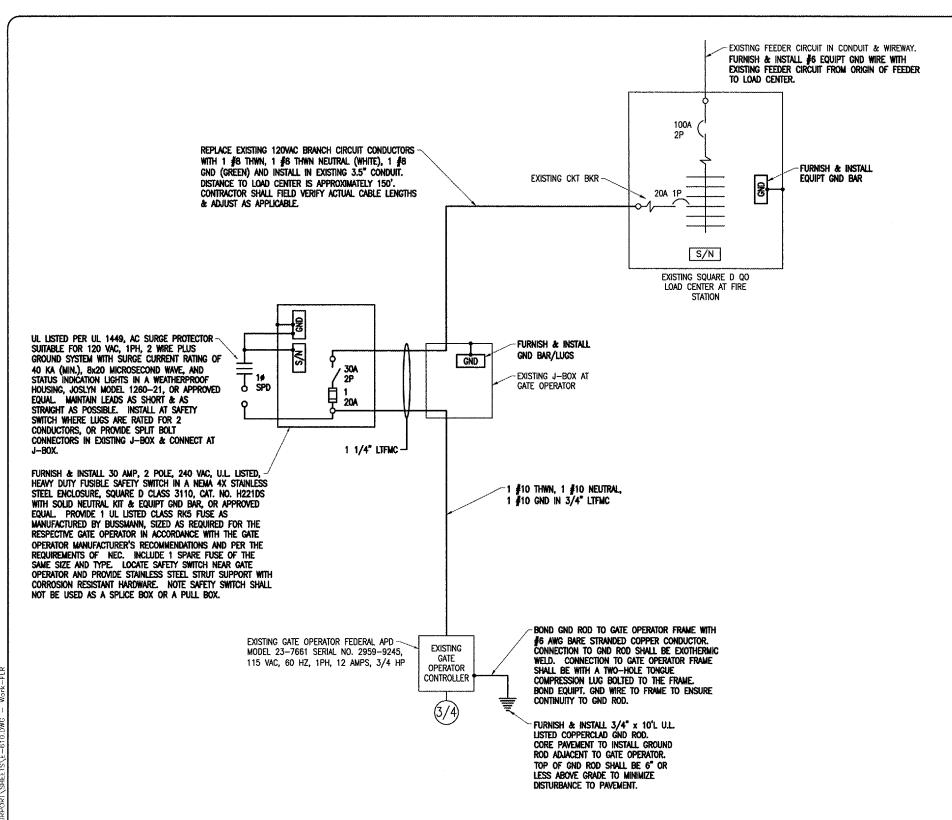

FIRE STATION GATE ELECTRICAL ONE LINE

MV054

#### ELECTRICAL NOTES

- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 (MOST CURRENT ISSUE IN FORCE), THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL. LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE SHALL NOT BE PERMITTED.
- CONTRACTOR SHALL COORDINATE NEW WORK AND ANY POWER OUTAGES TO EXISTING EQUIPMENT WITH THE RESPECTIVE USER PERSONNEL & THE AIRPORT MANAGER.
- ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.
- PROVIDE A WEATHERPROOF ENGRAVED PHENOLIC OR PLASTIC LEGEND PLATE FOR THE SAFETY SWITCH AT THE RESPECTIVE GATE OPERATOR LABELED "FIRE STATION GATE, 120 VAC, FED FROM FIRE STN
- FURNISH AND INSTALL A #12 AWG EQUIPMENT GROUND WIRE FROM THE GATE OPERATOR TO THE CARD READER UNIT IN THE EXISTING CONTROL WIRING CONDUIT.
- CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.
- EXISTING LIFMC (LIQUID TIGHT FLEXIBLE METAL CONDUIT) AT THE GATE OPERATOR IS IN POOR CONDITION. REPLACE ALL EXISTING LITTMC WITH NEW. LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE U.L. LISTED TO MEET THE REQUIREMENTS OF NEC 350.6 SUITABLE FOR GROUNDING AND SUNLIGHT RESISTANT. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO GATE OPERATORS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.60. DO NOT INSTALL LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS NOT UL LISTED.
- WORK SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER ITEM AT109200.

WORK SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 2

HANSON

RUNWAY 15-33 P.F.C. OVERLAY FIRE STATION GATE ELECTRICAL ONE LINE

29 of 29 sheets