
#86906

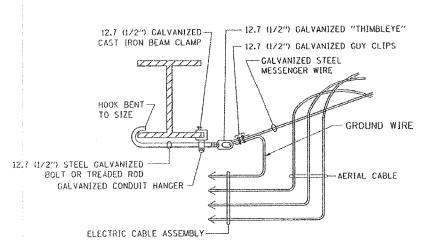


AERIAL CABLE

ATTACHED TO STRUCTURE

NOT TO SCALE

NOTES:

- 1. ALL DIMENSIONS IN MILLIMETERS (INCHES) UNLESS OTHERWISE INDICATED.
- 2. SEE PROPOSED LIGHTING PLAN FOR CONDUIT, CABLE AND ROUTING.
- 3. THE CONTRACTOR SHALL PROVIDE INTERMEDIATE SUPPORTS TO MAINTAIN MINIMUM CLEARANCES. REFER TO AERIAL AERIAL CABLE ATTACHED TO STRUCTURE DETAIL.
- 4. COST OF SPLICES AND MOUNTING HARDWARE SHALL BE INCLUDED IN THE UNIT PRICE FOR AERIAL CABLE.

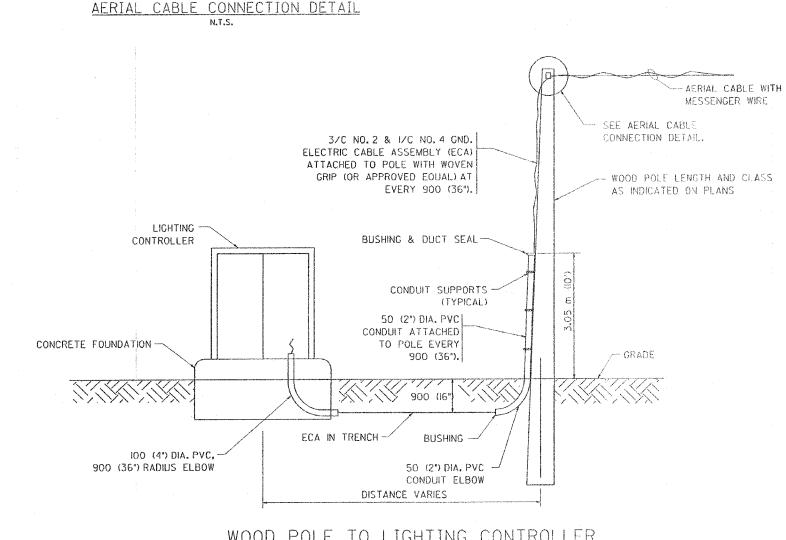

FORK BOLT GROUND CLAMP

PHASE CONDUCTORS & NEUTRAL CONDUCTOR

ELECTRICAL CABLE ASSEMBLY

(3/C NO. 2 & I/C NO. 4 GND)

ATTACHED TO WOOD POLE

MESSENGER TIED TO

FORMED CABLE TIE

INSULATOR WITH FACTORY

WOOD POLE TO LIGHTING CONTROLLER
WIRING CONNECTION DETAIL
N.T.S.

REVISIONS
NAME DATE

TEMPORARY AERIAL
CABLE INSTALLATION

SCALE: NONE DRAWN BY
DATE 05/21/2003 CHECKED BY

05/21/2003 KNdiststd\be80l.dgn WOOD POLE

WATERPROOF SPLICE --

GROUND CONDUCTOR

GRIP OR APPROVED EQUAL)

AT EVERY SOOMM

(TYP.)

REVISION DATE:

BE-801