


TRIMMED CABLES HEAT SHRINKABLE CAP WITH
FACTORY APPLIED WATERPROOF
SEALANT. (SIZED TO
ACCOMODATE NUMBER OF CABLES). SEALANT TAPE OR INSERT. (AROUND AND THROUGH CROTCH OF SPLICE). ELECTRIC FEEDER CABLES, (SIZE AS NOTED ON CONTRACT DRAWINGS). NOTE: NUMBER OF CABLES IN SPLICE MAY VARY - EXPOSED SEALANT - ELECTRICAL CABLE TO LUMINAIRE (SIZE AS NOTED ELSEWHERE IN THESE PLANS).

## SPLICING ELECTRICAL CABLES **BASIC MATERIALS AND METHODS** NO SCALE


-GROUND LUG

-UNIT

LUMINAIRE

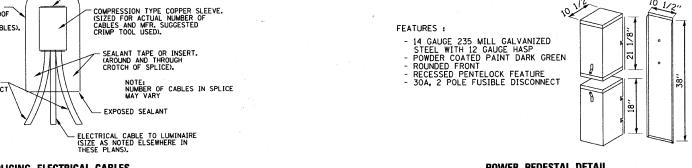

POWER PEDESTAL DETAIL NO SCALE

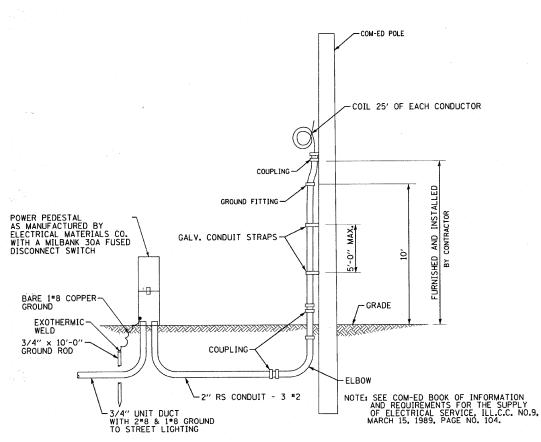

## COM-ED OVERHEAD CONNECTION WHERE REQUIRED

NO SCALE

REVISED - 12-01-10 IDOT REVIEW DESIGNED - MWH DRAWN CJC REVISED CHECKED MDK REVISED 10-01-10 FILE - 041180-SL-DETAILS.sht

CITY OF COUNTRY CLUB HILLS, ILLINOIS GLEN OAKS DRIVE INFRASTRUCTURE IMPROVEMENTS

POLE WIRING DETAIL

TOTAL SHEE SHEETS NO. SECTION COUNTY LIGHTING DETAILS 04-00027-03-PV соок CONTRACT NO. 63539 SCALE: NONE STA. TO STA. FED. ROAD DIST. NO. | ILLINOIS | FED. AID PROJECT HPD-897(008)