
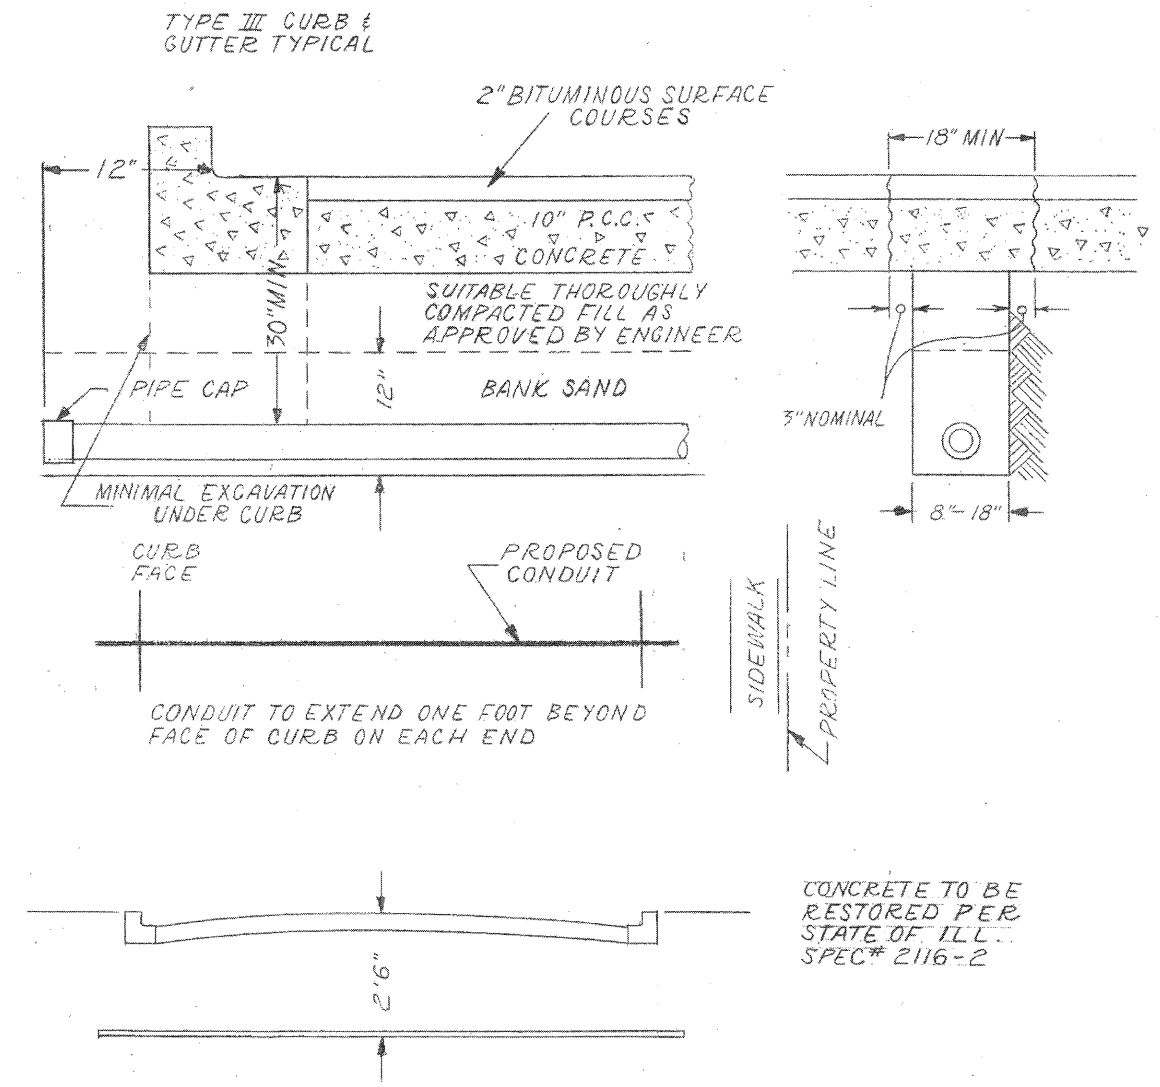


CONDUIT INSTALLATION UNDER PAVED STREET

NOTE: TERMINATE ALL METALLIC CONDUIT WITH GROUNDING BUSHING & GROUND TO GROUND ROD WHEN METALLIC CONDUIT IS USED DELETE GROUNDING CONDUCTOR

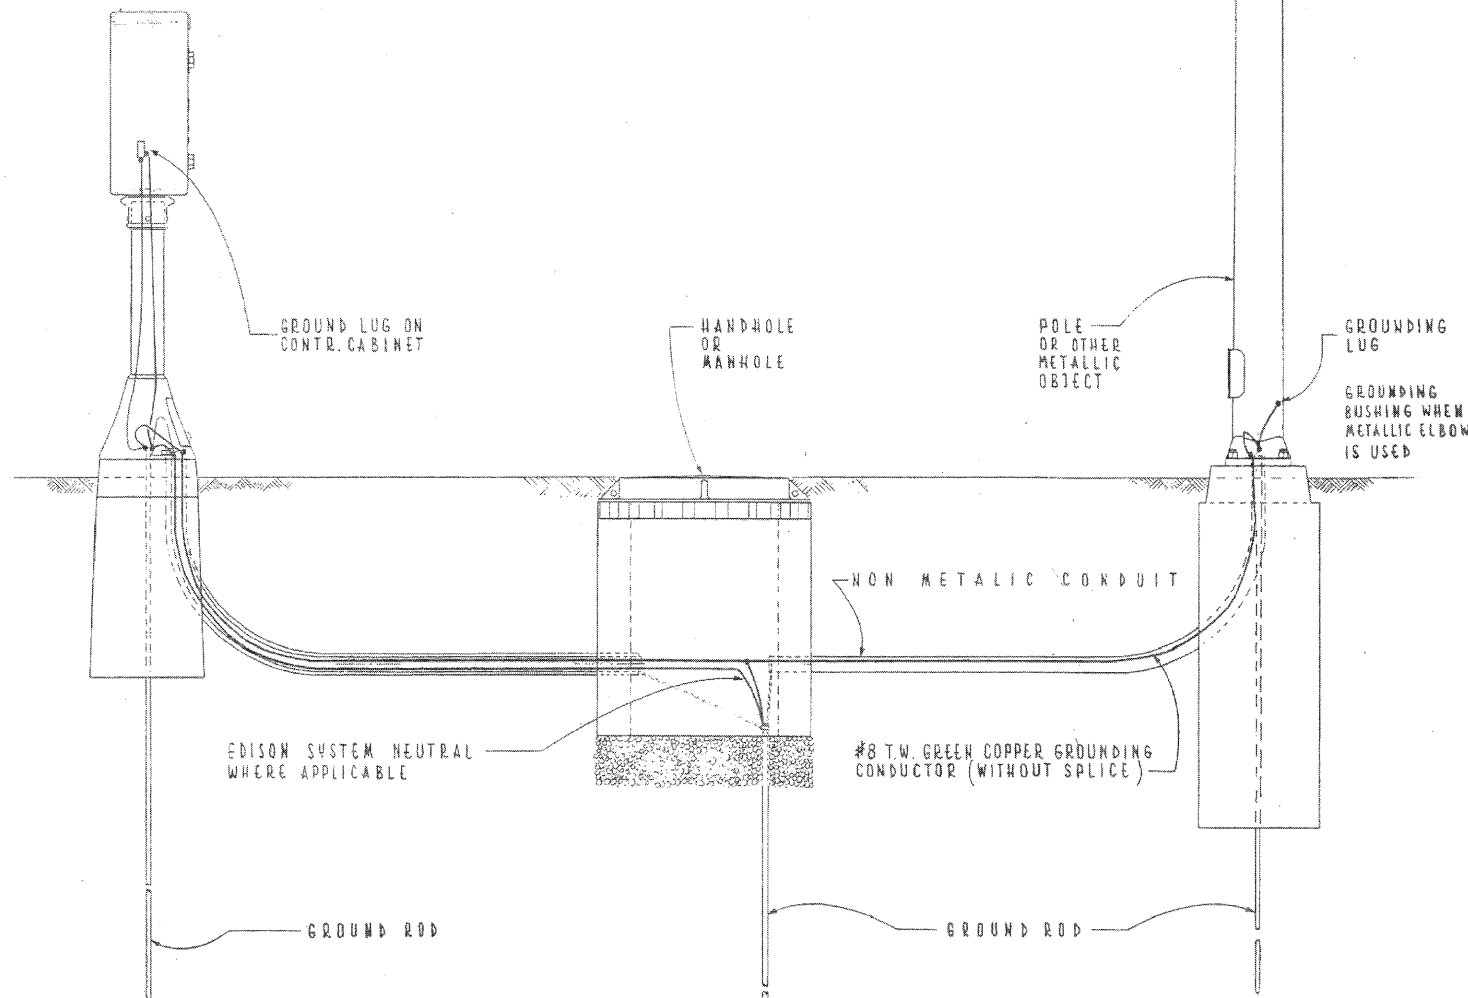

CONCRETE TO BE RESTORED PER STATE OF ILL. SPEC# 2116-2

TYPICAL GROUNDING METHODS FOR BUREAU OF ELECTRICITY EQUIPMENT

CITY OF CHICAGO DEPT. OF STREETS & SANITATION BUREAU OF ELECTRICITY DIVISION OF ELEC. ENGINEERING			
REVISED	DRAWN E. GERULIS	CHECKED M. SHINE	ENGINEER J. O'CONNOR
A	ENG. OF ELEC.		DWG. NO.
B	SUPT. OF CONST.		736
D	DEPT. OF CONST.		
E			
F	SIZE: 8 1/2" x 14"	SCALE: 1" = 10'	DATE: 5-12-76

INSTALLATION METHOD OF INSTALLING CONDUIT UNDER PAVED ROADWAY		
CITY OF CHICAGO DEPT. OF STREETS AND SANITATION BUREAU OF ELECTRICITY DIVISION OF ELECTRICAL ENGINEERING		
DRAWN A.M. JOHNSON	CHECKED R. SYCKOWSKI	ENGINEER R.L. MARTIN
		DWG. NO. 813
		DATE 5-13-81
SIZE 8 1/2" x 14"	SCALE N.T.S.	DATE 5-13-81