STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION

ROUTE NO. COUNTY TOTAL SHEETS SHEET NO. SECTION FAI 74 ROCK ISLAND 246 207

SHEET NO. 9 12 SHEETS


* 81 (1-2, 1, 2-2) RS-1 & M

The strip seal shall be made continuous and shall have a minimum thickness of \(\frac{1}{4} \). The configuration of the strip seal shall match the configuration of the Locking Edge Rails. Open or "webbed" strip seal gland configurations are not permitted. The gland shall be sized for a maximum rated movement of 4 inches.

The height and thickness of the Locking Edge Rails shown are minimum dimensions. The actual configuration of the Locking Edge Rails and matching strip seal may vary from manufacturer to manufacturer. Flanged edge rails will not be allowed. Locking Edge Rails may be spliced at slope discontinuities and stage construction joints.

The manufacturer's recommended installation methods shall be followed. The joint opening and deck dimensions detailed on the superstructure are based on a rolled rail expansion joint. If the Contractor elects to use the welded rail expansion joint, the opening and deck dimensions shall be modified according to the dimensions detailed on this sheet. Required modifications shall be made at no additional cost to the State.

All steel components shall be galvanized after fabrication according to Article 520.03 of the Standard Specifications.

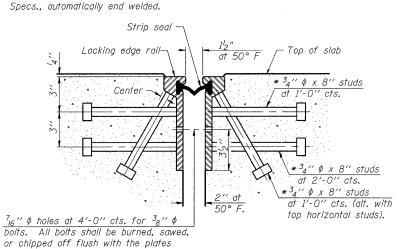

$\frac{1'_2"}{at 50^{\circ} F}$ \int Top of slab Locking edge rail-at 2'-0" cts. Anchor plate Place plates at 1'-0" cts. 7 ₁₆ " ϕ holes at 4'-0" cts. for 3 ₈" ϕ (alt. with top horizontal studs) bolts. All bolts shall be burned, sawed, or chipped off flush with the plates


SECTION THRU


WELDED RAIL JOINT

Strip seal-

after forms are removed, typ.

SECTION THRU ROLLED RAIL JOINT






(for welded rail,

ANCHOR P

Top of locking edge rail Top of deck

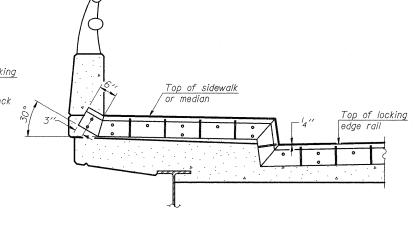

AT PARAPET

AT SIDEWALK OR MEDIAN

Shorter plates with a single row of studs at 12" cts. may be necessary on medians which are shallower than 9". See manufacturer's recommendation.

ROLLED EXTRUDED RAIL

* Granular or solid flux filled headed studs conforming to Article 1006.32 of the Std.

after forms are removed, typ.

WELDED RAIL


LOCKING EDGE RAIL SPLICE


complete joint penetration


is verified by mock-up.

The inside of the locking edge rail groove shall be free of weld residue.

LOCKING EDGE RAILS





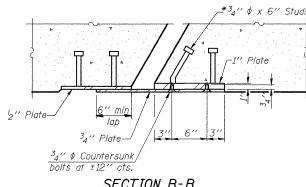

TYPICAL END TREATMENTS

SECTION B-B

BILL OF MATERIAL

Item	Unit	Total
Preformed Joint Strip Seal	Foot	123

DESIGNED DFM CHECKED DSG DRAWN EBS CHECKED DFM

PLAN

SECTION A-A

POINT BLOCK DETAILS (for skews > 30°)

EXPANSION JOINT DETAILS N.B. 27TH ST. OVER F.A.I. 74 ROCK ISLAND COUNTY STRUCTURE NO. 081-0108

EJ-SSJ

10-1-08