

### STANDARD BAR SPLICER ASSEMBLY

Minimum Lap Lengths							
Bar size to be spliced	Table 1	Table 2	Table 3	Table 4			
3, 4	1'-5''	1'-11''	2'-1"	2'-4"			
5	1'-9''	2'-5''	2'-7"	2'-11''			
6	2'-1''	2'-11''	3'-1''	3′-6′′			
7	2'-9''	3'-10''	4'-2"	4'-8''			
8	3'-8''	5'-1''	5'-5''	6'-2''			
9	4'-7''	6′-5″	6'-10''	7'-9"			

Table 1: Black bar, 0.8 Class C

Table 2: Black bar, Top bar lap, 0.8 Class C


Table 3: Epoxy bar, 0.8 Class C

Table 4: Epoxy bar, Top bar lap, 0.8 Class C

Threaded splicer bar length = min. lap length +  $I_2^{l}{}^{\prime\prime}$  + thread length


\* Epoxy not required on Bar Splicer Assembly components used in conjunction with black bars.

Location	Bar		Table for minimum
LOCUITOIT	size	required	lap length
Deck	#5	16	. 3
Backwall	#6	6	3

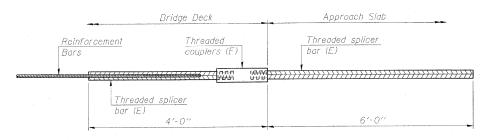


# BAR SPLICER ASSEMBLY FOR #5 BAR ON INTEGRAL OR SEMI-INTEGRAL ABUTMENTS

No. required =




# STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION

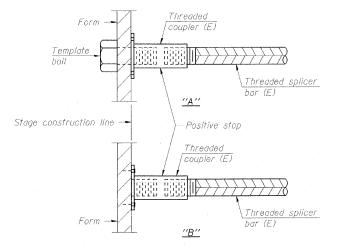


#### INSTALLATION AND SETTING METHODS

"A": Set bar splicer assembly by means of a template boll.
"B": Set bar splicer assembly by nalling to wood forms or cementing to steel forms.

(E): Indicates epoxy coating.

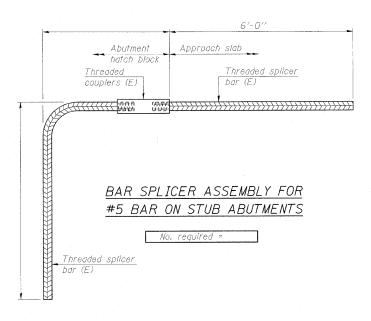



#### STANDARD MECHANICAL SPLICER

Location	Bar size	No. assemblies required
AM		

#### <u>NOTES</u>

Splicer bars shall be deformed with threaded ends and have a minimum 60 ksi yield strength.

All reinforcement shall be lapped and tied to the splicer bars.

Bar splicer assemblies shall be epoxy coafed according to the requirements for reinforcement bars. See Section 508 of the Standard Specifications. See special provision for Mechanical Splicers.

See approved list of bar splicer assemblies and mechanical splicers for alternatives.

## BAR SPLICER ASSEMBLY AND MECHANICAL SPLICER DETAILS STRUCTURE NO. 016-0573

SHEET NO. S8	F.A.U RTE.	SECTION		COUNTY	TOTAL SHEETS	SHEET NO.
OF	1620	20 43I-1		COOK	16	12
S10 SHEETS				CONTRACT	NO. 6	0J82
	ILLINOIS FED. AID PROJECT					