BAR LIST - EACH FOUNDATION

Bar	Number	Size	Length	Shape
V4(E)	24	#9	F less 5"	
#4 bo	ar spiral (E) - see	Side Elevatio	าก

NOTES

The foundation dimensions shown are based on the presence of mostly cohesive soils with an average Unconfined Compressive Strength (Qu) of at least 1.25 tsf, which must be determined by previous soil investigations at the jobsite. When other conditions are indicated, the boring data will be included in the plans and the foundation dimensions shown will be the result of site specific designs.


If the conditions encountered are different than those indicated, the Contractor shall notify the Engineer to determine if the foundation dimensions need to be modified. If dimensions "B" or "F" are revised by more than 12" by the Contractor, "as-built" plans shall be prepared and submitted to the District Bureau of Operations for future reference.

No sonotubes or decomposable forms shall be used below the lower conduit entrance. Permanent metal forms or other shielding may not be left in place below that elevation without the Engineer's written permission.


Concrete shall be placed monolithically, without construction joints.

Backfill shall be placed per Article 502 of Standard Specification and prior to erection of support column.

A normal surface finish followed by a Bridge Seat Sealer application will be required on concrete surfaces above the lowest elevation 6" below finished ground line. Cost included in Drilled Shaft Concrete Foundation.



DETAILS FOR 12" ¢ SUPPORT FRAME TYPE III-A TRUSS

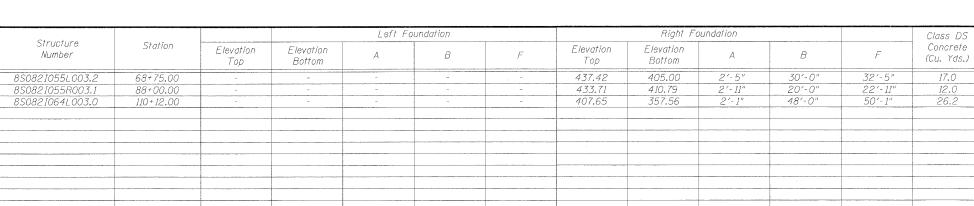

0S4-F4

12-#9 v4(E) bars-

3 hoops minimum top and bottom

7-1-10

	USER NAME =	DESIGNED - PMK	REVISED -
		CHECKED - MPW	REVISED -
	PLOT SCALE =	DRAWN - PMK	REVISED -
	PLOT DATE. =	CHECKED - MPW	REVISED -

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

OVERHEAD SIGN STRUCTURES
DRILLED SHAFT DETAILS

SHEET NO. 15 OF 17 SHEETS

12'-0"

12'-0"

1'-6"

9"

9"

9"

9"

9"

PLAN

SIDE ELEVATION

9'-0" & to &

Approved clamps for grounding*

#6 copper wire or cable

3'-0" ¢

3₄" ♦ x 10'-0" copper weld ground rod driven into groun 9'-0". Cost of rod, cable, conduit, caps and clamps shall be included in Drilled Shaft Concrete Foundations.

For anchor rod size and placement, see Support Frame Detail Sheet.

END VIEW

3'' ∮ Galvanized Steel

Conduit. Thread

and cap both ends.

* Anchor rod shall be ground or filed to bright metal at clamp and cable connection location.