
62583

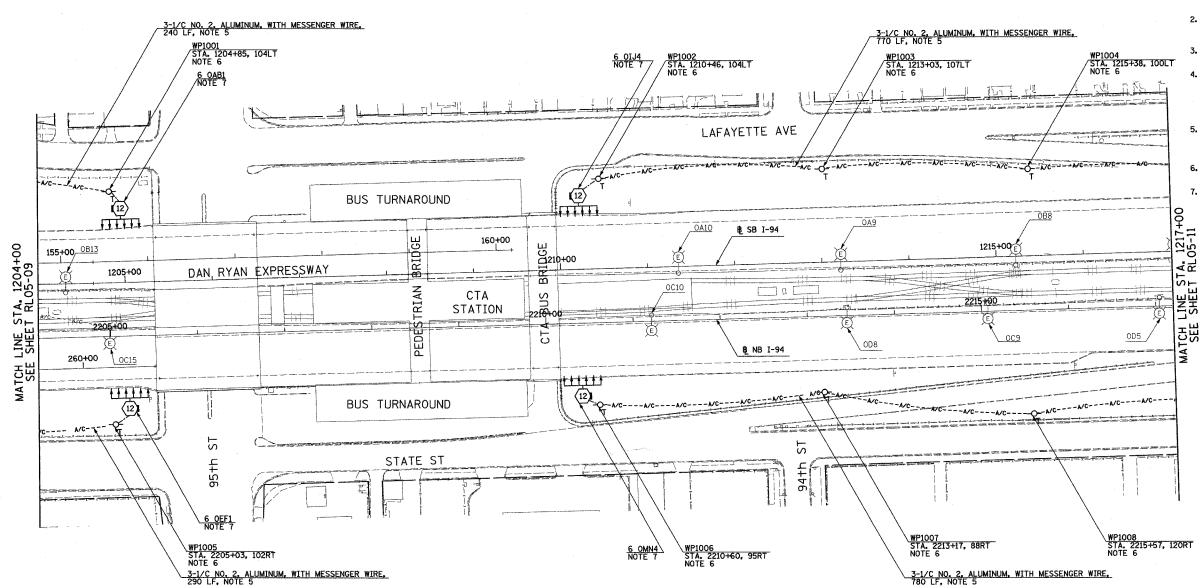

NOTES

- 1. SEE DRAWINGS ME-01 AND ME-02 FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS.
- 2. UNLESS NOTED OTHERWISE, ALL ITEMS AND WORK SHOWN IN HEAVY LINE WEIGHT ON THIS DRAWING ARE PROPOSED NEW ITEMS OF WORK.
- SEE SHEET ES-01 AND ES-02 FOR HIGH MAST LIGHT TOWER SCHEDULE.
- 4. THE EXISTING ROADWAY LIGHTING SYSTEM SHALL REMAIN IN OPERATION UNTIL THE PROPOSED ROADWAY LIGHTING SYSTEM HAS BEEN INSTALLED, ENERGIZED, TESTED, AND ACCEPTED BY THE ENGINEER, UNLESS OTHERWISE DIRECTED BY THE ENGINEER,
- 5. AERIAL CABLE AND TEMPORARY WOOD POLES SHALL BE REMOVED AFTER HIGH MAST LIGHT TOWERS ARE PERMANENTLY WIRED AND ACCEPTED BY THE ENGINEER.
- 6. TEMPORARY WOOD POLES SHALL BE INSERTED IN GROUND TO ACCOMMODATE PROPOSED GRADING.
- REFER SHEET ME-25 FOR TEMPORARY WIRING TO TOWER DETAIL.

0 50' 100' 1" = 50'

RL05-10

REVISIONS		ILLINOIS DEPARTMENT OF TRANSPORTATION					
NAME	DATE						
		F.A.I.	90/94	(DAN	RYAN	EXPRES	SSWAY
		31st STREET TO I-57					
		ROADWAY LIGHTING PLANS PROPOSED IMPROVEMENTS 2005					
			PROPOSE	D IMPI	KUVEMEI	NIS 2005	,
		ľ					

- SCALE: 1"=50" DATE: OCTOBER 29, 2004 DRAWN BY: VRK
CHECKED BY: TM

SINGH CHICAGO, IL 60606
SINGH & ASSOCIATES, INC.
CONSULTING ENGINEERS

TAX: (312) 629-0240
FAX: (312) 629-8449