


ALTERNATE MATERIALS FOR WALLS	T
PRECAST REINFORCED CONCRETE RISERS	4"
CONCRETE MASONRY UNIT	5"
MONOLITHIC CONCRETE	6"
BUILDING BRICK, GRADE SW FROM CLAY OR SHALE	8"
CONCRETE BUILDING BRICK, GRADE A	8"


NOTES

- 1. THE CONTRACT UNIT PRICE FOR FIELD TILE JUNCTION VAULT SHALL INCLUDE THE COST OF FURNISHING AND PLACING THE FRAME AND GRATE OR PRECAST CONCRETE LID AND WHEN REQUIRED, THE SAND CUSHION.
- 2. ALL FIELD TILE JUNCTION VAULTS SHALL BE 2'-0" IN DIAMETER UNLESS OTHERWISE NOTED ON THE PLANS.





± 145#



ILLINOIS DEPARTMENT OF TRANSPORTATION FIELD TILE **DETAILS**


> SCALE: VERT. HORIZ. DATE

DRAWN BY CHECKED BY

STORM SEWER, PROTECTED

DETAIL A

- *IF A 4" COVER CAN NOT BE PROVIDED A PAVED DITCH SHALL BE CONSTRUCTED AS SHOWN IN DETAIL C.
- 1. WIDTH OF CONCRETE SLAB SHALL BE THE SAME AS THE TRENCH WIDTH IN ACCORDANCE WITH SECTION 550 OF THE STD. SPECIFICATIONS, OR 3' MIN.
- 2. CONCRETE FOR SLAB, HEADWALL AND PAVED DITCH SHALL BE PAID FOR AT THE CONTRACT UNIT PRICE PER CUBIC YARD FOR MISCELLANEOUS CONCRETE."



STORM SEWER, PROTECTED

DETAIL C NO SCALE

PROPOSED

DITCH BOTTOM

- 3. COST OF FURNISHING AND INSTALLING WIRE MESH SHALL BE INCLUDED IN THE CONTRACT UNIT PRICE PER CUBIC YARD FOR MISCELLANEOUS CONCRETE. WIRE MESH TO WEIGH NOT LESS THAN 58# PER 100 SQ. FT.

FIELD TILE REPLACEMENT

FLOW

SEE DETAIL A

STORM SEWER, PROTECTED

EXISTING FIELD TILE TO BE CRUSHED OR REMOVED

LENGTH DETERMINED BY ENGINEER

CONCRETE SLAB/PAVED DITCH




CONCRETE HEADWALL (SEE DETAIL)

PIPE DRAIN

(ONE PIECE)

- 1. ANY STORM SEWER SPECIAL OR BACKSLOPE DRAIN OUTLET INTO A DITCH SHALL HAVE A HEADWALL BUILT IN ACCORDANCE WITH THIS
- 2. COST OF FURNISHING AND INSTALLING WIRE MESH SHALL BE INCLUDED IN THE CONTRACT
 UNIT PRICE PER CUBIC YARD FOR
 MISCELLANEOUS CONCRETE. WIRE MESH TO WEIGH NOT
 LESS THAN 58* PER 100 SO. FT.


END VIEW

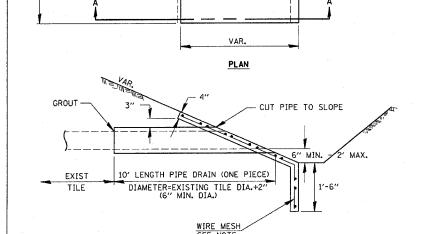

FIELD TILE JUNCTION VAULT

TO BE PLUGGED WITH MASONRY

SECTION A-A



CLASS SI CONCRETE HEADWALLS

36" OR 24" I.D. NON-REINF. CONC. PIPE FULL BELL AND SPIGOT OUTLET INLET CLASS SI CONCRETE OR PRECAST REINFORCED CONCRETE SLABS NOT LESS THAN 12" WIDE -SAND CUSHION NO. 4 BAR LIFT LOOP 2 1/2 DIA. AS REQUIRED

FIELD TILE JUNCTION VAULT