



2" BLOW-OFF ASSEMBLY DETAIL

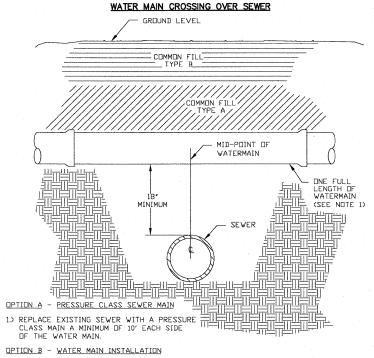

<u> OPTION B - WATER MAIN INSTALLATION</u>

- 1.) MID-POINT OF ONE FULL LENGTH OF WATER MAIN IS TO BE CENTERED ABOVE SEWER LINE.
- 2.) PROVIDE ADEQUATE SUPPORT FOR THE WATER MAIN TO PREVENT DAMAGE DUE TO SETTLEMENT.

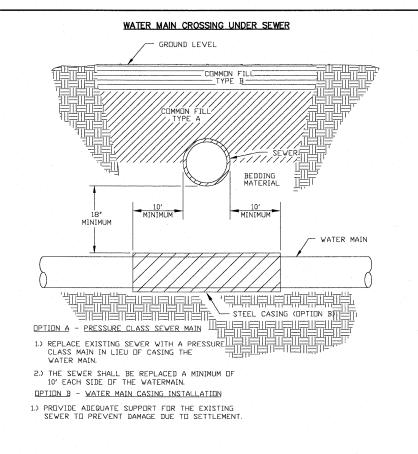

GENERAL NOTES

- CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL UTILITY LOCATIONS AND ELEVATIONS PRIOR TO CONSTRUCTION.
- PRIOR TO BID SUBMISSION, CONTRACTOR SHALL VISIT THE SITE AND RESOLVE ANY QUESTIONS WHICH MAY AFFECT THE WORK.
- 3. ALL CONSTRUCTION OPERATIONS SHALL BE IN ACCORDANCE WITH THE APPLICABLE REGULATIONS OF THE UNITED STATES OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (0,S.H.A.).
- 4. CONTRACTOR SHALL NOTIFY OWNER OF ALL UNDERGROUND TILES ENCOUNTERED IN THE WORK AREA.
- 5. THE CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE SPECIFICATIONS ACCOMPANYING
 THESE PLANS AND THE FOLLOWING
 SPECIFICATIONS;
 A. "STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION", BY THE ILLINOIS
 DEPT. OF TRANSPORTATION, LATEST EDITION.
 B. "SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL PROVISIONS", BY THE ILLINOIS
 DEPT. OF TRANSPORTATION, LATEST EDITION.
 C. ALL WORK SHALL BE CONDUCTED IN ACCORDANCE WITH THE "STANDARD SPECIFICATIONS
 FOR WATER AND SEWER MAIN CONSTRUCTION IN ILLINOIS", LATEST EDITION. ALL PROPOSED
 WATER MAINS SHALL MEET MINIMUM SEPARATION OR ENCASEMENT PER THE STANDARD SPECIFICATIONS.
- 6. CONTRACTOR SHALL PROVIDE A TEMPORARY MEANS OF ACCESS TO DRIVEWAYS UNTIL THE PERMANENT DRIVEWAY APRON IS INSTALLED. THIS SHALL CONSIST OF 6" MIN. OF CA-06 AGGREGATE COMPACTED TO THE SATISFACTION OF THE ENGINEER. THIS WORK SHALL NOT BE MEASURED AND PAID FOR SEPARATLY BUT SHALL BE INCLUDED IN THE COST FOR WATERMAIN PIPE.
- 7. ALL PIPE SHALL BE PVC SDR 21 UNLESS SHOWN OTHERWISE.
- 8. CONTRACTOR SHALL SATISFACTORILY DISINFECT ALL WATER MAINS PRIOR TO USE. IN ACCORDANCE WITH REQUIREMENTS OF AWWA C651-99, AT LEAST ONE SET OF SAMPLES SHALL BE COLLECTED FROM EVERY 1,200 FEET OF NEW WATER MAIN, PLUS ONE SET FROM THE MO OF THE LINE AND AT LEAST ONE SET FROM EACH BRANCH, SATISFACTORY DISINFECTION SHALL BE DEMONSTRATED IN ACCORDANCE WITH THE REQUIREMENTS OF 35 IL ADM. CODE 652-203. CONTRACTOR SHALL FURNISH AND INSTALL CORPORATION STOPS AT REQUIRED SAMPLING LENGTHS.
- 9. CONTRACTOR SHALL MAINTAIN A MINIMUM 2' SPOOL PIECE LENGTH.
- 10. THE PIPE SHALL BE LAID WITH A COVER OF AT LEAST 48 INCHES AND NO MORE THAN 54 INCHES AS MEASURED FROM THE TOP OF THE PIPE TO THE PROPOSED FINISHED GRADE OF THE GROUND OR PAVEMENT, UNLESS OTHERWISE INDICATED BY THE ENGINEER OR NOTED ON THE CONSTRUCTION DRAWINGS.
- 11. ANY WORK IN THE STREET THAT WILL REQUIRE THE CLOSURE OF A LANE TO TRAFFIC MUST PROVIDE A MINIMUM 48 HOURS NOTICE TO THE CITY OF HAVANA PUBLIC WORKS DEPARTMENT (309-494-8803) FOR PROPER PUBLIC AND E911 NOTIFICATION.

CSV DESIGNED REVISED FILE NAME 3081364_WM-Detail.dgr DRAWN JTC REVISED CHECKED REVISED 03/09/10 11:24:02 AM DATE REVISED

STATE OF ILLINOIS **DEPARTMENT OF TRANSPORTATION**

SECTION CITY OF HAVANA - BROADWAY STREET 05-00035-00-SS MASON **WATERMAIN DETAILS** CONTRACT NO. 93502 SHEET NO. OF SHEETS STA. 23+45 TO STA. 31+99.5

Farnsworth