


F.A.U. ROUTE	SECTION	COUNTY	TOTAL SHEETS	SHEET NUMBER
9521	10-00051-00-SW	PERRY	33	11
CITY OF DUQUOIN		PROJECT NO. TE-0009(105)		
CONTRACT NO. 99499		JOB NO. C-99-512-11		

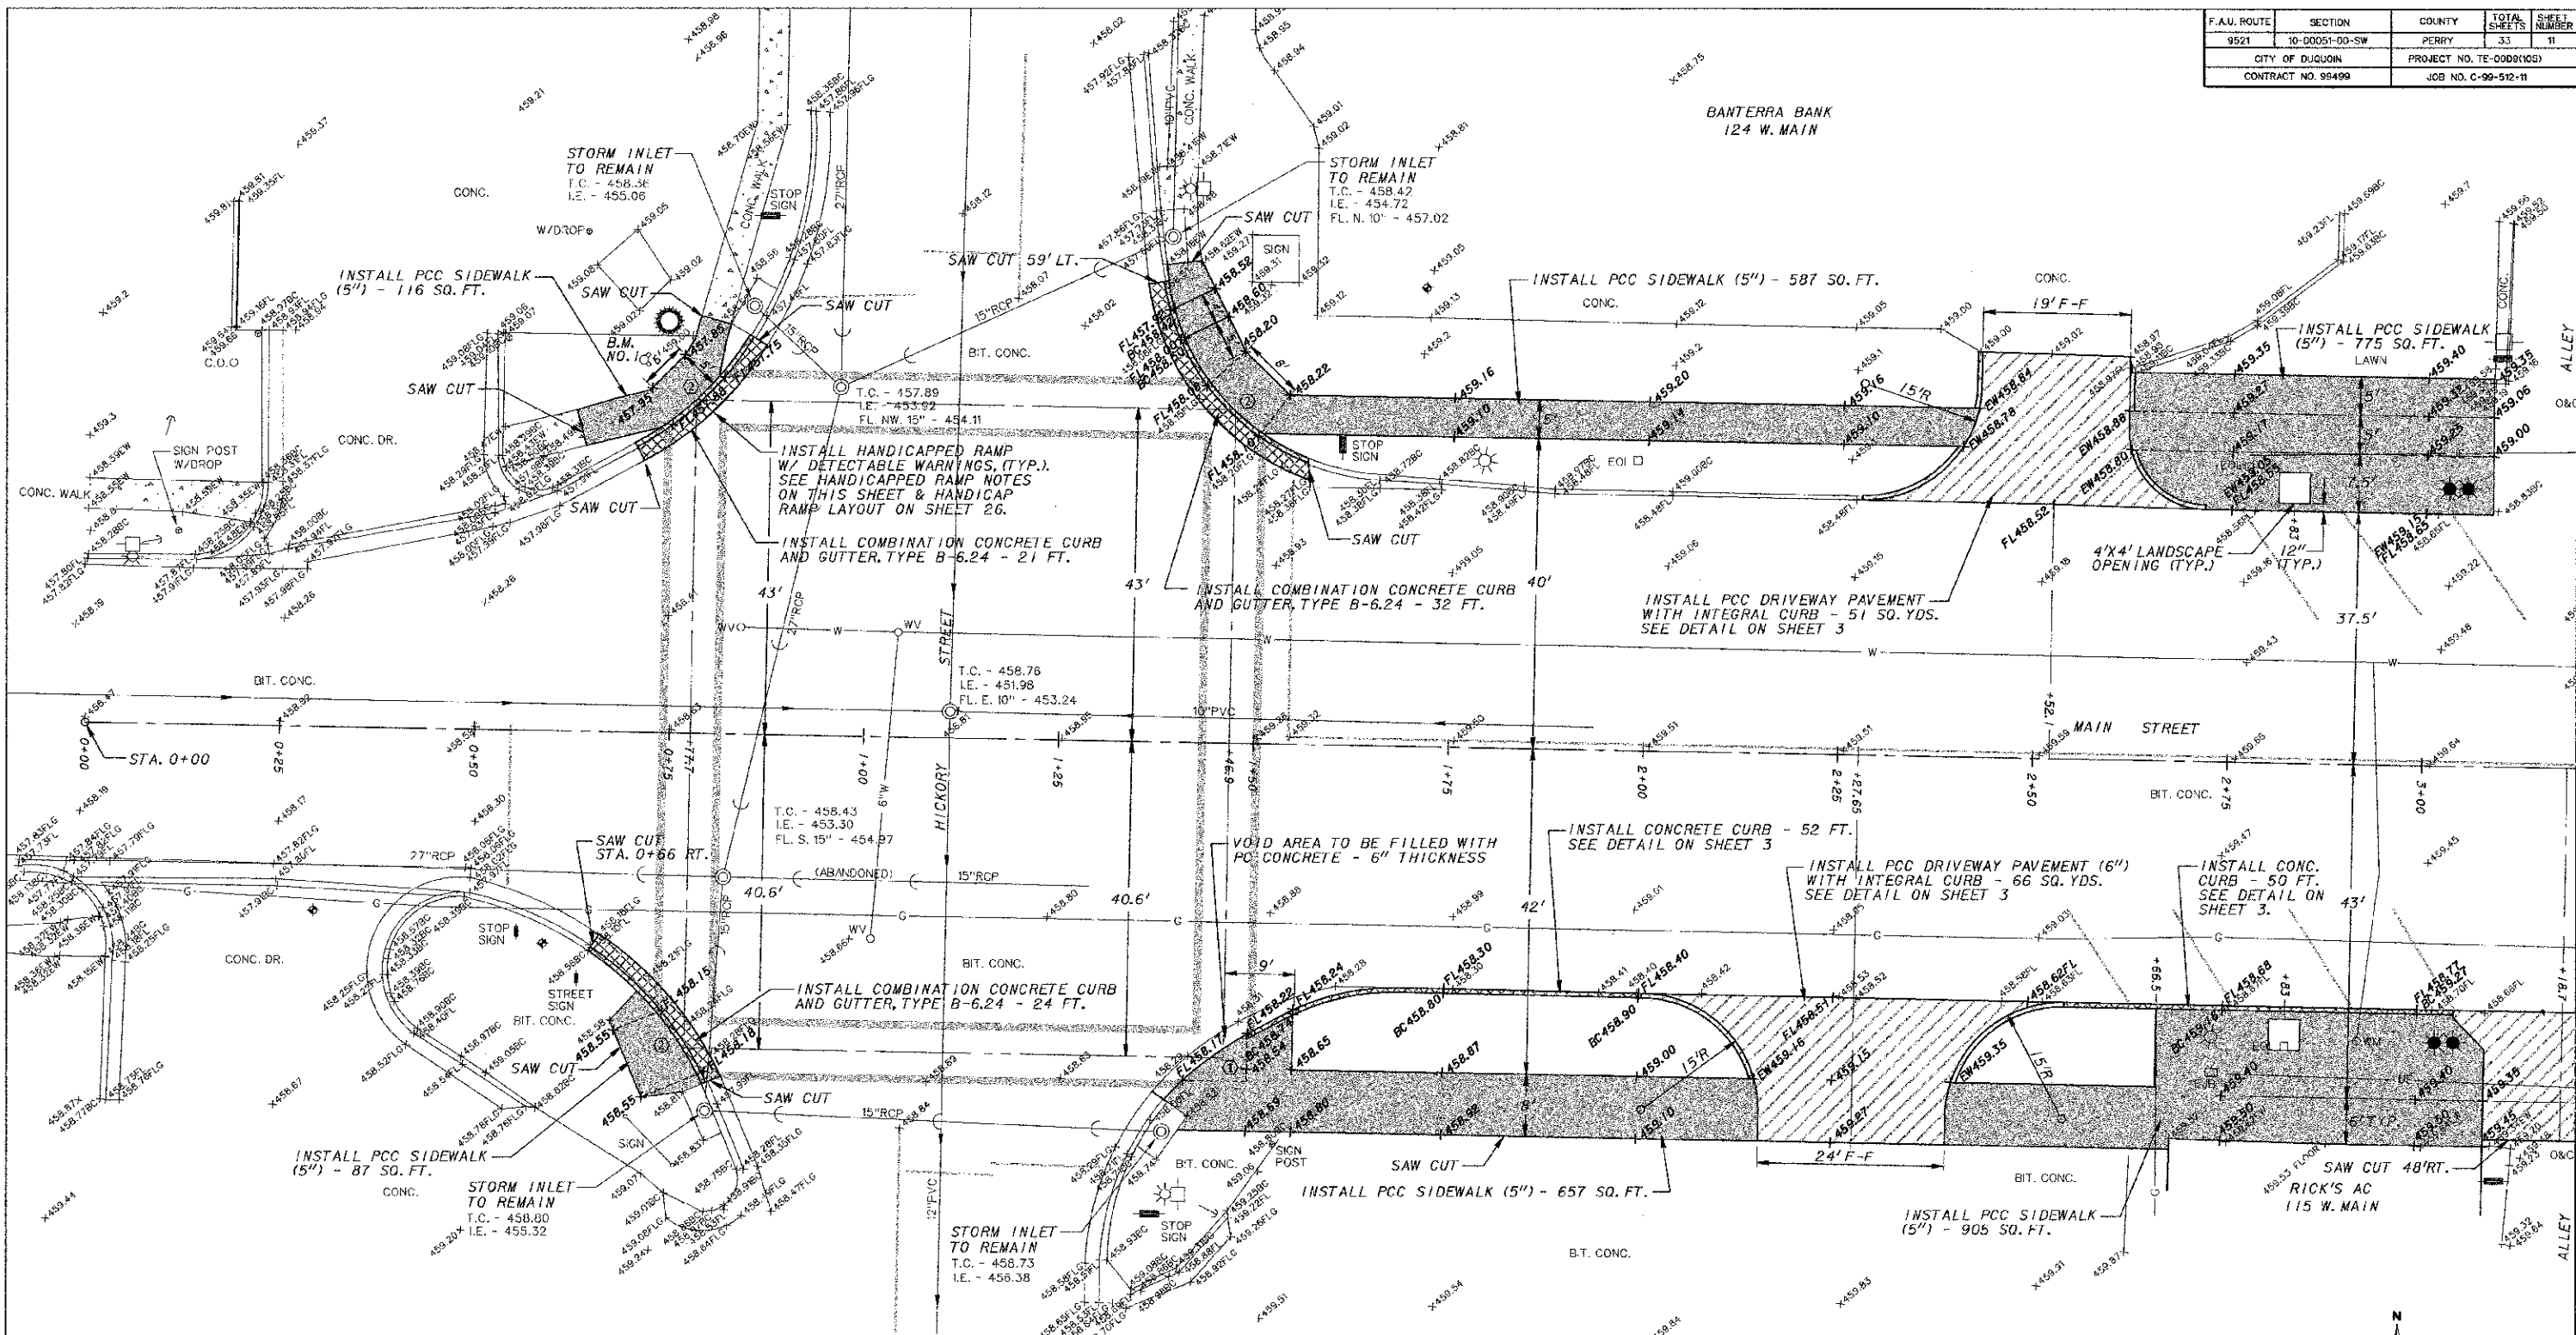

LEGEND

- | | | | |
|--|--|--|------------------------------|
| | - POWER POLE | | - SANITARY SEWER AND MANHOLE |
| | - POWER / TELEPHONE POLE | | - CLEAN OUT |
| | - POWER / TELEPHONE POLE W/ LIGHT | | - FIRE HYDRANT |
| | - STREET LIGHT POLE | | - WATER VALVE |
| | - SINGLE / DOUBLE FIXTURE PEDESTRIAN LIGHT | | - WATER METER |
| | - ELECTRICAL JUNCTION BOX | | - WATER SERVICE SHUTOFF |
| | - ELECTRICAL OUTLET | | - WATER MAIN & SIZE |
| | - ELECTRICAL CONDUIT | | - GAS LINE |
| | - UNDERGROUND ELECTRIC LINE | | - GAS VALVE |
| | - ANCHOR | | - GAS METER |
| | - TRAFFIC CONTROL LIGHT | | - STORM SEWER & MAN-HOLE |
| | - RAILROAD CROSSING GATE | | - STORM SEWER & INLET |
| | - FIBER OPTIC LINE | | - TRASH CAN |
| | - UNDERGROUND TELEPHONE LINE | | |


- | | | | |
|--|--------------------------------|--|--------------------------------|
| | - POST | | - MONITORING WELL |
| | - SIGN | | - REINSTALLED HANDICAP PARKING |
| | - ORNAMENTAL CONTAINER | | - ORNAMENTAL SHRUB |
| | - TREE W/ SIZE & TYPE | | - TOP OF CASTING - TOP OF CURB |
| | - TOP OF CASTING - TOP OF CURB | | - INVERT |
| | - INVERT | | - FLOW LINE |
| | - FLOW LINE | | - EXISTING CONCRETE SIDEWALK |
| | - PROPOSED PCC SIDEWALK | | |

HANDICAPPED RAMP NOTES FOR THIS SHEET

NO.	DETECTABLE WARNINGS LENGTH	WIDTH	TOTAL ON THIS SHEET
①	14	2	1
②	10	2	3

BENCHMARKS

- B.M. NO.1 - TOP OF HEADBOLT NEXT TO "M" IN MUELLER ON FIRE HYDRANT AT THE N.W. CORNER OF THE INTERSECTION OF MAIN STREET AND HICKORY STREET. (ELEV. 461.23)
- B.M. NO.2 - TOP OF BRONZE CAP MONUMENT SET IN CONCRETE SIDEWALK AT THE N.E. CORNER OF THE DU QUOIN STATE BANK AND AT THE S.W. CORNER OF THE INTERSECTION OF MAIN STREET AND DIVISION STREET. (ELEV. 463.39)



CITY OF DUQUOIN
PERRY COUNTY, ILLINOIS
MAIN STREET SIDEWALK REPLACEMENT
PROPOSED SIDEWALK PLAN
STA. 0+00 TO STA. 3+00

REVISED (04/23/2013)