

CONTRACT NO. 60B47 TOTAL SHEETS NO. COUNTY SECTION 55 99 (1&2) WRS-3 WILL 305 104 STA. TO STA. FED. ROAD DIST. NO. ILLINOIS FED. AID PROJECT EC-06 OF 07

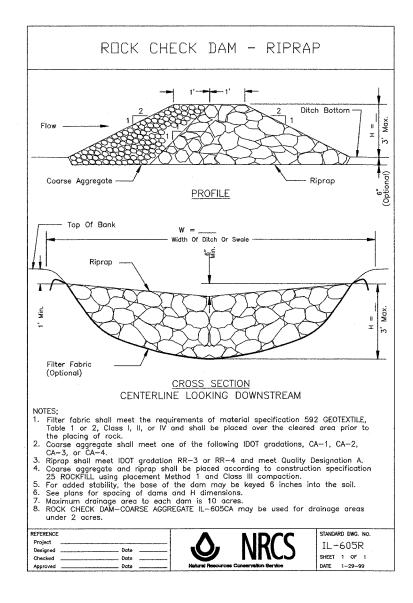

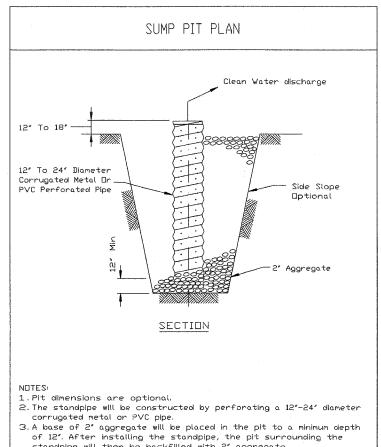

standpipe will then be backfilled with 2" aggregate.
4. The standpipe will extend 12" to 18" above the lip of the pit.

5. If discharge will be pumped directly to a storm drainage system, the standpipe will be wrapped with filter fabric before installation.

6. If desired, 1/4"-1/2" hardware cloth may be placed around the standpipe prior to attaching the filter fabric. This will increase the rate of water seepage into the pipe.

REFERENCE Project _ Designed _ Checked _ IL-650 _ Date . Date . Date SHEET 1 DF 1 Approved DATE 8-11-94

