


TO BE USED

STA 312+18.35 TO STA 314+78.35

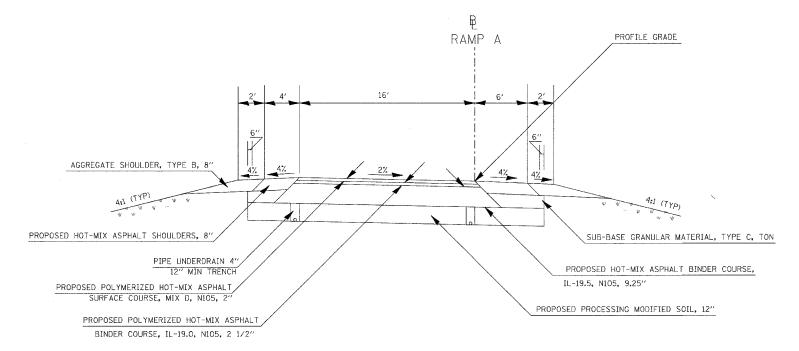

ATTAIN SUPERELEVATION STA 312+18.35 TO STA 314+78.35

REMOVE SUPERELEVATION SEE STANDARD 406001-03

TO BE USED
STA 307+60.07 TO STA 312+18.35

- \* ON THE HIGH SIDE OF SUPERELEVATED SECTIONS, THE MAXIMUM SHOULDER ROLLOVER SHALL NOT EXCEED 8%
- \* THE MINIMUM TRENCH WIDTH FOR PIPE UNDERDRAINS SHALL BE 12"
- \* FOR GUARDRAIL LOCATIONS SEE GUARDRAILS SCHEDULE
- \* SEE RAMP A CROSS SECTIONS FOR CROSS SLOPES