




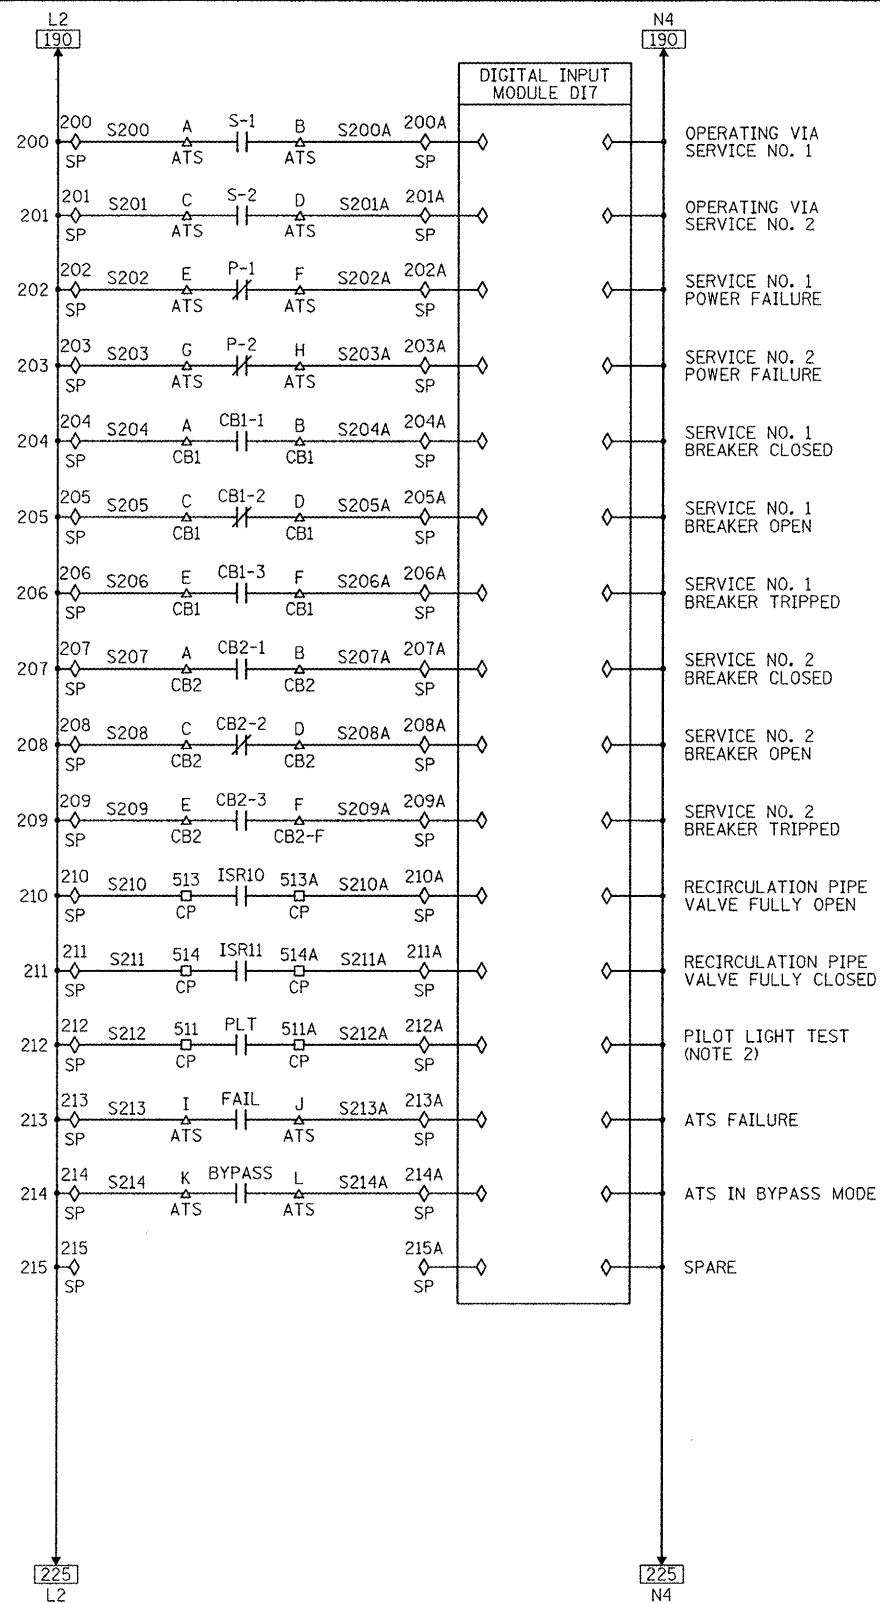

REFER TO SHEET E3 FOR ADDITIONAL DETAILS

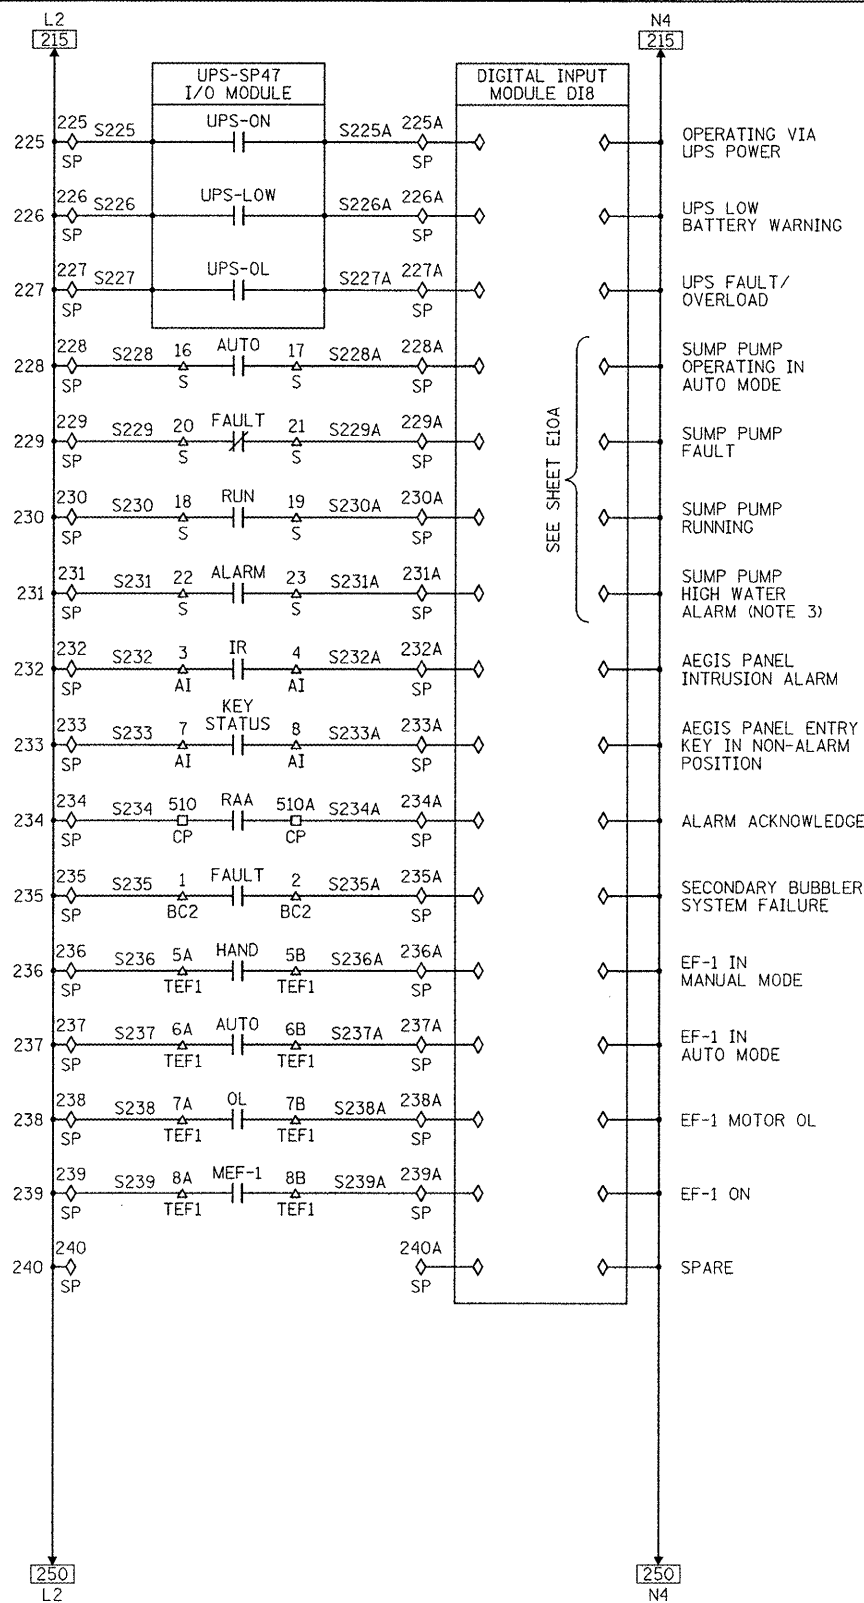

SEE SHEET E10A

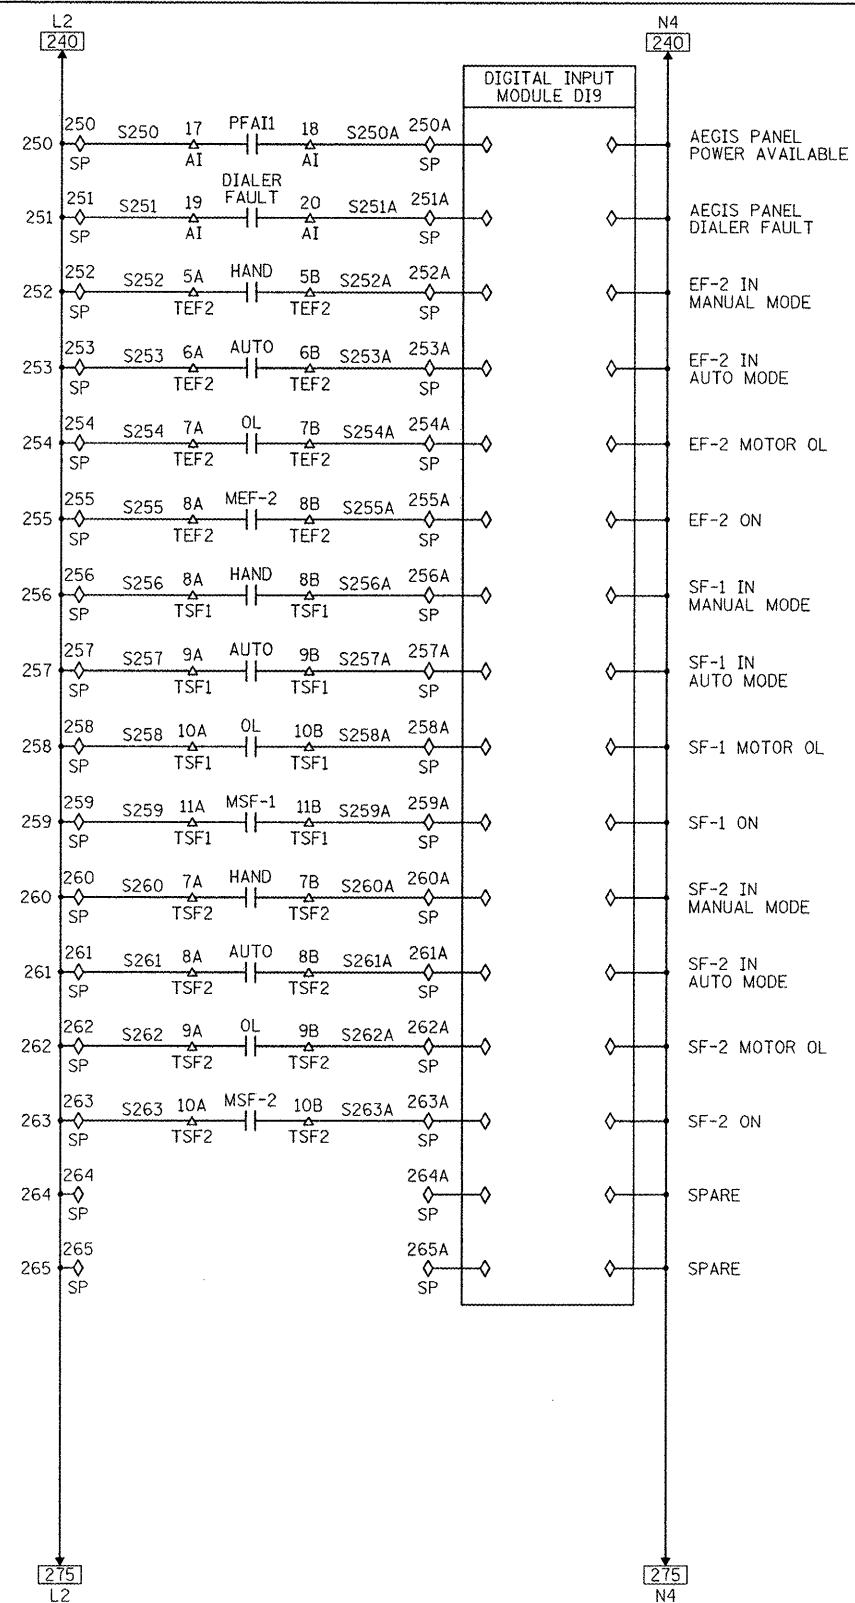

#### NOTES:

- SEE SHEETS GI-1 AND GI-2 FOR INSTRUMENTATION SYMBOL LIST, ABBREVIATIONS, AND GENERAL NOTES.
- INPUT USED TO TEST THE INDIVIDUAL FLOAT SWITCH PILOT LIGHTS. REFER TO SHEET CPD-3.
- THE HIGH WATER ALARM IS USED TO PROVIDE THE "DRY WELL FLOODING ALARM".
- ALL INTERCONNECTING WIRES/CABLES BETWEEN PANELS SHALL TERMINATE ON TERMINAL STRIPS AND SHOULD NOT BE DIRECTLY CONNECTED TO DEVICES LOCATED IN THE PANELS.