


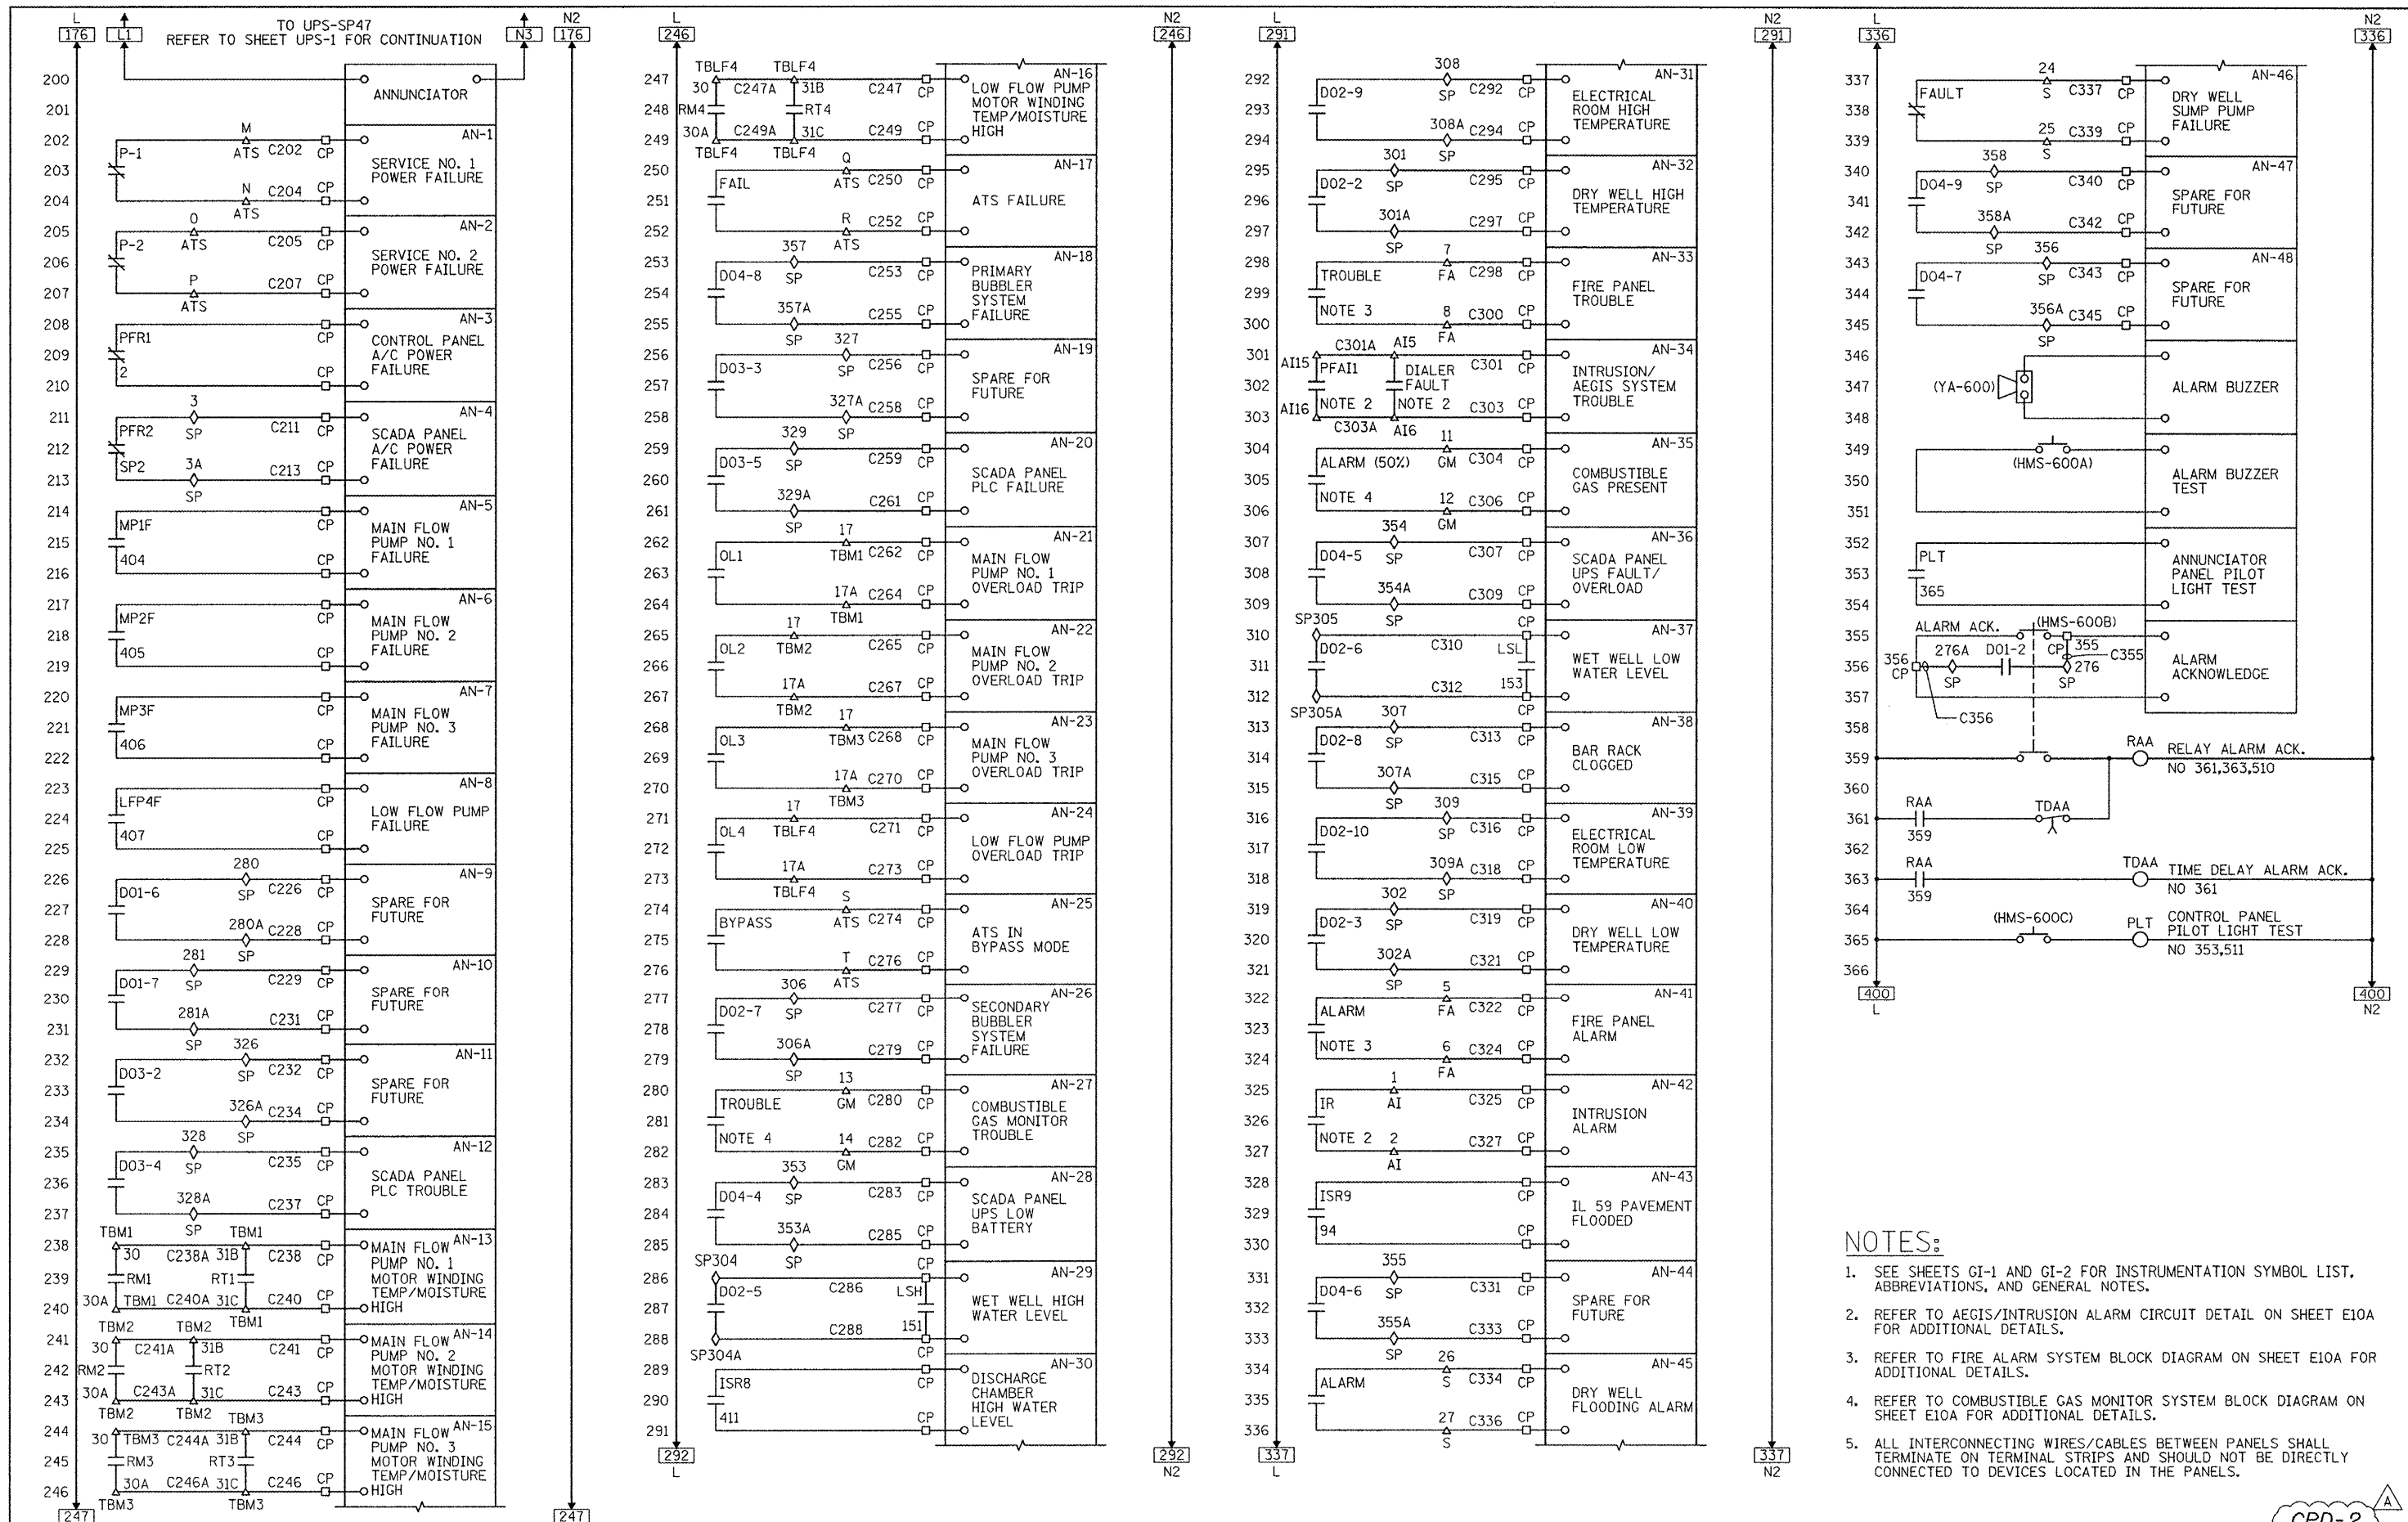

- NOTES:**
- SEE SHEETS GI-1 AND GI-2 FOR INSTRUMENTATION SYMBOL LIST, ABBREVIATIONS, AND GENERAL NOTES.
 - REFER TO AEGIS/INTRUSION ALARM CIRCUIT DETAIL ON SHEET E10A FOR ADDITIONAL DETAILS.
 - REFER TO FIRE ALARM SYSTEM BLOCK DIAGRAM ON SHEET E10A FOR ADDITIONAL DETAILS.
 - REFER TO COMBUSTIBLE GAS MONITOR SYSTEM BLOCK DIAGRAM ON SHEET E10A FOR ADDITIONAL DETAILS.
 - ALL INTERCONNECTING WIRES/CABLES BETWEEN PANELS SHALL TERMINATE ON TERMINAL STRIPS AND SHOULD NOT BE DIRECTLY CONNECTED TO DEVICES LOCATED IN THE PANELS.