




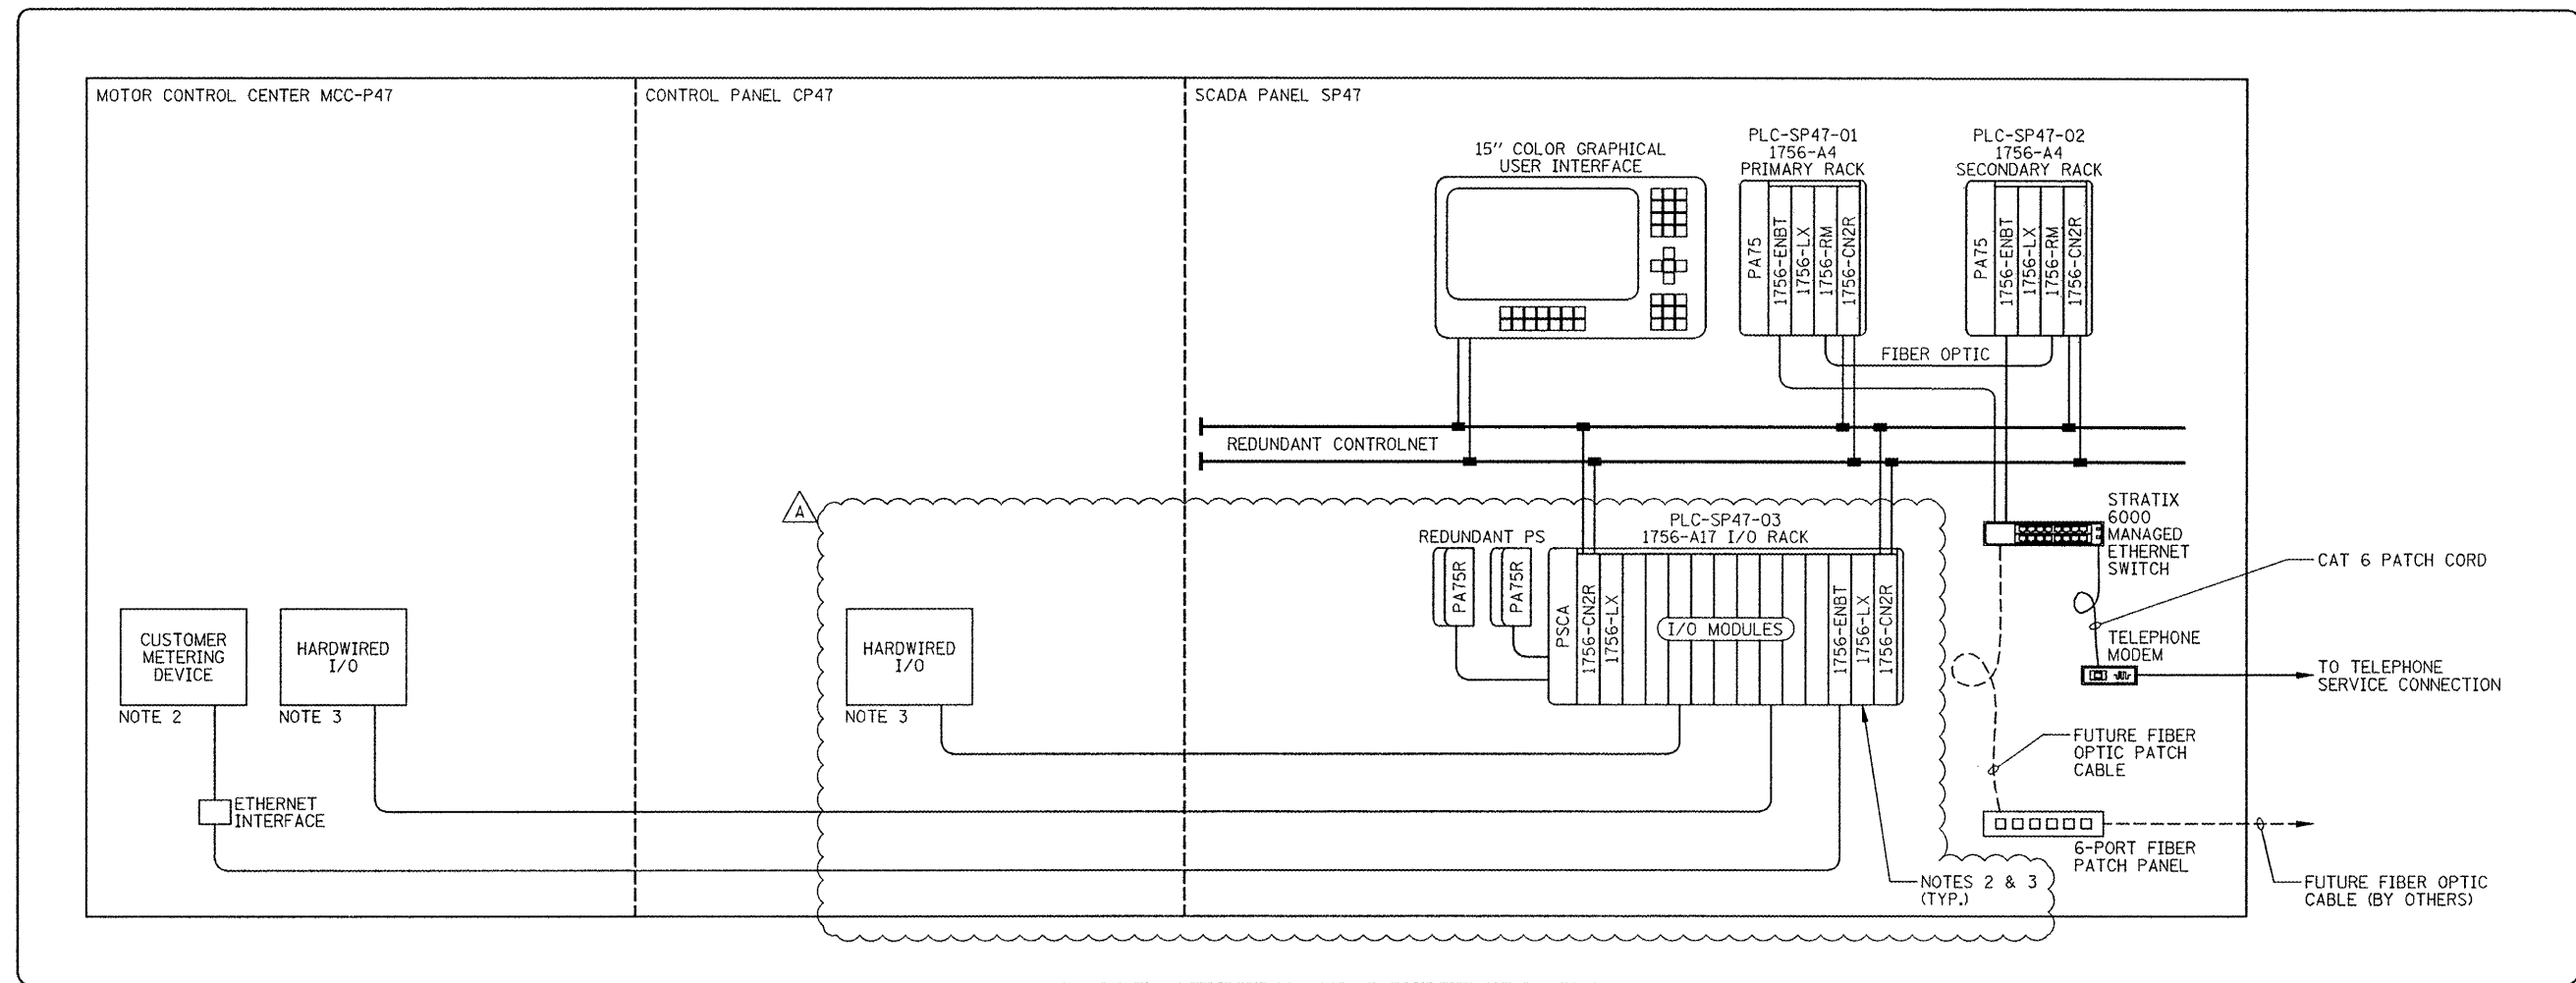

PUMP STATION 47

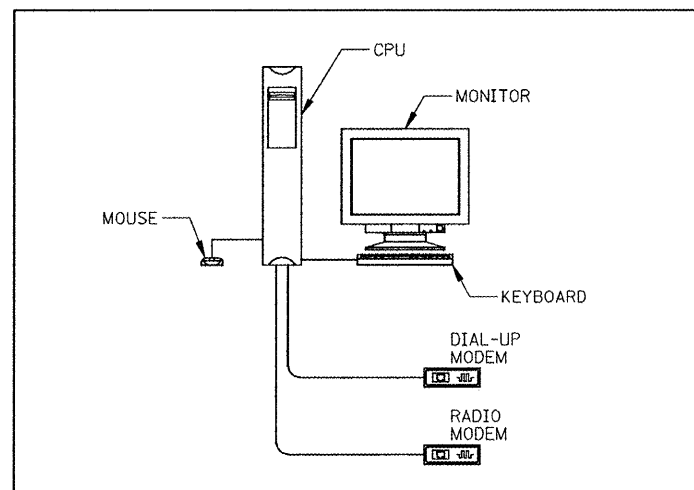

EXISTING IDOT DISTRICT 1
MONITORING STATION (NOTE 4)

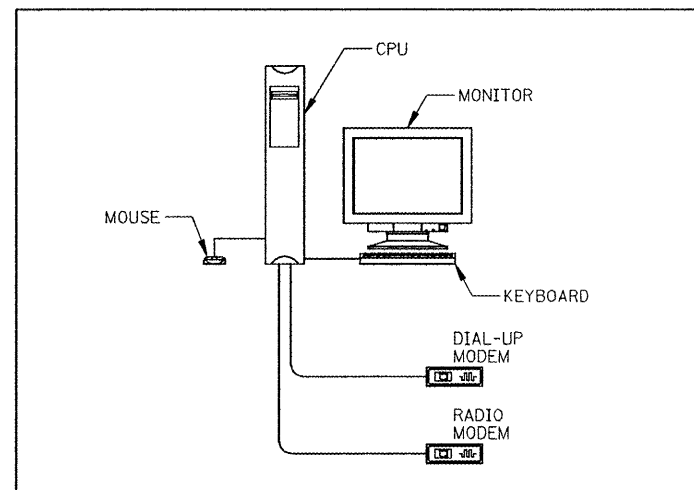

EXISTING IDOT ELECTRICAL
MAINTENANCE CONTRACTOR (EMC) FACILITY (NOTE 4)

NOTES:

1. SEE SHEETS GI-1 AND GI-2 FOR INSTRUMENTATION SYMBOL LIST, ABBREVIATIONS, AND GENERAL NOTES.
2. CONTRACTOR TO SIZE CONTROLLER FOR APPLICATION. PROVIDE 25% SPARE MEMORY FOR FUTURE GROWTH.
3. CONTRACTOR IS RESPONSIBLE FOR PROVIDING ADDITIONAL PLC MODULES AS REQUIRED TO ENSURE OPERATION AS DETAILED IN THE CONTRACT DOCUMENTS.
4. REFER TO SPECIFICATION SECTION 40 94 24 - HMI IMPROVEMENTS FOR DETAILS REGARDING WORK AT THIS LOCATION.