
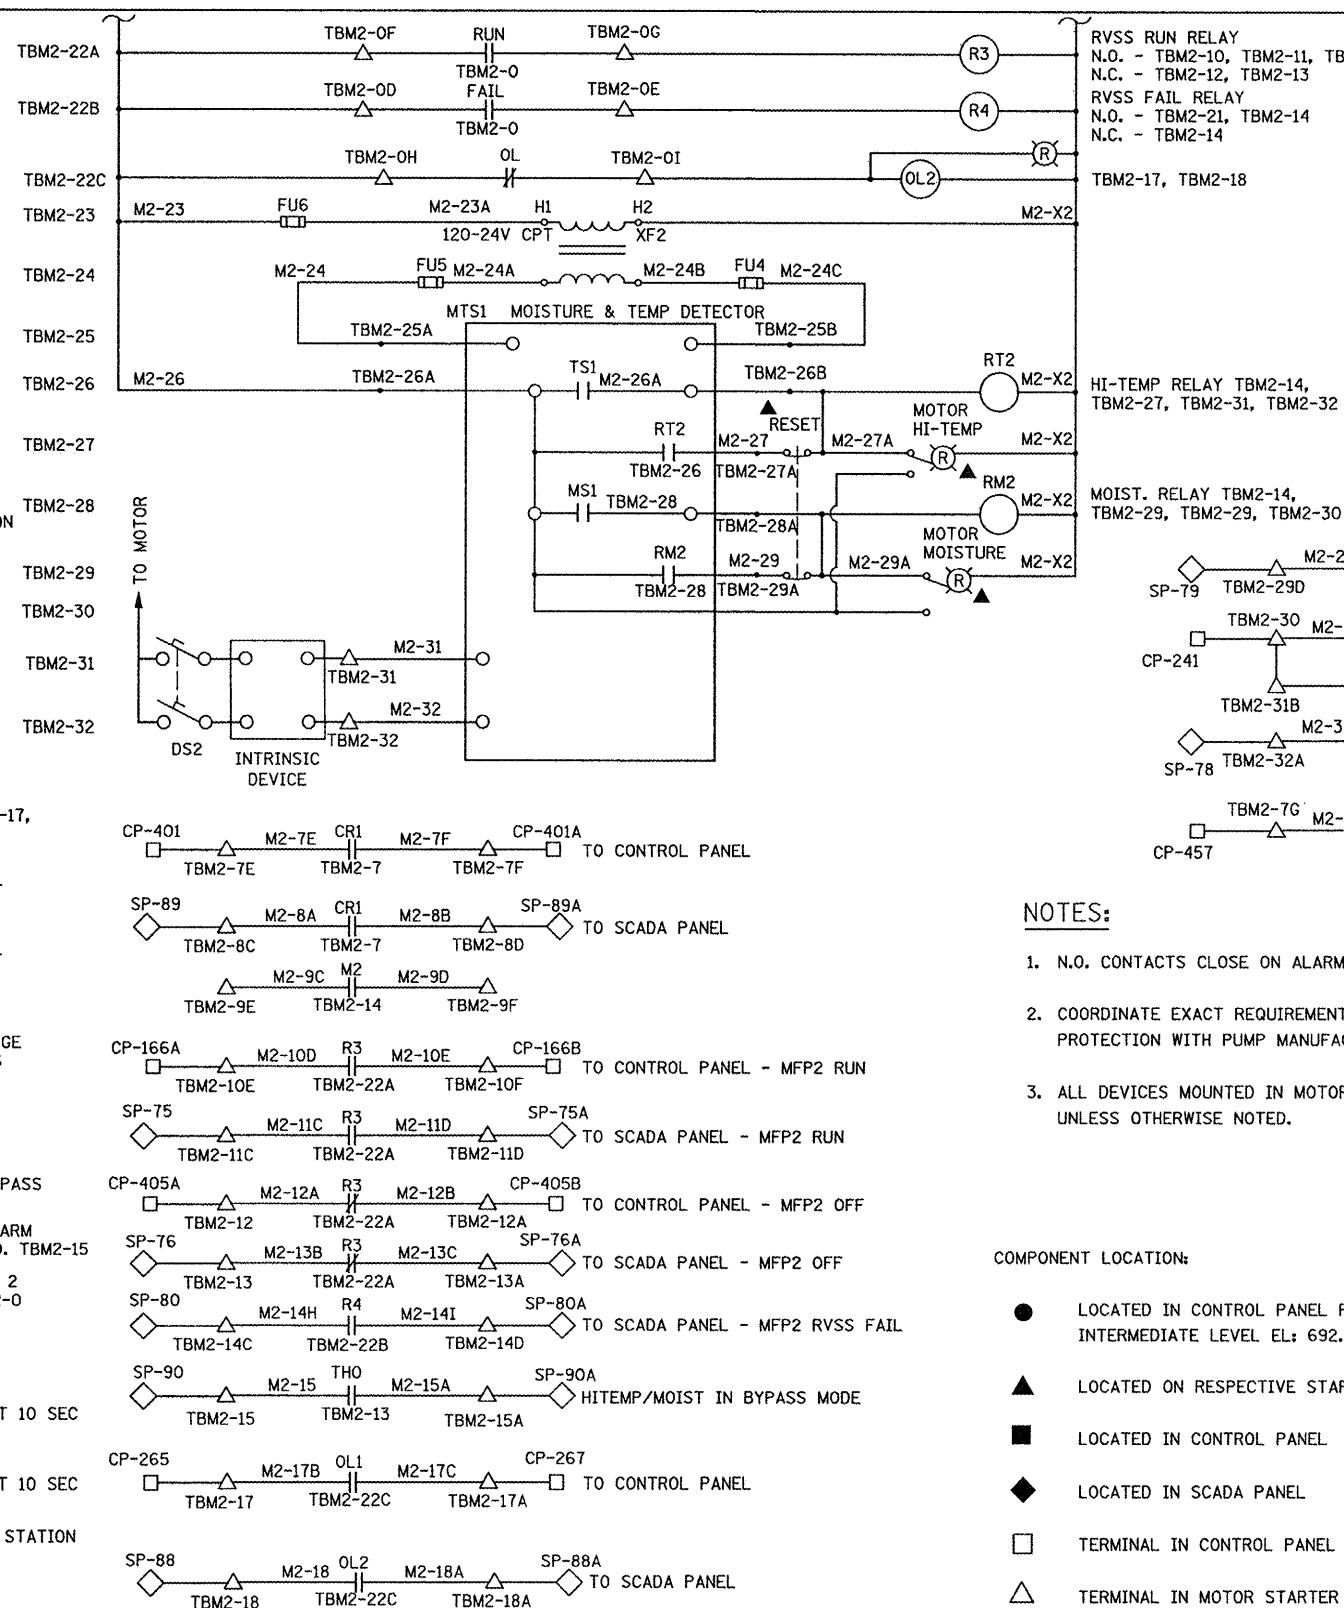


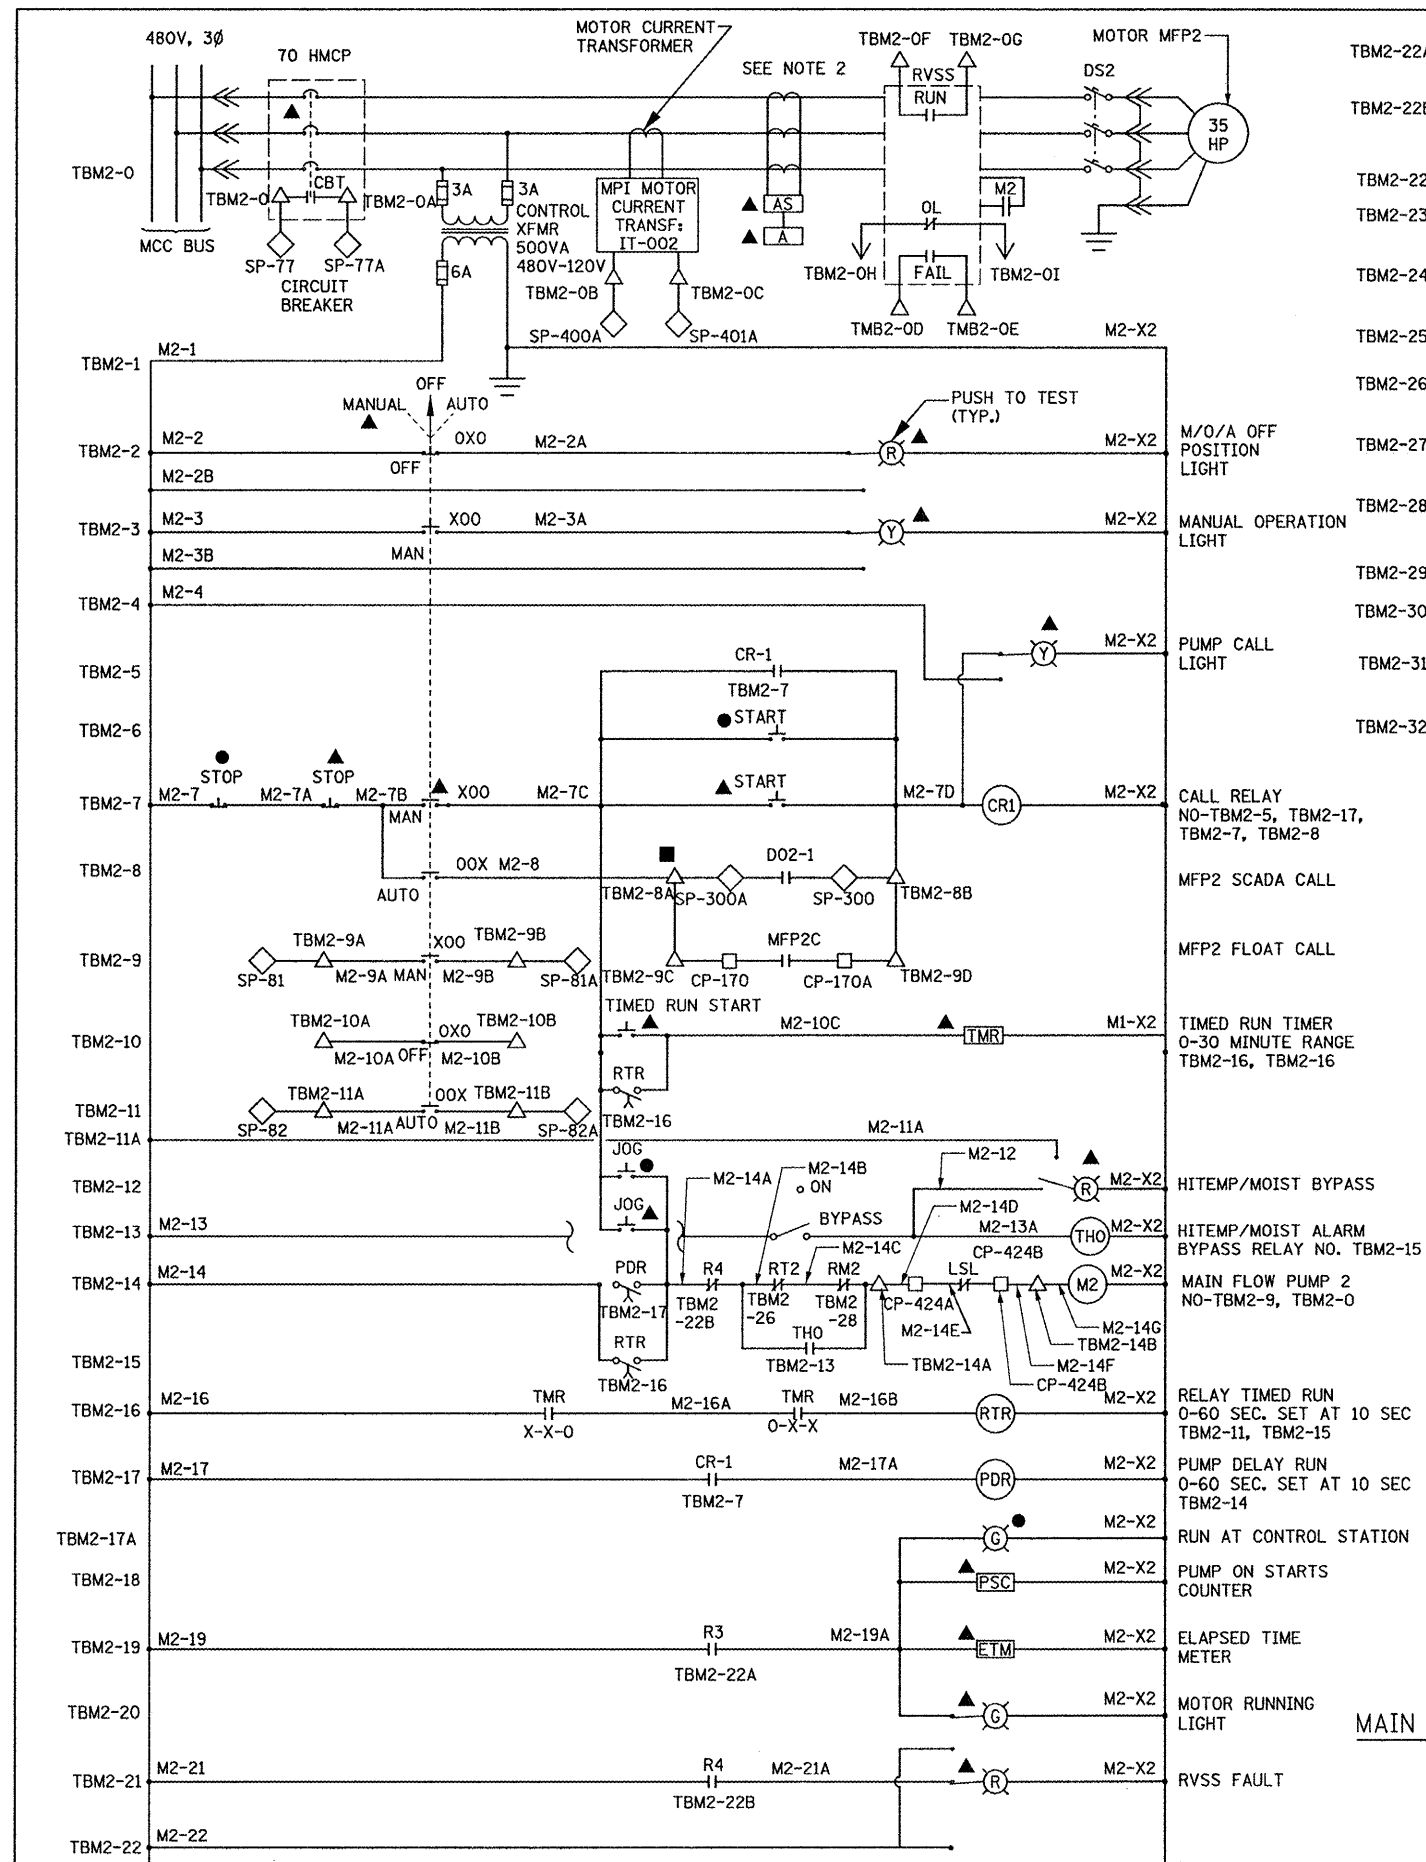

NOTES:

1. N.O. CONTACTS CLOSE ON ALARM.
2. COORDINATE EXACT REQUIREMENTS FOR PUMP PROTECTION WITH PUMP MANUFACTURER.
3. ALL DEVICES MOUNTED IN MOTOR STARTER, UNLESS OTHERWISE NOTED.

COMPONENT LOCATION:

- | | |
|-----|---|
| ● | LOCATED IN CONTROL PANEL PUMP ROOM
INTERMEDIATE LEVEL EL: 692.75 |
| ▲ | LOCATED ON RESPECTIVE STARTER DOOR |
| ■ | LOCATED IN CONTROL PANEL |
| ◆ | LOCATED IN SCADA PANEL |
| □ | TERMINAL IN CONTROL PANEL |
| △ | TERMINAL IN MOTOR STARTER |
| ◇ | TERMINAL IN SCADA PANEL |
| TSI | MOTOR TEMPERATURE SENSOR |
| MSI | MOTOR MOISTURE SENSOR |