



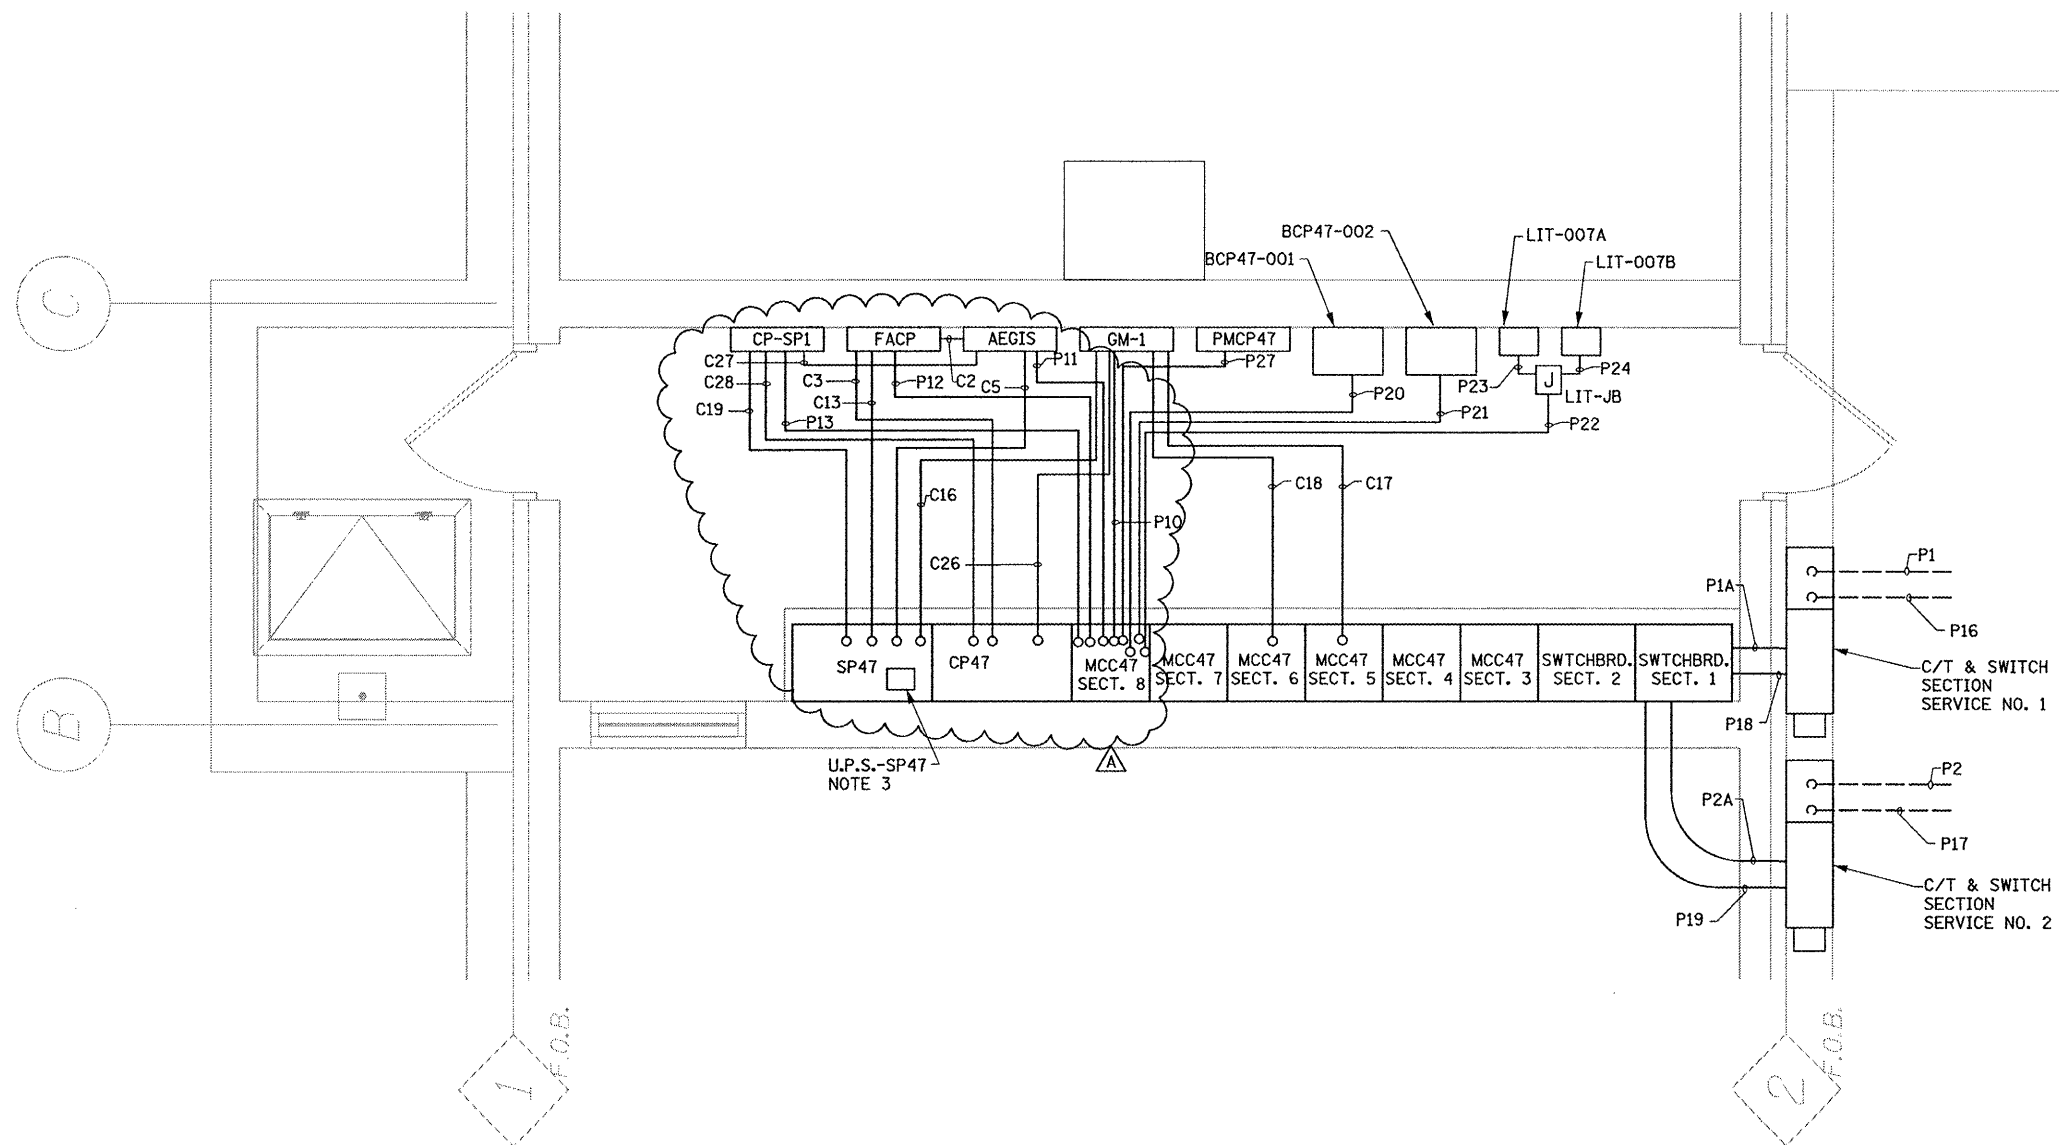

NOTES:

1. FOR CONDUIT AND CABLE RUNS FROM ELECTRICAL EQUIPMENT TO ALL OTHER EQUIPMENT/DEVICES, SEE PLAN AND SECTION ELEVATION SHEETS.
2. FOR C/T & SWITCH SECTION DETAILS, SEE SHEET E14.
3. INSTALL 3 KVA U.P.S. INSIDE SCADA PANEL SP-47. INSTALL 1 (ONE) 1 POLE 30A BREAKER IN PANEL LP-47 FOR U.P.S. CIRCUIT.
4. CP47 AND SCADA PANELS SHALL BE FED FROM UPS-CP47.



E13

KNIGHT Engineers & Architects	USER NAME = *USER*	DESIGNED - MCP	REVISED ADDENDUM A 5-23-12	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	PUMP STATION NO. 47 ELECTRICAL ROOM ELECTRICAL EQUIPMENT LAYOUT	F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
	PLOT SCALE = *SCALE*	DRAWN - MLB	REVISED -			338/IL 59	2011-035-I	DUPAGE	181	180
	PLOT DATE = *DATE*	CHECKED - MCP	REVISED -			CONTRACT NO. 60P41				
		DATE 03-22-2012	REVISED -			ILLINOIS FED. AID PROJECT				
SCALE: 1/2" = 1'-0" SHEET NO. OF SHEETS STA. TO STA.										