



FIELD SPLICE TOP VIEW

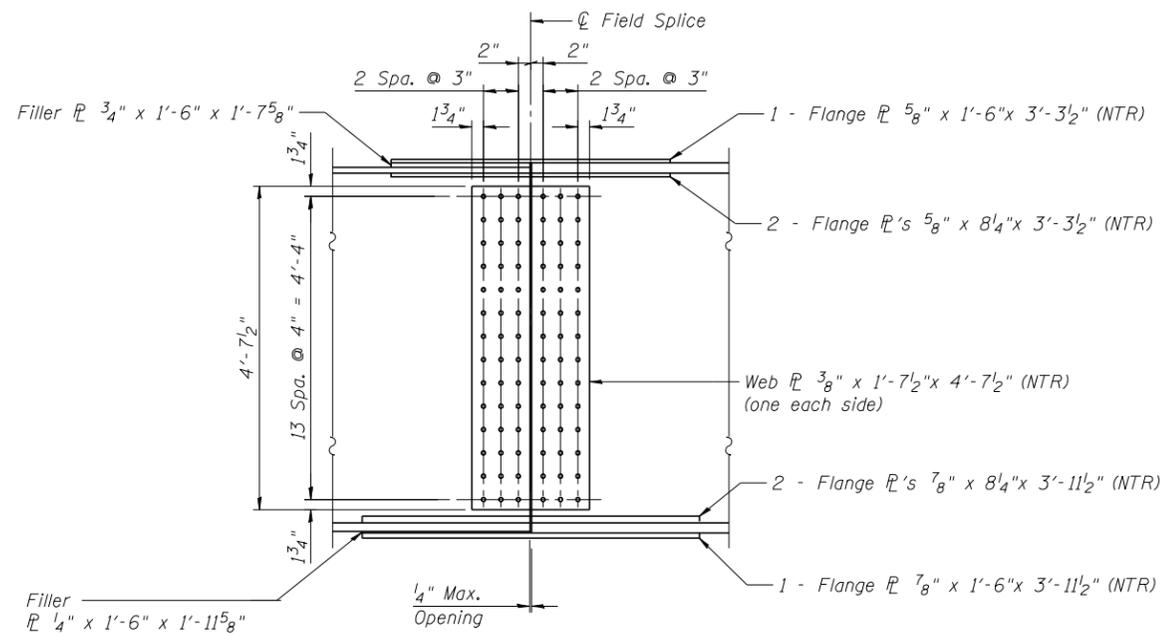


FIELD SPLICE ELEVATION

(26 Required)

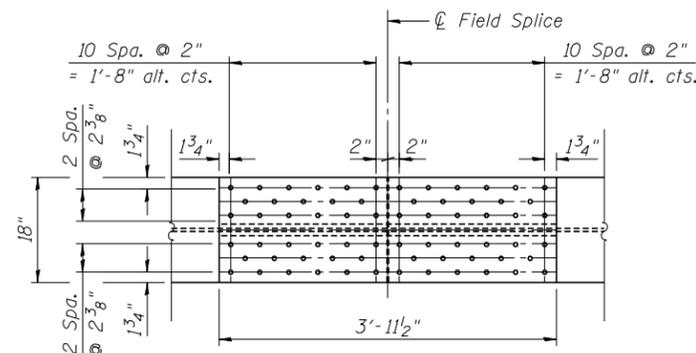

FIELD SPLICE BOTTOM VIEW

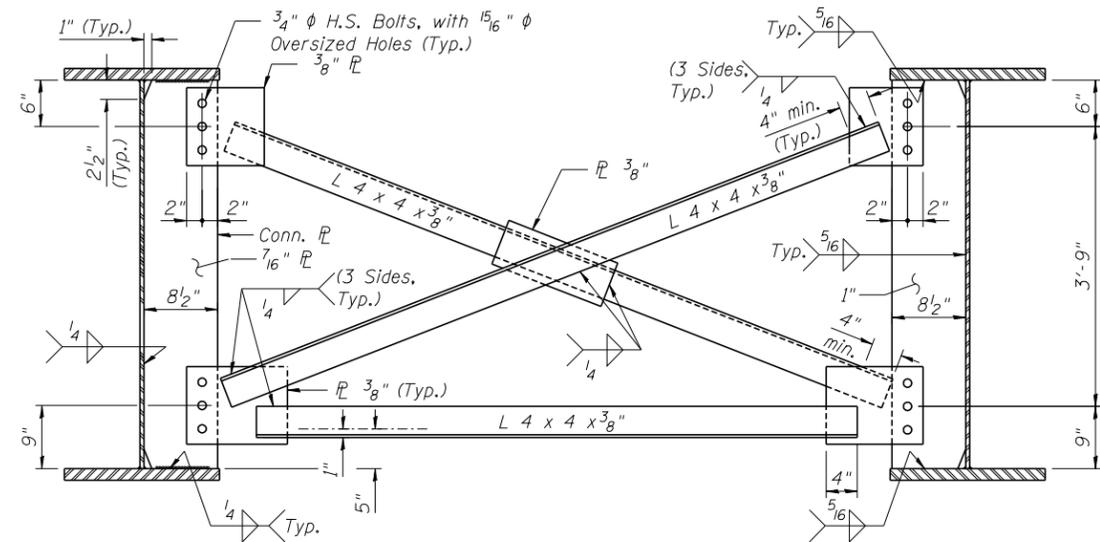

TYPE D1
HALF SECTION AT
INTERMEDIATE LOCATIONS

CROSS FRAME DETAILS (D1), (D2)

TYPE D2
HALF SECTION AT PIER

NOTE:

1. Two hardened washers required for each set of oversized holes.

NOTES:

- All Structural Steel for girders and splice plates shall conform to the requirements of AASHTO M270, Grade 50.
- Load carrying components designated "NTR" shall conform to the Impact Testing Requirements, Zone 2.