

REVISION	BY
DATE	

**DIMAX**  
**DEKALB TAYLOR MUNICIPAL AIRPORT**  
 IL PROJ.: DK0-3448 AIP PROJ.: 3-17-0139-B42

12/29/03	CAH
12/29/03	MDR
03/06/06	CAH
LAYOUT	
DRAWN	
REVIEWED	

**HANSON**  
 Hanson Professional Services Inc.  
 1505 E. 5th St. Suite 200  
 Springfield, Illinois 62705-2886  
 Offices Nationwide

REMOVE AND REGRADE  
 RUNWAY END 2  
 EXISTING ELECTRICAL PLAN

**LIGHT REMOVAL NOTES**

ALL EXISTING RUNWAY AND TAXIWAY LIGHTS THAT ARE DESIGNATED FOR REMOVAL WITH AN "X" WILL BE REMOVED. THE LIGHTS AND THEIR ISOLATING TRANSFORMER WILL BE TURNED OVER TO THE AIRPORT MANAGER. THE LIGHT STAKES/BASES WILL BE REMOVED AND DISPOSED OF OFF THE AIRPORT SITE.




THE HOLE LEFT FROM THE LIGHT REMOVAL WILL BE FILLED IN WITH EARTH AND COMPACTED TO PREVENT FUTURE SETTLEMENT. THE DISTURBED AREAS WILL BE FERTILIZED AND SEEDDED IN ACCORDANCE WITH THE SPECIAL PROVISIONS.

THE EXISTING RUNWAY CABLES WILL BE ABANDONED IN PLACE UNLESS IT CONFLICTS WITH THE INSTALLATION OF A PROPOSED LIGHT OR CABLE, THEN IT WILL BE REMOVED AT NO ADDITIONAL COST TO THE CONTRACT.

REMOVAL OF THE EXISTING LIGHTS AND ISOLATING TRANSFORMERS WILL BE PAID FOR UNDER ITEMS:  
 AR125901 "REMOVE STAKE MOUNTED LIGHT" PER EACH AND  
 AR125902 "REMOVE BASE MOUNTED LIGHT" PER EACH.

THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123.

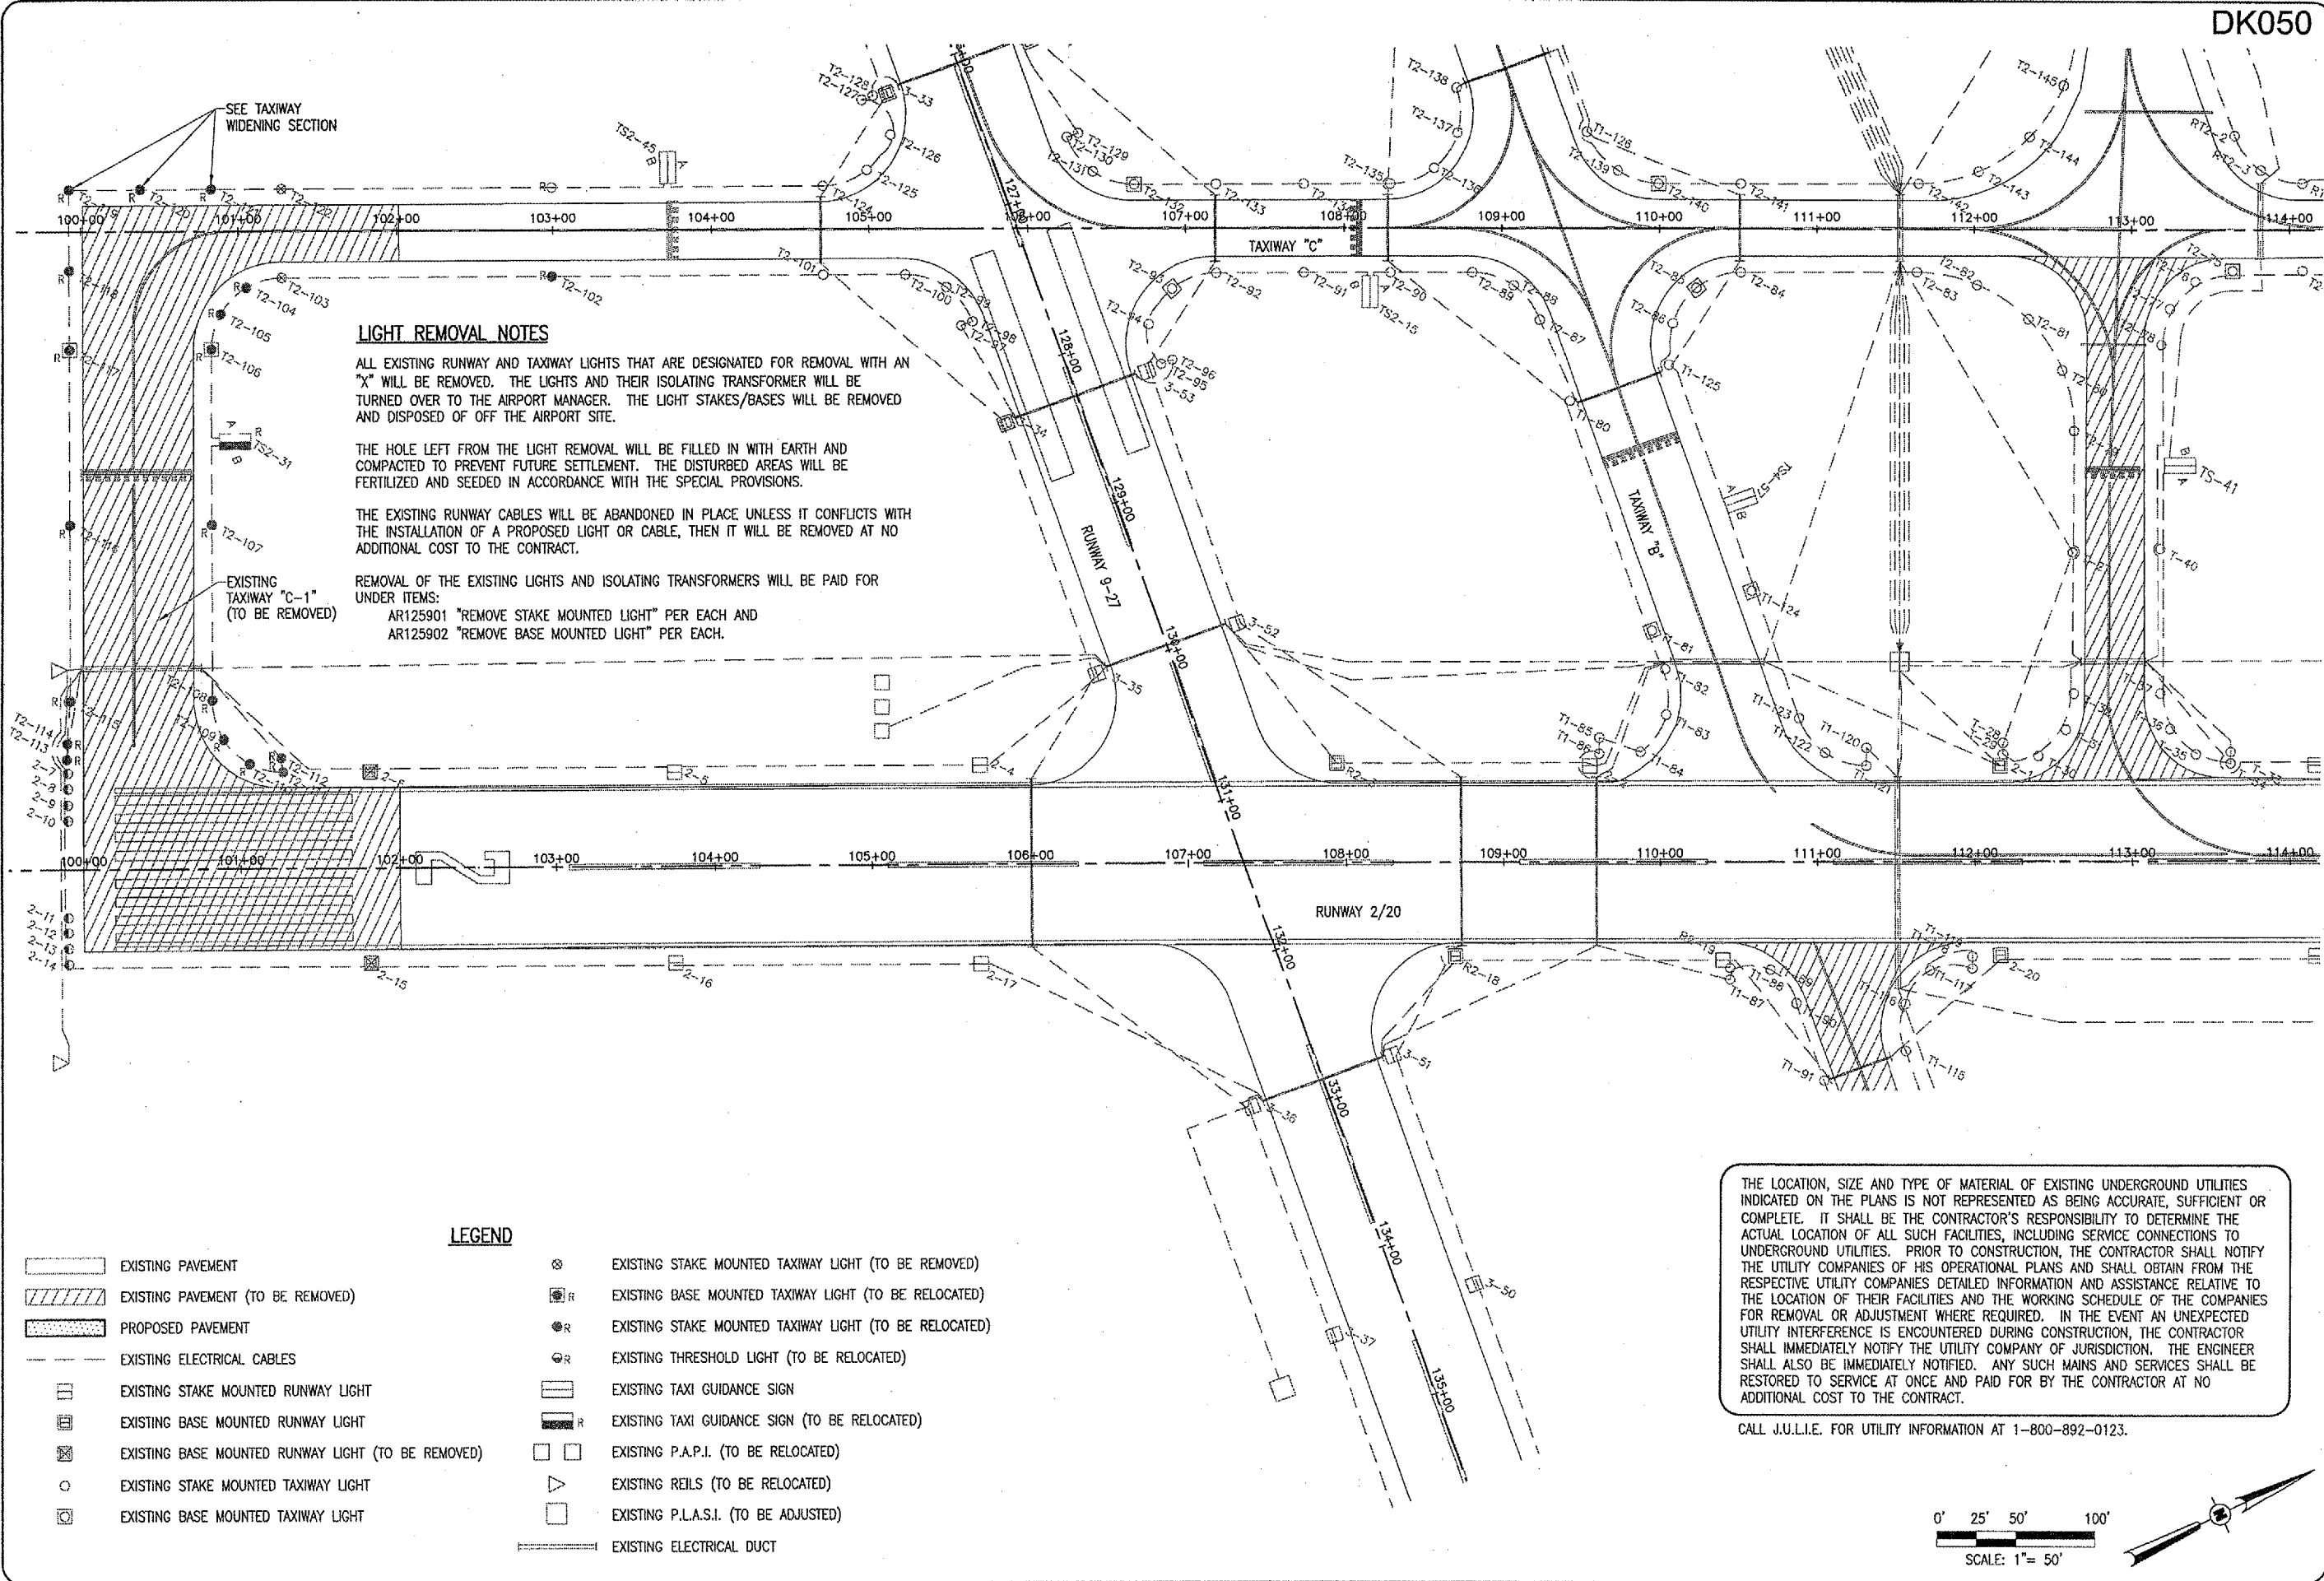

**LEGEND**

- EXISTING PAVEMENT
- EXISTING PAVEMENT (TO BE REMOVED)
- PROPOSED PAVEMENT
- EXISTING ELECTRICAL CABLES
- EXISTING STAKE MOUNTED RUNWAY LIGHT
- EXISTING BASE MOUNTED RUNWAY LIGHT
- EXISTING BASE MOUNTED RUNWAY LIGHT (TO BE REMOVED)
- EXISTING STAKE MOUNTED TAXIWAY LIGHT
- EXISTING BASE MOUNTED TAXIWAY LIGHT
- EXISTING STAKE MOUNTED TAXIWAY LIGHT (TO BE REMOVED)
- EXISTING BASE MOUNTED TAXIWAY LIGHT (TO BE REMOVED)
- EXISTING STAKE MOUNTED TAXIWAY LIGHT (TO BE RELOCATED)
- EXISTING BASE MOUNTED TAXIWAY LIGHT (TO BE RELOCATED)
- EXISTING STAKE MOUNTED TAXIWAY LIGHT (TO BE RELOCATED)
- EXISTING BASE MOUNTED TAXIWAY LIGHT (TO BE RELOCATED)
- EXISTING TAXI GUIDANCE SIGN
- EXISTING TAXI GUIDANCE SIGN (TO BE RELOCATED)
- EXISTING P.A.P.I. (TO BE RELOCATED)
- EXISTING REILS (TO BE RELOCATED)
- EXISTING P.L.A.S.I. (TO BE ADJUSTED)
- EXISTING ELECTRICAL DUCT

APR 03, 2006 11:25 AM BAK I:\AIRPORTS\DEKALB\803-05TAXIWAY\AIRPORT\SHEETS\RWY -2\R-141ELE.DWG