
TYPICAL SPLICE DETAIL

N.T.S.

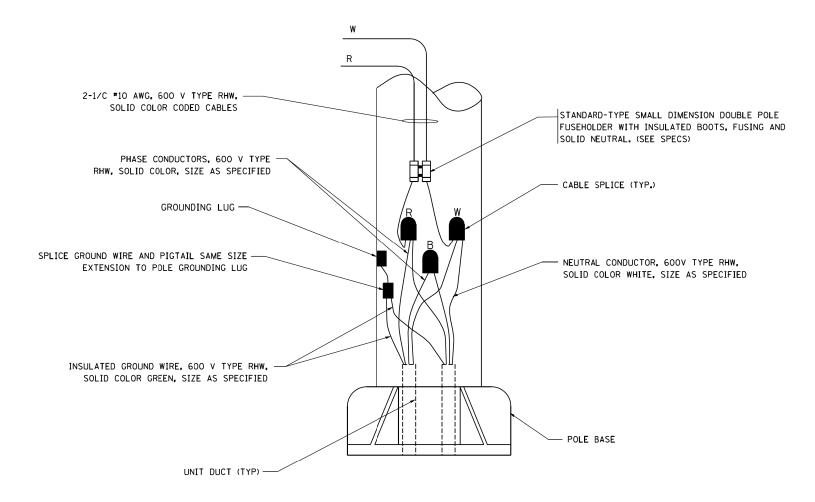

TYPICAL WIRING IN TRENCH DETAIL
N.T.S.

30" (762) MINIMUM COVER 12" (305) MAXIMUM WIDTH EXCEPT AS APPROVED BY THE ENGINEER

12" (305)

WARNING TAPE AS SPECIFIED

UNIT DUCT OR OTHER RACEWAY
AND WIRING AS PER PLANS. COMPLETE

WITH INTERNAL INSULATED EQUIPMENT GROUND WIRE.

POLE WIRING DETAIL

N.T.S.

AECOM
303 EAST WACKER DRIVE, SUITE 1400 CHICAGO, IL 60601-5276

D160W28-SHT-D1-Detail-[BE-702].dgn	DESIGNED -	REVISED - 08-08-03
USER NAME = augeungh	DRAWN -	REVISED -
PLOT SCALE = 50.0000 ' / in.	CHECKED -	REVISED -
PLOT DATE = 3/24/2014	DATE -	REVISED -

SCALE:

MISC. ELECTRICAL DETAILS						DETAILS		F.A.I. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
SHEET A					90/94/290	2013-010R	COOK	747	603			
						BE-702	CONTRACT	NO. 6	OW28			
	SHEET	19	OF	40	SHEETS	STA.	TO STA.	ILLINOIS FED. AID PROJECT				