


FOUNDATION DESIGN TABLE


| | DESIGN DEPTH OF FOUND'N | | REINFORCEMENT IN FOUNDATION | | | |
|----------------------------|-------------------------|----------|-----------------------------|-----------|---------------|----------|
| TYPE OF SOIL | SINGLE ARM | TWIN ARM | SINGLE | ARM | TWIN | ARM |
| | D | D | VERT BARS | SPIRAL | VERT BARS | SPIRAL |
| SOFT CLAY | 13′-0″ | 15'-0" | 8-#6 X 12'-6" | *3 X 122′ | 8-#6X14'X3' | #3 X 141 |
| MEDIUM CLAY | 9'-6" | 10'-9" | 8-*6 X 9'-0" | *3 X 90′ | 8-#6 X 10'-0" | #3 X 100 |
| STIFF CLAY | 7′-0″ | 8'-0" | 8-#6 X 6'-6" | *3 X 66" | 8-#6 X 7′-6″ | #3 X 76′ |
| LOOSE SAND | 9'-0" | 10'-0" | 8-#6 X 8'-6" | #3 X 85' | 8-*6 X 9'-6" | #3 X 94 |
| MEDIUM SAND | 8'-3'' | 9'-0" | 8-#6 X 8'-0" | *3 X 78′ | 8-#6 X 8'-6" | #3 X 85′ |
| DENSE SAND | 7′-9″ | 9'-0" | 8-#6 X 7'-6" | *3 X 73′ | 8-#6 X 8'-6" | *3 X 85 |
| ROCK OR SOLIDIFIED SLAG | 5′-0" | 5′-0″ | NONE | NONE | NONE | NONE |





ANCHOR BOLT DETAIL

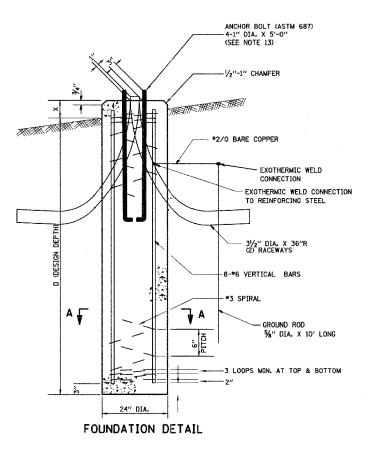



63023

| F. A. RIE. | SECTION | 1 | COUNTY | TOTAL SHEETS | SHEET HO |
|---------------|------------------|----------|--------|-----------------|-------------|
| | 06-00017- | 00-PV | KANE | 232 | 149 |
| STA. | | TO | STA. | | |
| FED. 1 | ROAD DEST. NO. 7 | ILLINOIS | FE | D. AND PROJECT | |

NOTES

- THE ENGINEER SHALL DETERMINE THE CLASS OF SOIL DURING EXCAVATION AND SELECT THE DESIGN DEPTH OF FOUNDATION FROM THE DESIGN TABLE.
- THE DESIGN DEPTH "D" OF FOUNDATION SHALL BE INCREASED BY VALUE OF X ACCORDING TO FIELD CONDITIONS.
- EXCAVATION OF THE POLE FOUNDATION SHALL BE MADE WITH AN AUGER, 24" IN DIAMETER.
- 4. THE CONTRACTOR SHALL USE *3 SPIRAL AT 6" PITCH OR AT HIS OPTION MAY SUBSTITUTE *3 TIES AT 12" O/C.
- 5. THE ANCHOR SHALL BE A TACK WELDED TYPE BOLT OR HOOK TYPE BOLT. COLD BENDING OF THE HOOK BOLT WILL NOT BE ALLOWED.
- 6. THE ANCHOR BOLTS AND RACEWAYS SHALL BE PROPERLY SECURED IN PLACE
- THE ENTIRE LENGTH OF THE ANCHOR BOLTS AS WELL AS THE NUTS AND WASHERS SHALL BE HOT DIP GALVANIZED IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM DESIGNATION A 153.
- 8. CONCRETE SHALL BE CLASS "SI". CONCRETE FOUNDATION MUST BE CURED FOR (10) TEN DAYS BEFORE THE LIGHT STANDARD IS ERECTED.
- 9. THE CABLE TRENCH SHALL BE BACKFILLED AND FIRMLY COMPACTED BEFORE THE LIGHT IS ERECTED.
- 10. ANCHOR BOLTS SHALL PROJECT 3" ABOVE THE TOP OF THE FOUNDATION.
- 11. RACEWAYS SHALL PROJECT 1" ABOVE THE TOP OF THE FOUNDATION.
- 12. THE CONTRACTOR SHALL COORDINATE THE EXTENSION OF ANCHOR BOLTS ABOVE TOP OF FOUNDATION WITH THE BREAKAWAY DEVICE MANUFACTURER'S REQUIREMENTS.
- 13. A MINIMUM OF 3" OF THE THREADING ON THE ANCHOR BOLTS SHALL REMAIN BELOW THE TOP OF THE FOUNDATION.



| | REVISIONS | | | |
|-----------------------|-----------|----------|---|--|
| | NAME | DATE | | |
| | D. SIMON | 4/93 | | |
| | D. DREW | 06/15/95 | | |
| | | | | |
| Sunjoy Inc. | | | | |
| Julijoj Illov | | | | |
| Arna Lighting | i. | | | |
| Area Lighting | | | | |
| 212 TIMBERCREST DRIVE | | | | |
| SCHAUMBURG, ILLINOIS | | | 5 | |
| 60193-1572 | | | Ε | |
| 00133 1312 | | | | |

ILLINOIS DEPARTMENT OF TRANSPORTATION INTERSECTION: GALENA BOULEVARD WITH ILLINOIS ROUTE 47

24" DIAMETER
LIGHT POLE FOUNDATION

SCALE: NONE DATE \$\$DATE\$\$ DRAWN BY JKM CHECKED BY