

# **CONCRETE HEADWALLS** FOR PIPE DRAINS

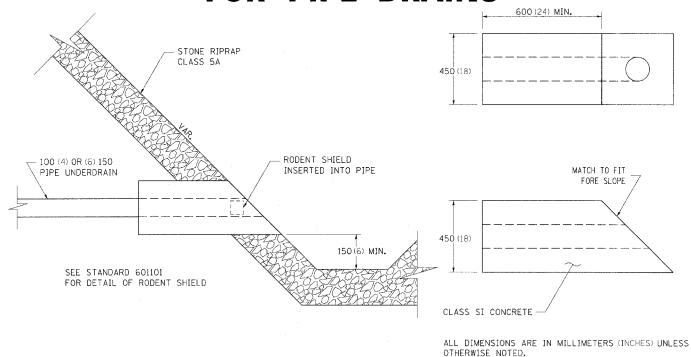

CONCRETE HEADWALLS FOR PIPE DRAINS

# SUBGRADE REPLACEMENT

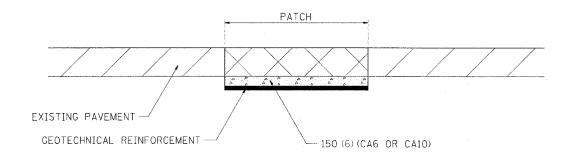

NOTES:

THE CA 6 OR CA 10 SHALL BE COMPACTED IN A MANNER APPROVED BY THE ENGINEER. IF THE MOISTURE CONTENT OF THE MATERIAL IS SUCH THAT COMPACTION SATISFACTORY TO THE ENGINEER CANNOT BE OBTAINED, SUFFICIENT WATER SHALL BE ADDED SO THAT SATISFACTORY COMPACTION CAN BE OBTAINED.

THE CA 6 OR CA 10 WILL BE PAID FOR AT THE CONTRACT LINIT PRICE PER CU YD FOR GRANULAR SUBGRADE REPLACEMENT


THE GEOTECHNICAL REINFORCEMENT WILL BE PAID FOR AT THE CONTRACT UNIT PRICE PER SQ YD FOR GEOTECHNICAL REINFORCEMENT

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE NOTED.

REVISED - 1-09-08

REVISED - 10-15-04

## PAVEMENT PATCHING FOR HOT-MIX **ASPHALT SURFACED PAVEMENT**

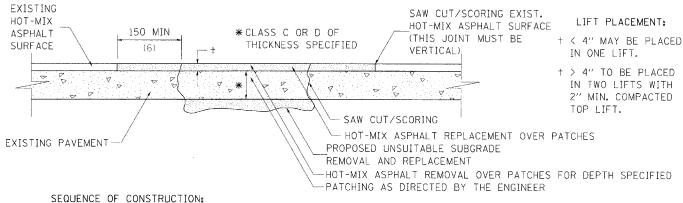

- 1. REMOVE THE EXISTING HOT-MIX ASPHALT SURFACE.
- 2. RESIDENT ENGINEER WILL DETERMINE IF LOCATION IS TO BE PATCHED OR TO ONLY REPLACE HOT-MIX ASPHALT SURFACE.
- 3. REMOVE AND REPLACE FULL DEPTH PATCHES AT LOCATIONS DIRECTED BY THE ENGINEER.
- 4. REPLACE HOT-MIX ASPHALT SURFACE OVER FULL DEPTH PATCHES AND AT LOCATIONS OF HOT-MIX ASPHALT SURFACE REMOVAL.

27.4

### GENERAL NOTES:

- 1. THE WIDTH OF THE FULL DEPTH PATCH OVER A TRENCH SHALL BE 300 (12) WIDER ON EACH SIDE OF THE TRENCH.
- 2. FOR BASIS OF PAYMENT: SEE THE RECURRING SPECIAL PROVISION "PATCHING WITH HOT-MIX ASPHALT OVERLAY REMOVAL".

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE NOTED.

32.4

PAVEMENT PATCHING FOR HOT-MIX ASPHALT SURFACED PAVEMENT

REVISED REVISED REGION 2 / DISTRICT 2 STANDARD \_CARROLL\_\_\_35\_\_29\_ \_17\_\_\_\_\_4RS-4\_\_\_\_\_ REVISED CONTRACT NO. \_64E12 SCALE: 20.0000 // IN SHEET NO. \_\_ OF \_\_ SHEETS STA. \_ REVISED