

SHEET NO. 20 *38* sheets

Contract #72813

Inserts for $^34^{\prime\prime}$ ϕ threaded dowel rods, when specified, are to be two strut, coil type for interior beams and single coil, flared loop type for exterior beams.

Prestressing steel shall be uncoated high strength, low relaxation 7-wire strand, Grade 270.

The nominal diameter shall be $\frac{1}{2}$ " and the nominal cross-sectional area shall be 0.153 sq. in.


Non-prestressing steel shall conform to ASTM A 706, Grade 60. See Special Provisions.

A minimum $2^l2''$ ϕ lifting pin shall be used to engage the lifting loops during handling.

Cut G_6 bars when necessary to maintain $1_2''$ clearance.

The top and bottom plates shall be AASHTO M270 Grade 50. The bottom plates and studs shall be galvanized according to AASHTO

Threaded rods shall be ASTM F 1554 Grade 55.

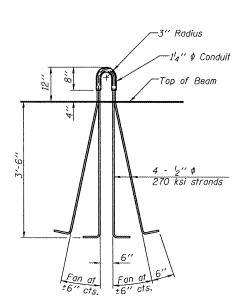

LIFTING LOOP DETAIL

PLAN OF BEAM AT PIER

3"

 $-m_7(E)$

ELEVATION OF BEAM AT PIER

-End of beams

lo. 9 wire ties


(See sheet 16 of 38)

To outside face


 $m_7(E)$


of bar, typ.

-Bottom of beam




TOP PLATE






BOTTOM PLATE (Showing threaded rods)




(Showing studs)

See bearing details for pintle hole locations when required. See sheet 18 of 38.

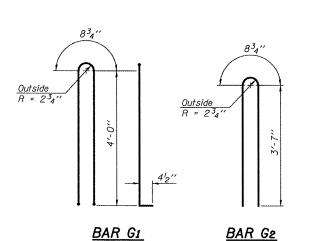

BAR G4



BAR G5

48" PPC I-BEAM DETAILS (SPAN 1) F.A.P. ROUTE 769 - SEC. 110B-2 MACOUPIN COUNTY STATION 104+41.00 STRUCTURE NO. 059-0509

Outside

3'-0"

BAR G6