2004-133F

GENERAL NOTES

recommendation after beams or girders have been erected and adjusted.

price for "Furnishing & Erecting Structural Steel". All dimensions are in millimeters (mm) except as noted.

Holes in the masonry for anchor bolts shall be drilled through the base plates to the diameter and depth shown or according to the manufacturer's


Prior to setting the bolts, the holes shall be dry and all dust and loose

particles shall be removed by the use of compressed air or vacuuming.

The anchor bolts, furnished and installed and including the epoxy grout or

capsules shall not be paid for separately but shall be included in the unit bid

CONTRACT NO. 62898

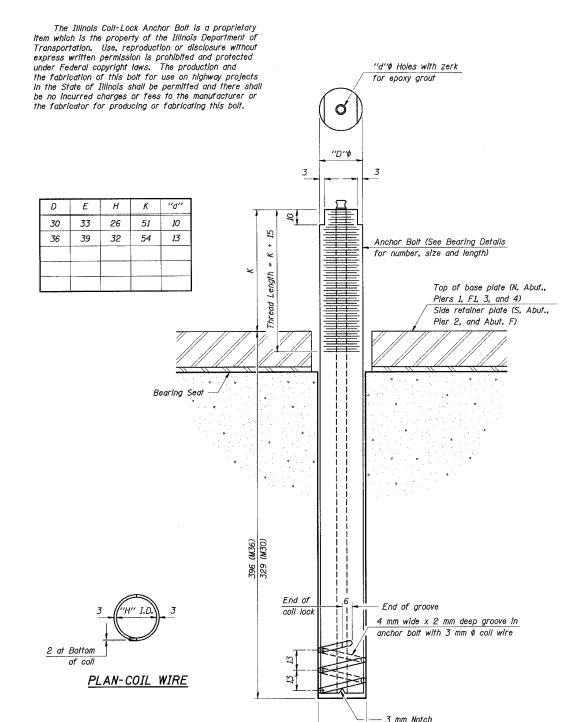

ILLINOIS COIL-LOCK ANCHOR BOLT

"E" \$

DESIGNED CHECKED LK DRAWN CHECKED

MATERIALS FOR ILLINOIS COIL-LOCK ANCHOR BOLT

The anchor bolt shall be fabricated from cold drawn or hot finished seamless carbon steel mechanical tubing conforming to ASTM A 519, Grade 1026, CW and supplied with hexagonal nuts and cut washers.

The coil wire shall be made of any sultable soft steel wire. The finished anchor bolt shall be cleaned of rust and other foreign materials and wrapped or packaged to prevent contamination until they are installed. The epoxy grout shall be a two-component, epoxy resin bonding system comforming to ASTM C 881, Type I, Grade 1 and of a Class suitable for the temperature at

INSTALLATION PROCEDURE for the ILLINOIS COIL-LOCK ANCHOR BOLT

- 1. With the coil wire in place, the bolt shall be inserted into the hole and turned clockwise to a snug fit in the hole. Nut and washer shall be placed on the bolt. The nut shall be tensioned until the steel base plates are held securely to the concrete bearing seat.
- 2. Epoxy grout shall be pumped through the zerk fitting with a pressure gun. Pumping shall continue until the epoxy overflows the hole around the bolt shank. After pumping is discontinued, excess epoxy shall be immediately wiped off.

ALTERNATE ANCHOR BOLTS

The Contractor may use, at his option, the capsule or the adhesive cartridge type anchor rods that have been previously tested and given a prior approval by the Department. The Contractor shall install these anchor rods in pre-drilled holes according to the manufacturer's recommendations and procedures.

The capsule or the adhesive cartridge type anchor rods shall be a two part system composed of:

 A threaded rod stud with nut and washer of the type specified. 2. A segled glass capsule or a sealed glass adhesive cartridge containing premeasured amounts of the adhesive chemical.

LOCATION		TYPE
Unit 1	Pier 2	M36 x 450mm (A307)
	Pler 3	M36 x 450mm (A307)
	Pier 4	M36 x 450mm (A307)
	N. Abut.	M36 x 450mm (A307)
Unit 2	S. Abut.	M30 x 380mm (A307)
	Pier 1	M36 x 450mm (A307)
	Pier 2	M36 x 450mm (A307)
Unit 3	Abut. F	M30 x 380mm (A307)
	Pier F1	M30 x 380mm (A307)
	Pier 2	M30 x 380mm (A307)

ASTM F 1554 (Fy = 724 MPa), ASTM A 449 and AASHTO M 314 (Fy = 724 MPa) anchor bolts may be substituted for the anchor bolts shown above.

ILLINOIS DEPARTMENT OF TRANSPORTATION I-94 EAST BOUND / IL 394 SOUTH BOUND

THIS SHEET FOR

INFORMATION ONLY

ANCHOR BOLT DETAILS

SB IL ROUTE 394 / RAMP F OVER THORN CREEK F.A.P. 332 SECTION 2004-133F COOK COUNTY STA. 440+704.350 STRUCTURE NO. 016-2800/2845

DATE 05/16/05 SCALE ---

HNTB