


TYPICAL SPLICE DETAIL

N.T.S.

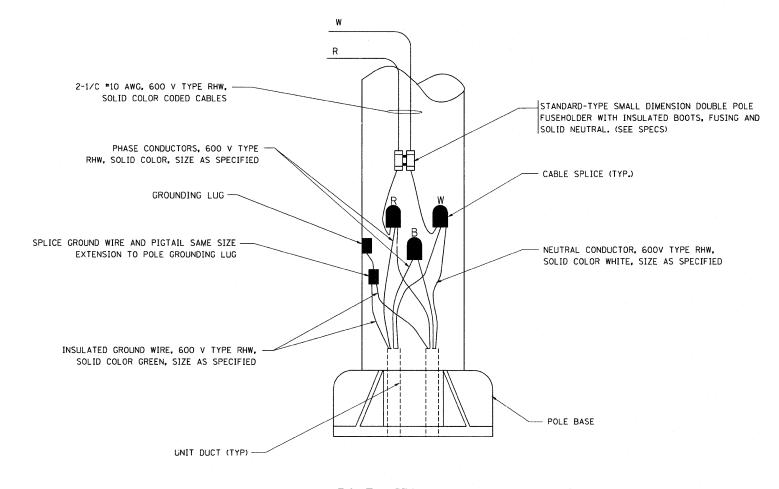

TYPICAL WIRING IN TRENCH DETAIL
N.T.S.

30" (762) MINIMUM COVER 12" (305) MAXIMUM WIDTH EXCEPT AS APPROVED BY THE ENGINEER

12" (305)

- WARNING TAPE AS SPECIFIED

UNIT DUCT OR OTHER RACEWAY

AND WIRING AS PER PLANS. COMPLETE

WITH INTERNAL INSULATED EQUIPMENT GROUND WIRE.

POLE WIRING DETAIL

N.T.S.

FILE NAME =	USER NAME = gaglianobt	DESIGNED -	REVISED - 08-08-03		MISC. ELECTRICAL DETAILS	F.A.P. SECTION	COUNTY TOTAL SHEET
W:\diststd\22×34\be702.dgn		DRAWN -	REVISED -	STATE OF ILLINOIS		940 143 N	WILL /21 80
	PLOT SCALE = 50.000 '/ IN.	CHECKED -	REVISED -	DEPARTMENT OF TRANSPORTATION	SHEET A	BE-702	CONTRACT NO. 66445
	PLOT DATE = 1/4/2008	DATE -	REVISED -		SCALE: NONE SHEET NO. 1 OF 1 SHEETS STA. TO STA.		D. AID PROJECT